


**** WARNING ** WARNING ** WARNING ** WARNING ****
This document is intended for informational purposes only.

Users are cautioned that Caltrans does not assume any liability or responsibility based on these electronic files or for any defective or incomplete copying, excerpting, scanning, faxing or downloading of the contract documents. As always, for the official paper versions of the bidders and non-bidder packages, write to the California Department of Transportation, Plans and Bid Documents, Room 0200, P.O. Box 942874, Sacramento, CA 94272-0001, telephone (916) 654-4490 or fax (916) 654-7028. Office hours are 7:30 a.m. to 4:15 p.m. When ordering bidder or non-bidder packages it is important that you include a telephone and fax number, P.O. Box and street address so that you can receive addenda.

Note: Addenda information is NOT included with the electronic documents available via electronic file transfer. Only bidder or non-bidder package holders listed with the Caltrans Plans and Bid Documents section as described above will receive addenda information.

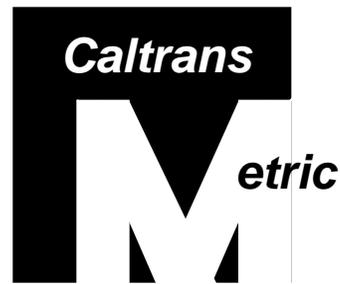

STATE OF CALIFORNIA

DEPARTMENT OF TRANSPORTATION

**NOTICE TO CONTRACTORS
AND**

SPECIAL PROVISIONS

FOR CONSTRUCTION ON STATE HIGHWAY IN

**LOS ANGELES COUNTY IN SANTA CLARITA FROM 0.1km WEST OF SIERRA HIGHWAY
UNDERCROSSING TO 1.1km EAST OF ROUTE 126 SEPARATION**

DISTRICT 07, ROUTE 14

**For Use in Connection with Standard Specifications Dated JULY 1995, Standard Plans Dated JULY 1997, and Labor
Surcharge and Equipment Rental Rates.**

CONTRACT NO. 07-119844

07-LA-14-R40.4/R44.7

**Federal Aid Project
ACNH-P014(053)E**

**Bids Open: January 4, 2001
Dated: November 20, 2000**

OSD

IMPORTANT SPECIAL NOTICES

- The Special Provisions for Federal-aid projects (with and without DBE goals) have been revised to incorporate changes made by new regulations governing the DBE Program (49 CFR Part 26).

Sections 2 and 5 incorporate the changes. Bidders should read these sections to become familiar with them. Attention is directed to the following significant changes:

Section 2, "Disadvantaged Business Enterprise (DBE)" revises the counting of participation by DBE primes, and the counting of trucking performed by DBE firms. The section also revises the information that must be submitted to the Department in order to receive credit for trucking.

Section 2, "Submission of DBE Information" revises the information required to be submitted to the Department to receive credit toward the DBE goal. It also revises the criteria to demonstrate good faith efforts.

Section 5, "Subcontractor and DBE Records" revises the information required to be reported at the end of the project, and information related to trucking that must be submitted throughout the project.

Section 5, "DBE Certification Status" adds new reporting requirements related to DBE certification.

Section 5, "Subcontracting" describes the efforts that must be made in the event a DBE subcontractor is terminated or fails to complete its work for any reason.

Section 5, "Prompt Progress Payment to Subcontractors" requires prompt payment to all subcontractors.

Section 5, "Prompt Payment of Withheld Funds to Subcontractors" requires the prompt payment of retention to all subcontractors.

- **SURETY 2000**

Caltrans is conducting a pilot program in cooperation with Surety 2000, to test electronic bond verification systems. The purpose of the pilot program is to test the use of Surety 2000 for verifying a bidder's bond electronically.

Surety 2000 is an Internet-based surety verification and security system, developed in conjunction with the surety industry. Surety agents may contact Surety 2000 at 1-800-660-3263.

Bidders are encouraged to participate in the pilot program. To participate, the bidder is asked to provide the "Authorization Code" provided by Surety 2000, on a separate sheet, together with the standard bidder's bond required by the specifications. The bidder's surety agent may obtain the "Authorization Code" from Surety 2000.

The Department will use the "Authorization Code" to access the Surety 2000 database, and independently verify the actual bidder's bond and document the functioning of the Surety 2000 system.

"Authorization Codes" will be used only to verify bidder's bonds, and only as part of the pilot program. The use of "Authorization Codes" will not be accepted in lieu of the bidder's bond or other bidder's security required in the specifications during the pilot study.

The function of the Surety 2000 system is to provide an easier way for Contractors to protect their bid security, and to discourage fraud. This system is available to all California admitted sureties and surety agents.

The results of the pilot study will be tabulated, and at some time in the future, the Department may consider accepting electronic bidder's bond verification in lieu of the bidder's bond specified.

TABLE OF CONTENTS

NOTICE TO CONTRACTORS.....	1
COPY OF ENGINEER'S ESTIMATE	3
SPECIAL PROVISIONS	7
SECTION 1. SPECIFICATIONS AND PLANS.....	7
SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS.....	7
2-1.01 GENERAL.....	7
2-1.015 FEDERAL LOBBYING RESTRICTIONS.....	7
2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE).....	8
2-1.02A DBE GOAL FOR THIS PROJECT.....	9
2-1.02B SUBMISSION OF DBE INFORMATION	10
SECTION 3. AWARD AND EXECUTION OF CONTRACT.....	11
SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES	11
SECTION 5. GENERAL	11
SECTION 5-1. MISCELLANEOUS	11
5-1.00 PLANS AND WORKING DRAWINGS	11
5-1.002 LABORATORY	11
5-1.003 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK	12
5-1.004 DIFFERING SITE CONDITIONS.....	12
5-1.005 CONTRACT BONDS	12
5-1.01 LABOR NONDISCRIMINATION.....	12
5-1.02 LABOR CODE REQUIREMENTS	13
5-1.023 INDEMNIFICATION AND INSURANCE.....	15
5-1.025 ARBITRATION	18
5-1.03 PAYMENT OF WITHHELD FUNDS.....	18
5-1.04 INTEREST ON PAYMENTS	18
5-1.041 FINAL PAYMENT AND CLAIMS.....	19
5-1.05 PUBLIC SAFETY	19
5-1.06 SURFACE MINING AND RECLAMATION ACT.....	20
5-1.07 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES.....	20
5-1.08 YEAR 2000 COMPLIANCE.....	20
5-1.085 BUY AMERICA REQUIREMENTS.....	21
5-1.09 SUBCONTRACTOR AND DBE RECORDS	21
5-1.093 DBE CERTIFICATION STATUS	21
5-1.095 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS	21
5-1.097 SUBCONTRACTING	22
5-1.098 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS	23
5-1.099 PROMPT PAYMENT OF WITHHELD FUNDS TO SUBCONTRACTORS	23
5-1.10 PARTNERING.....	23
5-1.106 COST REDUCTION INCENTIVE.....	23
5-1.11 FORCE ACCOUNT PAYMENT.....	23
5-1.12 AREAS FOR CONTRACTOR'S USE.....	24
5-1.13 PAYMENTS.....	24
5-1.14 SOUND CONTROL REQUIREMENTS.....	24
SECTION 6. (BLANK).....	25
SECTION 7. (BLANK).....	25
SECTION 8. MATERIALS	25
SECTION 8-1. MISCELLANEOUS	25
8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS	25
8-1.02 APPROVED TRAFFIC PRODUCTS.....	30
8-1.03 STATE-FURNISHED MATERIALS	35
8-1.04 SLAG AGGREGATE.....	36
8-1.05 MEASUREMENT OF QUANTITIES	36
8-1.06 ENGINEERING FABRICS.....	36
SECTION 8-2. CONCRETE.....	36

8-2.01 PORTLAND CEMENT CONCRETE.....	36
8-2.02 CEMENT AND WATER CONTENT	46
SECTION 8-3. WELDING	47
8-3.01 WELDING ELECTRODES	47
8-3.02 WELDING QUALITY CONTROL	47
SECTION 9. DESCRIPTION OF BRIDGE WORK.....	51
SECTION 10. CONSTRUCTION DETAILS.....	51
SECTION 10-1. GENERAL	51
10-1.00 CONSTRUCTION PROJECT INFORMATION SIGNS	51
10-1.01 ORDER OF WORK.....	51
10-1.02 MATERIAL CONTAINING AERIALY DEPOSITED LEAD	52
HEALTH AND SAFETY	52
SOIL HANDLING.....	52
10-1.03 WATER POLLUTION CONTROL.....	53
10-1.04 COOPERATION	57
10-1.05 PROGRESS SCHEDULE (CRITICAL PATH).....	57
10-1.06 OVERHEAD	64
10-1.07 OBSTRUCTIONS	65
10-1.08 MOBILIZATION	66
10-1.09 CONSTRUCTION AREA SIGNS	66
10-1.10 MAINTAINING TRAFFIC.....	67
10-1.11 CLOSURE REQUIREMENTS AND CONDITIONS	78
10-1.12 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE.....	79
10-1.13 BARRICADES	81
10-1.14 PORTABLE CHANGEABLE MESSAGE SIGN.....	81
10-1.15 TEMPORARY RAILING	81
10-1.16 TEMPORARY TRAFFIC SCREEN	82
10-1.17 TEMPORARY CRASH CUSHION MODULE.....	82
10-1.18 EXISTING HIGHWAY FACILITIES	83
10-1.18A REMOVE TRAFFIC STRIPES AND PAVEMENT MARKINGS.....	84
10-1.18B REMOVE PAVEMENT MARKERS.....	84
10-1.18C REMOVE ROADSIDE SIGNS AND SIGN PANELS.....	84
10-1.18D REMOVE DRAINAGE FACILITIES	84
10-1.18E REMOVE PORTLAND CEMENT CONCRETE PAVEMENT	85
10-1.18F RELOCATE ROADSIDE SIGNS	85
10-1.18G REMOVE CONCRETE BARRIER.....	85
10-1.18H CAP INLETS.....	85
10-1.18I BRIDGE REMOVAL	86
10-1.19 EARTHWORK.....	86
10-1.20 CONTROLLED LOW STRENGTH MATERIAL	87
10-1.21 AGGREGATE BASE.....	88
10-1.22 LEAN CONCRETE BASE	88
10-1.23 CONCRETE PAVEMENT.....	88
10-1.23A DRILL AND GROUT TIE BARS	89
10-1.23B DOWEL (SMOOTH, EPOXY COATED).....	89
10-1.24 PRESTRESSING CONCRETE.....	91
10-1.25 CONCRETE STRUCTURES.....	92
10-1.26 STRUCTURE APPROACH SLABS (TYPE N)	95
10-1.27 STRUCTURE APPROACH SLABS (TYPE R).....	97
10-1.28 PAVING NOTCH EXTENSION	100
10-1.29 SEALING JOINTS	101
10-1.30 REINFORCEMENT.....	102
10-1.31 SIGN STRUCTURES.....	108
10-1.32 ROADSIDE SIGNS.....	110
10-1.33 PLASTIC PIPE	111
10-1.34 REINFORCED CONCRETE PIPE.....	113
10-1.35 MISCELLANEOUS IRON AND STEEL.....	113
10-1.36 CHAIN LINK WALK GATES	113
10-1.37 INSTALL MEDIAN MILEAGE PANEL.....	114

10-1.38 CONCRETE BARRIER.....	114
10-1.39 THERMOPLASTIC TRAFFIC STRIPES AND PAVEMENT MARKINGS.....	116
10-1.40 PAINT TRAFFIC STRIPES.....	116
10-1.41 PAVEMENT MARKERS.....	116
SECTION 10-2. (BLANK).....	116
SECTION 10-3. LIGHTING AND ELECTRICAL SYSTEMS.....	116
10-3.01 DESCRIPTION.....	116
10-3.02 COST BREAK-DOWN.....	117
10-3.03 MAINTAINING EXISTING AND TEMPORARY ELECTRICAL SYSTEMS.....	117
10-3.04 CONDUIT.....	117
10-3.05 PULL BOXES.....	117
10-3.06 CONDUCTORS AND WIRING.....	118
10-3.07 SERVICE.....	118
10-3.08 NUMBERING ELECTRICAL EQUIPMENT.....	118
10-3.09 STATE-FURNISHED TRAFFIC MONITORING STATION CONTROLLER ASSEMBLY.....	118
10-3.10 INDUCTIVE LOOP DETECTORS.....	118
10-3.11 DISPOSING OF ELECTRICAL EQUIPMENT.....	119
SECTION 11. (BLANK).....	119
SECTION 12. (BLANK).....	119
SECTION 13. (BLANK).....	119
SECTION 14 FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION PROJECTS.....	120
FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS.....	139

STANDARD PLANS LIST

The Standard Plan sheets applicable to this contract include, but are not limited to those indicated below. The Revised Standard Plans (RSP) and New Standard Plans (NSP) which apply to this contract are included as individual sheets of the project plans.

A10A	Abbreviations
A10B	Symbols
A20A	Pavement Markers and Traffic Lines - Typical Details
A20B	Pavement Markers and Traffic Lines - Typical Details
A20C	Pavement Markers and Traffic Lines - Typical Details
A20D	Pavement Markers and Traffic Lines - Typical Details
A24A	Pavement Markings - Arrows
A24C	Pavement Markings - Symbols and Numerals
A24E	Pavement Markings - Words and Crosswalks
A35A	Portland Cement Concrete Paving Details
A62C	Limits of Payment for Excavation and Backfill - Bridge
A62D	Excavation and Backfill - Concrete Pipe Culverts
A73A	Object Markers
A73B	Markers
A73C	Delineators, Channelizers and Barricades
A75B	Concrete Barrier Type 50E
RSP A76A	Concrete Barrier Type 60
A76B	Concrete Barrier Type 60
A76C	Concrete Barrier Type 60E
RSP A76G	Concrete Barrier Type 60S
A76H	Concrete Barrier Type 60S
A85	Chain Link Fence
D73	Drainage Inlets
D74C	Drainage Inlet Details

RSP D77A	<i>Grate Details</i>
D77B	Bicycle Proof Grate Details
D79	Precast Reinforced Concrete Pipe - Direct Design Method
D88	Construction Loads On Culverts
D97H	Reinforced Concrete Pipe Or Non-Reinforced Concrete Pipe - Standard and Positive Joints
NSP T1A	<i>Temporary Crash Cushion, Sand Filled (Unidirectional)</i>
NSP T1B	<i>Temporary Crash Cushion, Sand Filled (Bidirectional)</i>
RSP T2	<i>Temporary Crash Cushion, Sand Filled (Shoulder Installations)</i>
T3	Temporary Railing (Type K)
RSP T4	<i>Temporary Traffic Screen</i>
T5	Temporary Terminal Section (Type K)
RSP T7	<i>Construction Project Information Signs</i>
T10	Traffic Control System for Lane Closure On Freeways and Expressways
T14	Traffic Control System for Ramp Closures
B0-1	Bridge Details
B0-3	Bridge Details
B0-5	Bridge Details
B0-13	Bridge Details
B6-21	Joint Seals (Maximum Movement Rating = 50 mm)
B7-1	Box Girder Details
B8-5	Cast-In-Place Prestressed Girder Details
RS1	Roadside Signs - Typical Installation Details No. 1
RS2	Roadside Signs - Wood Post, Typical Installation Details No. 2
RS4	Roadside Signs - Typical Installation Details No. 4
S1	Overhead Signs-Truss - Instructions and Examples
S2	Overhead Signs-Truss - Single Post Type, Post Types II through VII
RSP S4	<i>Overhead Signs-Truss - Single Post Type, Structural Frame Members</i>
S6	Overhead Signs-Truss - Structural Frame Details
S7	Overhead Signs-Truss - Frame Juncture Details
S8A	Overhead Signs - Steel Frame, Removable Sign Panel Frames
S8B	Overhead Signs - Removable Sign Panel Frames, Overhead Formed Panel Mounting Details
RSP S8C	<i>Overhead Signs-Truss - Sign Mounting Details, Laminated Panel-Type A</i>
S8D	Overhead Signs-Truss - Removable Sign Panel Frames, 2.794 m and 3.048 m Sign Panels
RSP S13	<i>Overhead Signs-Truss - Pile Foundation</i>
ES-1A	Signal, Lighting and Electrical Systems - Symbols and Abbreviations
ES-1B	Signal, Lighting and Electrical Systems - Symbols and Abbreviations
ES-2A	Signal, Lighting and Electrical Systems - Service Equipment
ES-2C	Signal, Lighting and Electrical Systems - Service Equipment Notes
ES-2E	Signal, Lighting and Electrical Systems - Service Equipment and Typical Wiring Diagram, Type B
ES-4B	Signal, Lighting and Electrical Systems - Controller Cabinet Details
ES-5A	Signal, Lighting and Electrical Systems - Detectors
ES-5B	Signal, Lighting and Electrical Systems - Detectors
ES-5E	Signal, Lighting and Electrical Systems - Detectors
ES-8	Signal, Lighting and Electrical Systems - Pull Box Details
ES-13	Signal, Lighting and Electrical Systems - Splicing Details
ES-30	Sign Illumination - 915 mm Fluorescent Sign Illumination Equipment

DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS

CONTRACT NO. 07-119844

07-LA-14-R40.4/R44.7

Sealed proposals for the work shown on the plans entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROJECT PLANS FOR CONSTRUCTION ON STATE HIGHWAY IN LOS ANGELES COUNTY IN SANTA CLARITA FROM 0.1km WEST OF SIERRA HIGHWAY UNDERCROSSING TO 1.1km EAST OF ROUTE 126 SEPARATION

will be received at the Department of Transportation, 3347 Michelson Drive, Suite 100, Irvine, CA 92612-1692, until 2 o'clock p.m. on January 4, 2001, at which time they will be publicly opened and read in Room C - 1116 at the same address.

Proposal forms for this work are included in a separate book entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROPOSAL AND CONTRACT FOR CONSTRUCTION ON STATE HIGHWAY IN LOS ANGELES COUNTY IN SANTA CLARITA FROM 0.1km WEST OF SIERRA HIGHWAY UNDERCROSSING TO 1.1km EAST OF ROUTE 126 SEPARATION

General work description: Construct HOV Lanes.

This project has a goal of 17 percent disadvantaged business enterprise (DBE) participation. No prebid meeting is scheduled for this project.

THIS PROJECT IS SUBJECT TO THE "BUY AMERICA" PROVISIONS OF THE SURFACE TRANSPORTATION ASSISTANCE ACT OF 1982 AS AMENDED BY THE INTERMODAL SURFACE TRANSPORTATION EFFICIENCY ACT OF 1991.

Bids are required for the entire work described herein.

At the time this contract is awarded, the Contractor shall possess either a Class A license or one of the following Class C licenses: C-8, C-12

This contract is subject to state contract nondiscrimination and compliance requirements pursuant to Government Code, Section 12990.

Project plans, special provisions, and proposal forms for bidding this project can only be obtained at the Department of Transportation, Plans and Bid Documents, Room 0200, MS #26, Transportation Building, 1120 N Street, Sacramento, California 95814, FAX No. (916) 654-7028, Telephone No. (916) 654-4490. Use FAX orders to expedite orders for project plans, special provisions and proposal forms. FAX orders must include credit card charge number, card expiration date and authorizing signature. Project plans, special provisions, and proposal forms may be seen at the above Department of Transportation office and at the offices of the District Directors of Transportation at Irvine, Oakland, and the district in which the work is situated. Standard Specifications and Standard Plans are available through the State of California, Department of Transportation, Publications Unit, 1900 Royal Oaks Drive, Sacramento, CA 95815, Telephone No. (916) 445-3520.

Cross sections for this project are not available.

The successful bidder shall furnish a payment bond and a performance bond.

The Department of Transportation hereby notifies all bidders that it will affirmatively insure that in any contract entered into pursuant to this advertisement, disadvantaged business enterprises will be afforded full opportunity to submit bids in response to this invitation.

The U.S. Department of Transportation (DOT) provides a toll-free "hotline" service to report bid rigging activities. Bid rigging activities can be reported Mondays through Fridays, between 8:00 a.m. and 5:00 p.m., eastern time, Telephone No. 1-800-424-9071. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use the "hotline" to report these activities. The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

Pursuant to Section 1773 of the Labor Code, the general prevailing wage rates in the county, or counties, in which the work is to be done have been determined by the Director of the California Department of Industrial Relations. These wages are set forth in the General Prevailing Wage Rates for this project, available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated, and available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>. The Federal minimum wage rates for this project as predetermined by the United States Secretary of Labor are set forth in the books issued for bidding purposes entitled "Proposal and Contract," and in copies of this book that may be examined at the offices described above where project plans, special provisions, and proposal forms may be seen. Addenda to modify the Federal minimum wage rates, if necessary, will be issued to holders of "Proposal and Contract" books. Future effective general prevailing wage rates which have been predetermined and are on file with the California Department of Industrial Relations are referenced but not printed in the general prevailing wage rates.

Attention is directed to the Federal minimum wage rate requirements in the books entitled "Proposal and Contract." If there is a difference between the minimum wage rates predetermined by the Secretary of Labor and the general prevailing wage rates determined by the Director of the California Department of Industrial Relations for similar classifications of labor, the Contractor and subcontractors shall pay not less than the higher wage rate. The Department will not accept lower State wage rates not specifically included in the Federal minimum wage determinations. This includes "helper" (or other classifications based on hours of experience) or any other classification not appearing in the Federal wage determinations. Where Federal wage determinations do not contain the State wage rate determination otherwise available for use by the Contractor and subcontractors, the Contractor and subcontractors shall pay not less than the Federal minimum wage rate which most closely approximates the duties of the employees in question.

DEPARTMENT OF TRANSPORTATION

Deputy Director Transportation Engineering

Dated November 20, 2000

ASF

**COPY OF ENGINEER'S ESTIMATE
(NOT TO BE USED FOR BIDDING PURPOSES)**

07-119844

Item	Item Code	Item	Unit of Measure	Estimated Quantity
1	070010	PROGRESS SCHEDULE (CRITICAL PATH)	LS	LUMP SUM
2	070018	TIME--RELATED OVERHEAD	WDAY	320
3	074019	PREPARE STORM WATER POLLUTION PREVENTION PLAN	LS	LUMP SUM
4	074020	WATER POLLUTION CONTROL	LS	LUMP SUM
5 (S)	120090	CONSTRUCTION AREA SIGNS	LS	LUMP SUM
6 (S)	120100	TRAFFIC CONTROL SYSTEM	LS	LUMP SUM
7 (S)	120120	TYPE III BARRICADE	EA	6
8 (S)	121161	TEMPORARY TERMINAL SECTION (TYPE K)	EA	3
9 (S)	129000	TEMPORARY RAILING (TYPE K)	M	6100
10	150711	REMOVE PAINTED TRAFFIC STRIPE	M	34 200
11	150715	REMOVE THERMOPLASTIC PAVEMENT MARKING	M2	31
12	150722	REMOVE PAVEMENT MARKER	EA	10 100
13	150745	REMOVE ROADSIDE SIGN (METAL POST)	EA	1
14	150763	REMOVE SIGN PANEL	EA	1
15	150806	REMOVE PIPE	M	94
16	150820	REMOVE INLET	EA	15
17	150846	REMOVE CONCRETE PAVEMENT	M2	110
18	152390	RELOCATE ROADSIDE SIGN	EA	8
19	153221	REMOVE CONCRETE BARRIER	M	2830
20	155003	CAP INLET	EA	4

Item	Item Code	Item	Unit of Measure	Estimated Quantity
21	157560	BRIDGE REMOVAL (PORTION)	LS	LUMP SUM
22	190101	ROADWAY EXCAVATION	M3	17 500
23	020172	LEAD COMPLIANCE PLAN	LS	LUMP SUM
24 (F)	192003	STRUCTURE EXCAVATION (BRIDGE)	M3	132
25 (F)	193003	STRUCTURE BACKFILL (BRIDGE)	M3	112
26 (F)	260210	AGGREGATE BASE (APPROACH SLAB)	M3	30
27	260301	CLASS 3 AGGREGATE BASE	M3	6490
28	280000	LEAN CONCRETE BASE	M3	4530
29	401000	CONCRETE PAVEMENT	M3	8610
30	406005	DRILL AND GROUT TIE BAR	EA	8830
31	018173	DOWEL (SMOOTH, EPOXY COATED)	EA	23 300
32 (S)	500001	PRESTRESSING CAST-IN-PLACE CONCRETE	LS	LUMP SUM
33 (F)	510051	STRUCTURAL CONCRETE, BRIDGE FOOTING	M3	16
34 (F)	510053	STRUCTURAL CONCRETE, BRIDGE	M3	239
35 (F)	510086	STRUCTURAL CONCRETE, APPROACH SLAB (TYPE N)	M3	52
36 (F)	510087	STRUCTURAL CONCRETE, APPROACH SLAB (TYPE R)	M3	307
37 (F)	510502	MINOR CONCRETE (MINOR STRUCTURE)	M3	50
38	510504	MINOR CONCRETE (PIPE ENCASMENT)	M3	19
39	510800	PAVING NOTCH EXTENSION	M3	7
40 (S)	519117	JOINT SEAL (MR 30 MM)	M	116

Item	Item Code	Item	Unit of Measure	Estimated Quantity
41 (S-F)	520102	BAR REINFORCING STEEL (BRIDGE)	KG	28 700
42 (F)	560218	FURNISH SIGN STRUCTURE (TRUSS)	KG	7682
43 (S-F)	560219	INSTALL SIGN STRUCTURE (TRUSS)	KG	7682
44 (S)	561008	760 MM CAST-IN-DRILLED-HOLE CONCRETE PILE (SIGN FOUNDATION)	M	7
45 (S)	561009	920 MM CAST-IN-DRILLED-HOLE CONCRETE PILE (SIGN FOUNDATION)	M	11
46	562002	METAL (BARRIER MOUNTED SIGN)	KG	860
47	566011	ROADSIDE SIGN - ONE POST	EA	3
48	568001	INSTALL SIGN (STRAP AND SADDLE BRACKET METHOD)	EA	2
49	641132	300 MM PLASTIC PIPE	M	62
50	650069	450 MM REINFORCED CONCRETE PIPE	M	3
51	650075	600 MM REINFORCED CONCRETE PIPE	M	1
52	650079	900 MM REINFORCED CONCRETE PIPE	M	1
53 (S-F)	750001	MISCELLANEOUS IRON AND STEEL	KG	7076
54	802592	2.4 M CHAIN LINK GATE (TYPE CL-1.8)	EA	1
55	820180	INSTALL MEDIAN MILEAGE PANEL	EA	24
56	839491	CONCRETE BARRIER (TYPE 50E)	M	25
57	839701	CONCRETE BARRIER (TYPE 60)	M	840
58	018174	CONCRETE BARRIER (TYPE 60W)	M	650
59 (F)	839702	CONCRETE BARRIER (TYPE 60A)	M	64
60	839705	CONCRETE BARRIER (TYPE 60E)	M	64

Item	Item Code	Item	Unit of Measure	Estimated Quantity
61	839710	CONCRETE BARRIER (TYPE 60S)	M	7
62	018175	CONCRETE BARRIER (TYPE 60SW)	M	1240
63 (S)	840515	THERMOPLASTIC PAVEMENT MARKING	M2	210
64 (S)	840561	100 MM THERMOPLASTIC TRAFFIC STRIPE	M	36 900
65 (S)	840563	200 MM THERMOPLASTIC TRAFFIC STRIPE	M	1350
66 (S)	840564	200 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 3.66 M - 0.92 M)	M	2180
67 (S)	840571	100 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 5.18 M - 2.14 M)	M	97
68 (S)	018176	100 MM THERMOPLASTIC TRAFFIC STRIPE (BRO KEN 5.49 M-3.66 M)	M	23 000
69 (S)	018177	200 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 11.00 M - 3.50 M)	M	1510
70 (S)	840655	PAINT TRAFFIC STRIPE (1-COAT)	M	24 820
71 (S)	850101	PAVEMENT MARKER (NON-REFLECTIVE)	EA	6260
72 (S)	850102	PAVEMENT MARKER (REFLECTIVE)	EA	6760
73 (S)	860508	MODIFY SIGN ILLUMINATION	LS	LUMP SUM
74 (S)	860889	MODIFY TRAFFIC MONITORING STATION	LS	LUMP SUM
75 (S)	860930	TRAFFIC MONITORING STATION	LS	LUMP SUM
76	999990	MOBILIZATION	LS	LUMP SUM

**STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION**

SPECIAL PROVISIONS

Annexed to Contract No. 07-119844

SECTION 1. SPECIFICATIONS AND PLANS

The work embraced herein shall conform to the provisions in the Standard Specifications dated July 1995, and the Standard Plans dated July 1997, of the Department of Transportation insofar as the same may apply, and these special provisions.

Amendments to the Standard Specifications set forth in these special provisions shall be considered as part of the Standard Specifications for the purposes set forth in Section 5-1.04, "Coordination and Interpretation of Plans, Standard Specifications and Special Provisions," of the Standard Specifications. Whenever either the term "Standard Specifications is amended" or the term "Standard Specifications are amended" is used in the special provisions, the indented text following said term shall be considered an amendment to the Standard Specifications. In case of conflict between such amendments and the Standard Specifications, the amendments shall take precedence over and be used in lieu of the conflicting portions.

In case of conflict between the Standard Specifications and these special provisions, the special provisions shall take precedence over and be used in lieu of the conflicting portions.

SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS

2-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 2, "Proposal Requirements and Conditions," of the Standard Specifications and these special provisions for the requirements and conditions which the bidder must observe in the preparation of the Proposal form and the submission of the bid.

In addition to the subcontractors required to be listed in conformance with Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications, each proposal shall have listed therein the portion of work that will be performed by each subcontractor listed.

The Bidder's Bond form mentioned in the last paragraph in Section 2-1.07, "Proposal Guaranty," of the Standard Specifications will be found following the signature page of the Proposal.

Submit request for substitution of an "or equal" item, and the data substantiating the request to the Department of Transportation, Construction Division Chief, 120 S. Spring Street, Room 232, Los Angeles, CA 90012, so that the request is received by the Department by close of business on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening.

In conformance with Public Contract Code Section 7106, a Noncollusion Affidavit is included in the Proposal. Signing the Proposal shall also constitute signature of the Noncollusion Affidavit.

The contractor, sub recipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate. Each subcontract signed by the bidder must include this assurance.

2-1.015 FEDERAL LOBBYING RESTRICTIONS

Section 1352, Title 31, United States Code prohibits Federal funds from being expended by the recipient or any lower tier subrecipient of a Federal-aid contract to pay for any person for influencing or attempting to influence a Federal agency or Congress in connection with the awarding of any Federal-aid contract, the making of any Federal grant or loan, or the entering into of any cooperative agreement.

If any funds other than Federal funds have been paid for the same purposes in connection with this Federal-aid contract, the recipient shall submit an executed certification and, if required, submit a completed disclosure form as part of the bid documents.

A certification for Federal-aid contracts regarding payment of funds to lobby Congress or a Federal agency is included in the Proposal. Standard Form - LLL, "Disclosure of Lobbying Activities," with instructions for completion of the Standard Form is also included in the Proposal. Signing the Proposal shall constitute signature of the Certification.

The above-referenced certification and disclosure of lobbying activities shall be included in each subcontract and any lower-tier contracts exceeding \$100,000. All disclosure forms, but not certifications, shall be forwarded from tier to tier until received by the Engineer.

The Contractor, subcontractors and any lower-tier contractors shall file a disclosure form at the end of each calendar quarter in which there occurs any event that requires disclosure or that materially affects the accuracy of the information contained in any disclosure form previously filed by the Contractor, subcontractors and any lower-tier contractors. An event that materially affects the accuracy of the information reported includes:

- A. A cumulative increase of \$25,000 or more in the amount paid or expected to be paid for influencing or attempting to influence a covered Federal action; or
- B. A change in the person(s) or individual(s) influencing or attempting to influence a covered Federal action; or,
- C. A change in the officer(s), employee(s), or Member(s) contacted to influence or attempt to influence a covered Federal action.

2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE)

This project is subject to Part 26, Title 49, Code of Federal Regulations entitled "Participation by Disadvantaged Business Enterprises in Department of Transportation Financial Assistance Programs." The Regulations in their entirety are incorporated herein by this reference.

Bidders shall be fully informed respecting the requirements of the Regulations and the Department's Disadvantaged Business Enterprise (DBE) program developed pursuant to the Regulations; particular attention is directed to the following matters:

- A. A DBE must be a small business concern as defined pursuant to Section 3 of U.S. Small Business Act and relevant regulations promulgated pursuant thereto.
- B. A DBE may participate as a prime contractor, subcontractor, joint venture partner with a prime or subcontractor, vendor of material or supplies, or as a trucking company.
- C. A DBE bidder, not bidding as a joint venture with a non-DBE, will be required to document one or a combination of the following:
 - 1. The bidder will meet the goal by performing work with its own forces.
 - 2. The bidder will meet the goal through work performed by DBE subcontractors, suppliers or trucking companies.
 - 3. The bidder, prior to bidding, made adequate good faith efforts to meet the goal.
- D. A DBE joint venture partner must be responsible for specific contract items of work, or portions thereof. Responsibility means actually performing, managing and supervising the work with its own forces. The DBE joint venture partner must share in the capital contribution, control, management, risks and profits of the joint venture. The DBE joint venturer must submit the joint venture agreement with the proposal or the DBE Information form required in the Section entitled "Submission of DBE Information" of these special provisions.
- E. A DBE must perform a commercially useful function, i.e., must be responsible for the execution of a distinct element of the work and must carry out its responsibility by actually performing, managing and supervising the work.
- F. DBEs must be certified by either the California Department of Transportation, or by a participating State of California or local agency which certifies in conformance with Title 49, Code of Federal Regulations, Part 26, as of the date of bid opening. It is the Contractor's responsibility to verify that DBEs are certified. Listings of DBEs certified by the Department are available from the following sources:
 - 1. The Department's DBE Directory, which is published quarterly. This Directory may be obtained from the Department of Transportation, Materiel Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520.
 - 2. The Department's Electronic Information Bulletin Board Service, which is accessible by modem and is updated weekly. The Bulletin Board may be accessed by first contacting the Department's Business Enterprise Program at Telephone: (916) 227-8937 and obtaining a user identification and password.
 - 3. The Department's web site at <http://www.dot.ca.gov/hq/bep/index.htm>.
 - 4. The organizations listed in the Section entitled "DBE Goal for this Project" of these special provisions.

G. Credit for materials or supplies purchased from DBEs will be as follows:

1. If the materials or supplies are obtained from a DBE manufacturer, 100 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE manufacturer is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications.
2. If the materials or supplies are purchased from a DBE regular dealer, 60 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE regular dealer is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a DBE regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question. A person may be a DBE regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone, or asphalt without owning, operating, or maintaining a place of business as provided in this paragraph G.2. if the person both owns and operates distribution equipment for the products. Any supplementing of regular dealers' own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Packagers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not DBE regular dealers within the meaning of this paragraph G.2.
3. Credit for materials or supplies purchased from a DBE which is neither a manufacturer nor a regular dealer will be limited to the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site, provided the fees are reasonable and not excessive as compared with fees charged for similar services.

H. Credit for DBE trucking companies will be as follows:

1. The DBE must be responsible for the management and supervision of the entire trucking operation for which it is responsible on a particular contract, and there cannot be a contrived arrangement for the purpose of meeting the DBE goal.
2. The DBE must itself own and operate at least one fully licensed, insured, and operational truck used on the contract.
3. The DBE receives credit for the total value of the transportation services it provides on the contract using trucks it owns, insures, and operates using drivers it employs.
4. The DBE may lease trucks from another DBE firm, including an owner-operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the contract.
5. The DBE may also lease trucks from a non-DBE firm, including an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The DBE does not receive credit for the total value of the transportation services provided by the lessee, since these services are not provided by a DBE.
6. For the purposes of this paragraph H, a lease must indicate that the DBE has exclusive use of and control over the truck. This does not preclude the leased truck from working for others during the term of the lease with the consent of the DBE, so long as the lease gives the DBE absolute priority for use of the leased truck. Leased trucks must display the name and identification number of the DBE.

I. Noncompliance by the Contractor with the requirements of the regulations constitutes a breach of this contract and may result in termination of the contract or other appropriate remedy for a breach of this contract.

J. Bidders are encouraged to use services offered by financial institutions owned and controlled by DBEs.

2-1.02A DBE GOAL FOR THIS PROJECT

The Department has established the following goal for Disadvantaged Business Enterprise (DBE) participation for this project:

Disadvantaged Business Enterprise (DBE): 17 percent

Bidders may use the services of the following firms to contact interested DBEs. These firms are available to assist DBEs in preparing bids for subcontracting or supplying materials.

The following firms may be contacted for projects in the following locations:

Districts 04, 05 (except San Luis Obispo and Santa Barbara Counties), 06 (except Kern County) and 10:	Districts 08, 11 and 12:
Triaxial Management Services, Inc. - Oakland 1545 Willow Street, 1st Floor Oakland, CA 94607 Telephone - (510) 286-1313 FAX No. - (510) 286-6792	Triaxial Management Services, Inc. - San Diego 2725 Congress Street, Suite 1-D San Diego, CA 92110 Telephone - (619) 543-5109 FAX No. - (619) 543-5108
Districts 07 and 08; in San Luis Obispo and Santa Barbara Counties in District 05; and in Kern County in District 06:	Districts 01, 02, 03 and 09:
Triaxial Management Services, Inc. - Los Angeles 2594 Industry Way, Suite 101 Lynwood, CA 90262 Telephone - (310) 537-6677 FAX No. - (310) 637-0128	Triaxial Management Services, Inc. - Sacramento 930 Alhambra Blvd., #205 Sacramento, CA 95816 Telephone - (916) 553-4172 FAX No. - (916) 553-4173

2-1.02B SUBMISSION OF DBE INFORMATION

The required DBE information shall be submitted on the "CALTRANS BIDDER - DBE INFORMATION" form included in the Proposal. If the DBE information is not submitted with the bid, the DBE Information form shall be removed from the documents prior to submitting the bid.

It is the bidder's responsibility to make enough work available to DBEs and to select those portions of the work or material needs consistent with the available DBEs to meet the goal for DBE participation or to provide information to establish that, prior to bidding, the bidder made adequate good faith efforts to do so.

If DBE information is not submitted with the bid, the apparent successful bidder (low bidder), the second low bidder and the third low bidder shall submit DBE information to the Department of Transportation, 1120 N Street, Room 0200, MS #26, Sacramento, California 95814 so the information is received by the Department no later than 4:00 p.m. on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening. DBE information sent by U.S. Postal Service certified mail with return receipt and certificate of mailing and mailed on or before the third day, not including Saturdays, Sundays and legal holidays, following bid opening will be accepted even if it is received after the fourth day following bid opening. Failure to submit the required DBE information by the time specified will be grounds for finding the bid or proposal nonresponsive. Other bidders need not submit DBE information unless requested to do so by the Department.

The bidder's DBE information shall establish that good faith efforts to meet the DBE goal have been made. To establish good faith efforts, the bidder shall demonstrate that the goal will be met or that, prior to bidding, adequate good faith efforts to meet the goal were made.

Bidders are cautioned that even though their submittal indicates they will meet the stated DBE goal, their submittal should also include their adequate good faith efforts information along with their DBE goal information to protect their eligibility for award of the contract in the event the Department, in its review, finds that the goal has not been met.

The bidder's DBE information shall include the names, addresses and phone numbers of DBE firms that will participate, with a complete description of work or supplies to be provided by each, the dollar value of each DBE transaction, and a written confirmation from the DBE that it is participating in the contract. A copy of the DBE's quote will serve as written confirmation that the DBE is participating in the contract. When 100 percent of a contract item of work is not to be performed or furnished by a DBE, a description of the exact portion of that work to be performed or furnished by that DBE shall be included in the DBE information, including the planned location of that work. The work that a DBE prime contractor has committed to performing with its own forces as well as the work that it has committed to be performed by DBE subcontractors, suppliers and trucking companies will count toward the goal.

The information necessary to establish the bidder's adequate good faith efforts to meet the DBE goal should include:

- A. The names and dates of each publication in which a request for DBE participation for this project was placed by the bidder.

- B. The names and dates of written notices sent to certified DBEs soliciting bids for this project and the dates and methods used for following up initial solicitations to determine with certainty whether the DBEs were interested.
- C. The items of work which the bidder made available to DBE firms, including, where appropriate, any breaking down of the contract work items (including those items normally performed by the bidder with its own forces) into economically feasible units to facilitate DBE participation. It is the bidder's responsibility to demonstrate that sufficient work to meet the DBE goal was made available to DBE firms.
- D. The names, addresses and phone numbers of rejected DBE firms, the firms selected for that work, and the reasons for the bidder's choice.
- E. Efforts made to assist interested DBEs in obtaining bonding, lines of credit or insurance, and any technical assistance or information related to the plans, specifications and requirements for the work which was provided to DBEs.
- F. Efforts made to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services, excluding supplies and equipment the DBE subcontractor purchases or leases from the prime contractor or its affiliate.
- G. The names of agencies contacted to provide assistance in contacting, recruiting and using DBE firms.
- H. Any additional data to support a demonstration of good faith efforts.

SECTION 3. AWARD AND EXECUTION OF CONTRACT

The bidder's attention is directed to the provisions in Section 3, "Award and Execution of Contract," of the Standard Specifications and these special provisions for the requirements and conditions concerning award and execution of contract.

The award of the contract, if it be awarded, will be to the lowest responsible bidder whose proposal complies with all the requirements prescribed and who has met the goal for DBE participation or has demonstrated, to the satisfaction of the Department, adequate good faith efforts to do so. Meeting the goal for DBE participation or demonstrating, to the satisfaction of the Department, adequate good faith efforts to do so is a condition for being eligible for award of contract.

A "Payee Data Record" form will be included in the contract documents to be executed by the successful bidder. The purpose of the form is to facilitate the collection of taxpayer identification data. The form shall be completed and returned to the Department by the successful bidder with the executed contract and contract bonds. For the purposes of the form, payee shall be deemed to mean the successful bidder. The form is not to be completed for subcontractors or suppliers. Failure to complete and return the "Payee Data Record" form to the Department as provided herein will result in the retention of 31 percent of payments due the contractor and penalties of up to \$20,000. This retention of payments for failure to complete the "Payee Data Record" form is in addition to any other retention of payments due the Contractor.

SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES

Attention is directed to the provisions in Section 8-1.03, "Beginning of Work," in Section 8-1.06, "Time of Completion," and in Section 8-1.07, "Liquidated Damages," of the Standard Specifications and these special provisions.

The Contractor shall begin work within 15 calendar days after the contract has been approved by the Attorney General or the attorney appointed and authorized to represent the Department of Transportation.

This work shall be diligently prosecuted to completion before the expiration of **320 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$650 per day, for each and every calendar day's delay in finishing the work in excess of the number of working days prescribed above.

SECTION 5. GENERAL

SECTION 5-1. MISCELLANEOUS

5-1.00 PLANS AND WORKING DRAWINGS

When the specifications require working drawings to be submitted to the Division of Structure Design, the drawings shall be submitted to: Division of Structure Design, Documents Unit, Mail Station 9, 1801 30th Street, Sacramento, CA 95816, Telephone (916) 227-8252.

5-1.002 LABORATORY

Section 1-1.25, "Laboratory," of the Standard Specifications is amended to read:

1-1.25 Laboratory.—The Division of Materials Engineering and Testing Services and the Division of Structural Foundations of the Department of Transportation, or established laboratories of the various Districts of the Department, or other laboratories authorized by the Department to test materials and work involved in the contract. When a reference

is made in the specifications to the "Transportation Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations, located at 5900 Folsom Boulevard, Sacramento, CA 95819, Telephone (916) 227-7000.

5-1.003 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK

The second paragraph of Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," of the Standard Specifications is amended to read:

Where the Department has made investigations of site conditions, including subsurface conditions in areas where work is to be performed under the contract, or in other areas, some of which may constitute possible local material sources, bidders or Contractors may, upon written request, inspect the records of the Department as to those investigations subject to and upon the conditions hereinafter set forth.

Attention is directed to "Differing Site Conditions" of these special provisions regarding physical conditions at the site which may differ from those indicated in "Materials Information," log of test borings or other geotechnical information obtained by the Department's investigation of site conditions.

5-1.004 DIFFERING SITE CONDITIONS

Attention is directed to Section 5-1.116, "Differing Site Conditions," of the Standard Specifications.

During the progress of the work, if subsurface or latent conditions are encountered at the site differing materially from those indicated in the "Materials Information," log of test borings, other geotechnical data obtained by the Department's investigation of subsurface conditions, or an examination of the conditions above ground at the site, the party discovering those conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

The Contractor will be allowed 15 days from the notification of the Engineer's determination of whether or not an adjustment of the contract is warranted, in which to file a notice of potential claim in conformance with the provisions of Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications and as specified herein; otherwise the decision of the Engineer shall be deemed to have been accepted by the Contractor as correct. The notice of potential claim shall set forth in what respects the Contractor's position differs from the Engineer's determination and provide any additional information obtained by the Contractor, including but not limited to additional geotechnical data. The notice of potential claim shall be accompanied by the Contractor's certification that the following were made in preparation of the bid: a review of the contract, a review of the "Materials Information," a review of the log of test borings and other records of geotechnical data to the extent they were made available to bidders prior to the opening of bids, and an examination of the conditions above ground at the site. Supplementary information, obtained by the Contractor subsequent to the filing of the notice of potential claim, shall be submitted to the Engineer in an expeditious manner.

5-1.005 CONTRACT BONDS

Attention is directed to Section 3-1.02, "Contract Bonds," of the Standard Specifications and these special provisions. The payment bond shall be in a sum not less than the following:

1. One hundred percent of the total amount payable by the terms of the contract when the total amount payable does not equal or exceed five million dollars (\$5,000,000).
2. Fifty percent of the total amount payable by the terms of the contract when the total amount payable is not less than five million dollars (\$5,000,000) and does not exceed ten million dollars (\$10,000,000).
3. Twenty-five percent of the total amount payable by the terms of the contract when the total amount payable exceeds ten million dollars (\$10,000,000).

5-1.01 LABOR NONDISCRIMINATION

Attention is directed to the following Notice that is required by Chapter 5 of Division 4 of Title 2, California Code of Regulations.

NOTICE OF REQUIREMENT FOR NONDISCRIMINATION PROGRAM (GOV. CODE, SECTION 12990)

Your attention is called to the "Nondiscrimination Clause", set forth in Section 7-1.01A(4), "Labor Nondiscrimination," of the Standard Specifications, which is applicable to all nonexempt state contracts and subcontracts, and to the "Standard California Nondiscrimination Construction Contract Specifications" set forth therein. The Specifications are applicable to all nonexempt state construction contracts and subcontracts of \$5000 or more.

Contract No. 07-119844

5-1.02 LABOR CODE REQUIREMENTS

Section 7-1.01A(1), "Hours of Labor," of the Standard Specifications is amended to read:

7-1.01A(1) Hours of Labor.— Eight hours labor constitutes a legal day's work. The Contractor or any subcontractor under the Contractor shall forfeit, as a penalty to the State of California, \$25 for each worker employed in the execution of the contract by the respective Contractor or subcontractor for each calendar day during which that worker is required or permitted to work more than 8 hours in any one calendar day and 40 hours in any one calendar week in violation of the provisions of the Labor Code, and in particular, Section 1810 to Section 1815, thereof, inclusive, except that work performed by employees of Contractors in excess of 8 hours per day, and 40 hours during any one week, shall be permitted upon compensation for all hours worked in excess of 8 hours per day at not less than one and one-half times the basic rate of pay, as provided in Section 1815 thereof.

Section 7-1.01A(2), "Prevailing Wage," of the Standard Specifications is amended to read:

7-1.01A(2) Prevailing Wage.— The Contractor and any subcontractor under the Contractor shall comply with Labor Code Sections 1774 and 1775. Pursuant to Section 1775, the Contractor and any subcontractor under the Contractor shall forfeit to the State or political subdivision on whose behalf the contract is made or awarded a penalty of not more than fifty dollars (\$50) for each calendar day, or portion thereof, for each worker paid less than the prevailing rates as determined by the Director of Industrial Relations for the work or craft in which the worker is employed for any public work done under the contract by the Contractor or by any subcontractor under the Contractor in violation of the provisions of the Labor Code and in particular, Labor Code Sections 1770 to 1780, inclusive. The amount of this forfeiture shall be determined by the Labor Commissioner and shall be based on consideration of the mistake, inadvertence, or neglect of the Contractor or subcontractor in failing to pay the correct rate of prevailing wages, or the previous record of the Contractor or subcontractor in meeting their respective prevailing wage obligations, or the willful failure by the Contractor or subcontractor to pay the correct rates of prevailing wages. A mistake, inadvertence, or neglect in failing to pay the correct rate of prevailing wages is not excusable if the Contractor or subcontractor had knowledge of the obligations under the Labor Code. In addition to the penalty and pursuant to Labor Code Section 1775, the difference between the prevailing wage rates and the amount paid to each worker for each calendar day or portion thereof for which each worker was paid less than the prevailing wage rate shall be paid to each worker by the Contractor or subcontractor. If a worker employed by a subcontractor on a public works project is not paid the general prevailing per diem wages by the subcontractor, the prime contractor of the project is not liable for the penalties described above unless the prime contractor had knowledge of that failure of the subcontractor to pay the specified prevailing rate of wages to those workers or unless the prime contractor fails to comply with all of the following requirements:

1. The contract executed between the contractor and the subcontractor for the performance of work on the public works project shall include a copy of the provisions of Sections 1771, 1775, 1776, 1777.5, 1813, and 1815 of the Labor Code.
2. The contractor shall monitor the payment of the specified general prevailing rate of per diem wages by the subcontractor to the employees, by periodic review of the certified payroll records of the subcontractor.
3. Upon becoming aware of the subcontractor's failure to pay the specified prevailing rate of wages to the subcontractor's workers, the contractor shall diligently take corrective action to halt or rectify the failure, including, but not limited to, retaining sufficient funds due the subcontractor for work performed on the public works project.
4. Prior to making final payment to the subcontractor for work performed on the public works project, the contractor shall obtain an affidavit signed under penalty of perjury from the subcontractor that the subcontractor has paid the specified general prevailing rate of per diem wages to the subcontractor's employees on the public works project and any amounts due pursuant to Section 1813 of the Labor Code.

Pursuant to Section 1775 of the Labor Code, the Division of Labor Standards Enforcement shall notify the Contractor on a public works project within 15 days of the receipt by the Division of Labor Standards Enforcement of a complaint of the failure of a subcontractor on that public works project to pay workers the general prevailing rate of per diem wages. If the Division of Labor Standards Enforcement determines that employees of a subcontractor were not paid the general prevailing rate of per diem wages and if the Department did not retain sufficient money under the contract to pay those employees the balance of wages owed under the general prevailing rate of per diem wages, the contractor shall withhold an amount of moneys due the subcontractor sufficient to pay those employees the general prevailing rate of per diem wages if requested by the Division of Labor Standards Enforcement. The Contractor shall

pay any money retained from and owed to a subcontractor upon receipt of notification by the Division of Labor Standards Enforcement that the wage complaint has been resolved. If notice of the resolution of the wage complaint has not been received by the Contractor within 180 days of the filing of a valid notice of completion or acceptance of the public works project, whichever occurs later, the Contractor shall pay all moneys retained from the subcontractor to the Department. These moneys shall be retained by the Department pending the final decision of an enforcement action.

Pursuant to the provisions of Section 1773 of the Labor Code, the Department has obtained the general prevailing rate of wages (which rate includes employer payments for health and welfare, pension, vacation, travel time, and subsistence pay as provided for in Section 1773.8 of the Labor Code, apprenticeship or other training programs authorized by Section 3093 of the Labor Code, and similar purposes) applicable to the work to be done, for straight time, overtime, Saturday, Sunday and holiday work. The holiday wage rate listed shall be applicable to all holidays recognized in the collective bargaining agreement of the particular craft, classification or type of workmen concerned. The general prevailing wage rates and any applicable changes to these wage rates are available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated. For work situated in District 9, the wage rates are available at the Labor Compliance Office at the offices of the District Director of Transportation for District 6, located at Fresno. General prevailing wage rates are also available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>.

The wage rates determined by the Director of Industrial Relations for the project refer to expiration dates. Prevailing wage determinations with a single asterisk after the expiration date are in effect on the date of advertisement for bids and are good for the life of the contract. Prevailing wage determinations with double asterisks after the expiration date indicate that the wage rate to be paid for work performed after this date has been determined. If work is to extend past this date, the new rate shall be paid and incorporated in the contract. The Contractor shall contact the Department of Industrial Relations as indicated in the wage rate determinations to obtain predetermined wage changes.

Pursuant to Section 1773.2 of the Labor Code, general prevailing wage rates shall be posted by the Contractor at a prominent place at the site of the work.

Changes in general prevailing wage determinations which conform to Labor Code Section 1773.6 and Title 8 California Code of Regulations Section 16204 shall apply to the project when issued by the Director of Industrial Relations at least 10 days prior to the date of the Notice to Contractors for the project.

The State will not recognize any claim for additional compensation because of the payment by the Contractor of any wage rate in excess of the prevailing wage rate set forth in the contract. The possibility of wage increases is one of the elements to be considered by the Contractor in determining the bid, and will not under any circumstances be considered as the basis of a claim against the State on the contract.

7-1.01A(2)(a) Travel and Subsistence Payments.—Attention is directed to the requirements of Section 1773.8 of the Labor Code. The Contractor shall make travel and subsistence payments to each workman, needed to execute the work, in accordance with the requirements in Labor Code Section 1773.8.

The first and second paragraphs of Section 7-1.01A(3), "Payroll Records," of the Standard Specifications are amended to read:

7-1.01A(3) Payroll Records.— Attention is directed to the provisions of Labor Code Section 1776, a portion of which is quoted below. Regulations implementing Labor Code Section 1776 are located in Sections 16016 through 16019 and Sections 16207.10 through 16207.19 of Title 8, California Code of Regulations.

"1776. (a) Each contractor and subcontractor shall keep accurate payroll records, showing the name, address, social security number, work classification, straight time and overtime hours worked each day and week, and the actual per diem wages paid to each journeyman, apprentice, worker, or other employee employed by him or her in connection with the public work. Each payroll record shall contain or be verified by a written declaration that it is made under penalty of perjury, stating both of the following:

- (1) The information contained in the payroll record is true and correct.
- (2) The employer has complied with the requirements of Sections 1771, 1811, and 1815 for any work performed by his or her employees on the public works project.

"(b) The payroll records enumerated under subdivision (a) shall be certified and shall be available for inspection at all reasonable hours at the principal office of the contractor on the following basis:

- (1) A certified copy of an employee's payroll record shall be made available for inspection or furnished to the employee or his or her authorized representative on request.

(2) A certified copy of all payroll records enumerated in subdivision (a) shall be made available for inspection or furnished upon request to a representative of the body awarding the contract, the Division of Labor Standards Enforcement, and the Division of Apprenticeship Standards of the Department of Industrial Relations.

(3) A certified copy of all payroll records enumerated in subdivision (a) shall be made available upon request by the public for inspection or for copies thereof. However, a request by the public shall be made through either the body awarding the contract, the Division of Apprenticeship Standards, or the Division of Labor Standards Enforcement. If the requested payroll records have not been provided pursuant to paragraph (2), the requesting party shall, prior to being provided the records, reimburse the costs of preparation by the contractor, subcontractors, and the entity through which the request was made. The public shall not be given access to the records at the principal office of the contractor.

"(c) The certified payroll records shall be on forms provided by the Division of Labor Standards Enforcement or shall contain the same information as the forms provided by the division.

"(d) A contractor or subcontractor shall file a certified copy of the records enumerated in subdivision (a) with the entity that requested the records within 10 days after receipt of a written request.

"(e) Any copy of records made available for inspection as copies and furnished upon request to the public or any public agency by the awarding body, the Division of Apprenticeship Standards, or the Division of Labor Standards Enforcement shall be marked or obliterated in a manner so as to prevent disclosure of an individual's name, address, and social security number. The name and address of the contractor awarded the contract or the subcontractor performing the contract shall not be marked or obliterated.

"(f) The contractor shall inform the body awarding the contract of the location of the records enumerated under subdivision (a), including the street address, city and county, and shall, within five working days, provide a notice of a change of location and address.

"(g) The contractor or subcontractor shall have 10 days in which to comply subsequent to receipt of a written notice requesting the records enumerated in subdivision (a). In the event that the contractor or subcontractor fails to comply within the 10-day period, he or she shall, as a penalty to the state or political subdivision on whose behalf the contract is made or awarded, forfeit twenty-five dollars (\$25) for each calendar day, or portion thereof, for each worker, until strict compliance is effectuated. Upon the request of the Division of Apprenticeship Standards or the Division of Labor Standards Enforcement, these penalties shall be withheld from progress payments then due. A contractor is not subject to a penalty assessment pursuant to this section due to the failure of a subcontractor to comply with this section."

The penalties specified in subdivision (g) of Labor Code Section 1776 for noncompliance with the provisions of Section 1776 may be deducted from any moneys due or which may become due to the Contractor.

5-1.023 INDEMNIFICATION AND INSURANCE

Section 7-1.12, "Responsibility for Damage," of the Standard Specifications is deleted. All references to Section 7-1.12 in the Contract documents shall be deemed to mean Sections 7-1.121, "Indemnification," and 7-1.122, "Insurance," as added below.

The Standard Specifications is amended by adding the following Section 7-1.121, "Indemnification," and Section 7-1.122, "Insurance," before Section 7-1.125, "Legal Action Against the Department":

7-1.121 Indemnification.—With the exception that this section shall in no event be construed to require indemnification by the Contractor to a greater extent than permitted by law, the Contractor shall defend, indemnify and save harmless the State, including its officers, directors, agents (excluding agents who are design professionals), and employees, and each of them (Indemnitees), from any and all claims, demands, causes of action, damages, costs, expenses, actual attorneys' fees, losses or liabilities, in law or in equity, of every kind and nature whatsoever (Claims), arising out of or in connection with the Contractor's performance of this contract for:

- A. Bodily injury including, but not limited to, bodily injury, sickness or disease, emotional injury or death to persons, including, but not limited to, the public, any employees or agents of the Contractor, State, Department, or any other contractor and;
- B. Damage to property of anyone including loss of use thereof;

caused or alleged to be caused in whole or in part by any negligent or otherwise legally actionable act or omission of the Contractor or anyone directly or indirectly employed by the Contractor or anyone for whose acts the Contractor may be liable.

Except as otherwise provided by law, the indemnification provisions above shall apply regardless of the existence or degree of fault of Indemnitees. The Contractor, however, shall not be obligated to indemnify Indemnitees for Claims arising from conduct delineated in Civil Code section 2782. Further, the Contractor's indemnity obligation shall not extend to Claims to the extent they arise from any defective or substandard condition of the roadway which existed at or prior to the time the Contractor commenced work, unless this condition has been changed by the work or the scope of the work requires the Contractor to maintain existing Roadway facilities and the claim arises from the Contractor's failure to maintain. The Contractor's indemnity obligation shall extend to Claims arising after the work is completed and accepted only if these Claims are directly related to alleged acts or omissions of the Contractor which occurred during the course of the work. No inspection by the Department, its employees or agents shall be deemed a waiver by the Department of full compliance with the requirements of this section.

The Contractor's obligation to defend and indemnify shall not be excused because of the Contractor's inability to evaluate liability or because the Contractor evaluates liability and determines that the Contractor is not liable to the claimant. The Contractor will respond within 30 days to the tender of any claim for defense and indemnity by the State, unless this time has been extended by the State. If the Contractor fails to accept or reject a tender of defense and indemnity within 30 days, in addition to any other remedy authorized by law, so much of the money due the Contractor under and by virtue of the contract as shall reasonably be considered necessary by the Department, may be retained by the State until disposition has been made of the claim or suit for damages, or until the Contractor accepts or rejects the tender of defense, whichever occurs first.

With respect to third party claims against the Contractor, the Contractor waives any and all rights of any type to express or implied indemnity against the State, its directors, officers, employees, or agents (excluding agents who are design professionals).

7-1.122 Insurance.—Insurance shall conform to the following requirements:

7-1.122A Casualty Insurance.—The Contractor shall, at the Contractor's expense, procure and maintain insurance on all of its operations with companies acceptable to the Department as follows. All insurance shall be kept in full force and effect from the beginning of the work through final acceptance by the State. In addition, the Contractor shall maintain completed operations coverage with a carrier acceptable to the Department through the expiration of the patent deficiency in construction statute of repose set forth in Section 337.1 of the Code of Civil Procedure.

7-1.122A(1) Workers' Compensation and Employer's Liability Insurance.—Workers' Compensation insurance shall be provided as specified in Section 7-1.01A(6), "Workers' Compensation." Employer's Liability Insurance shall be provided in amounts not less than:

- (a) \$1 000 000 for each accident for bodily injury by accident.
- (b) \$1 000 000 policy limit for bodily injury by disease.
- (c) \$1 000 000 for each employee for bodily injury by disease.

If there is an exposure of injury to the Contractors' employees under the U.S. Longshoremen's and Harbor Workers' Compensation Act, the Jones Act or under laws, regulations or statutes applicable to maritime employees, coverage shall be included for such injuries or claims.

7-1.122A(2) Liability Insurance.—The Contractor shall carry General Liability and Umbrella or Excess Liability Insurance covering all operations by or on behalf of the Contractor providing insurance for bodily injury liability, and property damage liability for the limits of liability indicated below and including coverage for:

- (a) premises, operations and mobile equipment
- (b) products and completed operations
- (c) broad form property damage (including completed operations)
- (d) explosion, collapse and underground hazards
- (e) personal injury
- (f) contractual liability

7-1.122A(3) Liability Limits/Additional Insureds.—The limits of liability shall be at least:

- (a) \$1 000 000 for each occurrence (combined single limit for bodily injury and property damage).
- (b) \$2 000 000 aggregate for products-completed operations.
- (c) \$2 000 000 general aggregate. This general aggregate limit shall apply separately to the Contractor's work under this Agreement.
- (d) \$5 000 000 umbrella or excess liability. For projects over \$25 000 000 only, an additional \$10 000 000 umbrella or excess liability (for a total of \$15 000 000). Umbrella or excess policy shall include products liability completed operations coverage and may be subject to \$5 000 000 or \$15 000 000 aggregate limits. Further, the umbrella or excess policy shall contain a clause stating that it takes effect (drops down) in the event the primary limits are impaired or exhausted.

The State and the Department, including their officers, directors, agents (excluding agents who are design professionals), and State employees, shall be named as additional insureds under the General Liability and Umbrella Liability Policies with respect to liability arising out of or connected with work or operations performed by or on behalf of the Contractor under this contract. Coverage for such additional insureds shall not extend to liability:

- (1) arising from any defective or substandard condition of the Roadway which existed at or prior to the time the Contractor commenced work, unless such condition has been changed by the work or the scope of the work requires the Contractor to maintain existing Roadway facilities and the claim arises from the Contractor's failure to maintain; or
- (2) for claims occurring after the work is completed and accepted unless these claims are directly related to alleged acts or omissions of the Contractor which occurred during the course of the work; or
- (3) to the extent prohibited by Section 11580.04 of the Insurance Code.

The policy shall stipulate that the insurance afforded the additional insureds shall apply as primary insurance. Any other insurance or self insurance maintained by the Department or State will be excess only and shall not be called upon to contribute with this insurance. Such additional insured coverage shall be provided by a policy provision or by an endorsement providing coverage at least as broad as Additional Insured (Form B) endorsement form CG 2010, as published by the Insurance Services Office (ISO).

7-1.122B Automobile Liability Insurance.—The Contractor shall carry automobile liability insurance, including coverage for all owned, hired and non-owned automobiles. The primary limits of liability shall be not less than \$1 000 000 combined single limit each accident for bodily injury and property damage. The umbrella or excess liability coverage required under Section 7-1.122A(3), "Liability Limits/Additional Insureds," shall also apply to automobile liability.

7-1.122C Policy Forms, Endorsements and Certificates.—The Contractor's General Liability Insurance shall be provided under Commercial General Liability policy form no. CG0001 as published by the Insurance Services Office (ISO) or under a policy form at least as broad as policy form no. CG0001.

Evidence of insurance in a form acceptable to the Department, including the required "additional insured" endorsements, shall be furnished by the Contractor to the Department at or prior to the pre-construction conference. The evidence of insurance shall provide that there will be no cancellation, lapse, or reduction of coverage without thirty (30) days' prior written notice to the Department. Certificates of Insurance, as evidence of required insurance, for the General Liability, Auto Liability and Umbrella-Excess Liability policies shall set forth deductible amounts applicable to each policy and all exclusions which are added by endorsement to each policy. The Department may expressly allow deductible clauses, which it does not consider excessive, overly broad, or harmful to the interests of the State. Standard ISO form CG 0001 or similar exclusions will be allowed provided they are not inconsistent with the requirements of this section. Allowance of any additional exclusions is at the discretion of the Department. Regardless of the allowance of exclusions or deductions by the Department, the Contractor shall be responsible for any deductible amount and shall warrant that the coverage provided to the Department is consistent with the requirements of this section.

7-1.122D Enforcement.—The Department may take any steps as are necessary to assure Contractor's compliance with its obligations. Should any insurance policy lapse or be canceled during the contract period the Contractor shall, within thirty (30) days prior to the effective expiration or cancellation date, furnish the Department with evidence of renewal or replacement of the policy. Failure to continuously maintain insurance coverage as herein provided is a material breach of contract. In the event the Contractor fails to maintain any insurance coverage required, the Department may, but is not required to, maintain this coverage and charge the expense to the Contractor or terminate this Agreement. The required insurance shall be subject to the approval of Department, but any acceptance of insurance

certificates by the Department shall in no way limit or relieve the Contractor of the Contractor's duties and responsibilities under the Contract to indemnify, defend and hold harmless the State, its officers, agents, and employees. Insurance coverage in the minimum amounts set forth herein shall not be construed to relieve the Contractor for liability in excess of such coverage, nor shall it preclude the State from taking other actions as is available to it under any other provision of the contract or law. Failure of the Department to enforce in a timely manner any of the provisions of this section shall not act as a waiver to enforcement of any of these provisions at a later date.

7-1.122E Self-Insurance.—Self-insurance programs and self-insured retentions in insurance policies are subject to separate annual review and approval by the State of evidence of the Contractor's financial capacity to respond. Additionally, self-insurance programs or retentions must provide the State with at least the same protection from liability and defense of suits as would be afforded by first-dollar insurance.

7-1.122F Miscellaneous.—Nothing contained in the Contract is intended to make the public or any member thereof a third party beneficiary of the Insurance or Indemnity provisions of these Standard Specifications, nor is any term, condition or other provision of the Contract intended to establish a standard of care owed to the public or any member thereof.

5-1.025 ARBITRATION

The last paragraph in Section 9-1.10, "Arbitration," of the Standard Specifications, is amended to read:

Arbitration shall be initiated by a Complaint in Arbitration made in compliance with the requirements of those regulations. A Complaint in Arbitration by the Contractor shall be made not later than 90 days after the date of service in person or by mail on the Contractor of the final written decision by the Department on the claim.

5-1.03 PAYMENT OF WITHHELD FUNDS

Section 9-1.065, "Payment of Withheld Funds," of the Standard Specifications, is amended by adding the following after the third paragraph:

Alternatively, and subject to the approval of the Department, the payment of retentions earned may be deposited directly with a person licensed under Division 6 (commencing with Section 17000) of the Financial Code as the escrow agent. Upon written request of an escrow agent that has not been approved by the Department under subdivision (c) of Section 10263 of the Public Contract Code, the Department will provide written notice to that escrow agent within 10 business days of receipt of the request indicating the reason or reasons for not approving that escrow agent. The payments will be deposited in a trust account with a Federally chartered bank or savings association within 24 hours of receipt by the escrow agent. The Contractor shall not place any retentions with the escrow agent in excess of the coverage provided to that escrow agent pursuant to subdivision (b) of Section 17314 of the Financial Code. In all respects not inconsistent with subdivision (c) of Section 10263 of the Public Contract Code, the remaining provisions of Section 10263 of the Public Contract Code shall apply to escrow agents acting pursuant to subdivision (c) of Section 10263 of the Public Contract Code.

5-1.04 INTEREST ON PAYMENTS

Interest shall be payable on progress payments, payments after acceptance, final payments, extra work payments and claim payments as follows:

1. Unpaid progress payments, payment after acceptance and final payments shall begin to accrue interest 30 days after the Engineer prepares the payment estimate.
2. Unpaid extra work bills shall begin to accrue interest 30 days after preparation of the first pay estimate following the receipt of a properly submitted and undisputed extra work bill. To be properly submitted, the bill must be submitted within 7 days of the performance of the extra work and in accordance with the requirements of Section 9-1.03C, "Records," and Section 9-1.06, "Partial Payments," of the Standard Specifications. An undisputed extra work bill not submitted within 7 days of performance of the extra work will begin to accrue interest 30 days after the preparation of the second pay estimate following submittal of the bill.
3. The rate of interest payable for unpaid progress payments, payments after acceptance, final payments and extra work payments shall be 10 percent per annum.
4. The rate of interest payable on a claim, protest or dispute ultimately allowed under this contract shall be 6 percent per annum. Interest shall begin to accrue 61 days after the Contractor submits to the Engineer information in sufficient detail to enable the Engineer to ascertain the basis and amount of said claim, protest or dispute.

The rate of interest payable on any award in arbitration shall be 6 percent per annum if allowed under the provisions of Civil Code Section 3289.

5-1.041 FINAL PAYMENT AND CLAIMS

Attention is directed to Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications.

The District that administers the contract shall submit a claim position letter to the Contractor within 135 days after acceptance of the contract. After receipt of the claim position letter from the District, or 135 days after acceptance of the contract, whichever occurs first, the Contractor may request a meeting with the person or board designated by the District Director to review claims that remain in dispute. If the Contractor requests a meeting, the review person or board shall meet with the Contractor within 45 days after the request is received.

5-1.05 PUBLIC SAFETY

The Contractor shall provide for the safety of traffic and the public in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications and these special provisions.

The Contractor shall install temporary railing (Type K) between a lane open to public traffic and an excavation, obstacle, or storage area when the following conditions exist:

- (1) Excavations.—The near edge of the excavation is 3.6 m or less from the edge of the lane, except:
 - (a) Excavations covered with sheet steel or concrete covers of adequate thickness to prevent accidental entry by traffic or the public.
 - (b) Excavations less than 0.3-m deep.
 - (c) Trenches less than 0.3-m wide for irrigation pipe or electrical conduit, or excavations less than 0.3-m in diameter.
 - (d) Excavations parallel to the lane for the purpose of pavement widening or reconstruction.
 - (e) Excavations in side slopes, where the slope is steeper than 1:4 (vertical:horizontal).
 - (f) Excavations protected by existing barrier or railing.
- (2) Temporarily Unprotected Permanent Obstacles.—The work includes the installation of a fixed obstacle together with a protective system, such as a sign structure together with protective railing, and the Contractor elects to install the obstacle prior to installing the protective system; or the Contractor, for the Contractor's convenience and with permission of the Engineer, removes a portion of an existing protective railing at an obstacle and does not replace such railing complete in place during the same day.
- (3) Storage Areas.—Material or equipment is stored within 3.6 m of the lane and the storage is not otherwise prohibited by the provisions of the Standard Specifications and these special provisions.

The approach end of temporary railing (Type K), installed in conformance with the provisions in this section "Public Safety" and in Section 7-1.09, "Public Safety," of the Standard Specifications, shall be offset a minimum of 4.6 m from the edge of the traffic lane open to public traffic. The temporary railing shall be installed on a skew toward the edge of the traffic lane of not more than 0.3-m transversely to 3 m longitudinally with respect to the edge of the traffic lane. If the 4.6-m minimum offset cannot be achieved, the temporary railing shall be installed on the 10 to 1 skew to obtain the maximum available offset between the approach end of the railing and the edge of the traffic lane, and an array of temporary crash cushion modules shall be installed at the approach end of the temporary railing.

Temporary railing (Type K) shall conform to the provisions in Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications. Temporary railing (Type K), conforming to the details shown on 1995 Standard Plan T3 or 1992 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

The fourteenth paragraph of Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications is amended to read:

Each rail unit placed within 3 m of a traffic lane shall have a reflector installed on top of the rail as directed by the Engineer. A Type P marker panel shall also be installed at each end of railing installed adjacent to a two-lane, two-way highway and at the end facing traffic of railing installed adjacent to a one-way roadbed. If the railing is placed on a skew, the marker shall be installed at the end of the skew nearest the traveled way. Type P marker panels shall conform to the provisions in Section 82, "Markers and Delineators," except that the Contractor shall furnish the marker panels.

Reflectors on temporary railing (Type K) shall conform to the provisions in "Approved Traffic Products" of these special provisions.

Temporary crash cushion modules shall conform to the provisions in "Temporary Crash Cushion Module" of these special provisions.

Except for installing, maintaining and removing traffic control devices, whenever work is performed or equipment is operated in the following work areas the Contractor shall close the adjacent traffic lane unless otherwise provided in the Standard Specifications and these special provisions:

Approach speed of public traffic (Posted Limit) (Kilometers Per Hour)	Work Areas
Over 72 (45 Miles Per Hour)	Within 1.8 m of a traffic lane but not on a traffic lane
56 to 72 (35 to 45 Miles Per Hour)	Within 0.9-m of a traffic lane but not on a traffic lane

The lane closure provisions of this section shall not apply if the work area is protected by permanent or temporary railing or barrier.

When traffic cones or delineators are used to delineate a temporary edge of traffic lane, the line of cones or delineators shall be considered to be the edge of traffic lane, however, the Contractor shall not reduce the width of an existing lane to less than 3 m without written approval from the Engineer.

When work is not in progress on a trench or other excavation that required closure of an adjacent lane, the traffic cones or portable delineators used for the lane closure shall be placed off of and adjacent to the edge of the traveled way. The spacing of the cones or delineators shall be not more than the spacing used for the lane closure.

Suspended loads or equipment shall not be moved nor positioned over public traffic or pedestrians.

Full compensation for conforming to the provisions in this section "Public Safety," including furnishing and installing temporary railing (Type K) and temporary crash cushion modules, shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

5-1.06 SURFACE MINING AND RECLAMATION ACT

Attention is directed to the Surface Mining and Reclamation Act of 1975, commencing in Public Resources Code, Mining and Geology, Section 2710, which establishes regulations pertinent to surface mining operations.

Material from mining operations furnished for this project shall only come from permitted sites in compliance with the Surface Mining and Reclamation Act of 1975.

The requirements of this section shall apply to all materials furnished for the project, except for acquisition of materials in conformance with Section 4-1.05, "Use of Materials Found on the Work," of the Standard Specifications.

5-1.07 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES

When the presence of asbestos or hazardous substances are not shown on the plans or indicated in the specifications and the Contractor encounters materials which the Contractor reasonably believes to be asbestos or a hazardous substance as defined in Section 25914.1 of the Health and Safety Code, and the asbestos or hazardous substance has not been rendered harmless, the Contractor may continue work in unaffected areas reasonably believed to be safe, and shall immediately cease work in the affected area and report the condition to the Engineer in writing.

In accordance with Section 25914.1 of the Health and Safety Code, all such removal of asbestos or hazardous substances including any exploratory work to identify and determine the extent of the asbestos or hazardous substance will be performed by separate contract.

If delay of work in the area delays the current controlling operation, the delay will be considered a right of way delay and the Contractor will be compensated for the delay as provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

5-1.08 YEAR 2000 COMPLIANCE

This contract is subject to Year 2000 Compliance for automated devices in the State of California. Year 2000 compliance is defined as follows:

Year 2000 compliance for automated devices in the State of California is achieved when embedded functions have or create no logical or mathematical inconsistencies when dealing with dates prior to and beyond 1999. The year 2000 is recognized and processed as a leap year. The product must also operate accurately in the manner in which it was intended for date operation without requiring manual intervention.

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer in accordance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for all automated devices furnished for the project.

5-1.085 BUY AMERICA REQUIREMENTS

Attention is directed to the "Buy America" requirements of the Surface Transportation Assistance Act of 1982 (Section 165) and the Intermodal Surface Transportation Efficiency Act of 1991 (ISTEA) Sections 1041(a) and 1048(a), and the regulations adopted pursuant thereto. In accordance with the law and regulations, all manufacturing processes for steel and iron materials furnished for incorporation into the work on this project shall occur in the United States; with the exception that pig iron and processed, pelletized and reduced iron ore manufactured outside of the United States may be used in the domestic manufacturing process for such steel and iron materials. The application of coatings, such as epoxy coating, galvanizing, painting and any other coating that protects or enhances the value of steel or iron materials shall be considered a manufacturing process subject to the "Buy America" requirements.

A Certificate of Compliance, conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications, shall be furnished for steel and iron materials. The certificates, in addition to certifying that the materials comply with the specifications, shall also specifically certify that all manufacturing processes for the materials occurred in the United States, except for the above exceptions.

The requirements imposed by the law and regulations do not prevent a minimal use of foreign steel and iron materials if the total combined cost of the materials used does not exceed one-tenth of one percent (0.1%) of the total contract cost or \$2500, whichever is greater. The Contractor shall furnish the Engineer acceptable documentation of the quantity and value of any foreign steel and iron prior to incorporating the materials into the work.

5-1.09 SUBCONTRACTOR AND DBE RECORDS

The Contractor shall maintain records showing the name and business address of each first-tier subcontractor. The records shall also show the name and business address of every DBE subcontractor, DBE vendor of materials and DBE trucking company, regardless of tier. The records shall show the date of payment and the total dollar figure paid to all of these firms. DBE prime contractors shall also show the date of work performed by their own forces along with the corresponding dollar value of the work.

Upon completion of the contract, a summary of these records shall be prepared on Form CEM-2402 (F) and certified correct by the Contractor or the Contractor's authorized representative, and shall be furnished to the Engineer. The form shall be furnished to the Engineer within 90 days from the date of contract acceptance. \$10,000 will be withheld from payment until the Form CEM-2402 (F) is submitted. The amount will be returned to the Contractor when a satisfactory Form CEM-2402 (F) is submitted.

Prior to the fifteenth of each month, the Contractor shall submit documentation to the Engineer showing the amount paid to DBE trucking companies listed in the Contractor's DBE information. This monthly documentation shall indicate the portion of the revenue paid to DBE trucking companies which is claimed toward DBE participation. The Contractor shall also obtain and submit documentation to the Engineer showing the amount paid by DBE trucking companies to all firms, including owner-operators, for the leasing of trucks. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The records must confirm that the amount of credit claimed toward DBE participation conforms with Section 2-1.02, "Disadvantaged Business Enterprise," of these special provisions.

The Contractor shall also obtain and submit documentation to the Engineer showing the truck number, owner's name, California Highway Patrol CA number, and if applicable, the DBE certification number of the owner of the truck for all trucks used during that month for which DBE participation will be claimed. This documentation shall be submitted on Form CEM-2404 (F).

5-1.093 DBE CERTIFICATION STATUS

If a DBE subcontractor is decertified during the life of the project, the decertified subcontractor shall notify the Contractor in writing with the date of decertification. If a subcontractor becomes a certified DBE during the life of the project, the subcontractor shall notify the Contractor in writing with the date of certification. The Contractor shall furnish the written documentation to the Engineer.

Upon completion of the contract, Form CEM-2403 (F) indicating the DBE's existing certification status shall be signed and certified correct by the Contractor. The certified form shall be furnished to the Engineer within 90 days from the date of contract acceptance.

5-1.095 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS

The DBEs listed by the Contractor in response to the provisions in Section 2-1.02B, "Submission of DBE Information," and Section 3, "Award and Execution of Contract," of these special provisions, which are determined by the Department to be certified DBEs, shall perform the work and supply the materials for which they are listed, unless the Contractor has received prior written authorization to perform the work with other forces or to obtain the materials from other sources.

Authorization to use other forces or sources of materials may be requested for the following reasons:

- A. The listed DBE, after having had a reasonable opportunity to do so, fails or refuses to execute a written contract, when such written contract, based upon the general terms, conditions, plans and specifications for the project, or on the terms of such subcontractor's or supplier's written bid, is presented by the Contractor.
- B. The listed DBE becomes bankrupt or insolvent.
- C. The listed DBE fails or refuses to perform the subcontract or furnish the listed materials.
- D. The Contractor stipulated that a bond was a condition of executing a subcontract and the listed DBE subcontractor fails or refuses to meet the bond requirements of the Contractor.
- E. The work performed by the listed subcontractor is substantially unsatisfactory and is not in substantial conformance with the plans and specifications, or the subcontractor is substantially delaying or disrupting the progress of the work.
- F. It would be in the best interest of the State.

The Contractor shall not be entitled to any payment for such work or material unless it is performed or supplied by the listed DBE or by other forces (including those of the Contractor) pursuant to prior written authorization of the Engineer.

5-1.097 SUBCONTRACTING

Attention is directed to the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, and Section 2, "Proposal Requirements and Conditions," and Section 3, "Award and Execution of Contract," of these special provisions.

Section 8-1.01 of the Standard Specifications is amended by adding the following before the sixth paragraph:

Pursuant to the provisions of Section 6109 of the Public Contract Code, the Contractor shall not perform work on a public works project with a subcontractor who is ineligible to perform work on the public works project pursuant to Section 1777.1 or 1777.7 of the Labor Code.

Pursuant to the provisions of Section 1777.1 of the Labor Code, the Labor Commissioner publishes and distributes a list of contractors ineligible to perform work as a subcontractor on a public works project. This list of debarred contractors is available from the Department of Industrial Relations web site at:

<http://www.dir.ca.gov/DLSE/Debar.html>.

The provisions in the third paragraph of Section 8-1.01, "Subcontracting," of the Standard Specifications, that the Contractor shall perform with the Contractor's own organization contract work amounting to not less than 50 percent of the original contract price, is not changed by the Federal Aid requirement specified under "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions that the Contractor perform not less than 30 percent of the original contract work with the Contractor's own organization.

Each subcontract and any lower tier subcontract that may in turn be made shall include the "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions. This requirement shall be enforced as follows:

- A. Noncompliance shall be corrected. Payment for subcontracted work involved will be withheld from progress payments due, or to become due, until correction is made. Failure to comply may result in termination of the contract.

The DBE information furnished under Section 2-1.02B, "Submission of DBE Information," of these special provisions is in addition to the subcontractor information required to be furnished under Section 8-1.01, "Subcontracting," and Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications.

In conformance with the Federal DBE regulations Sections 26.53(f)(1) and 26.53(f)(2) Part 26, Title 49 CFR:

- A. The Contractor shall not terminate for convenience a DBE subcontractor listed in response to Section 2-1.02B, "Submission of DBE Information," and then perform that work with its own forces, or those of an affiliate without the written consent of the Department, and
- B. If a DBE subcontractor is terminated or fails to complete its work for any reason, the Contractor will be required to make good faith efforts to substitute another DBE subcontractor for the original DBE subcontractor, to the extent needed to meet the contract goal.

The requirement in Section 2-1.02, "Disadvantaged Business Enterprise (DBE)," of these special provisions that DBEs must be certified on the date bids are opened does not apply to DBE substitutions after award of the contract.

5-1.098 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS

Attention is directed to the provisions in Sections 10262 and 10262.5 of the Public Contract Code and Section 7108.5 of the Business and Professions Code concerning prompt payment to subcontractors.

5-1.099 PROMPT PAYMENT OF WITHHELD FUNDS TO SUBCONTRACTORS

The Contractor shall return all moneys withheld in retention from the subcontractor within 30 days after receiving payment for work satisfactorily completed, even if the other contract work is not completed and has not been accepted in conformance with Section 7-1.17, "Acceptance of Contract," of the Standard Specifications. This requirement shall not be construed to limit or impair any contractual, administrative, or judicial remedies otherwise available to the Contractor or subcontractor in the event of a dispute involving late payment or nonpayment by the Contractor or deficient subcontract performance or noncompliance by a subcontractor.

5-1.10 PARTNERING

The State will promote the formation of a "Partnering" relationship with the Contractor in order to effectively complete the contract to the benefit of both parties. The purpose of this relationship will be to maintain cooperative communication and mutually resolve conflicts at the lowest possible management level.

The Contractor may request the formation of such a "Partnering" relationship by submitting a request in writing to the Engineer after approval of the contract. If the Contractor's request for "Partnering" is approved by the Engineer, scheduling of a "Partnering" workshop, selecting the "Partnering" facilitator and workshop site, and other administrative details shall be as agreed to by both parties.

The costs involved in providing a facilitator and a workshop site will be borne equally by the State and the Contractor. The Contractor shall pay all compensation for the wages and expenses of the facilitator, and of the expenses for obtaining the workshop site. The State's share of such costs will be reimbursed to the Contractor in a change order written by the Engineer. Markups will not be added. All other costs associated with the "Partnering" relationship will be borne separately by the party incurring the costs.

The establishment of a "Partnering" relationship will not change or modify the terms and conditions of the contract and will not relieve either party of the legal requirements of the contract.

5-1.106 COST REDUCTION INCENTIVE

Attention is directed to Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

Prior to preparing a cost reduction proposal, the Contractor shall request a meeting with the Engineer to discuss the proposal in concept and to determine the merit of the cost reduction proposal. Items of discussion will also include permit issues, impact on other projects, impact on the project schedule, peer reviews, and review times required by the Department and other agencies.

5-1.11 FORCE ACCOUNT PAYMENT

The second, third and fourth paragraphs of Section 9-1.03A, "Work Performed by Contractor," in the Standard Specifications, shall not apply.

Attention is directed to "Overhead" of these special provisions.

To the total of the direct costs for work performed on a force account basis, computed as provided in Sections 9-1.03A(1), "Labor," 9-1.03A(2), "Materials," and 9-1.03A(3), "Equipment Rental," of the Standard Specifications, there will be added the following markups:

Cost	Percent Markup
Labor	28
Materials	10
Equipment Rental	10

The above markups shall be applied to all work performed on a force account basis, regardless of whether the work revises the current contract completion date.

The above markups, together with payments made for time-related overhead pursuant to "Overhead" of these special provisions, shall constitute full compensation for all overhead costs for work performed on a force account basis. These overhead costs shall be deemed to include all items of expense not specifically designated as cost or equipment rental in conformance with the provisions in Sections 9-1.03A(1), "Labor," 9-1.03A(2), "Materials," and 9-1.03A(3), "Equipment

Rental," of the Standard Specifications. The total payment made as provided above and in the first paragraph of Section 9-1.03A, "Work Performed by Contractor," of the Standard Specifications shall be deemed to be the actual cost of the work performed on a force account basis, and shall constitute full compensation therefor. Full compensation for all overhead costs for work performed on a force account basis, and for which no adjustment is made to the quantity of time-related overhead pursuant to "Overhead" of these special provisions, shall be considered as included in the markups specified above, and no additional compensation will be allowed therefor.

When extra work to be paid for on a force account basis is performed by a subcontractor, approved in conformance with the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, an additional markup of 7 percent will be added to the total cost of that extra work including all markups specified in this section "Force Account Payment". The additional 7 percent markup shall reimburse the Contractor for additional administrative costs, and no other additional payment will be made by reason of performance of the extra work by a subcontractor.

5-1.12 AREAS FOR CONTRACTOR'S USE

Attention is directed to the requirements specified in Section 7-1.19, "Rights in Land and Improvements," of the Standard Specifications and these special provisions.

The highway right of way shall be used only for purposes that are necessary to perform the required work. The Contractor shall not occupy the right of way, or allow others to occupy the right of way, for purposes which are not necessary to perform the required work.

There are no State-owned parcels adjacent to the right of way for the exclusive use of the Contractor within the contract limits. The Contractor shall secure, at the Contractor's own expense, any area required for plant sites, storage of equipment or materials, or for other purposes.

No area is available within the contract limits for the exclusive use of the Contractor. However, temporary storage of equipment and materials on State property may be arranged with the Engineer, subject to the prior demands of State maintenance forces and to all other contract requirements. Use of the Contractor's work areas and other State-owned property shall be at the Contractor's own risk, and the State shall not be held liable for any damage to or loss of materials or equipment located within such areas.

5-1.13 PAYMENTS

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications and these special provisions.

For the purpose of making partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications, the amount set forth for the contract items of work hereinafter listed shall be deemed to be the maximum value of the contract item of work which will be recognized for progress payment purposes:

Bridge Removal (Portion)	\$21,000
--------------------------	----------

After acceptance of the contract pursuant to Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, the amount, if any, payable for a contract item of work in excess of the maximum value for progress payment purposes hereinabove listed for the item, will be included for payment in the first estimate made after acceptance of the contract.

In determining the partial payments to be made to the Contractor, only the following listed materials will be considered for inclusion in the payment as materials furnished but not incorporated in the work:

- Prestressing steel for cast-in-place members (sealed packages only)
- Ducts and anchorages
- Joint seal (MR 30 mm)
- Bar reinforcing steel (Bridge)
- Metal (Barrier Mounted Sign)
- Miscellaneous Iron and Steel
- Pavement Markers

5-1.14 SOUND CONTROL REQUIREMENTS

Sound control shall conform to the provisions in Section 7-1.01I, "Sound Control Requirements," of the Standard Specifications and these special provisions.

The noise level from the Contractor's operations, between the hours of 9:00 p.m. and 7:00 a.m., shall not exceed 86 dbA at a distance of 15 m. This requirement in no way relieves the Contractor from responsibility for complying with local ordinances regulating noise level.

The noise level requirement shall apply to the equipment on the job or related to the job, including but not limited to trucks, transit mixers or transient equipment that may or may not be owned by the Contractor. The use of loud sound signals shall be avoided in favor of light warnings except those required by safety laws for the protection of personnel.

Full compensation for conforming to the requirements of this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

SECTION 6. (BLANK)

SECTION 7. (BLANK)

SECTION 8. MATERIALS

SECTION 8-1. MISCELLANEOUS

8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the inch-pound (imperial) system which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following provisions:

Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.

Before other non-metric materials and products will be considered for use the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish necessary information as required by the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision will be final.

When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, the list of sources of material as specified in Section 6-1.01, "Source of Supply and Quality of Materials," of the Standard Specification shall include a list of substitutions to be made and contract items involved. In addition, for a change in design or details the Contractor shall submit plans and working drawings in conformance with Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications.

Unless otherwise specified, the following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR SIZES OF HIGH STRENGTH STEEL FASTENERS
ASTM Designation: A 325M

METRIC SIZE SHOWN ON THE PLANS mm x thread pitch	IMPERIAL SIZE TO BE SUBSTITUTED inch
M16 x 2	5/8
M20 x 2.5	3/4
M22 x 2.5	7/8
M24 x 3	1
M27 x 3	1-1/8
M30 x 3.5	1-1/4
M36 x 4	1-1/2

SUBSTITUTION TABLE FOR PLAIN WIRE REINFORCEMENT, ASTM Designation: A 82

METRIC SIZE SHOWN ON THE PLANS mm ²	US CUSTOMARY UNITS SIZE TO BE SUBSTITUTED inch ² x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

SUBSTITUTION TABLE FOR BAR REINFORCEMENT

METRIC BAR DESIGNATION NUMBER SHOWN ON THE PLANS	EQUIVALENT IMPERIAL BAR DESIGNATION NUMBER TO BE SUBSTITUTED
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

No adjustment will be required in spacing or total number of reinforcing bars due to a difference in minimum yield strength between metric and non-metric bars.

The sizes in the following tables of materials and products are exact conversions of metric sizes of materials and products and are listed as acceptable equivalents:

CONVERSION TABLE FOR SIZES OF:

- (1) STEEL FASTENERS FOR GENERAL APPLICATIONS, ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55, and
- (2) HIGH STRENGTH STEEL FASTENERS, ASTM Designation: A 325 or A 449

METRIC SIZE SHOWN ON THE PLANS mm	EQUIVALENT IMPERIAL SIZE inch
6, or 6.35	1/4
8 or 7.94	5/16
10, or 9.52	3/8
11, or 11.11	7/16
13 or 12.70	1/2
14, or 14.29	9/16
16, or 15.88	5/8
19, or 19.05	3/4
22, or 22.22	7/8
24, 25, or 25.40	1
29, or 28.58	1-1/8
32, or 31.75	1-1/4
35, or 34.93	1-3/8
38 or 38.10	1-1/2
44, or 44.45	1-3/4
51, or 50.80	2
57, or 57.15	2-1/4
64, or 63.50	2-1/2
70 or 69.85	2-3/4
76, or 76.20	3
83, or 82.55	3-1/4
89 or 88.90	3-1/2
95, or 95.25	3-3/4
102, or 101.60	4

CONVERSION TABLE FOR NOMINAL THICKNESS OF SHEET METAL

UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED SHEETS (GALVANIZED)	
METRIC THICKNESS SHOWN ON THE PLANS	EQUIVALENT US STANDARD GAGE	METRIC THICKNESS SHOWN ON THE PLANS	EQUIVALENT GALVANIZED SHEET GAGE
mm	inch	mm	inch
7.94	0.3125	4.270	0.1681
6.07	0.2391	3.891	0.1532
5.69	0.2242	3.510	0.1382
5.31	0.2092	3.132	0.1233
4.94	0.1943	2.753	0.1084
4.55	0.1793	2.372	0.0934
4.18	0.1644	1.994	0.0785
3.80	0.1495	1.803	0.0710
3.42	0.1345	1.613	0.0635
3.04	0.1196	1.461	0.0575
2.66	0.1046	1.311	0.0516
2.28	0.0897	1.158	0.0456
1.90	0.0747	1.006 or 1.016	0.0396
1.71	0.0673	0.930	0.0366
1.52	0.0598	0.853	0.0336
1.37	0.0538	0.777	0.0306
1.21	0.0478	0.701	0.0276
1.06	0.0418	0.627	0.0247
0.91	0.0359	0.551	0.0217
0.84	0.0329	0.513	0.0202
0.76	0.0299	0.475	0.0187
0.68	0.0269	-----	-----
0.61	0.0239	-----	-----
0.53	0.0209	-----	-----
0.45	0.0179	-----	-----
0.42	0.0164	-----	-----
0.38	0.0149	-----	-----

CONVERSION TABLE FOR WIRE

METRIC THICKNESS SHOWN ON THE PLANS mm	EQUIVALENT USA STEEL WIRE THICKNESS inch	GAGE NO.
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

CONVERSION TABLE FOR PIPE PILES

METRIC SIZE SHOWN ON THE PLANS mm x mm	EQUIVALENT IMPERIAL SIZE inch x inch
PP 360 x 4.55	NPS 14 x 0.179
PP 360 x 6.35	NPS 14 x 0.250
PP 360 x 9.53	NPS 14 x 0.375
PP 360 x 11.12	NPS 14 x 0.438
PP 406 x 12.70	NPS 16 x 0.500
PP 460 x T	NPS 18 x T"
PP 508 x T	NPS 20 x T"
PP 559 x T	NPS 22 x T"
PP 610 x T	NPS 24 x T"
PP 660 x T	NPS 26 x T"
PP 711 x T	NPS 28 x T"
PP 762 x T	NPS 30 x T"
PP 813 x T	NPS 32 x T"
PP 864 x T	NPS 34 x T"
PP 914 x T	NPS 36 x T"
PP 965 x T	NPS 38 x T"
PP 1016 x T	NPS 40 x T"
PP 1067 x T	NPS 42 x T"
PP 1118 x T	NPS 44 x T"
PP 1219 x T	NPS 48 x T"
PP 1524 x T	NPS 60 x T"

The thickness in inches (T") represents an exact conversion of the metric thickness in millimeters (T).

CONVERSION TABLE FOR STRUCTURAL TIMBER AND LUMBER

METRIC MINIMUM DRESSED DRY, SHOWN ON THE PLANS mm x mm	METRIC MINIMUM DRESSED GREEN, SHOWN ON THE PLANS mm x mm	EQUIVALENT NOMINAL US SIZE inch x inch
19x89	20x90	1x4
38x89	40x90	2x4
64x89	65x90	3x4
89x89	90x90	4x4
140x140	143x143	6x6
140x184	143x190	6x8
184x184	190x190	8x8
235x235	241x241	10x10
286x286	292x292	12x12

CONVERSION TABLE FOR NAILS AND SPIKES

METRIC COMMON NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC BOX NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC SPIKE, SHOWN ON THE PLANS Length, mm Diameter, mm	EQUIVALENT IMPERIAL SIZE Penny-weight
50.80 2.87	50.80 2.51	————	6d
63.50 3.33	63.50 2.87	————	8d
76.20 3.76	76.20 3.25	76.20 4.88	10d
82.55 3.76	82.55 3.25	82.55 4.88	12d
88.90 4.11	88.90 3.43	88.90 5.26	16d
101.60 4.88	101.60 3.76	101.60 5.72	20d
114.30 5.26	114.30 3.76	114.30 6.20	30d
127.00 5.72	127.00 4.11	127.00 6.68	40d
————	————	139.70 7.19	50d
————	————	152.40 7.19	60d

8-1.02 APPROVED TRAFFIC PRODUCTS

The Department maintains a List of Approved Traffic Products. The Engineer shall not be precluded from sampling and testing products on the List of Approved Traffic Products.

The manufacturer of products on the List of Approved Traffic Products shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each type of traffic product supplied.

The following is the List of Approved Traffic Products:

PAVEMENT MARKERS, PERMANENT TYPE

RETROREFLECTIVE

Apex, Model 921 (100 mm x 100 mm)

Ray-O-Lite, Models SS (100 mm x 100 mm), RS (100 mm x 100 mm) and AA (100 mm x 100 mm)

Stimsonite, Models 88 (100 mm x 100 mm), 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
3M Series 290 (89 mm x 100 mm)

RETROREFLECTIVE WITH ABRASION RESISTANT SURFACE (ARS)

Ray-O-Lite "AA" ARS (100 mm x 100 mm)
Stimsonite, Models 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
3M Series 290 (89 mm x 100 mm)

RETROREFLECTIVE WITH ABRASION RESISTANT SURFACE (ARS) (Used for recessed applications)

Stimsonite, Model 948 (58 mm x 119 mm)
Ray-O-Lite, Model 2002 (58 mm x 117 mm)
Stimsonite, Model 944SB (51 mm x 100 mm)*
Ray-O-Lite, Model 2004 ARS (51 mm x 100 mm)*

*For use only in 114 mm wide (older) recessed slots

NON-REFLECTIVE FOR USE WITH EPOXY ADHESIVE, 100 mm Round

Apex Universal (Ceramic)
Highway Ceramics, Inc. (Ceramic)

NON-REFLECTIVE FOR USE WITH BITUMEN ADHESIVE, 100 mm Round

Apex Universal (Ceramic)
Apex Universal, Model 929 (ABS)
Elgin Molded Plastics, "Empco-Lite" Model 900 (ABS)
Highway Ceramics, Inc. (Ceramic)
Hi-Way Safety, Inc., Models P20-2000W and 2001Y (ABS)
Interstate Sales, "Diamond Back" (ABS) and (Polypropylene)
Alpine Products, D-Dot (ABS)
Road Creations, Model RCB4NR (Acrylic)

PAVEMENT MARKERS, TEMPORARY TYPE

TEMPORARY MARKERS FOR LONG TERM DAY/NIGHT USE (6 months or less)

Apex Universal, Model 924 (100 mm x 100 mm)
Davidson Plastics Corp., Model 3.0 (100 mm x 100 mm)
Elgin Molded Plastics, "Empco-Lite" Model 901 (100 mm x 100 mm)
Road Creations, Model R41C (100 mm x 100 mm)
Vega Molded Products "Temporary Road Marker" (75 mm x 100 mm)

TEMPORARY MARKERS FOR SHORT TERM DAY/NIGHT USE (14 days or less) (For seal coat or chip seal applications, clear protective covers are required)

Apex Universal, Model 932
Davidson Plastics, Models T.O.M., T.R.P.M., and "HH" (High Heat)
Hi-Way Safety, Inc., Model 1280/1281

STRIPING AND PAVEMENT MARKING MATERIALS

PERMANENT TRAFFIC STRIPING AND PAVEMENT MARKING TAPE

Advanced Traffic Marking, Series 300 and 400
Brite-Line, Series 1000

Swarco Industries, "Director 35" (For transverse application only)
Swarco Industries, "Director 60"
3M, "Stamark" Series 380 and 5730
3M, "Stamark" Series A320 Bisymmetric (For use on low-volume roadways only)
3M, "Stamark" Series A420, A440, N420, and N440 (For transverse application only)

TEMPORARY (REMOVABLE) STRIPING AND PAVEMENT MARKING TAPE
(6 months or less)

Brite-Line, Series 100
P.B. Laminations, Aztec, Grade 102
Swarco Industries, "Director-2"
3M, "Stamark," Series A620
3M Series A145 Removable Black Line Mask
(Black Tape: For use only on Asphalt Concrete Surfaces)
Advanced Traffic Marking Black "Hide-A-Line"
(Black Tape: For use only on Asphalt Concrete Surfaces)

PREFORMED THERMOPLASTIC (Heated in place)

Flint Trading, "Premark" and "Premark 20/20 Flex"
Pavemark, "Hotape"

REMOVABLE TRAFFIC PAINT

Belpro, Series 250/252 and No. 93 Remover

CLASS 1 DELINEATORS

ONE-PIECE DRIVEABLE FLEXIBLE TYPE, 1700 mm

Carsonite, Curve-Flex CFRM-400
Carsonite, Roadmarker CRM-375
Davidson Plastics, "Flexi-Guide Models 400 and 566"
FlexStake, Model 654TM
GreenLine Models HWD1-66 and CGD1-66
J. Miller Industries, Model JMI-375 (with soil anchor)

SPECIAL USE FLEXIBLE TYPE, 1700 mm

Carsonite, "Survivor" with 450 mm U-Channel base
FlexStake, Model 604
GreenLine Models HWD and CGD (with 450 mm U-Channel base)
Safe-Hit with 200 mm pavement anchor (SH248-GP1)
Safe-Hit with 380 mm soil anchor (SH248-GP2) and with 450 mm soil anchor (SH248-GP3)

SURFACE MOUNT FLEXIBLE TYPE, 1200 mm

Bent Manufacturing Company, "Masterflex" Model MF-180EX-48
Carsonite, "Super Duck II"
FlexStake, Surface Mount, Models 704 and 754TM

CHANNELIZERS

SURFACE MOUNT TYPE, 900 mm

Bent Manufacturing Company, "Masterflex" Models MF-360-36 (Round) and MF-180-36 (Flat)
Carsonite, "Super Duck" (Flat SDF-436, Round SDR-336)
Carsonite, Super Duck II Model SDCF203601MB "The Channelizer"

Contract No. 07-119844

Davidson Plastics, Flex-Guide Models FG300LD and FG300UR
FlexStake, Surface Mount, Models 703 and 753TM
GreenLine, Model SMD-36
The Line Connection, "Dura-Post" Model DP36-3 (Permanent)
The Line Connection, "Dura-Post" Model DP36-3C (Temporary)
Repo, Models 300 and 400
Safe-Hit, Guide Post, Model SH236SMA

CONICAL DELINEATORS, 1070 mm

(For 700 mm Traffic Cones, see Standard Specifications)

Bent Manufacturing Company "T-Top"
Plastic Safety Systems "Navigator-42"
Roadmaker Company "Stacker"
TraFFix Devices "Grabber"

OBJECT MARKERS

TYPE "K", 450 mm

Carsonite, Model SMD-615
FlexStake, Model 701KM
Repo, Models 300 and 400
Safe-Hit, Model SH718SMA
The Line Connection, Model DP21-4K

TYPE "K-4", 450-600 mm
(Shown as Type "Q" in the Traffic Manual)

Carsonite, Super Duck II
FlexStake, Model 701KM
Repo, Models 300 and 400
Safe-Hit, Models SH8 24SMA_WA and SH8 24GP3_WA
The Line Connection, Model DP21-4Q

TEMPORARY RAILING (TYPE K) REFLECTORS AND CONCRETE BARRIER MARKERS

IMPACTABLE TYPE

ARTUK, "FB"
Davidson Plastics, Model PCBM-12
Duraflex Corp., "Flexx 2020" and "Electriflexx"

NON-IMPACTABLE TYPE

ARTUK, JD Series
Stimsonite, Model 967 (with 83 mm Acrylic cube corner reflector)
Stimsonite, Model 967LS
Vega Molded Products, Models GBM and JD

THREE BEAM BARRIER MARKERS

(For use to the left of traffic)

Duraflex Corp., "Railrider"
Davidson Plastics, "Mini" (75 mm x 254 mm)

CONCRETE BARRIER DELINEATORS, 400 mm

(For use to the right of traffic. When mounted on top of barrier, places top of reflective element at 1200 mm)

Davidson Plastics, Model PCBM T-16
Safe-Hit, Model SH216RBM

**CONCRETE BARRIER-MOUNTED MINI-DRUM
(260 mm x 360 mm x 570 mm)**

Stinson Equipment Company "SaddleMarker"

SOUND WALL DELINEATOR

(Applied to a vertical surface. Top of reflective element at 1200 mm)

Davidson Plastics, PCBM S-36

GUARD RAILING DELINEATOR

(Top of reflective element at 1200 mm above plane of roadway)

WOOD POST TYPE, 686 mm

Carsonite, Model 427
Davidson Plastics FG 427 and FG 527
FlexStake, Model 102 GR
GreenLine GRD 27
J. Miller Model JMI-375G
Safe-Hit, Model SH227GRD

STEEL POST TYPE

Carsonite, Model CFGR-327 with CFGRBK300 Mounting Bracket

RETROREFLECTIVE SHEETING FOR:

CHANNELIZERS, BARRIER MARKERS, AND DELINEATORS

3M, High Intensity
Reflexite, PC-1000 Metalized Polycarbonate
Reflexite, AC-1000 Acrylic
Reflexite, AP-1000 Metalized Polyester
Reflexite, AR-1000 Abrasion Resistant Coating
Stimsonite, Series 6200 (For rigid substrate devices only)

TRAFFIC CONES, 330 mm Sleeves

Reflexite SB (Polyester), Vinyl or "TR" (Semi-transparent)

TRAFFIC CONES, 100 mm and 150 mm Sleeves

3M Series 3840
Reflexite Vinyl, "TR" (Semi-transparent) or "Conformalite"

BARRELS AND DRUMS

Reflexite, "Super High Intensity" or "High Impact Drum Sheeting"
3M Series 3810

BARRICADES: Type I, Engineering Grade

American Decal, Adcolite
Avery Dennison, 1500 and 1600
3M, Scotchlite, Series CW

BARRICADES: Type II, Super Engineering Grade

Avery Dennison, "Fasign" 2500 Series
Kiwalite Type II
Nikkalite 1800 Series

SIGNS: Type II, Super Engineering Grade

Avery Dennison, "Fasign" 2500 Series
Kiwalite, Type II
Nikkalite 1800 Series

SIGNS: Type III, High-Intensity Grade

3M Series 3800
Nippon Carbide, Nikkalite Brand Ultralite Grade II

SIGNS: Type IV, High-Intensity Prismatic Grade

Stimsonite Series 6200

SIGNS: Type VII, High-Intensity Prismatic Grade

3M Series 3900

SIGNS: Type VI, Roll-Up Signs

Reflexite, Vinyl (Orange), Reflexite "SuperBright" (Fluorescent orange)
3M Series RS34 (Orange) and RS20 (Fluorescent orange)

SIGN SUBSTRATE FOR CONSTRUCTION AREA SIGNS

ALUMINUM

FIBERGLASS REINFORCED PLASTIC (FRP)

Sequentia, "Polyplate"
Fiber-Brite

8-1.03 STATE-FURNISHED MATERIALS

Attention is directed to Section 6-1.02, "State-Furnished Materials," of the Standard Specifications and these special provisions.

The following materials will be furnished to the Contractor:

Sign panels for roadside signs and overhead sign structures.
Target plates for median mileage panels.
Padlocks.
Model 170 controller assembly (including wired cabinet controller unit and loop detector sensor units).

Completely wired controller cabinets (with auxiliary equipment but without controller unit and loop detector sensor units) for traffic monitoring stations systems will be furnished to the Contractor at the:

Department of Transportation
District Maintenance Yard
7310 East Bandini Boulevard
Commerce, CA 90040

The Contractor shall notify the Engineer and the Maintenance warehouse, telephone (213) 620-2185, at least 15 working days prior to picking up the type 334-traffic monitoring station controller cabinet and loop detector sensor units.

8-1.04 SLAG AGGREGATE

Aggregate produced from slag resulting from any steel-making process or from air-cooled iron blast furnace slag shall not be used on this project.

8-1.05 MEASUREMENT OF QUANTITIES

Attention is directed to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications and these special provisions.

The following is added after the third paragraph in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications:

All elements of the material plant controller which affect the accuracy or delivery of data shall be made available for the application of security seals. These devices will be inspected and adjusting elements sealed prior to the first production of materials for the contract. The security seals will be furnished by the Engineer. Material production shall cease when alteration, disconnection, or otherwise manipulation of the security seals occur and production shall not resume until the device is inspected and resealed by the Engineer.

Within the limits of the project or at the plant site, the Contractor shall provide a vehicle platform scale of sufficient weighing capacity to check full production sized batches from the proportioning scales to be used in producing materials for the project. This vehicle platform scale shall conform to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications.

Full compensation for furnishing and operating the vehicle platform scale required to check proportioning scales shall be considered to be included in the contract prices paid for the various contract items of work requiring the proportioning scales and no separate payment will be made therefor.

8-1.06 ENGINEERING FABRICS

Engineering fabrics shall conform to the requirements in Section 88, "Engineering Fabrics," of the Standard Specifications and these special provisions.

Filter fabric for this project shall be ultraviolet ray (UV) protected.

SECTION 8-2. CONCRETE

8-2.01 PORTLAND CEMENT CONCRETE

Portland cement concrete shall conform to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

Unless the use of mineral admixture is prohibited, whenever the word "cement" is found in the Standard Specifications or the special provisions, it shall be understood to mean "cementitious material" when both of the following conditions are met:

- A. The cement content of portland cement concrete is specified, and
- B. Section 90, "Portland Cement Concrete," of the Standard Specifications is referenced.

Portland cement concrete that is produced using equipment where the cement and mineral admixture are proportioned in the same weigh hopper shall be sampled and tested by the Contractor, in the presence of the Engineer, for mix uniformity in conformance with the requirements of ASTM Designation: C 94 Section 11, "Mixing and Delivery," and "Annex A1." The testing shall be performed on concrete produced using an approved project mix design and may be done at the project concrete placement site.

The batch plant producing the portland cement concrete for the project shall have met the requirements of California Test 109 within one year prior to producing concrete for the project.

Sampling for mix uniformity tests shall be performed the first time portland cement concrete, of sufficient volume to perform these tests, is placed on the project. All test results shall be presented to the Engineer no later than 10 days after completion of sampling.

Test results from mixer uniformity testing will not be used for contract compliance, acceptance, or payment.

Prior to placing any concrete on the project, the Contractor shall supply a list of all portland cement concrete mixers to be used. When truck mixers are to be used, the list shall contain the truck identification number, mixer brand, mixer age and mixer condition.

When truck mixers are used, the mix uniformity testing shall be performed on 5 truck mixers per project. The truck mixers selected for testing shall be representative of the different mixer brands, ages, and conditions of the mixers on the list and approved by the Engineer. Mixer selection shall be completed before mix uniformity testing is started. Sampling for the mix uniformity tests from each of the 5 mixers shall be completed within the same work shift, unless otherwise approved in writing by the Engineer. The Contractor shall notify the Engineer, in writing, a minimum of 24 hours prior to performing the sampling for these tests. The letter of notification shall include 1) the truck mixer information, 2) the specific gravity of the coarse aggregate in the mix to be tested, and 3) a copy of the current ACI "Concrete Field Testing Technician, Grade 1" certification for each tester who will perform testing for the Contractor. The Contractor shall provide an adequate number of testers to successfully perform the testing with a minimum amount of impact to the Contractor's operations.

When concrete is completely mixed in stationary mixers, each mixer used for the project shall be tested one time.

Full compensation for the testing of mix uniformity as specified herein will be considered as included in the contract price paid for the concrete work involved and no additional compensation will be allowed therefor.

Unless otherwise specified, Type C accelerating chemical admixture conforming to the requirements of ASTM Designation: C 494, may be used in portland cement concrete for precast steam cured concrete members.

Section 90-1.01, "Description," of the Standard Specifications is amended to read:

90-1.01 Description.—Portland cement concrete shall be composed of cementitious material, fine aggregate, coarse aggregate, admixtures if used, and water, proportioned and mixed as specified in these specifications.

Unless otherwise specified, cementitious material to be used in portland cement concrete shall conform to the requirements for cement and mineral admixtures in Section 90-2, "Materials" and shall be either: 1) "Type IP (MS Modified) cement; or 2) a combination of "Type II Modified" portland cement and mineral admixture.

Concrete for each portion of the work shall comply with the requirements for the Class, cementitious material content in kilograms per cubic meter, 28-day compressive strength, minor concrete, or commercial quality concrete, as shown on the plans or specified in these specifications or the special provisions.

Class 1 concrete shall contain not less than 400 kg of cementitious material per cubic meter.

Class 2 concrete shall contain not less than 350 kg of cementitious material per cubic meter.

Class 3 concrete shall contain not less than 300 kg of cementitious material per cubic meter.

Class 4 concrete shall contain not less than 250 kg of cementitious material per cubic meter.

Minor concrete shall contain not less than 325 kg of cementitious material per cubic meter unless otherwise specified in these specifications or the special provisions.

Unless otherwise designated on the plans or specified in these specifications or the special provisions, the amount of cementitious material used per cubic meter of concrete in structures or portions of structures shall conform to the following:

Use	Cementitious Material Content (kg/m ³)
Concrete which is designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min., 475 max.
Roof sections of exposed top box culverts	400 min., 475 max.
Other portions of structures	350 min., 475 max.
Concrete not designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min.
Roof sections of exposed top box culverts	400 min.
Prestressed members	400 min.
Seal courses	400 min.
Other portions of structures	350 min.
Concrete for precast members	350 min., 550 max.

Whenever the 28-day compressive strength shown on the plans is greater than 25 MPa, the concrete shall be considered to be designated by compressive strength. If the plans show a 28-day compressive strength which is 31 MPa or greater, an additional 7 days will be allowed to obtain the specified strength. The 28-day compressive strengths shown on the plans which are 25 MPa or less, are shown for design information only and are not to be considered a requirement for acceptance of the concrete.

Concrete designated by compressive strength shall be proportioned such that the concrete will conform to the strength shown on the plans or specified in the special provisions.

The Contractor shall determine the mix proportions for all concrete except pavement concrete. The Engineer will determine the mix proportions for pavement concrete.

Before using concrete for which the mix proportions have been determined by the Contractor, or in advance of revising those mix proportions, the Contractor shall submit in writing to the Engineer a copy of the mix design.

Compliance with cementitious material content requirements will be verified in conformance with procedures described in California Test 518 for cement content. For testing purposes, mineral admixture shall be considered to be cement. Batch proportions shall be adjusted as necessary to produce concrete having the specified cementitious material content.

If any concrete used in the work has a cementitious material content, consisting of cement, mineral admixture, or cement plus mineral admixture, which is less than the minimum required for the work, the concrete shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place and the Contractor shall pay to the State \$0.55 for each kilogram of cement, mineral admixture, or cement plus mineral admixture which is less than the minimum required for the work. The Department may deduct the amount from any monies due, or that may become due, the Contractor under the contract. The deductions will not be made unless the difference between the contents required and those actually provided exceeds the batching tolerances permitted by Section 90-5, "Proportioning." No deductions for cementitious material content will be made based on the results of California Test 518.

The requirements of the preceding paragraph shall not apply to minor concrete nor commercial quality concrete.

All concrete for which the mix proportions are determined either by the Contractor or the Engineer shall conform to the requirements of this Section 90.

The first paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

90-2.01 Portland Cement.—Unless otherwise specified, portland cement shall be either "Type IP (MS) Modified" cement or "Type II Modified" portland cement.

"Type IP (MS) Modified" cement shall conform to the specifications for Type IP (MS) cement in ASTM Designation: C 595, and shall be comprised of an intimate mixture of Type II cement and not more than 25 percent of a mineral admixture. The type and minimum amount of mineral admixture used in the manufacture of "Type IP (MS) Modified" cement shall be in conformance with the provisions of Section 90-4.08, "Required Use of Mineral Admixtures."

"Type II Modified" portland cement shall conform to the specifications for Type II portland cement in ASTM Designation: C 150.

In addition, "Type IP (MS) Modified" cement and "Type II Modified" portland cement shall conform to the following requirements:

- A. The cement shall not contain more than 0.60 percent by mass of alkalis, calculated as the percentage of Na₂O plus 0.658 times the percentage of K₂O, when determined by either direct intensity flame photometry or by the atomic absorption method. The instrument and procedure used shall be qualified as to precision and accuracy in conformance with the requirements of ASTM Designation: C 114.
- B. The autoclave expansion shall not exceed 0.50 percent.
- C. Mortar, containing the cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not expand in water more than 0.010 percent and shall not contract in air more than 0.048 percent except that when cement is to be used for precast prestressed concrete piling, precast prestressed concrete members or steam cured concrete products, the mortar shall not contract in air more than 0.053 percent.

The second paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

Type III and Type V portland cements shall conform to the specifications in ASTM Designation: C 150, and the additional requirements listed above for Type II Modified portland cement, except that when tested in conformance with California Test 527, mortar containing Type III portland cement shall not contract in air more than 0.075 percent.

The third paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is deleted.
The twelfth paragraph in Section 90-2.02, "Aggregates," of the Standard Specifications is deleted.
The first paragraph in Section 90-2.03, "Water," of the Standard Specifications is amended to read:

90-2.03 Water.—In conventionally reinforced concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 1,000 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In prestressed concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 650 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In no case shall the water contain an amount of impurities that will cause either: 1) a change in the setting time of cement of more than 25 percent when tested in conformance with ASTM Designation: C 191 or ASTM Designation: C 266; or 2) a reduction in the compressive strength of mortar at 14 days of more than 5 percent, when tested in conformance with ASTM Designation: C 109, when compared to the results obtained with distilled water or deionized water, tested in conformance with ASTM Designation: C 109.

The following section is added to Section 90-2, "Materials," of the Standard Specifications:

90-2.04 Admixture Materials.—Admixture materials shall conform to the requirements of the ASTM Designations shown below:

Chemical Admixtures—ASTM Designation: C 494.

Air-entraining Admixtures—ASTM Designation: C 260.

Calcium Chloride—ASTM Designation: D 98.

Mineral Admixtures—Coal fly ash, raw or calcined natural pozzolan as specified in ASTM Designation: C 618, except that the loss on ignition shall not exceed 4 percent, or, silica fume as specified in ASTM Designation: C 1240, with reduction of mortar expansion of 80 percent, minimum, using the cement from the proposed mix design.

Mineral admixtures shall be used in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."

Section 90-4.02, "Materials," of the Standard Specifications is amended to read:

90-4.02 Materials.—Admixture materials shall be as specified in Section 90-2.04, "Admixture Materials."

Section 90-4.05, "Optional Use of Chemical Admixtures," of the Standard Specifications is amended to read:

90-4.05 Optional Use of Chemical Admixtures.—The Contractor will be permitted to use Type A or F, water-reducing; Type B, retarding; or Type D or G, water-reducing and retarding admixtures as described in ASTM Designation: C 494 to conserve cementitious material or to facilitate any concrete construction application subject to the following conditions:

When a water-reducing admixture or a water-reducing and retarding admixture is used, the cementitious material content specified or ordered may be reduced by a maximum of 5 percent by mass except that the resultant cementitious material content shall be not less than 300 kilograms per cubic meter.

When a reduction in cementitious material content is made, the dosage of admixture used shall be the dosage used in determining approval of the admixture.

Section 90-4.07, "Optional Use of Air-entraining Admixtures," of the Standard Specifications is amended to read:

90-4.07 Optional Use of Air-entraining Admixtures.—When air-entrainment has not been specified or ordered by the Engineer, the Contractor will be permitted to use an air-entraining admixture to facilitate the use of any construction procedure or equipment provided that the average air content, as determined by California Test 504, of 3 successive tests does not exceed 4 percent and no single test value exceeds 5.5 percent. If the Contractor elects to use an air-entraining admixture in concrete for pavement, the Contractor shall so indicate at the time the Contractor designates the source of aggregate as provided in Section 40-1.015, "Cement Content."

Section 90-4.08, "Required Use of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.08 Required Use of Mineral Admixtures.—Unless otherwise specified, mineral admixture shall be combined with cement to make cementitious material for use in portland cement concrete.

The calcium oxide content of mineral admixtures shall not exceed 10 percent and the available alkali, as sodium oxide equivalent, shall not exceed 1.5 percent when measured in conformance with the requirements of ASTM Designation: C 618.

The amounts of cement and mineral admixture used in cementitious material for portland cement concrete shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," and shall conform to the following:

The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content.

The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:

- A. When the calcium oxide content of a mineral admixture, measured in conformance with the requirements of ASTM Designation: C 618 and Section 90-2.04, "Admixture Materials," is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix.
- B. When the calcium oxide content of a mineral admixture, measured in conformance with the requirements of ASTM Designation: C 618 and Section 90-2.04, "Admixture Materials," is greater than 2 percent, the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix.
- C. When a mineral admixture is used, which conforms to the requirements for silica fume in Section 90-2.04, "Admixture Materials," is used, the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix.

If more than the required amount of cementitious material is used, the additional cementitious material in the mix may be either cement, any mineral admixture conforming to the requirements of Section 90-2.04, "Admixture Materials," or a combination of both; however, the maximum total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

Section 90-4.09, "Optional Use of Mineral Admixture," of the Standard Specifications is deleted.

Section 90-4.11, "Storage, Proportioning, and Dispensing of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.11 Storage, Proportioning, and Dispensing of Mineral Admixtures.—Mineral admixtures shall be protected from exposure to moisture until used. Sacked material shall be piled to permit access for tally, inspection and identification for each shipment.

Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.

Mineral admixtures shall be incorporated into concrete using equipment conforming to the requirements for cement weigh hoppers, and charging and discharging mechanisms in ASTM Designation: C 94, in Section 90-5.03, "Proportioning," and in this Section 90-4.11.

When interlocks are required for cement and mineral admixture charging mechanisms by Section 90-5.03A, "Proportioning for Pavement," and cement and mineral admixtures are weighed cumulatively, their charging mechanisms shall be interlocked to prevent the introduction of mineral admixture until the mass of cement in the cement weigh hopper is within the tolerances specified in Section 90-5.02, "Proportioning Devices."

Mineral admixture used in concrete for exposed surfaces of like elements of a structure shall be from the same source and of the same percentage.

Section 90-5.02, "Proportioning Devices," of the Standard Specifications is amended to read:

90-5.02 Proportioning Devices.—All weighing, measuring or metering devices used for proportioning materials shall conform to the requirements in Section 9-1.01, "Measurement of Quantities," and this Section 90-5.02. In addition, any automatic weighing systems used shall comply with the requirements for automatic proportioning devices in Section 90-5.03A, "Proportioning for Pavement." These automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, and mineral admixture for one batch of concrete is a single operation of a switch or starter.

Proportioning devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the plant is in operation, the mass of each batch of material shall not vary from the mass designated by the Engineer by more than the tolerances specified herein.

Equipment for cumulative weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. For systems with individual weigh hoppers for the various sizes of aggregate, the zero tolerance shall be ± 0.5 percent of the individual batch mass designated for each size of aggregate. Equipment for cumulative weighing of cement and mineral admixtures shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the cement and mineral admixture. Equipment for weighing cement or mineral admixture separately shall have a zero tolerance of ± 0.5 percent of their designated individual batch masses. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.

The mass indicated for any batch of material shall not vary from the preselected scale setting by more than the following:

- A. Aggregate weighed cumulatively shall be within 1.0 percent of the designated total batch mass of the aggregate. Aggregates weighed individually shall be within 1.5 percent of their respective designated batch masses.
- B. Cement shall be within 1.0 percent of its designated batch mass. When weighed individually, mineral admixture shall be within 1.0 percent of its designated batch mass. When mineral admixture and cement are permitted to be weighed cumulatively, cement shall be weighed first to within 1.0 percent of its designated batch mass, and the total for cement and mineral admixture shall be within 1.0 percent of the sum of their designated batch masses.
- C. Water shall be within 1.5 percent of its designated mass or volume.

Each scale graduation shall be approximately 0.001 of the total capacity of the scale. The capacity of scales for weighing cement, mineral admixture, or cement plus mineral admixture and aggregates shall not exceed that of commercially available scales having single graduations indicating a mass not exceeding the maximum permissible mass variation above, except that no scale shall be required having a capacity of less than 500 kg, with 0.5 kg graduations.

Section 90-5.03, "Proportioning," excluding Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03 Proportioning.—Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture and water as provided in these specifications. Aggregates shall be proportioned by mass.

At the time of batching, all aggregates shall have been dried or drained sufficiently to result in a stable moisture content such that no visible separation of water from aggregate will take place during transportation from the proportioning plant to the point of mixing. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.

Bulk "Type IP (MS) Modified" cement, that conforms to the requirements in Section 90-2.01, "Portland Cement," shall be weighed in an individual hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer.

Bulk cement to be blended with mineral admixture for use in portland cement concrete for pavement and structures may be weighed in separate, individual weigh hoppers or may be weighed in the same weigh hopper with mineral admixture and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer. If the cement and mineral admixture are weighed cumulatively, the cement shall be weighed first.

When cement and mineral admixtures are weighed in separate weigh hoppers, the weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material weighing device. The cement and the mineral admixture shall be discharged into the mixer simultaneously with the aggregate.

The scale and weigh hopper for bulk weighing cement, mineral admixture, and cement plus mineral admixture shall be separate and distinct from the aggregate weighing equipment.

When the source of any aggregate is changed for concrete structures, the Contractor shall adjust the mix proportions and submit in writing to the Engineer a copy of the mix design before using such aggregates. When the source of any aggregate is changed for other concrete, the Engineer shall be allowed sufficient time to adjust the mix and such aggregates shall not be used until necessary adjustments are made.

For all batches with a volume of one cubic meter or more, the batching equipment shall conform to one of the following combinations:

- A. Separate boxes and separate scale and indicator for weighing each size of aggregate.
- B. Single box and scale indicator for all aggregates.
- C. Single box or separate boxes and automatic weighing mechanism for all aggregates.

In order to check the accuracy of batch masses, the gross mass and tare mass of batch trucks, truck mixers, truck agitators, and non-agitating hauling equipment shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03A Proportioning for Pavement.—Aggregates and bulk cement, mineral admixture, and cement plus mineral admixture for use in pavement shall be proportioned by mass by means of automatic proportioning devices of approved type conforming to the requirements specified in this Section 90-5.03A.

The Contractor shall install and maintain in operating condition an electrically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.

The batching of cement, mineral admixture, or cement plus mineral admixture and aggregate shall be interlocked so that a new batch cannot be started until all weigh hoppers are empty, the proportioning devices are within zero tolerance, and the discharge gates are closed. The interlock shall permit no part of the batch to be discharged until all aggregate hoppers and the cement and mineral admixture hoppers or the cement plus mineral admixture hopper are charged with masses which are within the tolerances specified in Section 90-5.02, "Proportioning Devices."

The discharge gate on the cement and mineral admixture hoppers or the cement plus mineral admixture hopper shall be designed to permit regulating the flow of cement, mineral admixture, or cement plus mineral admixture into the aggregate as directed by the Engineer.

When separate weigh boxes are used for each size of aggregate, the discharge gates shall permit regulating the flow of each size of aggregate as directed by the Engineer.

Material discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of withdrawal from the several bins, and of discharge from the weigh box, shall be interlocked so that not more than one bin can discharge at a time, and that the weigh box cannot be tripped until the required quantity from each of the several bins has been deposited therein. Should a separate weigh box be used for each size of aggregate, all may be operated and discharged simultaneously.

When the discharge from the several bins is controlled by gates, each gate shall be actuated automatically so that the required mass is discharged into the weigh box, after which the gate shall automatically close and lock.

The automatic weighing system shall be designed so that all proportions required may be set on the weighing controller at the same time.

The third paragraph in Section 90-6.01, "General," of the Standard Specifications is amended to read:

All concrete shall be homogeneous and thoroughly mixed, and there shall be no lumps or evidence of undispersed cement, mineral admixture, or cement plus mineral admixture.

The third and fourth paragraphs in Section 90-6.02, "Machine Mixing," of the Standard Specifications are amended to read:

The batch shall be so charged into the mixer that some water will enter in advance of cementitious materials and aggregates. All water shall be in the drum by the end of the first one-fourth of the specified mixing time.

Cementitious materials shall be batched and charged into the mixer by means that will not result either in loss of cementitious materials due to the effect of wind, or in accumulation of cementitious materials on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cementitious material in the concrete mixture.

The sixth paragraph in Section 90-6.02, "Machine Mixing," of the Standard Specifications is amended to read:

The total elapsed time between the intermingling of damp aggregates and all cementitious materials and the start of mixing shall not exceed 30 minutes.

The seventh through tenth paragraphs in Section 90-6.03, "Transporting Mixed Concrete," of the Standard Specifications are amended to read:

When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be completed within 1.5 hours, or before 250 revolutions of the drum or blades, whichever comes first, after the introduction of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30° C, or above, a time less than 1.5 hours may be required.

When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be completed within one hour after the addition of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30° C, or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.

Each load of concrete delivered at the jobsite shall be accompanied by a weight certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load and for transit-mixed concrete, the reading of the revolution counter at the time the truck mixer is charged with cement. This weight certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.

Weight certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on 90 mm diskette with a capacity of at least 1.4 megabytes. Captured data, for the ingredients represented by each batch shall be LFCR (one line, separate record) with allowances for sufficient fields to satisfy the amount of data required by these specifications.

The Contractor may furnish a weight certificate that is accompanied by a separate certificate which lists the actual batch masses or measurements for a load of concrete provided that both certificates are 1) imprinted with the same non-repeating load number that is unique to the contract and 2) delivered to the jobsite with the load.

All weight certificates furnished by the Contractor shall conform to the requirements of Section 9-1.01, "Measurement of Quantities."

Section 90-6.05, "Hand-Mixing," of the Standard Specifications is amended to read:

90-6.05 Hand-Mixing.—Hand-mixed concrete shall be made in batches not more than one-fourth cubic meter and shall be mixed on a watertight, level platform. The proper amount of coarse aggregate shall be measured in measuring boxes and spread on the platform and the fine aggregate shall be spread on this layer, the 2 layers being not more than 0.3 meters in total depth. On this mixture shall be spread the dry cement and mineral admixture and the whole mass turned no fewer than 2 times dry; then sufficient clean water shall be added, evenly distributed, and the whole mass again turned no fewer than 3 times, not including placing in the carriers or forms.

The table in the first paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

Type of Work	Nominal Penetration (mm)	Maximum Penetration (mm)
Concrete pavement	0-25	40
Non-reinforced concrete facilities	0-35	50
Reinforced concrete structures:		
Sections over 300 mm thick	0-35	65
Sections 300 mm thick or less	0-50	75
Concrete placed under water	75-100	115
Cast-in-place concrete piles	65-90	100

The first paragraph following the table of penetration ranges in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

The amount of free water used in concrete shall not exceed 183 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 325 kg/m³.

The fourth paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

Where there are adverse or difficult conditions which affect the placing of concrete, the above specified penetration and free water content limitations may be exceeded providing the Contractor is granted permission by the Engineer in writing to increase the cementitious material content per cubic meter of concrete. The increase in water and cementitious material shall be at a ratio not to exceed 30 kg of water per added 100 kg of cementitious material per cubic meter. The cost of additional cementitious material and water added under these conditions shall be at the Contractor's expense and no additional compensation will be allowed therefor.

Section 90-9.01, "General," of the Standard Specifications is amended to read:

90-9.01 General.—Concrete compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified elsewhere or are shown on the plans.

The compressive strength of concrete will be determined from test cylinders which have been fabricated from concrete sampled in conformance with California Test 539. Test cylinders will be molded and initial field cured in conformance with California Test 540. Test cylinders will be cured and tested after receipt at the testing laboratory in conformance with California Test 521. A strength test shall consist of the average strength of 2 cylinders fabricated from material taken from a single load of concrete, except that, if any cylinder should show evidence of improper sampling, molding, or testing, that cylinder shall be discarded and the strength test shall consist of the strength of the remaining cylinder.

When concrete compressive strength is specified as a prerequisite to applying loads or stresses to a concrete structure or member, test cylinders for other than steam cured concrete will be cured in conformance with Method 1 of California Test 540. The compressive strength of concrete determined for these purposes will be evaluated on the basis of individual tests.

When concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete strength to be used as a basis for acceptance of other than steam cured concrete will be determined from cylinders cured in conformance with Method 1 of California Test 540. If the result of a single compressive strength test at the maximum age specified or allowed is below the specified strength but is 95 percent or more of the specified strength, the Contractor shall, at the Contractor's expense, make corrective changes, subject to approval of the Engineer, in the mix proportions or in the concrete fabrication procedures, before placing additional concrete, and shall pay to the State \$14.00 for each in-place cubic meter of concrete represented by the deficient test. If the result of a single compressive strength test at the maximum age specified or allowed is below 95 percent of the specified strength, but is 85 percent or more of the specified strength, the Contractor shall make the corrective changes specified above, and shall pay to the State \$20.00 for each in place cubic meter of concrete represented by the deficient test. In addition, such corrective changes shall be made when the compressive strength of concrete tested at 7 days indicates, in the judgment of the Engineer, that the concrete will not attain the required compressive strength at the maximum age specified or allowed. All concrete represented by a single test which indicates a compressive strength of less than 85 percent of the specified 28-day compressive strength will be rejected in conformance with the provisions in Section 6-1.04, "Defective Materials."

If the test result indicates that the compressive strength at the maximum curing age specified or allowed is below the specified strength, but 85 percent or more of the specified strength, payments to the State as required above shall be made, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength of the concrete placed in the work meets or exceeds the specified 28-day compressive strength. If the test result indicates a compressive strength at the maximum curing age specified or allowed below 85 percent, the concrete represented by that test will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the concrete placed in the work are acceptable. If the evidence consists of tests made on cores taken from the work, the cores shall be obtained and tested in conformance with the specifications of ASTM Designation: C 42.

No single compressive strength test shall represent more than 250 cubic meters.

When a precast concrete member is steam cured, the compressive strength of the concrete will be determined from test cylinders which have been handled and stored in conformance with Method 3 of California Test 540. The compressive strength of steam cured concrete will be evaluated on the basis of individual tests representing specific portions of production. When the concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete shall be considered to be acceptable whenever its compressive strength reaches the specified 28-day compressive strength provided that strength is reached in not more than the maximum number of days specified or allowed after the member is cast.

When concrete is specified by compressive strength, prequalification of materials, mix proportions, mixing equipment, and procedures proposed for use, will be required prior to placement of the concrete. Prequalification shall be accomplished by the submission of acceptable certified test data or trial batch reports by the Contractor. Prequalification data shall be based on the use of materials, mix proportions, mixing equipment, procedures, and size of batch proposed for use in the work.

Certified test data, in order to be acceptable, must indicate that not less than 90 percent of at least 20 consecutive tests exceed the specified strength at the maximum number of cure days specified or allowed, and none of those tests are less than 95 percent of specified strength. Strength tests included in the data shall be the most recent tests made on concrete of the proposed mix design and all shall have been made within one year of the proposed use of the concrete.

Trial batch test reports, in order to be acceptable, must indicate that the average compressive strength of 5 consecutive concrete cylinders, taken from a single batch, at not more than 28 days (or the maximum age allowed) after molding shall be at least 4 MPa greater than the specified 28-day compressive strength, and no individual cylinder shall have a strength less than the specified strength at the maximum age specified or allowed. Data contained in the report shall be from trial batches which were produced within one year of the proposed use of specified strength concrete in the project. Whenever air-entrainment is required, the air content of trial batches shall be equal to or greater than the air content specified for the concrete without reduction due to tolerances.

All tests shall be performed in conformance with either the appropriate California Test methods or the comparable ASTM test methods. All equipment employed in testing shall be in good condition and shall be properly calibrated. If the tests are performed during the life of the contract, the Engineer shall be notified sufficiently in advance of performing the tests in order to witness the test procedures.

The certified test data and trial batch test reports shall include the following information:

- A. Date of mixing.
- B. Mixing equipment and procedures used.
- C. The size of batch in cubic meters and the mass, type and source of all ingredients used.
- D. Penetration of the concrete.
- E. The air content of the concrete if an air-entraining admixture is used.
- F. The age at time of testing and strength of all concrete cylinders tested.

All certified test data and trial batch test reports shall be signed by an official of the firm which performed the tests.

When approved by the Engineer, concrete from trial batches may be used in the work at locations where concrete of a lower quality is required and the concrete will be paid for as the type or class of concrete required at that location.

After materials, mix proportions, mixing equipment, and procedures for concrete have been prequalified for use, additional prequalification by testing of trial batches will be required prior to making any changes which, in the judgment of the Engineer, could result in a lowering of the strength of the concrete below that specified.

The Contractor's attention is directed to the time required to test trial batches and the Contractor shall be responsible for production of trial batches at a sufficiently early date so that the progress of the work is not delayed.

When precast concrete members are manufactured at the plant of an established manufacturer of precast concrete members, the mix proportions of the concrete shall be determined by the Contractor, and a trial batch and prequalification of the materials, mix proportions, mixing equipment, and procedures will not be required.

Section 90-10.02A, "Portland Cement," of the Standard Specifications is renamed "Cementitious Material" and is amended to read:

90-10.02A Cementitious Material.—Cementitious material shall conform to the provisions in Section 90-1.01, "Description." Compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified elsewhere or are shown on the plans.

The fifth paragraph in Section 90-10.02B, "Aggregate," of the Standard Specifications is deleted.
Section 90-10.03, "Production," of the Standard Specifications is amended to read:

90-10.03 Production.—Cementitious material, water, aggregate, and admixtures shall be stored, proportioned, mixed, transported, and discharged in conformance with recognized standards of good practice, which will result in concrete that is thoroughly and uniformly mixed, that is suitable for the use intended, and which conforms to requirements specified herein. "Recognized standards of good practice" are outlined in various industry publications such as are issued by American Concrete Institute, AASHTO, or California Department of Transportation.

The cementitious material content of minor concrete shall conform to the provisions in Section 90-1.01, "Description."

The amount of water used shall result in a consistency of concrete conforming to the provisions in Section 90-6.06, "Amount of Water and Penetration." Additional mixing water shall not be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer.

Discharge of ready-mixed concrete from the transporting vehicle shall be made while the concrete is still plastic and before any stiffening occurs. An elapsed time of 1.5 hours (one hour in non-agitating hauling equipment), or more than 250 revolutions of the drum or blades, after the introduction of the cementitious material to the aggregates, or a temperature of concrete of more than 32° C. will be considered as conditions contributing to the quick stiffening of concrete. The Contractor shall take whatever action is necessary to eliminate quick stiffening, except that the addition of water will not be permitted.

The required mixing time in stationary mixers shall be not less than 50 seconds nor more than 5 minutes.

The minimum required revolutions at mixing speed for transit-mixed concrete shall be not less than that recommended by the mixer manufacturer, and shall be increased, if necessary, to produce thoroughly and uniformly mixed concrete.

Each load of ready-mixed concrete shall be accompanied by a weight certificate which shall be delivered to the Engineer at the discharge location of the concrete, unless otherwise directed by the Engineer. The weight certificate shall be clearly marked with the date and time of day when the load left the batching plant and, if hauled in truck mixers or agitators, the time the mixing cycle started.

A Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer, prior to placing minor concrete from a source not previously used on the contract, stating that minor concrete to be furnished meets all contract requirements, including minimum cementitious material content specified.

The third and fourth paragraphs in Section 90-11.02, "Payment," of the Standard Specifications are amended to read:

Should the Engineer order the Contractor to incorporate any admixtures in the concrete when their use is not required by these specifications or the special provisions, furnishing the admixtures and adding them to the concrete will be paid for as extra work as provided in Section 4-1.03D.

Should the Contractor use admixtures as permitted under Sections 90-4.05, "Optional Use of Chemical Admixtures;" or 90-4.07, "Optional Use of Air-entraining Admixtures;" or should the Contractor request and obtain permission to use other admixtures for the Contractor's benefit, the Contractor shall furnish those admixtures and incorporate them in the concrete at the Contractor's expense and no additional compensation will be allowed therefor.

8-2.02 CEMENT AND WATER CONTENT

The amount of free water used in concrete for deck slabs of bridges and structure approach slabs shall not exceed 195 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 400 kg/m³.

SECTION 8-3. WELDING

8-3.01 WELDING ELECTRODES

Flux core welding electrodes conforming to the requirements of AWS A5.20 E6XT-4 or E7XT-4 shall not be used to perform any type of welding for this project.

8-3.02 WELDING QUALITY CONTROL

Welding quality control shall conform to the requirements in the AWS welding codes, the Standard Specifications and these special provisions.

Welding quality control shall apply when any work is welded in conformance with the provisions in Section 49, "Piling," Section 52, "Reinforcement," Section 55, "Steel Structures," Section 56-1, "Overhead Sign Structures," Section 75-1.035, "Bridge Joint Restrainer Units," or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

Wherever reference is made to the following AWS welding codes in the Standard Specifications, on the plans or in these special provisions, the year of adoption for these codes shall be as listed:

AWS Code	Year of Adoption
D1.1	1998
D1.4	1992
D1.5	1995
D1.5 (metric only)	1996

All requirements of the AWS welding codes shall apply unless specified otherwise in the Standard Specifications, on the plans or in these special provisions. Wherever the abbreviation AWS is used, it shall be equivalent to the abbreviations ANSI/AWS or ANSI/AASHTO/AWS.

The welding of all fracture critical members (FCMs) shall conform to the provisions specified in the Fracture Control Plan (FCP) and herein.

The Contractor shall designate in writing a welding Quality Control Manager (QCM). The QCM shall be responsible directly to the Contractor for the quality of welding, including materials and workmanship, performed by the Contractor and all subcontractors.

The QCM shall be the sole individual responsible to the Contractor for submitting, receiving, and approving all correspondence, required submittals, and reports to and from the Engineer.

The QCM shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project. The QCM may be an employee of the Contractor.

Welding inspection personnel or nondestructive testing (NDT) firms to be used in the work shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project, except for the following conditions:

1. The welding is performed at a permanent fabrication facility which is certified under the AISC Quality Certification Program, Category Cbr, Major Steel Bridges.
2. The welding is performed at a permanent fabrication facility which is certified under the AISC Quality Certification Program, Category Sbd, Conventional Steel Building Structures. This condition shall apply only for work welded in conformance with the provisions in Section 56-1, "Overhead Sign Structures" or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

For welding performed at such certified facilities, the inspection personnel or NDT firms may be employed or compensated by the fabrication facility performing the welding.

Prior to submitting the Welding Quality Control Plan (WQCP) required herein, a pre-welding meeting between the Engineer, Contractor and any welding subcontractors or entities hired by these subcontractors to be used in the work, shall be held to discuss the requirements for the WQCP.

Prior to performing any welding, the Contractor shall submit to the Engineer, in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, 3 copies of a separate WQCP for each item of work for which welding is to be performed. As a minimum, each WQCP shall include the following:

1. The name of the welding firm and the NDT firm to be used;
2. A manual prepared by the NDT firm that shall include equipment, testing procedures, code of safe practices, the Written Practice of the NDT firm, and the names, qualifications and documentation of certifications for all personnel to be used;
3. The name of the QCM and the names, qualifications and documentation of certifications for all Quality Control (QC) Inspectors and Assistant Quality Control Inspectors to be used;
4. An organizational chart showing all QC personnel and their assigned QC responsibilities;
5. The methods and frequencies for performing all required quality control procedures, including QC inspection forms to be used, as required by the specifications including:
 - (a) all visual inspections;
 - (b) all NDT including radiographic geometry, penetrometer and shim selection, film quality, film processing, radiograph identification and marking system, and film interpretation and reports; and
 - (c) calibration procedures and calibration frequency for all NDT equipment;
6. A system for the identification and tracking of all welds, NDT and any required repairs, and a procedure for the reinspection of any repaired welds. The system shall have provisions for 1) permanently identifying each weld and the person who performed the weld, 2) placing all identification and tracking information on each radiograph and 3) a method of reporting nonconforming welds to the Engineer;
7. Standard procedures for performing noncritical repair welds. Noncritical repair welds are defined as welds to deposit additional weld beads or layers to compensate for insufficient weld size and to fill limited excavations that were performed to remove unacceptable edge or surface discontinuities, rollover or undercut. The depth of these excavations shall not exceed 65 percent of the specified weld size;
8. The welding procedure specification (WPS), including documentation of all supporting Procedure Qualification Record (PQR) tests performed, and the name of the testing laboratory who performed the tests, to verify the acceptability of the WPS. The submitted WPS shall be within the allowable period of effectiveness;
9. Documentation of all certifications for welders for each weld process and position that will be used. Certifications shall list the electrodes used, test position, base metal and thickness, tests performed, and the witnessing authority. All certifications shall be within the allowable period of effectiveness; and
10. One copy each of all AWS welding codes and the FCP which are applicable to the welding to be performed. These codes and the FCP shall become the permanent property of the Department.
11. Example forms to be used for Certificates of Compliance, daily production logs, and daily reports.

The Engineer shall have 10 working days to review the WQCP submittal after a complete plan has been received. No welding shall be performed until the WQCP is approved in writing by the Engineer. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the WQCP, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

An amended WQCP or addendum shall be submitted to, and approved in writing by the Engineer, for any proposed revisions to the approved WQCP. An amended WQCP or addendum will be required for any revisions to the WQCP, including but not limited to a revised WPS, additional welders, changes in NDT firms or procedures, QC or NDT personnel, or updated systems for tracking and identifying welds. The Engineer shall have 3 working days to complete the review of the amended WQCP or addendum. Work that is affected by any of the proposed revisions shall not be performed until the amended WQCP or addendum has been approved. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the amended WQCP or addendum, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

After final approval of the WQCP, amended WQCP or addendum, the Contractor shall submit to the Engineer 7 copies each of these approved documents.

It is expressly understood that the Engineer's approval of the Contractor's WQCP shall not relieve the Contractor of any responsibility under the contract for the successful completion of the work in conformity with the requirements of the plans and specifications. The Engineer's approval shall not constitute a waiver of any of the requirements of the plans and specifications nor relieve the Contractor of any obligation thereunder, and defective work, materials and equipment may be rejected notwithstanding approval of the WQCP.

A daily production log for welding shall be kept by the QCM for each day that welding is performed. The log shall clearly indicate the locations of all welding, and shall include the welders' names, amount of welding performed, any problems or deficiencies discovered, and any testing or repair work performed, at each location. The daily report from each Quality Control Inspector shall also be included in the log.

The following items shall be included in a Welding Report that is to be submitted to the Engineer within 7 days following the performance of any welding:

1. Reports of all visual weld inspections and NDT;
2. Radiographs and radiographic reports, and other required NDT reports;
3. Documentation that the Contractor has evaluated all radiographs and other nondestructive tests, corrected all rejectable deficiencies, and all repaired welds have been reexamined by the required NDT and found acceptable; and
4. Daily production log.

All radiographic envelopes shall have clearly written on the outside of the envelope the following information: name of the QCM, name of the nondestructive testing firm, name of the radiographer, date, contract number, complete part description, and all included weld numbers or a report number, as detailed in the WQCP. In addition, all innerleaves shall have clearly written on them the part description and all included weld numbers, as detailed in the WQCP.

All reports regarding NDT, including radiographs, shall be signed by both the NDT technician and the person that performed the review, and then submitted directly to the QCM for review and signature prior to submittal to the Engineer. Corresponding names shall be clearly printed or typewritten next to all signatures.

The Engineer will review the Welding Report to determine if the Contractor is in conformance with the WQCP. Except for steel piling, the Engineer shall be allowed 7 days to review the report and respond in writing after a complete Welding Report has been received. The review time for steel piling shall be as specified in "Piling" of these special provisions. Prior to receiving notification from the Engineer of the Contractor's conformance with the WQCP, the Contractor may encase in concrete or cover any welds for which a Welding Report has been submitted. However, should the Contractor elect to encase or cover those welds prior to receiving notification from the Engineer, it is expressly understood that the Contractor shall not be relieved of the responsibility for incorporating material in the work that conforms to the requirements of the plans and specifications. Any material not conforming to these requirements will be subject to rejection. Should the Contractor elect to wait to encase or cover any welds pending notification by the Engineer, and should the Engineer fail to complete the review and provide notification within this time allowance, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in notification, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Sections 6.1.2 through 6.1.4.3 of AWS D 1.1, Sections 7.1.1 and 7.1.2 of AWS D 1.4, and Sections 6.1.1.1 through 6.1.3.3 of AWS D 1.5 are replaced with the following:

Quality Control (QC) shall be the responsibility of the Contractor. As a minimum, the Contractor shall perform inspection and testing prior to welding, during welding and after welding as specified in this section and additionally as necessary to ensure that materials and workmanship conform to the requirements of the contract documents.

The Quality Control (QC) Inspector shall be the duly designated person who performs inspection, testing, and quality matters for all welding.

Quality Assurance (QA) is the prerogative of the Engineer. The QA Inspector is the duly designated person who acts for and on behalf of the Engineer.

All QC Inspectors shall be responsible for quality control acceptance or rejection of materials and workmanship, and shall be currently certified as AWS Certified Welding Inspectors (CWI) in conformance with the requirements in AWS QC1, "Standard and Guide for Qualification of Welding Inspectors."

The QC Inspector may be assisted by an Assistant QC Inspector provided that this individual is currently certified as an AWS Certified Associate Welding Inspector (CAWI) in conformance with the requirements in AWS QC1, "Standard and Guide for Qualification of Welding Inspectors," or has equivalent qualifications. The QC Inspector shall monitor the Assistant QC Inspector's work, and shall be responsible for signing all reports.

When the term "Inspector" is used without further qualification, it shall refer to the QC Inspector.

Section 6.14.6, "Personnel Qualification," of AWS D 1.1, Section 7.7.6, "Personnel Qualification," of AWS D 1.4 and Section 6.1.3.4, "Personnel Qualification," of AWS D 1.5 are replaced with the following:

Personnel performing NDT shall be qualified in conformance with the requirements in the current edition of the American Society for Nondestructive Testing (ASNT) Recommended Practice No. SNT-TC-1A and the Written Practice of the NDT firm. The Written Practice of the NDT firm shall meet or exceed the requirements of the current edition of the ASNT Recommended Practice No. SNT-TC-1A. Only individuals who are 1) qualified for NDT Level II, or 2) Level III technicians who have been directly certified by the ASNT and are authorized to perform the work of Level II technicians, shall perform NDT, review the results, and prepare the written reports.

Section 6.5.4, "Scope of Examination," of AWS D 1.1 and Section 7.5.4 of AWS D 1.4 are replaced with the following:

The QC Inspector shall inspect and approve the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder to make certain that the applicable requirements of this code and the approved WPS are met.

Section 6.5.4 of AWS D 1.5 is replaced with the following:

The QC Inspector shall inspect and approve the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder to make certain that the applicable requirements of this code and the approved WPS are met. The QC Inspector shall examine the work to make certain that it meets the requirements of section 3 and 9.21. The size and contour of welds shall be measured using suitable gages. Visual inspection for cracks in welds and base metal, and for other discontinuities should be aided by strong light magnifiers, or such other devices as may be helpful. Acceptance criteria different from those specified in this code may be used when approved by the Engineer.

The Engineer shall have the authority to verify the qualifications or certifications of any welder, Quality Control Inspector, or NDT personnel to specified levels by retests or other means.

A sufficient number of QC Inspectors shall be provided to ensure continuous inspection when any welding is being performed. Continuous inspection, as a minimum, shall include (1) having QC Inspectors continually present on all shifts when any welding is being performed, or (2) having a QC Inspector within such close proximity of all welding operations that inspections by the QC Inspector of each operation, at each welding location, shall not lapse for a period exceeding 30 minutes.

Inspection and approval of the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder shall be documented by the QC Inspector on a daily basis for each day that welding is performed.

The QC Inspector shall provide reports to the QCM on a daily basis for each day that welding is performed.

Except for noncritical weld repairs, base metal repairs, or any other type of repairs not submitted in the WQCP, the Engineer shall be notified immediately in writing when any welding problems or deficiencies are discovered and also of the proposed repair procedures to correct them. The Engineer shall have 5 working days to review these procedures. No remedial work shall begin until the repair procedures are approved in writing by the Engineer. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the proposed repair procedures, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

When joint details that are not prequalified by the applicable AWS codes are proposed for use in the work, all welders using these details shall perform a qualification test plate using the approved WPS variables and the joint detail to be used in production. The test plate shall be the maximum thickness to be used in production. The test plate shall be mechanically or radiographically tested as directed by the Engineer. Mechanical and radiographic testing and acceptance criteria shall be as specified in the applicable AWS codes.

The period of effectiveness for a welder's or welding operator's qualification shall be a maximum of 3 years for the same weld process, welding position, and weld type. A valid qualification at the beginning of work on a contract will be acceptable for the entire period of the contract, as long as the welder's work remains satisfactory.

All qualification tests for welders, welding operators, and WPSs used in welding operations will be witnessed by the Engineer.

Section 6.6.5, "Nonspecified Nondestructive Testing Other Than Visual," of AWS D 1.1, Section 6.6.5 of AWS D 1.4 and Section 6.6.5 of AWS D 1.5 shall not apply.

For any welding, the Engineer may direct the Contractor to perform NDT that is in addition to the visual inspection or NDT specified in the AWS welding codes, in the Standard Specifications or in these special provisions. Additional NDT required by the Engineer, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications. Should any welding deficiencies be discovered by this additional NDT, the cost of the testing will not be paid for as extra work, and shall be at the Contractor's expense.

All required repair work to correct welding deficiencies, whether discovered by the required visual inspection or NDT, or by additional NDT directed by the Engineer, and any associated delays or expenses caused to the Contractor by performing these repairs, shall be at the Contractor's expense.

At the completion of all welding, the QCM shall sign and furnish to the Engineer, a certificate of compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each item of work for which welding was performed. The certificate shall state that all of the materials and workmanship incorporated in the work, and all required tests and inspections of this work, have been performed in conformance with the details shown on the plans and the provisions of the Standard Specifications and these special provisions.

Full compensation for conforming to all of the requirements of this section, Welding Quality Control, shall be considered as included in the contract prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

SECTION 9. DESCRIPTION OF BRIDGE WORK

The work to be done consists, in general, of constructing a cast-in-place prestressed concrete box girder bridge widening approximately 42.1 meters long and 7.6 meters wide at the following location:

LOS PINETOS ROAD UNDERCROSSING (WIDEN)
(Bridge No. 53-2096R/L)

SECTION 10. CONSTRUCTION DETAILS

SECTION 10-1. GENERAL

10-1.00 CONSTRUCTION PROJECT INFORMATION SIGNS

Before any major physical construction work readily visible to highway users is started on this contract, the Contractor shall furnish and erect 2 Type 2 Construction Project Information signs at the locations designated by the Engineer.

The signs and overlays shall be of a type and material consistent with the estimated time of completion of the project and shall conform to the details shown on the plans.

The sign letters, border and Caltrans construction logos shall conform to the colors (non-reflective) and details shown on the plans, and shall be on a white background (non-reflective). The colors blue and orange shall conform to PR Color Number 3 and Number 6, respectively, as specified in the Federal Highway Administration's Color Tolerance Chart.

The sign message to be used for fund types shall consist of the following, in the order shown:

**FEDERAL HIGHWAY TRUST FUNDS
STATE HIGHWAY FUNDS
LOS ANGELES COUNTY METROPOLITAN
TRANSPORTATION AUTHORITY FUNDS**

The sign message to be used for type of work shall consist of the following:

HIGHWAY CONSTRUCTION

The sign message to be used for the Year of Completion of Project Construction will be furnished by the Engineer. The Contractor shall furnish and install the "Year" sign overlay within 10 working days of notification of the year date to be used.

The letter sizes to be used shall be as shown on the plans. The information shown on the signs shall be limited to that shown on the plans.

The signs shall be kept clean and in good repair by the Contractor.

Upon completion of the work, the signs shall be removed and disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications.

Full compensation for furnishing, erecting, maintaining, and removing and disposing of the construction project information signs shall be considered as included in the contract lump sum price paid for construction area signs and no additional compensation will be allowed therefor.

10-1.01 ORDER OF WORK

Order of work shall conform to the provisions in Section 5-1.05, "Order of Work," of the Standard Specifications and these special provisions.

The first order of work shall be to place the order for the electrical equipment. The Contractor shall furnish the Engineer with a statement from the vendor that the order for the electrical equipment has been received and accepted by the vendor.

Attention is directed to "Maintaining Traffic" of these special provisions.

Temporary railing (Type K) shall be placed prior to beginning any construction operations that require limiting public access within all the construction areas as shown on the plans.

Attention is directed to "Progress Schedule (Critical Path)" of these special provisions regarding the submittal of a general time-scaled logic diagram within 10 days after approval of the contract. The diagram shall be submitted prior to performing any work that may be affected by any proposed deviations to the construction staging of the project.

10-1.02 MATERIAL CONTAINING AERIALY DEPOSITED LEAD

This work shall consist of handling soil contaminated by aerially deposited lead in conformance with the Standard Specifications and these special provisions.

Aerially deposited lead is typically found within the top 0.6-m of material in unpaved areas within the highway right of way. Levels of lead found near the project limits range from less than 2.5 to 150 mg/kg total lead, as analyzed by EPA Test Method 6010 or EPA Test Method 7000 series.

After the Contractor has completed handling materials containing aerially deposited lead, in conformance with the plans, Standard Specifications, and these special provisions, the Contractor shall have no responsibility for such materials in place and shall not be obligated for further cleanup, removal, or remedial actions for such materials.

Handling material containing aerially deposited lead shall be in conformance with all the rules and regulations of agencies including, but not limited to, the following:

California Division of Occupational Safety and Health Administration (Cal-OSHA)
California Regional Water Quality Control Board, Region 4.

The Contractor shall procure all permits and licenses, pay all charges and fees, except as otherwise provided in these special provisions, and give all notices necessary and incidental to the due and lawful prosecution of the work.

Full compensation for conforming to the requirements of this section, (except for the Lead Compliance Plan) shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

HEALTH AND SAFETY

The Contractor shall prepare a project specific Lead Compliance Plan to prevent or minimize worker exposure to lead contamination in soil. Attention is directed to Title 8, California Code of Regulations, Section 1532.1, "Lead," for specific Cal-OSHA requirements when working with lead.

The Lead Compliance Plan shall contain all of the elements listed in Title 8, California Code of Regulations, Section 1532.1(e)(2)(B). Before submission to the Engineer, the Lead Compliance Plan shall be approved by an Industrial Hygienist certified in Comprehensive Practice by the American Board of Industrial Hygiene. The Plan shall be submitted to the Engineer at least 7 days prior to beginning work in areas containing aerially deposited lead.

Prior to performing work in areas containing lead, personnel who have no prior training, including State personnel, shall complete a safety training program provided by the Contractor, that meets the requirements of Title 8, California Code of Regulations, Section 1532.1, "Lead," and the Contractor's Lead Compliance Program.

Personal protective equipment, training, washing facilities, and medical surveillance required by the Contractor's Lead Compliance Plan shall be supplied to State personnel by the Contractor. The number of State personnel will be 2.

Lead Compliance Plan will be paid as a lump sum.

The contract lump sum price paid for Lead Compliance Plan shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals and for doing all the work involved in preparing the Lead Compliance Plan, including paying the Certified Industrial Hygienist, and for providing personal protective equipment, training and medical surveillance, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

SOIL HANDLING

Handling of soils containing aerially deposited lead shall result in no visible dust migration. The Contractor shall have a dust palliative available at all times while handling soils in work areas containing aerially deposited lead.

The Contractor shall separate soil from vegetation and the soils shall remain on site.

Surplus soil excavated from areas containing aerially deposited lead shall remain in the area of soil disturbance. The surplus soil shall not be disposed of outside the highway right of way.

Full compensation for handling soil contaminated with aerially deposited lead, except as otherwise provided, shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

10-1.03 WATER POLLUTION CONTROL

Water pollution control work shall conform to the requirements in Section 7-1.01G, "Water Pollution," of the Standard Specifications and these special provisions.

This project shall conform to the requirements of General Construction Activity Storm Water Permit No. CAS000002 issued by the State Water Resources Control Board. This General Permit, hereafter referred to as the "Permit," regulates storm water discharges associated with construction activities.

Water pollution control work shall conform to the requirements in the Construction Contractor's Guide and Specifications of the Caltrans Storm Water Quality Handbooks, dated April 1997, and addenda thereto issued up to, and including, the date of advertisement of the project, hereafter referred to as the "Handbook". Copies of the Handbook and the General Permit may be obtained from the Department of Transportation, Material Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520 or from the internet at <http://www.dot.ca.gov/hq/construc/stormwater.html>.

Copies of the Handbook and the Permit are also available for review at the Department of Transportation, Construction Office, Room 244, 120 South Spring Street, Los Angeles, California 90012, Telephone: (213) 897-0054.

The Contractor shall become fully informed of and comply with the applicable provisions of the Handbook, Permit and Federal, State and local regulations that govern the Contractor's operations and storm water discharges from both the project site and areas of disturbance outside the project limits during construction. The Contractor shall maintain a copy of the Permit at the project site and shall make the Permit available during construction activities.

Unless arrangements for disturbance of areas outside the project limits are made by the Department and made part of the contract, it is expressly agreed that the Department assumes no responsibility to the Contractor or property owner whatsoever with respect to any arrangements made between the Contractor and property owner to allow disturbance of areas outside the project limits.

The Contractor shall be responsible for the costs and for any liability imposed by law as a result of the Contractor's failure to comply with the requirements set forth in this section "Water Pollution Control", including but not limited to, compliance with the applicable provisions of the Handbook, Permit and Federal, State and local regulations. For the purposes of this paragraph, costs and liabilities include, but are not limited to, fines, penalties and damages whether assessed against the State or the Contractor, including those levied under the Federal Clean Water Act and the State Porter Cologne Water Quality Act.

In addition to any remedy authorized by law, so much of the money due the Contractor under the contract that shall be considered necessary by the Department may be retained by the State of California until disposition has been made of the costs and liabilities.

The retention of money due the Contractor shall be subject to the following:

1. The Department will give the Contractor 30 days notice of its intention to retain funds from any partial payment which may become due to the Contractor prior to acceptance of the contract. Retention of funds from any payment made after acceptance of the contract may be made without prior notice to the Contractor.
2. No retention of additional amounts out of partial payments will be made if the amount to be retained does not exceed the amount being withheld from partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications.
3. If the Department has retained funds and it is subsequently determined that the State is not subject to the costs and liabilities in connection with the matter for which the retention was made, the Department shall be liable for interest on the amount retained at the legal rate of interest for the period of the retention.

Conformance with the requirements of this section "Water Pollution Control" shall not relieve the Contractor from the Contractor's responsibilities, as provided in Sections 7-1.11, "Preservation of Property," 7-1.121, "Indemnification," and 7-1.122, "Insurance," of the Standard Specifications.

The Contractor shall, at reasonable times, allow authorized agents of the California Regional Water Quality Control Board, State Water Resources Control Board, U. S. Environmental Protection Agency and local storm water management agency, upon the presentation of credentials and other documents as may be required by law, to:

1. Enter upon the construction site and the Contractor's facilities pertinent to the work;
2. Have access to and copy any records that must be kept as specified in the Permit;
3. Inspect the construction site and related soil stabilization practices and sediment control measures; and
4. Sample or monitor for the purpose of ensuring compliance with the Permit.

The Contractor shall notify the Engineer immediately upon request from regulatory agencies to enter, inspect, sample, monitor or otherwise access the project site or the Contractor's records.

STORM WATER POLLUTION PREVENTION PLAN PREPARATION, APPROVAL AND UPDATES

As part of the water pollution control work, a Storm Water Pollution Prevention Plan, hereafter referred to as the "SWPPP," is required for this contract. The SWPPP shall conform to the requirements in Section 7-1.01G, "Water Pollution," of the Standard Specifications, the requirements in the Handbook, the requirements of the Permit and these special provisions. Upon the Engineer's approval of the SWPPP, the SWPPP shall be deemed to fulfill the requirements of Section 7-1.01G, "Water Pollution," of the Standard Specifications for development and submittal of a Water Pollution Control Program.

No work having potential to cause water pollution, as determined by the Engineer, shall be performed until the SWPPP has been approved by the Engineer.

Within 30 days after the approval of the contract, the Contractor shall submit 3 copies of the SWPPP to the Engineer. The Contractor shall allow 15 days for the Engineer to review the SWPPP. If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the SWPPP within 15 days of receipt of the Engineer's comments and shall allow 15 days for the Engineer to review the revisions. Upon the Engineer's approval of the SWPPP, 3 additional copies of the SWPPP, incorporating the required changes, shall be submitted to the Engineer. In order to allow construction activities to proceed, the Engineer may conditionally approve the SWPPP while minor revisions are being completed.

The objectives of the SWPPP shall be to identify pollution sources that may adversely affect the quality of storm water discharges associated with the project and to identify, construct, implement and maintain water pollution control measures, hereafter referred to as control measures, to reduce to the extent feasible pollutants in storm water discharges from the construction site both during and after construction is completed under this contract.

The SWPPP shall incorporate control measures in the following categories:

1. Soil stabilization practices;
2. Sediment control practices;
3. Sediment tracking control practices;
4. Wind erosion control practices; and
5. Non-storm water management and waste management and disposal control practices.

Specific objectives and minimum requirements for each category of control measures are contained in the Handbook.

The Contractor shall consider the objectives and minimum requirements presented in the Handbook for each of the above categories. When minimum requirements are listed for any category, the Contractor shall incorporate into the SWPPP and implement on the project, one or more of the listed minimum controls required in order to meet the pollution control objectives for the category. In addition, the Contractor shall consider other control measures presented in the Handbook and shall incorporate into the SWPPP and implement on the project the control measures necessary to meet the objectives of the SWPPP. The Contractor shall document the selection process in accordance with the procedure specified in the Handbook.

The SWPPP shall include, but not be limited to, the following items as described in the Handbook and Permit:

1. Source Identification;
2. Erosion and Sediment Controls;
3. Non-Storm Water Management;
4. Waste Management and Disposal;
5. Maintenance, Inspection and Repair;
6. Training;
7. List of Contractors and Subcontractors;
8. Post-Construction Storm Water Management;
9. Preparer;
10. A copy of the Notice of New Construction (NONC) submitted by the Department for this project;
11. Copy of the General Permit;
12. BMP Consideration Checklist;
13. SWPPP Checklist;
14. Schedule of Values; and
15. Water Pollution Control Drawings.

The Contractor shall amend the SWPPP, graphically and in narrative form, whenever there is a change in construction activities or operations which may affect the discharge of significant quantities of pollutants to surface waters, ground waters, municipal storm drain systems, or when deemed necessary by the Engineer. The SWPPP shall also be amended if it is in violation of any condition of the Permit, or has not effectively achieved the objective of reducing pollutants in storm water discharges. Amendments shall show additional control measures or revised operations, including those in areas not shown in the initially approved SWPPP, which are required on the project to control water pollution effectively. Amendments to the

SWPPP shall be submitted for review and approval by the Engineer in the same manner specified for the initially approved SWPPP. Approved amendments shall be dated and logged in the SWPPP. Upon approval of the amendment, the Contractor shall implement the additional control measures or revised operations.

The Contractor shall keep a copy of the SWPPP and approved amendments at the project site. The SWPPP shall be made available upon request of a representative of the Regional Water Quality Control Board, State Water Resources Control Board, U.S. Environmental Protection Agency or local storm water management agency. Requests by the public shall be directed to the Engineer.

By June 15 of each year, the Contractor shall submit an annual certification to the Engineer stating compliance with the requirements governing the Permit. If the project is in non-compliance at any time, the Contractor shall make a written report to the Engineer within 15 days of identification of non-compliance.

SCHEDULE OF VALUES

The Contractor shall submit with the SWPPP, for approval by the Engineer, a schedule of values detailing the cost breakdown of the contract lump sum item for water pollution control. The schedule of values shall reflect the items of work, quantities and costs for control measures shown in the SWPPP, except for critical temporary controls and permanent control measures which are shown on the project plans and for which there is a contract item of work. Adjustments in the items of work and quantities listed in the schedule of values shall be made when required to address approved amendments to the SWPPP.

The sum of the amounts for the units of work listed in the schedule of values shall be equal to the contract lump sum price for water pollution control.

If approved in writing by the Engineer, the schedule of values will be used to determine progress payments for water pollution control during the progress of the work, and as the basis for calculating any adjustment in compensation for the contract item for water pollution control due to changes in the work ordered by the Engineer.

SWPPP IMPLEMENTATION

Upon approval of the SWPPP, the Contractor shall be responsible throughout the duration of the project for installing, constructing, inspecting and maintaining the control measures included in the SWPPP and any amendments thereto and for removing and disposing of temporary control measures. Unless otherwise directed by the Engineer or specified in these special provisions, the Contractor's responsibility for SWPPP implementation shall continue throughout any temporary suspension of work ordered in accordance with Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. Requirements for installation, construction, inspection, maintenance, removal and disposal of control measures are specified in the Handbook and these special provisions.

Soil stabilization practices and sediment control measures, including minimum requirements, shall be provided throughout the winter season, defined as between October 1 and May 1.

Implementation of soil stabilization practices and sediment control measures for soil-disturbed areas of the project site shall be completed, except as provided for below, no later than 20 days prior to the beginning of the winter season or upon start of applicable construction activities for projects which begin either during or within 20 days of the winter season.

Throughout the winter season, the active, soil-disturbed area of the project site shall be no more than 2 hectares. The Engineer may approve, on a case-by-case basis, expansions of the active, soil-disturbed area limit. The Contractor shall demonstrate the ability and preparedness to fully deploy soil stabilization practices and sediment control measures to protect soil-disturbed areas of the project site before the onset of precipitation. The Contractor shall maintain a quantity of soil stabilization and sediment control materials on site equal to 125 percent of that sufficient to protect unprotected, soil-disturbed areas on the project site and shall maintain a detailed plan for the mobilization of sufficient labor and equipment to fully deploy control measures required to protect unprotected, soil-disturbed areas on the project site prior to the onset of precipitation. The Contractor shall include a current inventory of control measure materials and the detailed mobilization plan as part of the SWPPP.

Throughout the winter season, soil-disturbed areas of the project site shall be considered to be nonactive whenever soil disturbing activities are expected to be discontinued for a period of 20 or more days and the areas are fully protected. Areas that will become nonactive either during the winter season or within 20 days thereof shall be fully protected with soil stabilization practices and sediment control measures within 10 days of the discontinuance of soil disturbing activities or prior to the onset of precipitation, whichever is first to occur.

Throughout the winter season, active soil-disturbed areas of the project site shall be fully protected at the end of each day with soil stabilization practices and sediment control measures unless fair weather is predicted through the following work day. The weather forecast shall be monitored by the Contractor on a daily basis. The National Weather Service forecast shall be used, or an alternative weather forecast proposed by the Contractor may be used if approved by the Engineer. If precipitation is predicted prior to the end of the following work day, construction scheduling shall be modified, as required, and the Contractor shall deploy functioning control measures prior to the onset of the precipitation.

The Contractor shall implement, year-round and throughout the duration of the project, control measures included in the SWPPP for sediment tracking, wind erosion, non-storm water management and waste management and disposal.

The Engineer may order the suspension of construction operations which create water pollution if the Contractor fails to conform to the requirements of this section "Water Pollution Control" as determined by the Engineer.

MAINTENANCE

To ensure the proper implementation and functioning of control measures, the Contractor shall regularly inspect and maintain the construction site for the control measures identified in the SWPPP. The Contractor shall identify corrective actions and time frames to address any damaged measures or reinitiate any measures that have been discontinued.

The construction site inspection checklist provided in the Handbook shall be used to ensure that the necessary measures are being properly implemented, and to ensure that the control measures are functioning adequately. The Contractor shall submit one copy of each site inspection record to the Engineer.

During the winter season, inspections of the construction site shall be conducted by the Contractor to identify deficient measures, as follows:

1. Prior to a forecast storm;
2. After any precipitation which causes runoff capable of carrying sediment from the construction site;
3. At 24 hour intervals during extended precipitation events; and
4. Routinely, at a minimum of once every 2 weeks.

If the Contractor or the Engineer identifies a deficiency in the deployment or functioning of an identified control measure, the deficiency shall be corrected by the Contractor immediately, or by a later date and time if requested by the Contractor and approved by the Engineer in writing, but not later than the onset of subsequent precipitation events. The correction of deficiencies shall be at no additional cost to the State.

PAYMENT

The contract lump sum price paid for prepare storm water pollution prevention plan shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals for doing all the work involved in developing, preparing, obtaining approval of, revising and amending the SWPPP as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications. Payments for prepare storm water pollution prevention plan will be made as follows:

1. After the SWPPP has been approved by the Engineer, 75 percent of the contract item price for prepare storm water pollution prevention plan will be included in the monthly partial payment estimate; and
2. After acceptance of the contract pursuant to Section 7-1.17, "Acceptance of Contract," the remaining 25 percent of the contract item price for prepare storm water pollution prevention plan will be made in accordance with Section 9-1.07.

The contract lump sum price paid for water pollution control shall include full compensation for furnishing all labor, materials, tools, equipment and incidentals, and for doing all the work involved in installing, constructing, maintaining, removing and disposing of control measures, except those shown on the project plans and for which there is a contract item of work, and excluding developing, preparing, obtaining approval of, revising and amending the SWPPP, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Changes in control measures required by an approved amendment to the SWPPP, except changes to those control measures shown on the project plans and for which there is a contract item of work, will be considered extra work, in accordance with Section 4-1.03D of the Standard Specifications and the following:

If the control measure is listed in the approved SWPPP schedule of values, an adjustment in compensation for the contract item for water pollution control will be made by applying the increase or decrease in quantities to the approved schedule of values. No adjustment of compensation will be made to the unit price listed for any item in the schedule of values due to any increase or decrease in the quantities, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," shall not apply to items listed in the schedule of values.

If the control measure is not listed in the approved SWPPP schedule of values, payment will be made by force account.

Those control measures which are shown on the project plans and for which there is a contract item of work will be measured and paid for as that item of work.

The Engineer will retain an amount equal to 25 percent of the estimated value of the contract work performed during estimate periods in which the Contractor fails to conform to the requirements of this section "Water Pollution Control" as determined by the Engineer.

Retentions for failure to conform to the requirements of this section "Water Pollution Control" shall be in addition to the other retentions provided for in the contract. The amounts retained for failure of the Contractor to conform to the requirements of this section will be released for payment on the next monthly estimate for partial payment following the date that an approved SWPPP has been implemented and maintained, and water pollution is adequately controlled, as determined by the Engineer.

10-1.04 COOPERATION

Attention is directed to Sections 7-1.14, "Cooperation," and 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications and these special provisions.

State Contract No. 07-2N9204, modify drainage, may be under construction during the execution of this contract.

In the event of a loss caused to the Contractor due to unnecessary delays or failure to finish the work within the time specified for completion caused by another contractor under contract with the Department performing work for the State, the State will reimburse the delayed contractor in conformance with the provisions in Section 8-1.09 "Right of Way Delays," of the Standard Specifications. Deductions will be made from any moneys due or that may become due the contractor causing the loss or delay.

10-1.05 PROGRESS SCHEDULE (CRITICAL PATH)

Progress schedules will be required for this contract and shall conform to the requirements of these special provisions. Progress schedules shall utilize the Critical Path Method (CPM). Contractor's attention is directed to "Cooperation" and "Obstructions" elsewhere in these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7, "Legal Relations and Responsibility," of the Standard Specifications.

Definitions.—The following definitions shall apply to these special provisions:

Activity.—Any task or item of work that shall be performed in order to complete a project.

Baseline Schedule.—The initial CPM progress schedule as accepted by the Engineer representing the Contractor's original work plan.

Concurrent Delay.—Two or more delays on the critical path that occur at the same time.

Contract Completion Date.—The date the Contractor is contractually obligated to complete the project, including any authorized adjustments, as specified in Section 8-1.06, "Time of Completion," of the Standard Specifications.

Contractor Delay.—A delay that extends the time required to complete a controlling operation caused by and within the control of the Contractor, his subcontractor at any tier or suppliers.

Controlling Operation.—A feature of work or activity on the critical path.

Critical Path.—In a project network, the sequence of activities yielding the longest path in a CPM analysis necessary to complete the project.

Critical Path Method (CPM).—A mathematical calculation method using the sequence of activities and their interrelationships, interdependencies, resources and durations to determine the critical path that shows the expected time to complete a project.

Data Date.—The day after the date through which progress updates have been calculated; everything occurring earlier than the data date is "As-Built," and everything on or after the data date is "Planned."

Early Completion Time.—The difference in time between the contract completion date and the current State-accepted scheduled completion date.

Excusable Delay.—A delay as defined in Section 8-1.07, "Liquidated Damages," of the Standard Specifications where the Contractor may be granted an extension of time commensurate with the provisions in Section 8-1.06, "Time of Completion," of the Standard Specifications with no entitlement for adjustment in compensation.

Float.—The amount of time between the early start date and the late start date or the early finish date and the late finish date of any activity or group of activities in the network.

Free Float.—The amount of time an activity can be delayed before delaying a subsequent activity.

Fragnet.—A section or fragment of the network diagram comprised of a group of activities.

Milestone.—A marker in a network which is typically used to mark a point in time or denote the beginning or end of a sequence of activities. A milestone has zero duration and zero resources, but will otherwise function in the network as if the milestone were an activity.

Narrative Report.—A report that identifies potential problem areas, current and anticipated delaying factors and their impact, actions taken or proposed, proposed changes in schedule logic, extension or contraction of activities, proposed addition or deletion of activities, explanation for changes in the critical path, explanation for changes in scheduled completion date, out of sequence work, and any other topics related to job progress or scheduling.

Near Critical Path.—A path having 10 working days or less of total float.

Punch List.—A list of details needing attention to complete task or work for both contract item and extra work.

Schedule Revision.—A change in the future portion of the schedule that modifies logic; alters construction sequences such as performing sequential activities concurrently or concurrent activities sequentially; adds or deletes activities or significantly alters activity durations, as determined or accepted by the Engineer.

Scheduled Completion Date.—The Contractor's scheduled completion date as shown on the accepted baseline schedule as modified by subsequent accepted schedule updates and revisions.

State Delay.—A delay that is attributable solely to the State, is beyond the control of the Contractor, and extends the time required to complete a controlling operation.

State Owned Float Activity.—The activity documenting time saved on the critical path by contract changes or other actions of the State, except contract change orders that result from significant Contractor development and investment.

Time Impact Analysis.—An analysis demonstrating the estimated time impact of a contract change order, delay or other event on the scheduled completion date.

Total Float.—The amount of time that an activity may be delayed without delaying the scheduled completion date.

Update.—The routine modification of the CPM progress schedule through a regular monthly review to incorporate actual past progress to date by activity, projected completion dates, and approved time adjustments.

Materials (Computer System).—The Contractor shall provide a computer system for the State's exclusive possession and use for CPM progress schedules. The minimum computer system to be furnished shall be complete with keyboard, mouse, monitor, printer and plotter. The system shall be from those identified by the Gartner Group as Tier 1 and shall also conform to the following requirements:

1. Latest industry-available Intel Pentium processor, Motorola RISC processor or equivalent.
2. Latest computer operating system software compatible with the selected processor, either Windows or MACINTOSH.
3. Minimum of 128 megabytes of random access memory (RAM).
4. Internal drives, including: one 4-gigabyte minimum hard disk drive, one 1.44 megabyte 3.5-inch floppy disk drive, one Iomega Jaz drive with two 1-gigabyte minimum cartridges, and one 32x speed CD-ROM drive.
5. Internal fax/modem, latest speed and software version of U.S. Robotics, 3COM or equivalent.
6. A 17-inch minimum, color monitor capable of at least 1,024 x 768 pixels.
7. A color-ink-jet-type, E-size plotter with a minimum 8 megabytes RAM, capable of 300 dots per inch color, 600 dots per inch monochrome, or equivalent, compatible with the selected system capable of plotting, in color, fully legible time-scaled logic diagrams, network diagrams, and bar charts. The plotter shall have the capability of being connected to or networked with a minimum of 5 computers.
8. A color-ink-jet-type, B-size plotter compatible with the selected system capable of printing fully legible, time-scaled charts, network diagrams and reports.
9. A manual parallel cable switching device, with connecting cables, allowing the user to alternate printing between the plotters.
10. CPM software shall be compatible with the hardware provided, shall be the latest version of Primavera Project Planner for Windows, SureTrak for Windows, or equal, and shall be able to create files that can easily be imported into the latest version of Primavera.
11. General software shall be latest versions of Microsoft Office Professional and McAfee VirusScan virus protection. The general software shall be compatible with the hardware provided.
12. Upgrades to the CPM and general software shall be provided, as the upgrades become available.

The computer hardware and software furnished by the Contractor shall be compatible with that used for the production of the CPM progress schedule required by these special provisions, including original instruction manuals and other documentation normally provided with the CPM and general software. Before delivery and setup of the computer system, the Contractor shall submit to the Engineer for approval a detailed list of the computer hardware and software the Contractor proposes to furnish, including an itemized schedule of costs for the system.

The Contractor shall furnish, install, set up, maintain and repair the computer system ready-for-use, and provide plotter supplies as necessary during the course of the project at a location determined by the Engineer. The first submittal of the baseline schedule will not be considered complete until the hardware and software are installed and ready for use with the submitted baseline schedule. The Contractor shall instruct and assist the Engineer in the use of the hardware and software. When requested by the Engineer, the Contractor shall provide one 8-hour session of outside commercial training in the use of

the CPM software for a maximum of 2 project staff at a location acceptable to the Engineer. Hardware repairs shall be made within 48 hours of notification by the Engineer, or replacement equipment shall be furnished and installed by the Contractor until repairs have been completed.

Computer hardware and software furnished shall remain the property of the Contractor and shall be removed by the Contractor upon acceptance of the contract if no claims involving contract progress are pending. If contract claims involving contract progress are pending, computer hardware or software shall not be removed until the final estimate has been submitted to the Contractor.

General.—Early completion time shall be considered a resource for the exclusive use of the Contractor. The Contractor may increase early completion time by increasing production or reallocating resources to be more efficient, or by proposing, and the State accepting, contract change orders that are the result of significant Contractor development and investment or from an appropriate share of an accepted Cost Reduction Incentive Proposal.

State owned float shall be considered a resource for the exclusive use of the State. The Engineer may either accrue State owned float to mitigate past or anticipated future State delays, or reduce contract working days. The State may reduce contract working days if the action is the result of a contract change order other than those that result from significant Contractor development and investment. The Engineer will document State owned float by directing the Contractor in writing to update the State owned float activity and the activity relative to the State action that created the float. The Contractor shall conduct a time impact analysis to determine the effect of the change in the same manner described in "Schedule Time Adjustment", specified herein and shall include the impacts acceptable to the Engineer in the next update or revision. The Contractor shall include a log of the action in the State owned float activity, and include a discussion of the action in the narrative report of the next schedule update.

Contractor delays that are concurrent with State delays may be excusable, but are not compensable. Other Contractor delays are not excusable. Changes or delays that do not affect the controlling operation or operations on the critical path will not be considered as the basis for a time adjustment.

The State will be responsible for the impacts of: State delays; State's action or lack of action; utility companies who perform work on the project or impact the project schedule as set forth in Section 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications; and other contractors working directly for the State who impact the project or project schedule as specified in "Cooperation" of these special provisions. The Contractor shall mitigate these delays and impacts, and shall minimize the costs of these delays and impacts. If an unanticipated State delay or project impact results in an increased cost to the Contractor, the Contractor will be entitled to an adjustment in compensation in conformance with the provisions in Section 8-1.09, "Right of Way Delays" of the Standard Specifications.

The Contractor shall be responsible for assuring that the work sequences are logical and the network shows a coordinated plan for complete performance of the work. Failure of the Contractor to include in the schedule any element of work required for the performance of the contract shall not relieve the Contractor from completing the work within the time limit specified in the contract. If the Contractor or the Engineer discovers an undefined element of work, activity or logic, it shall be corrected by the Contractor in a schedule revision, as specified in these special provisions. If a planned activity requires greater-than-normal daily resources to accomplish, relative submittals shall include a narrative describing the activity, and the amount and use of the extraordinary resources.

The Baseline Schedule or Schedule Update submitted for acceptance shall not show variances from the requirements of these special provisions unless approved by the Engineer. The Contractor shall make specific mention of the variations in the letter of transmittal, and shall make the associated adjustments to the project schedule. The Contractor will not be relieved of the responsibility for executing the work in strict conformance with the provisions in the requirements of these special provisions. In the event of a conflict between the requirements of these special provisions and the information provided or shown on an accepted schedule, the requirements of these special provisions shall take precedence.

Each schedule submitted to the Engineer shall comply with the limits imposed by these special provisions, with the specified intermediate milestones and completion dates, and with the constraints, restraints or sequences included in these special provisions, except that after the Engineer accepts the baseline schedule, the Contractor may show a late scheduled completion date on subsequent updates or revisions. The degree of detail shall include factors to the satisfaction of the Engineer, including, but not limited to:

1. Physical breakdown of the project;
2. Contract milestones and completion dates, substantial completion dates, constraints, restraints, sequences of work shown in these special provisions, the planned substantial completion date, and the final completion date;
3. Type of work to be performed, the sequences, and the activities to be performed by subcontractors;
4. Procurement, submittal, submittal review, manufacture, test, delivery, and installation of major materials and equipment that require approval;
5. Preparation, submittal, and approval of shop or working drawings and material samples showing time, as specified in these special provisions, for the Engineer's review;

6. Identification of interfaces and dependencies with preceding, concurrent and follow-on contractors, railroads, and utilities as indicated in these special provisions;
7. Identification of each utility relocation or interface as a separate activity;
8. Batch plant erection and plant certification;
9. Erection and removal of falsework or shoring;
10. Submission and approval of reports or results for major tests, such as that for pile loading or traffic controllers;
11. Indicate long-term ramp and connector closing and opening events, traffic switches, and opening and closing of pavements to traffic as separate one day activities;
12. Punch-list and final clean-up.
13. State owned float as the last activity in the schedule, at the end of which is the Scheduled Completion Date.
14. Activity coding conventions shall include the following:

	Code	Value	Description
(1) Responsibility	RESP	CT	Caltrans
		UTIL	Utility Company
		RAIL	Railroad
		xxxx	Contractor
		xxxx	Subcontractor
		xxxx	others, as needed
(2) Stage	STGE	1	Stage 1
		2	Stage 2
		other designations	other descriptions, as needed
(3) Phase	PHAS	1	Phase 1
		2	Phase 2
		other phases	other phases, as needed
(4) Utilities	UTIL	PGE	Pacific Gas & Electric
		BELL	Pacific Bell
		GTE	GTE
		SCE	Southern California Edison
		other utilities	other utilities, as needed
The Contractor may include additional coding conventions, such as Ramps (RAMP), Facilities (FAC), and Events (EVNT).			

The work shall be executed in the sequence indicated in the accepted baseline schedule and subsequent accepted updates and revisions. Once the Engineer accepts a CPM schedule, the Contractor shall neither artificially improve the progress nor artificially change the quantity of float in any part of the schedule by artificially adding or deleting activities, revising schedule logic restraints, or changing planned activity durations. Schedule changes of planned work shall be documented in a properly submitted revision. The Contractor may improve the progress by performing sequential activities concurrently or by performing activities more quickly than planned. In the case of multiple critical paths, float generated by early completion of one or a sequence of activities will be considered in determining if that sequence of activities remains on the critical path.

The schedule shall be modified to reflect actual events and conditions, including non-work days, as these events and conditions occur for historical purposes and for use in time impact analysis. Submittals and Engineer review time shall be shown in the progress schedule, including CPM schedule updates and revisions. The duration of the Engineer review activity shall be 15 days unless specified otherwise in these special provisions.

The Contractor will be allowed to show an early or late scheduled completion date on schedule updates and revisions. The Engineer shall use the most current, accepted schedule update and revision, and Contractor-provided cause, time-impact and schedule-delay analysis that is acceptable to the Engineer to determine apparent impacts.

The Engineer shall be allowed 20 days to review and accept or reject the baseline schedule. The Engineer shall be allowed 15 days to review and accept or reject any updated or revised schedule. Rejected schedules shall be resubmitted to the Engineer within 5 days, at which time a new review period of 5 days will begin. After the baseline schedule is accepted, schedules that are not accepted or rejected within the required review period will be deemed to have been accepted by the Engineer. Acceptance of any schedule does not relieve the Contractor from the responsibility of submitting complete and accurate information.

Pre-Construction Scheduling Conference.—The Contractor shall schedule, and the Engineer will conduct a Pre-Construction Scheduling Conference with the Contractor's Project Manager and Construction Scheduler within 10 days after approval of the contract. At this meeting, the Engineer will review the requirements of this section of the special provisions with the Contractor. The Contractor shall submit a general time-scaled logic diagram displaying the major activities and sequence of planned operations and shall be prepared to discuss the proposed work plan and schedule methodology that complies with the requirements in these special provisions. If the Contractor proposes deviations to the construction staging of the project, the Contractor shall submit a general time-scaled logic diagram displaying the deviations and resulting time impacts, and shall be prepared to discuss the proposal. At this meeting, the Contractor shall additionally submit the alpha-numeric coding structure and the activity identification system for labeling the work activities. To easily identify relationships, each activity description shall indicate its associated scope or location of work by including such terms as quantity of material, type of work, Bridge Number, Station to Station location, side of highway (such as left, right, northbound, southbound), lane number, shoulder, ramp name, ramp line descriptor or mainline. The Engineer will review and comment on the logic diagram, the coding structure and activity identification system within 15 days after submission by the Contractor. The Contractor shall make all modifications to the time-scaled logic diagram, the coding structure, and activity identification system that the Engineer requests and shall employ that coding structure and identification system. The Contractor shall include the Engineer-requested modifications in the baseline schedule.

Network Diagram and Project Schedule Reports—Schedules submitted to the Engineer, including the baseline schedule, shall include originally-plotted time-scaled network diagram(s). Network diagrams shall be based on early start and early finish dates of activities shown. The network diagrams submitted to the Engineer shall also be accompanied by the CPM software-generated tabular reports for each activity included in the project schedule. Three different report sorts shall be provided: Early Start, Total Float, and Activity Number which shall show the predecessors and successors for each activity. Tabular reports (8 1/2" x 11" size) shall be submitted to the Engineer and shall include at a minimum, the following:

1. Data date;
2. Predecessor and successor activity numbers and descriptions;
3. Activity number and description;
4. Activity code(s);
5. Scheduled, or actual and remaining durations for each activity;
6. Earliest start date (by calendar date);
7. Earliest finish date (by calendar date);
8. Actual start date (by calendar date);
9. Actual finish date (by calendar date);
10. Latest start date (by calendar date);
11. Latest finish date (by calendar date);
12. Free Float, in work days;
13. Total Float, in work days;
14. Percentage of activity complete and remaining duration for incomplete activities;
15. Lag(s); and
16. Imposed constraints.

The networks shall be drafted time-scaled to show a continuous flow of information from left to right. The primary path(s) of criticality shall be clearly and graphically identified on the network(s). The network diagram shall be prepared on E-size sheets (34" x 44"), and shall have a title block in the lower right-hand corner and a timeline on each page. Exceptions to the size of the network sheets and the use of computer graphics to generate the networks shall be subject to the Engineer's approval.

The narrative report shall be organized as follows:

1. Contractor's Transmittal Letter
2. Work completed during the period
3. Identification of any unusual resources: manpower, material, or equipment restrictions or use, including multiple shifts, six day weeks, specified overtime, or work at times other than regular days or hours
4. Description of the current critical path
5. Changes to the critical path since the last schedule submittal
6. Description of problem areas
7. Current and anticipated delays

- a. Cause of the delay
 - b. Impact of the delay on other activities, milestones, and completion dates
 - c. Corrective action and schedule adjustments to correct the delay
8. Pending items and status thereof
- a. Permits
 - b. Change Orders
 - c. Time Adjustments
 - d. Non-Compliance Notices
9. Contract completion date(s) status
- a. Ahead of schedule and number of days
 - b. Behind schedule and number of days
 - c. If date changes, explain the cause
- 10 Attached Updated Network Diagram and Reports

Schedule network diagrams, tabular reports and the narrative reports shall be submitted to the Engineer for acceptance in the following quantities:

- 1. Two sets of originally-plotted, time-scaled network diagram(s);
- 2. Two copies of each of the three sorts of the CPM software-generated tabular reports (8 1/2" x 11" size);
- 3. One 1.44-megabyte 3.5 inch floppy diskette containing the schedule data.
- 4. Two copies of the narrative report.

Baseline Schedule Requirements.—Within 30 days after approval of the contract, the Contractor shall submit a baseline schedule to the Engineer. The baseline project schedule shall have a data date of the first working day of the contract and shall not include any completed work to-date. The baseline schedule shall be practicable; include the entire scope of work; meet interim target dates, milestones, stage construction requirements, and internal time constraints; show logical sequence of activities; and shall not extend beyond the number of working days originally provided in these special provisions. An early completion schedule will be acceptable provided that the schedule meets the requirements of these special provisions and the Standard Specifications.

The baseline CPM progress schedule submitted by the Contractor shall have a sufficient number of activities to assure adequate planning of the project, and to permit monitoring and evaluation of progress, and the analysis of time impacts. The baseline schedule shall depict how the Contractor plans to complete the whole work involved, and shall show the activities that define the critical path. Multiple critical paths and near-critical paths shall be kept to a minimum, as determined by the Engineer. A total of not more than 50 percent of the baseline schedule activities shall be critical or near-critical, unless otherwise approved by the Engineer.

Activities shall have a duration of not less than one working day nor more than 20 working days, unless otherwise approved by the Engineer. The activities in the baseline schedule, with the exception of the first and last activities, shall have a minimum of one predecessor and a minimum of one successor. The baseline schedule shall not attribute negative float or negative lag to any activity.

Monthly Schedule Updates.—On or before the first calendar day of each month, the Contractor shall meet with the Engineer to review contract progress. At the monthly progress meeting the Contractor shall submit to the Engineer an update of the network diagram and project schedule reports as defined above. Update schedules shall have a data date of the twenty-first calendar day of the month, or other date as established by the Engineer, and shall include the information available up to that date. Durations for work that has been completed will be shown on the schedule as the work actually occurred, including Engineer submittal review and Contractor resubmittal times.

Schedule Revisions.—When the Contractor proposes a revision to an accepted schedule, the Contractor shall state in writing the reasons for the change, as well as the specifics, such as, but not limited to, revisions to activities, logic, durations, and other matters pertinent to the proposed revisions. If the Engineer considers a schedule revision to be of a major nature, the Engineer may require the Contractor to revise and submit for acceptance the affected portion(s) of the project schedule and an analysis to show the effect on the entire project. In addition to the revision submittal, the Contractor shall submit a schedule update with the same data date as the revision which is to reflect the project condition just prior to implementing the revision. The Contractor shall discuss contemplated revisions with the Engineer prior to the submittal.

Within 15 days, the Contractor shall submit a revised CPM network for approval when requested by the Engineer, or when any of the following occurs:

1. There is a significant change in the Contractor's operations that affects the critical or near critical path(s).
2. The scheduled completion date of the current submitted updated CPM schedule indicates that the contract progress is 20 days or more behind the current accepted schedule or revision.
3. The Contractor or the Engineer considers that an approved or anticipated change will impact the critical or near critical path or contract progress.

Schedule Time Adjustment.—When the Contractor requests a time adjustment due to contract change orders or delays, or if the Contractor or the Engineer considers that an approved or anticipated change will impact the critical path or contract progress, the Contractor shall submit a written time impact analysis to the Engineer illustrating the impacts of each change or delay on the current scheduled completion date or milestone completion date. The analysis shall use the currently accepted schedule that has a data date closest to and prior to the event. If the Engineer determines that the currently accepted schedule does not appropriately represent the conditions prior to the event, the schedule shall be updated to the day before the event being analyzed. An additional analysis shall be performed after the completion of said event. If the event is on the critical path at the time of its completion, then the difference between the scheduled completion dates of these 2 analyses shall be equal to the adjustment in time. The time impact analysis shall include one or more fragnet(s) demonstrating how the Contractor proposes to incorporate the event(s) into the schedule, including logic and duration of the proposed activities. Until such time that the Contractor provides the analysis, the Engineer may, at his option, construct and utilize the project as-built schedule or other recognized method to determine delay impacts.

Time impact analyses shall be submitted in duplicate within 15 days of a delay, and shall be used in determining contract change order days. Approval or rejection of each time impact analysis by the Engineer will be made within 15 days after receipt of the time impact analysis. In the event the Contractor does not agree with the decision of the Engineer regarding the impact of a change or delay, notice shall be given in conformance with the provisions in Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications.

Final Schedule Update.—Within 30 days after acceptance of the contract by the Director, the Contractor shall submit a final update of the schedule (as-built schedule) with actual start and actual finish dates for the activities. The Contractor shall submit a written certificate with this submittal signed by the Contractor's Project Manager and an officer of the company stating "To the best of my knowledge, the enclosed final update of the project schedule reflects the actual start and completion dates of the actual activities for the project contained herein." An officer of the company may delegate in writing the authority to sign the certificate to a responsible manager. Submittal of the final schedule update and the certification shall be a condition precedent to the release of any retained funds under the contract.

Payment.—Progress schedule (critical path) will be paid for at a lump sum price. The contract lump sum price paid for progress schedule (critical path) shall include full compensation for furnishing all labor, material (including computer hardware and software), tools, equipment, and incidentals; and for doing all the work involved in preparing, furnishing, updating, and revising progress schedules; maintaining and repairing the computer hardware; and instructing and assisting the Engineer in the use of the computer hardware and software, as specified in the Standard Specifications and in these special provisions, and as directed by the Engineer. Payments for the progress schedule (critical path) contract item will be made as follows:

1. A total of 50 percent of the progress schedule (critical path) contract item amount will be made upon achieving all of the following: 5 percent of all work completed, accepted baseline, all accepted required schedule updates and revisions, and required CPM training.
2. A total of 60 percent of the progress schedule (critical path) contract item amount will be made upon achieving all of the following: 25 percent of all work completed, accepted baseline, and all accepted required schedule updates and revisions.
3. A total of 75 percent of the progress schedule (critical path) contract item amount will be made when 50 percent of all work completed, accepted baseline, and all accepted required schedule updates and revisions.
4. A total of 100 percent of the progress schedule (critical path) contract item amount will be made when 100 percent of all work completed, accepted baseline, all accepted required schedule updates and revisions, and a completed and certified Final Schedule Update.

The adjustment provisions in Section 4-1.03, "Changes," of the Standard Specifications, shall not apply to the item of progress schedule (critical path). Adjustments in compensation for progress schedule (critical path) will not be made for any increased or decreased work ordered by the Engineer in furnishing progress schedules.

Retention.—The Department will retain an amount equal to 25 percent of the estimated value of the work performed during each estimate period in which the Contractor fails to submit pre-construction scheduling documents, an acceptable baseline, acceptable updated schedule, or acceptable revised progress schedule (critical path) conforming to the requirements of these special provisions as determined by the Engineer. Retentions for failure to submit acceptable CPM progress schedules shall be in addition to other retentions provided for in the contract. Retentions for failure to submit progress schedules (critical path) will be released for payment on the next monthly estimate for partial payment following the date that pre-construction scheduling documents and acceptable progress schedules (critical path) are submitted to the Engineer, and no interest will be due the Contractor.

10-1.06 OVERHEAD

Overhead shall conform to the provisions of this section, "Overhead," of these special provisions. The Contractor will be compensated for time-related overhead in accordance with these special provisions.

Attention is directed to "Force Account Payment" and "Progress Schedule (Critical Path)" of these special provisions.

The provisions in Section 9-1.08, "Adjustment of Overhead Costs," of the Standard Specifications shall not apply.

Time-related overhead shall consist of those overhead costs, including field and home office overhead, that are in proportion to the time required to complete the work. Time-related overhead shall not include costs that are not related to time, including but not limited to, mobilization, licenses, permits, and any other charges incurred only once during the contract.

Field office overhead expenses include time-related costs associated with the normal and recurring operations of the construction project, and shall not include costs directly attributable to any of the work of the contract. Such time-related costs include, but are not limited to, the salaries and benefits of project managers, general superintendents, field office managers and other field office staff assigned to the project, and rent, utilities, maintenance, security, supplies and equipment costs of the project field office.

Home office overhead or general and administrative expenses refer to the fixed costs of operating the Contractor's business. Such costs include, but are not limited to, general administration, insurance, personnel and subcontract administration, purchasing, accounting, and project engineering and estimating. The rate of home office overhead shall exclude expenses specifically related to other contracts or other businesses of the Contractor, equipment coordination, material deliveries, and consultant and legal fees.

The quantity of time-related overhead to be paid will be measured by the working day, as specified in the Engineer's Estimate as WDAYS. The estimated amount will be based on the number of working days, excluding any days for plant establishment, as specified in "Beginning of Work, Time of Completion and Liquidated Damages" of these special provisions. In the event an early completion progress schedule, as defined in "Progress Schedule (Critical Path)" of these special provisions, is submitted by the Contractor and approved by the Engineer, the quantity of time-related overhead eligible for payment will be based on the total number of working days as specified in "Beginning of Work, Time of Completion and Liquidated Damages" of these special provisions, rather than the Contractor's early completion progress schedule. The quantity of time-related overhead, as measured above, will be adjusted only as a result of suspensions and adjustments of time which revise the current contract completion date and which are also any of the following:

1. suspensions of work ordered in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications, except:
 - a. suspensions ordered due to weather conditions being unfavorable for the suitable prosecution of the controlling operation or operations; or
 - b. suspensions ordered due to the failure on the part of the Contractor to carry out orders given, or to perform any provision of the contract; or
 - c. any other suspensions mutually agreed upon between the Engineer and the Contractor.
2. extensions of time granted by the State in conformance with the provisions in the fifth paragraph in Section 8-1.07, "Liquidated Damages," of the Standard Specifications; or
3. reductions in contract time set forth in approved contract change orders, in conformance with the provisions in Section 4-1.03, "Changes," of the Standard Specifications.

In the event a cost reduction proposal is submitted by the Contractor, and is subsequently approved by the Engineer, which provides for a reduction in contract time, the contract amount of time-related overhead associated with the reduction in contract time shall be considered as a net savings in the total cost of time-related overhead. The Contractor will be paid 50 percent of the estimated net savings of the time-related overhead, in conformance with the provisions in Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

If the quantity of time-related overhead, measured as specified in this special provision, exceeds 149 percent of the number of working days specified in the Engineer's Estimate, the Contractor shall, within 60 calendar days of the Engineer's written request, submit to the Engineer an audit examination and report performed by an independent Certified Public Accountant of the Contractor's actual overhead costs. The independent Certified Public Accountant's audit examination shall be performed in conformance with the requirements of the American Institute of Certified Public Accountants Attestation Standards. The audit examination and report shall depict the Contractor's project and company-wide financial records and shall specify the actual overall average daily rates for both field and home office overhead for the entire duration of the project, and whether the costs have been properly allocated. The rates of field and home office overhead shall exclude all unallowable costs as determined in the Federal Acquisition Regulations, 48 CFR, Chapter 1, Part 31. The audit examination shall determine if the rates of field and home office overhead:

1. are allowable in conformance with the requirements of the Federal Acquisition Regulations, 48 CFR, Chapter 1, Part 31;
2. are adequately supported by reliable documentation; and
3. related solely to the project under examination.

Upon the Engineer's written request, the Contractor shall make its financial records available for audit by the State for the purpose of verifying the actual rate of time-related overhead specified in the audit submitted by the Contractor. The actual rate of time-related overhead specified in the audit, submitted by the Contractor, will be subject to approval by the Engineer.

If the Engineer elects, or if requested in writing by the Contractor, contract item payments for time-related overhead, in excess of 149 percent of the number of working days designated in the Engineer's Estimate, will be adjusted to reflect the actual rate.

The cost of performing an audit examination and submitting the report, requested by the Engineer, will be borne equally by the State and the Contractor. The division of the cost will be made by determining the cost of providing an audit examination in conformance with the provisions of Section 9-1.03B, "Work performed by Special Forces or Other Special Services" of the Standard Specifications, and paying to the Contractor one-half of that cost.

The contract price paid per working day for time-related overhead shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in time-related overhead, complete in place, including all field and home office overhead costs incurred by the Contractor and by any joint venture partner, subcontractor, supplier or other party associated with the Contractor, and the Contractor's share of costs of audits of overhead costs requested by the Engineer, as specified in these special provisions, and as directed by the Engineer. The provisions in Sections 4-1.03B, "Increased or Decreased Quantities," 4-1.03C, "Changes in Character of the Work," of the Standard Specifications shall not apply to time-related overhead.

Full compensation for additional overhead costs involved in the performance of extra work at force account shall be considered as included in the markups specified in "Force Account Payment," of these special provisions.

Full compensation for additional overhead cost involved in performing additional contract item work that is not a controlling operation and for all overhead, other than the time-related overhead measured and paid for as specified in this section "Overhead", shall be considered as included in the various items of work involved, and no additional compensation will be allowed therefor.

For the purpose of making partial payments pursuant to the provisions in Section 9-1.06, "Partial Payments," of the Standard Specifications, the number of working days to be paid for time-related overhead in each monthly partial payment will be the number of working days, specified above to be measured for payment, that occurred during that monthly estimate period. The amount earned per working day for time-related overhead shall be either the contract item price, or 20 percent of the original total contract amount divided by the number of working days specified in "Beginning of Work, Time of Completion and Liquidated Damages," of these special provisions, whichever is the lesser.

After acceptance of the contract pursuant to the provisions in Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, the amount of the total contract item price for time-related overhead not yet paid, will be included for payment in the first estimate made after acceptance of the contract in conformance with the provisions in Section 9-1.07, "Payment After Acceptance," of the Standard Specifications.

10-1.07 OBSTRUCTIONS

Attention is directed to Sections 8-1.10, "Utility and Non-Highway Facilities," and 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

The Contractor's attention is directed to the existence of certain underground facilities that may require special precautions be taken by the Contractor to protect the health, safety and welfare of workers and of the public. Facilities requiring special precautions include, but are not limited to: conductors of petroleum products, oxygen, chlorine, and toxic or flammable gases; natural gas in pipelines greater than 150 mm in diameter or pipelines operating at pressures greater than 415 kPa (gage); underground electric supply system conductors or cables, with potential to ground of more than 300 V, either

directly buried or in duct or conduit which do not have concentric grounded or other effectively grounded metal shields on sheaths.

The Contractor shall notify the Engineer and the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to performing any excavation or other work close to any underground pipeline, conduit, duct, wire or other structure. Regional notification centers include but are not limited to the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444 1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133 1-800-227-2600

10-1.08 MOBILIZATION

Mobilization shall conform to the provisions in Section 11, "Mobilization," of the Standard Specifications.

10-1.09 CONSTRUCTION AREA SIGNS

Construction area signs shall be furnished, installed, maintained, and removed when no longer required in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

The Contractor shall notify the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to commencing excavation for construction area sign posts. The regional notification centers include but are not limited to the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444 1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133 1-800-227-2600

Excavations required to install construction area signs shall be performed by hand methods without the use of power equipment, except that power equipment may be used if it is determined there are no utility facilities in the area of the proposed post holes.

The second sentence of the third paragraph in Section 12-3.02, "Barricades," of the Standard Specifications is amended to read:

The entire area of orange and white stripes shall be Type I, engineering grade, or Type II, super engineering grade, retroreflective sheeting conforming to the requirements of ASTM Designation: D 4956-95.

The third paragraph in Section 12-3.06A, "Stationary Mounted Signs," of the Standard Specifications is amended to read:

Sign panels for stationary mounted signs shall consist of Type III or Type IV reflective sheeting applied to an aluminum substrate conforming to the requirements in the Department's "Specifications for Reflective Sheeting Aluminum Signs." The type of reflective sheeting, Type III or Type IV, shall be at the Contractor's option and sign substrates fabricated from materials other than aluminum may be used when specified in the special provisions.

Legend and border may be applied by a screening process or by use of pressure sensitive cut-out sheeting. Size and spacing of letters and symbols shall be as depicted on the sign specification sheets published by the Department.

Rectangular signs over 1375 mm measured along the horizontal axis, and diamond-shaped signs 1500 mm and larger shall be framed unless otherwise specified. Frames shall be constructed in conformance with the requirements of the Department's "Framing Details for Sheet Aluminum Signs," Sheets 1 through 4 and Table 1 on Sheet 5.

Copies of the Department's "Specifications for Reflective Sheeting Aluminum Signs," "Framing Details for Sheet Aluminum Signs," and sign specification sheets may be obtained from the Department's Office of Business Management, Materiel Operations Branch, 1900 Royal Oaks Drive, Sacramento, CA 95815.

The second paragraph in Section 12-3.06B, "Portable Signs," of the Standard Specifications is amended to read:

Sign panels for portable signs shall conform to the provisions of sign panels for stationary mounted signs in Section 12-3.06A, "Stationary Mounted Signs," or shall be Type VI reflective sheeting as specified in the special provisions, or shall be cotton drill fabric, flexible industrial nylon fabric, or other approved fabric. Fabric signs shall not be used during the hours of darkness. Size, color, and legend requirements for portable signs shall be as described for stationary mounted sign panels in Section 12-3.06A. The height to the bottom of the sign panel above the edge of traveled way shall be at least 0.3-m.

The third paragraph in Section 12-3.06B, "Portable Signs," of the Standard Specifications is deleted.

Sign substrates for stationary mounted construction area signs may be fabricated from fiberglass reinforced plastic as specified under "Approved Traffic Products" of these special provisions.

Type VI reflective sheeting for sign panels for portable construction area signs shall conform to the provisions in "Approved Traffic Products" of these special provisions.

The term "construction area signs" shall also include temporary object markers required for the direction of public traffic through or around the work during construction. Object markers listed or designated on the plans as construction area signs shall be considered to be signs and shall be furnished, erected, maintained, and removed by the Contractor in the same manner specified for construction area signs and the following:

Object markers shall be stationary mounted on wood or metal posts in accordance with the details shown on the plans and the requirements in Section 82, "Markers and Delineators," of the Standard Specifications.

Marker panels for Type P object markers shall conform to the requirements for sign panels for stationary mounted signs.

Target plates for Type K and Type L object markers, and posts, reflectors, and hardware shall conform to the requirements in Section 82, but need not be new.

10-1.10 MAINTAINING TRAFFIC

Attention is directed to Sections 7-1.08, "Public Convenience," 7-1.09, "Public Safety," and 12, "Construction Area Traffic Control Devices," of the Standard Specifications and to the Section entitled "Portable Changeable Message Signs", "Public Safety", "Temporary Traffic Screen", and "Structural Concrete Approach Slabs (Type R)" elsewhere in these special provisions, and these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7-1.09.

Lane closures shall conform to the provisions in the section of these special provisions entitled "Traffic Control System for Lane Closure."

In addition to the provisions set forth in "Public Safety", elsewhere in these special provisions, whenever work to be performed on the freeway traveled way (except for grinding operations, and except the work of installing, maintaining, and removing traffic control devices) is within 1.8 m of the adjacent traffic lane, the adjacent traffic lane shall be closed.

At the following location no temporary railing is required. Each side of each vehicular passageway between portals shall be illuminated by a string of yellow 25-W lamps spaced at 3.6 m intervals, mounted at a height of 2.4 to 2.6 meters above the pavement:

Los Pinetos Road

	Number	Width	Height
Vehicle Openings	1	3.7	4.4

(Width and Height in meters)

The exact location of openings will be determined by the Engineer.

Personal vehicles of the Contractor's employees shall not be parked within the freeway right of way. The Contractor shall notify local authorities of the Contractor's intent to begin work at least 5 days before work is begun. The Contractor shall cooperate with local authorities relative to handling traffic through the area and shall make all arrangements relative to keeping the working area clear of parked vehicles.

Whenever vehicles or equipment are parked on the freeway shoulder within 1.8 m of a traffic lane, the shoulder area shall be closed as shown on the plans.

Except as otherwise provided in these special provisions, freeway lanes, connectors, and ramps shall be closed only during the hours shown on Charts 1 through 14 included in this section "Maintaining Traffic." Except work required under Sections 7-1.08 and 7-1.09, work that interferes with public traffic shall be performed only during the hours shown for lane closures.

The Contractor may be allowed to work during the hours designated as "No freeway lane closure permitted; no work permitted ... " shown on Charts 1 through 4 provided temporary traffic screens are installed on top of temporary railings (Type K), as shown on the plans, or Contractor-furnished temporary railings (Type K). Temporary traffic screens and Contractor-furnished temporary railings (Type K) shall be furnished, installed, maintained, and removed at the Contractor's expense.

HOV lanes may be closed anytime the adjacent freeway lane is permitted to be closed as shown on Charts 2 and 3. When the HOV lane is to be closed, the Contractor shall furnish and erect, at his expense, "Lane Closed" (C30) sign at 300 meter intervals.

Traffic lanes, which are outside of through traffic lanes, as described in the Charts 1 and 2 may be closed anytime the adjacent freeway lane, or connector, or ramp is permitted to be closed in accordance with Charts 5 through 14.

When performing work over the roadway, the Contractor shall close the traffic lane(s) or shoulder directly below the work, except when working on overhead sign structures equipped with walkways. When work is to be performed on sign structures equipped with walkways over traffic lanes not closed to public traffic, the Contractor shall have the sign safety railings in place, all personnel secured to the structure, all tools secured to personnel, and a netting placed below the work area on the sign structure which is capable of catching material that may be accidentally dropped.

When removing and replacing approach slabs, the Contractor shall schedule his operations in conformance with the hours and requirements shown on Tables 1 and 2 in place of Charts 1 and 4. The Contractor shall place a special "WET CONCRETE" sign in front of newly poured concrete pavement during curing period.

When a designated legal holiday falls between and including Thursday and the following Tuesday, no work will be permitted during the intervening weekend for concrete pavement reconstruction.

When work requires a connector to be closed within the limits of a freeway lane closure, all work on the connector shall be completed first. Work on portions of the freeway mainline necessary to insure a safe passageway for public traffic between the connector and the open lanes of the freeway mainline shall also be completed. The connector shall then be opened to public traffic before commencing work on the remaining portions of the freeway mainline, unless otherwise permitted by the Engineer.

When an off-ramp is closed, the Contractor shall furnish and erect, as directed by the Engineer, a special sign for exit ramp closures (sign SP-3 or SP-5) as shown on the plans.

Special advance notice publicity signs (sign SP-1), as shown on the plans shall be posted as directed by the Engineer, a minimum of 7 days prior to the actual ramp or connector closure. When ramp is closed, public traffic shall be detoured as directed by the Engineer.

Furnishing, erecting, maintaining, and removing special portable freeway detour signs (sign SP-2) along the detour routes as directed by the Engineer shall be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Full compensation for furnishing, erecting, maintaining, and removing special signs for exit ramp closures (SP-3 or SP-5), special advance notice publicity signs (SP-1), and special "WET CONCRETE" (2100 MM X 900 MM, series "D" letter and black on orange) signs as shown on the plans or in these special provisions shall be considered as included in the contract lump sum price paid for traffic control system and no additional payment will be made therefor.

All aforementioned special signs shall become the property of the Contractor at the conclusion of this project and shall be removed from the worksite.

Designated legal holidays are: January 1st, the third Monday in February, the last Monday in May, July 4th, the first Monday in September, November 11th, Thanksgiving Day, and December 25th. When a designated legal holiday falls on a Sunday, the following Monday shall be a designated legal holiday. When November 11th falls on a Saturday, the preceding Friday shall be a designated legal holiday.

Minor deviations from the requirements of this section concerning hours of work which do not significantly change the cost of the work may be permitted upon the written request of the Contractor if in the opinion of the Engineer, public traffic will be better served and the work expedited. These deviations shall not be adopted by the Contractor until the Engineer has approved them in writing. All other modifications will be made by contract change order.

**Chart No. 1
Lane Requirements and Hours of Work**

Location: Northbound Route 14 Freeway - Route 5 to San Fernando Rd. UC

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	1	1	2	2	2	2	2	2	2	3	3	4					4	3	2	2	1	1
Fridays	1	1	1	1	1	2	2	2	2	2	2	3	3	4					4	3	3	2	2	2	2
Saturdays	1	1	1	1	1	1	2	2	2	3	3	3	3	3	3	3	3	3	3	3	2	2	2	2	2
Sundays	1	1	1	1	1	1	1	2	2	2	3	3	3	3	3	3	3	3	3	3	3	2	2	1	1
Working day before designated legal holiday	1	1	1	1	1	2	2	2	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

- Provide at least one through freeway lane open in direction of travel
- Provide at least two through freeway lanes open in direction of travel
- Provide at least three through freeway lanes open in direction of travel
- Provide at least four through freeway lanes open in direction of travel
- No lane closure permitted; work permitted anywhere that does not require freeway lane closure
- No lane closure permitted; no work permitted on north roadway

REMARKS: Number of Through Traffic Lanes - 5 and Var.*

Legend* - Traffic lanes which are outside of the through traffic lanes and are delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

Chart No. 2																								
Lane Requirements and Hours of Work																								
Location: Northbound Route 14 Freeway - San Fernando Rd. UC to Placerita Cyn. Rd. UC																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	1	1	1	1	1	1	2	2	2	2	2	2	2								2	2	1	1
Fridays	1	1	1	1	1	1	2	2	2	2	2	2	2								2	2	1	1
Saturdays	1	1	1	1	1	1	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	1
Sundays	1	1	1	1	1	1	1	1	1	2	2	2	2	2	2	2	2	2	2	2	2	2	1	1
Working day before designated legal holiday	1	1	1	1	1	1	2	2	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1 Provide at least one through freeway lane open in direction of travel

2 Provide at least two through freeway lanes open in direction of travel

No lane closure permitted; work permitted anywhere that does not require freeway lane closure

X No lane closure permitted; no work permitted on north roadway

REMARKS: Number of Through Traffic Lanes - 3 (Does not include HOV lane.)

Chart No. 3																									
Lane Requirements and Hours of Work																									
Location: Southbound Route 14 Freeway - Placerita Cyn. Rd. UC to San Fernando Rd. UC																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	1	2					2	2	2	2	2	2	2	2	2	2	2	2	1	1	1	1
Fridays	1	1	1	1	2					2	2	2	2	2	2	2	2	2	2	2	2	1	1	1	1
Saturdays	1	1	1	1	1	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	1	1	1
Sundays	1	1	1	1	1	1	1	1	1	2	2	2	2	2	2	2	2	2	2	2	2	2	1	1	
Working day before designated legal holiday	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	

Legend:

1 Provide at least one through freeway lane open in direction of travel

2 Provide at least two through freeway lanes open in direction of travel

No lane closure permitted; work permitted anywhere that does not require freeway lane closure

X No lane closure permitted; no work permitted on south roadway

REMARKS: Number of Through Traffic Lanes - 3 (Does not include HOV lane.)

**Chart No. 4
Lane Requirements and Hours of Work**

Location: Southbound Route 14 Freeway - San Fernando Rd. UC to Route 5

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	2		X	X		3	3	2	2	2	2	3	3	2	2	2	2	1	1	1	1	
Fridays	1	1	1	2		X	X		3	3	2	2	2	2	3	3	3	3	3	2	2	2	1	1	1
Saturdays	1	1	1	1	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2	2	1	1
Sundays	1	1	1	1	1	1	2	2	2	3	3	3	3	3	3	3	3	3	3	3	2	2	1	1	
Working day before designated legal holiday	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

- 1 Provide at least one through freeway lane open in direction of travel
- 2 Provide at least two through freeway lanes open in direction of travel
- 3 Provide at least three through freeway lanes open in direction of travel
- 4 Provide at least four through freeway lanes open in direction of travel
- No lane closure permitted; work permitted anywhere that does not require freeway lane closure
- X No lane closure permitted; no work permitted on south roadway

REMARKS: Number of Through Traffic Lanes - 5 and Var.*

Legend* - Traffic lanes which are outside of the through traffic lanes and are delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

Chart No. 5																								
Connector Lane Requirements and Hours of Work																								
Location: Northbound Route 5 Truck Lane to Northbound Route 14																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X					X	X	X	X	X						X	X	X	X	X
Fridays	X	X	X	X	X					X	X	X	X							X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X						X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X																			
Designated legal holidays																								
<p>Legend:</p> <p><input checked="" type="checkbox"/> Connector may be closed</p> <p><input type="checkbox"/> Work permitted that does not require connector lane closure</p>																								
<p>REMARKS:</p> <p>Detour the truck traffic to use auto lane from N/B 5 to N/B 14.</p> <p>Place a PCMS on the right shoulder of Northbound Route 5, 500 meters upstream of the exit to truck lane with the message: "ROUTE 14/TRUCK LANE/CLOSED----DETOUR/USE/AUTO LANE".</p> <p>PCMS = Portable Changeable Message Sign</p>																								

Chart No. 6																								
Connector Lane Requirements and Hours of Work																								
Location: Southbound Route 5 to Northbound Route 14 (Auto and Truck Lane)																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X			X	X	X	X	X	X	X				X	X	X	X	X	X
Fridays	X	X	X	X	X	X			X	X	X	X	X	X	X				X	X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								
<p>Legend:</p> <p><input checked="" type="checkbox"/> Connector may be closed</p> <p><input type="checkbox"/> Work permitted that does not require connector lane closure</p>																								
<p>REMARKS:</p> <p>Detour traffic to continue south on Route 5 and exit at Roxford Street, north to the onramp to Route 5.</p> <p>Place a PCMS on the right shoulder of southbound Route 5, by Welden Canyon OC with the message: "ROUTE 14/EXITS/CLOSED ---- DETOUR/USE/ROXFORD ST".</p> <p>PCMS = Portable Changeable Message Sign</p>																								

Chart No. 7																									
Connector Lane Requirements and Hours of Work																									
Location: Southbound 14 to Southbound Route 5 Truck Lane																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X					X	X	X	X	X	X				X	X	X	X	X	X	
Fridays	X	X	X	X	X					X	X	X	X	X	X				X	X	X	X	X	X	
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Working day before designated legal holiday	X	X	X	X	X																				
Designated legal holidays																									

Legend:

Connector may be closed

Work permitted that does not require connector lane closure

REMARKS:

Detour the truck traffic to use auto lane from S/B 14 to S/B 5.
Place a PCMS on the right shoulder of southbound Route 14, 500 meters upstream of the exit to truck lane with the message: "SOUTH 5/TRUCK LANE/CLOSED ---- DETOUR /USE/AUTO LANE".

PCMS = Portable Changeable Message Sign

Chart No. 8																									
Connector Lane Requirements and Hours of Work																									
Location: Southbound Route 14 to Northbound Route 5																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X			X	X	X	X	X	X	X				X	X	X	X	X	X	
Fridays	X	X	X	X	X	X			X	X	X	X	X	X	X				X	X	X	X	X	X	
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

Connector may be closed

Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to S/B 5 truck lane and exit at The Old Road, north to the on-ramp to N/B Rte 5 Freeway.
Place a PCMS on the right shoulder of S/B 14 Freeway, 500 meters upstream of the S/B 5 truck lane exit with the message: "NORTH 5/EXIT/CLOSED ---- USE/TRUCK LN/TO OLD RD."

PCMS = Portable Changeable Message Sign

Chart No. 9																								
Ramp Lane Requirements and Hours of Work																								
Location: Route 14 - Northbound on-ramp from Sierra Highway																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X			X	X	X	X	X	X						X	X	X	X	X
Fridays	X	X	X	X	X	X			X	X	X	X	X	X						X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								
Legend:																								
<input checked="" type="checkbox"/> Ramp may be closed																								
<input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																								

Chart No. 10																									
Ramp Lane Requirements and Hours of Work																									
Location: Route 14 - Northbound off-ramps to San Fernando Rd.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																		X	X
Saturdays	X	X	X	X	X	X	X	X	X															X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X													X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
<input checked="" type="checkbox"/> Ramp may be closed																									
<input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																									
REMARKS:																									

Chart No. 11																										
Ramp Lane Requirements and Hours of Work																										
Location: Route 14 - Northbound on-ramp from San Fernando Rd.																										
FROM HOUR TO HOUR	a.m.												p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	X	X	X	X	X																		X	X	X	X
Fridays	X	X	X	X	X																		X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X																					
Designated legal holidays																										
Legend: <input checked="" type="checkbox"/> Ramp may be closed <input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																										
REMARKS:																										

Chart No. 12																									
Ramp Lane Requirements and Hours of Work																									
Location: Route 14 - Southbound off-ramp to San Fernando Rd.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X			X	X	X	X	X	X	X	X			X	X	X	X	X	X	X
Fridays	X	X	X	X	X	X			X	X	X	X	X	X	X	X			X	X	X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend: <input checked="" type="checkbox"/> Ramp may be closed <input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																									
REMARKS:																									

Chart No. 13																									
Ramp Lane Requirements and Hours of Work																									
Location: Route 14 - Southbound on-ramp from San Fernando Rd.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X																X	X	X	X	X
Fridays	X	X	X	X	X																X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X									X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X									X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X																				
Designated legal holidays																									
Legend: <input checked="" type="checkbox"/> Ramp may be closed <input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																									
REMARKS:																									

Chart No. 14																									
Ramp Lane Requirements and Hours of Work																									
Location: Route 14 - Southbound off-ramp to Weldon Cyn Rd.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X			X	X	X	X	X	X	X	X	X			X	X	X	X	X	X
Fridays	X	X	X	X	X	X			X	X	X	X	X	X	X	X	X			X	X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend: <input checked="" type="checkbox"/> Ramp may be closed <input type="checkbox"/> Work permitted anywhere that does not require ramp lane closure																									
REMARKS:																									

TABLE 1

PERMISSIBLE HOURS OF LANE CLOSURES FOR
APPROACH SLAB RECONSTRUCTION

Slab/Lane No. Being Replaced	Remove, Replace, and Cure Slabs			
	Lane No. Closed	Closure Hours		
		Friday	Saturday	Sunday
Location: Northbound Route 14 Freeway at Los Pinetos Road UC				
#1	#1 and 2	7:00 pm -----Anytime		
#2 or #1 and 2	#1,2, and 3	9:00 pm -----1:00 pm		
			7:00 pm -----2:00 pm	
#3 or #3 and 4 or #3,4, and 5	#2, 3, 4, and 5	Midnight -----9:00 am		
			Midnight-----10:00 am	
#4 or #4 and 5	#3,4, and 5	9:00 pm -----1:00 pm		
			7:00 pm -----2:00 pm	
#5	#4 and 5	7:00 pm -----Anytime		
Other Closure Requirements				
#1	Open lane #2 during curing period.			
#2 or 1 and 2	Open lane #3 during curing period.			
#3 or 3 and 4 or #3,4, and 5	Open lane #2 during curing period. Close southbound route 5 (auto and truck) connectors to Route 14. Refer to Chart 6 for detour and other requirement			
#4 or 4 and 5	Open lane #3 during curing period. Close southbound Route 5 (auto and truck) connectors to Route 14. Refer to Chart 6 for detour and other requirement.			
#5	Open lane #4 during curing period. Close southbound Route 5 (auto and truck) connectors to Route 14. Refer to Chart 6 for detour and other requirement.			

Note: Outside shoulder slabs may be reconstructed concurrently with the adjacent freeway slab.

TABLE 2

PERMISSIBLE HOURS OF LANE CLOSURES FOR
APPROACH SLAB RECONSTRUCTION

Slab/Lane No. Being Replaced	Remove, Replace, and Cure Slabs			
	Lane No. Closed	Closure Hours		
		Friday	Saturday	Sunday
Location: Southbound Route 14 Freeway at Los Pinetos Road UC				
#1	#1 and 2	6:00 pm -----Anytime		
#2 or #1 and 2	#1,2, and 3	6:00 pm -----10:00 am		
			6:00 pm -----1:00 pm	
#3 or #3 and4 or #3,4, and 5	#2, 3, 4, and 5	9:00 pm -----6:00 am		
			10:00 pm-----7:00 am	
#4 or #4 and 5	#3,4, and 5	6:00 pm -----10:00 am		
			6:00 pm -----1:00 pm	
#5	#4 and 5	6:00 am -----Anytime		
Other Closure Requirements				
#1	Open lane #2 during curing period.			
#2 or 1 and 2	Open lane #3 during curing period.			
#3 or 3 and 4 or #3,4, and 5	Open lane #2 during curing period. Close San Fernando Road on-ramp.			
#4 or 4 and 5	Open lane #3 during curing period. Close San Fernando Road on-ramp.			
#5	Open lane #4 during curing period. Close San Fernando Road on-ramp.			

Note: Outside shoulder slabs may be reconstructed concurrently with the adjacent freeway slab.

10-1.11 CLOSURE REQUIREMENTS AND CONDITIONS

Lane closures shall conform to the provisions in "Maintaining Traffic" of these special provisions and these special provisions.

The term closure, as used herein, is defined as the closure of a traffic lane or lanes, including ramp or connector lanes, within a single traffic control system.

CLOSURE SCHEDULE

By Noon Monday, the Contractor shall submit a written schedule of planned closures for the next week period, defined as Friday Noon through the following Friday Noon.

The Closure Schedule shall show the locations and times when the proposed closures are to be in effect. The Contractor shall use closure schedule request forms furnished by the Engineer for this purpose. Closure schedules submitted with incomplete, unintelligible or inaccurate information will be returned for correction. The Contractor will be notified of disapproved closures or closures that will require coordination with other parties as a condition of approval.

Amendments to the Closure Schedule, including additional closures, shall be submitted to the Engineer, in writing, at least 3 working days in advance of any planned closure. Approval of amendments to the Closure Schedule will be at the discretion of the Engineer.

The Contractor shall confirm, in writing, all scheduled closures by no later than 8:00 a.m. 3 working days prior to the date on which the closure is to be made. Approval or denial of scheduled closures will be made by no later than 4:00 p.m. 2 working days prior to the date on which the closure is to be made. Closures not confirmed or approved will not be allowed.

Confirmed closures that are cancelled due to unsuitable weather may be rescheduled at the discretion of the Engineer for the next working day.

CONTINGENCY PLAN

The Contractor shall prepare a contingency plan for reopening closures to public traffic. The Contractor shall submit the contingency plan for a given operation to the Engineer within one working day of the Engineer's request.

LATE REOPENING OF CLOSURES

If a closure is not reopened to public traffic by the specified time, work shall be suspended in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. The Contractor shall not make any further closures until the Engineer has accepted a work plan, submitted by the Contractor, that will insure that future closures will be reopened to public traffic at the specified time. The Engineer will have 2 working days to accept or reject the Contractor's proposed work plan. The Contractor will not be entitled to any compensation for the suspension of work resulting from the late reopening of closures.

For each 10-minute interval, or fraction thereof past the time specified to reopen the closure, the Department will deduct \$3600.00 per interval from moneys due or that may become due the Contractor under the contract.

COMPENSATION

The Contractor shall notify the Engineer of any delay in the Contractor's operations due to the following conditions, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of those conditions, and the Contractor's loss due to that delay could not have been avoided by rescheduling the affected closure or by judicious handling of forces, equipment and plant, the delay will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09:

- A. The Contractor's proposed Closure Schedule is denied and his planned closures are within the time frame allowed for closures in "Maintaining Traffic" of these special provisions, except that the Contractor will not be entitled to any compensation for amendments to the Closure Schedule that are not approved.
- B. The Contractor is denied a confirmed closure.

Should the Engineer direct the Contractor to remove a closure prior to the time designated in the approved Closure Schedule, any delay to the Contractor's schedule due to removal of the closure will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09.

10-1.12 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE

A traffic control system shall consist of closing traffic lanes and ramps in accordance with the details shown on the plans, the provisions of Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications, the provisions under "Maintaining Traffic" and "Construction Area Signs" elsewhere in these special provisions and these special provisions.

The provisions in this section will not relieve the Contractor from the responsibility to provide additional devices or take the measures as may be necessary to comply with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

During traffic stripe operations and pavement marker placement operations using bituminous adhesive, traffic shall be controlled, at the option of the Contractor, with either stationary or moving type lane closures. During all other operations traffic shall be controlled with stationary type lane closures. The Contractor's attention is directed to the provisions in Section 84-1.04, "Protection From Damage," and Section 85-1.06, "Placement," of the Standard Specifications.

If any component in the traffic control system is displaced, or ceases to operate or function as specified, from any cause, during the progress of the work, the Contractor shall immediately repair the component to its original condition or replace the component and shall restore the component to its original location.

STATIONARY TYPE LANE CLOSURE.—When lane and ramp closures are made for work periods only, at the end of each work period, all components of the traffic control system, except portable delineators placed along open trenches or excavation adjacent to the traveled way, shall be removed from the traveled way and shoulder. If the Contractor so elects, the

components may be stored at selected central locations, approved by the Engineer, within the limits of the highway right of way.

Each vehicle used to place, maintain and remove components of a traffic control system on multilane highways shall be equipped with a Type II flashing arrow sign which shall be in operation when the vehicle is being used for placing, maintaining, or removing the components. Vehicles equipped with Type II flashing arrow sign not involved in placing, maintaining, or removing the components when operated within a stationary type lane closure shall only display the caution display mode. The sign shall be controllable by the operator of the vehicle while the vehicle is in motion. The flashing arrow sign shown on the plans shall not be used on the vehicles which are doing the placing, maintaining and removing of components of a traffic control system, and shall be in place before a lane closure requiring its use is completed.

MOVING TYPE LANE CLOSURE.—Flashing arrow signs used in moving lane closures shall be truck-mounted. Changeable message signs used in moving lane closure operations shall conform to Section 12-3.12, "Portable Changeable Message Signs," of the Standard Specifications, except the signs shall be truck-mounted and the full operation height of the bottom of the sign may be less than 2.1 m above the ground, but should be as high as practicable.

Truck-mounted crash cushions (TMCC) for use in moving lane closures shall be any of the following approved models, or equal:

Hexfoam TMA Series 3000, Alpha 1000 TMA Series 1000, Alpha 2001 TMA Series 2001, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone (312) 467-6750.

Distributor(Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX (916) 387-9734.

Distributor(Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274.

Cal T-001 Model 2 or Model 3, manufacturer and distributor; Hexcel Corporation, 11711 Dublin Boulevard, P.O. Box 2312, Dublin, CA 94568, Telephone (510) 828-4200.

Renco Rengard Model Nos. CAM 8-815 and RAM 8-815, manufacturer and distributor, Renco Inc., 1582 Pflugerville Loop Road, P.O. Box 730, Pflugerville, TX 78660-0730, Telephone 1-800-654-8182.

Each TMCC shall be individually identified with the manufacturer's name, address, TMCC model number, and a specific serial number. The names and numbers shall each be a minimum 13 mm high, and located on the left (street) side at the lower front corner. The TMCC shall have a message next to the name and model number in 13 mm high letters which states, "The bottom of this TMCC shall be _____ mm \pm _____ mm above the ground at all points for proper impact performance." Any TMCC which is damaged or appears to be in poor condition shall not be used unless recertified by the manufacturer. The Engineer shall be the sole judge as to whether used TMCCs supplied under this contract need recertification. Each unit shall be certified by the manufacturer to meet the requirements for TMCCs in accordance with the standards established by the Transportation Laboratory Structures Research Section.

Approvals for new TMCC designs proposed as equal to the above approved models shall be in accordance with the procedures (including crash testing) established by the Transportation Laboratory Structures Research Section. For information regarding submittal of new designs for evaluation contact: Transportation Laboratory, Structures Research Section, P.O. Box 19128, 5900 Folsom Boulevard, Sacramento, CA 95819.

New TMCCs proposed as equal to approved TMCCs or approved TMCCs determined by the Engineer to need recertification shall not be used until approved or recertified by the Transportation Laboratory Structures Research Section.

PAYMENT.—The contract lump sum price paid for traffic control system shall include full compensation for furnishing all labor, materials (including signs), tools, equipment and incidentals, and for doing all the work involved in placing, removing, storing, maintaining, moving to new locations, replacing and disposing of the components of the traffic control system as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The adjustment provisions in Section 4-1.03, "Changes," of the Standard Specifications, shall not apply to the item of traffic control system. Adjustments in compensation for traffic control system will be made only for increased or decreased traffic control system required by changes ordered by the Engineer and will be made on the basis of the cost of the increased or decreased traffic control necessary. The adjustment will be made on a force account basis as provided in Section 9-1.03, "Force Account Payment," of the Standard Specifications for increased work, and estimated on the same basis in the case of decreased work.

Traffic control system required by work which is classed as extra work, as provided in Section 4-1.03D of the Standard Specifications, will be paid for as a part of the extra work.

10-1.13 BARRICADES

Barricades shall be furnished, placed, and maintained at locations shown on the plans, specified in the Standard Specifications or in these special provisions or designated by the Engineer. Barricades shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Type II reflective sheeting for stripes on barricade rail faces shall conform to the provisions in "Approved Traffic Products" of these special provisions.

Construction area sign and marker panels conforming to the provisions in Section 12-3.06, "Construction Area Signs," of the Standard Specifications shall be installed on barricades as directed by the Engineer at the locations shown on the plans.

Sign panels for construction area signs and marker panels installed on barricades shall conform to the provisions in Section 12-3.06A, "Stationary Mounted Signs," of the Standard Specifications.

Full compensation for furnishing, installing, maintaining, and removing construction area signs and markers on barricades shall be considered as included in the contract lump sum price paid for construction area signs and no separate payment will be made therefor.

Barricades shown on the plans as part of a traffic control system will be paid for as provided in "Traffic Control System for Lane Closure," of these special provisions, and will not be included in counts for payment for barricades.

10-1.14 PORTABLE CHANGEABLE MESSAGE SIGN

Portable changeable message signs shall be furnished, placed, operated, and maintained at locations provided for in these special provisions and shall conform to the provisions of Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to Charts 5 through 8 in "Maintaining Traffic" of these special provisions concerning the use and locations of the portable changeable message signs.

Full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing, placing, operating, maintaining, repairing, replacing, transporting from location to location, and removing the portable changeable message signs as specified in these special provisions shall be considered as included in the contract lump sum price paid for traffic control system and no additional payment will be made therefor.

10-1.15 TEMPORARY RAILING

Temporary railing (Type K) shall be placed as shown on the plans, specified in the Standard specifications or in these special provisions or ordered by the Engineer, and shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

The fourth paragraph of Section 12-4.01, "Measurement and Payment," of the Standard Specifications is amended to read:

When the Engineer's Estimate includes a contract item for temporary railing (Type K), the temporary railing (Type K) will be measured by the meter along the top of the railing, at each location shown on the plans, specified, or ordered by the Engineer. If the Engineer orders a lateral move of the temporary railing (Type K), and the repositioning is not shown on the plans, moving the temporary railing will be paid for as extra work as provided in Section 4-1.03D and the temporary railing will not be measured in the new position. Temporary railing (Type K) placed in excess of the length shown, specified, or ordered will not be paid for. The contract price paid per meter for temporary railing (Type K) shall include full compensation for furnishing all labor, materials (including reinforcement and Type P marker panels), tools, equipment and incidentals, and for doing all the work involved in furnishing, placing, maintaining, repairing, replacing, and removing the temporary railing, including excavation and backfill, drilling holes and bonding threaded rods or dowels when required, removing threaded rods or dowels and filling the drilled holes with mortar, furnishing and installing reflectors, and moving and replacing removable panels as required, complete in place, as shown on the plans, as specified in these specifications and the special provisions, and as directed by the Engineer.

Reflectors on temporary railing (Type K) shall conform to the provisions in "Approved Traffic Products" of these special provisions.

Attention is directed to "Maintaining Traffic" elsewhere in these special provisions regarding temporary traffic screen provided at the Contractor's option.

Temporary railing (Type K), conforming to the details shown on 1995 Standard Plan T3 or 1992 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance and vertical holes are not drilled in the top of the temporary railing to secure temporary traffic screen to the temporary railing.

The Contractor's attention is directed to the provisions in "Public Safety" and "Order of Work" of these special provisions.

Temporary railing (Type K) placed in conformance with the provisions in "Public Safety" of these special provisions will be neither measured nor paid for.

Full compensation for reflectors and adhesive for temporary railing (Type K) shall be considered as included in the contract unit price paid per meter for temporary railing (Type K) and no additional compensation will be allowed therefor.

Temporary terminal section (Type K) for connecting temporary railing (Type K) to Type 50 concrete barrier shall consist of either new or undamaged used precast units, as shown on the plans. Fabricating, placing, painting and removal of the units shall conform to the requirements specified for temporary railing (Type K).

Closure plate for the temporary terminal section (Type K) shall be of a good commercial quality steel shaped to conform to cross section of the barriers. Mechanical expansion anchors for connecting closure plate to railings shall conform to the provisions specified for concrete anchorage devices in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

Temporary terminal section (Type K) will be measured and paid for by the unit from actual count.

The contract unit price paid for temporary terminal section (Type K) shall include full compensation for furnishing all labor, materials (including reinforcement and concrete anchorage devices), tools, equipment, and incidentals, and for doing all the work involved in furnishing, placing, maintaining, repairing, replacing and removing temporary terminal section (Type K), complete in place, including excavation, backfill, grout and concrete, and connecting to concrete barrier, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.16 TEMPORARY TRAFFIC SCREEN

Temporary traffic screen shall be furnished, installed, and maintained on top of temporary railing (Type K) as specified elsewhere in these special provisions, and shall conform to the requirements specified for traffic handling equipment and devices in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to "Maintaining Traffic" of these special provisions regarding temporary traffic screen provided at the Contractor's option.

Temporary traffic screen panels shall be new or used CDX Grade, or better, plywood or weather resistant strandboard mounted and anchored on temporary railing (Type K). Wale boards shall be new or used Douglas fir, rough sawn, Construction Grade, or better. Pipe screen supports shall be new or used galvanized steel pipe, Schedule 40. Nuts, bolts and washers shall be cadmium plated. Screws shall be black or cadmium plated flat head, cross slotted screws with full thread length.

When no longer required, as determined by the Engineer, temporary traffic screen shall be removed from the site of the work.

10-1.17 TEMPORARY CRASH CUSHION MODULE

This work shall consist of furnishing, installing and maintaining sand filled temporary crash cushion modules in groupings or arrays at each location shown on the plans, specified in the special provisions or directed by the Engineer. The grouping or array of sand filled modules shall form a complete sand filled temporary crash cushion in accordance with the details shown on the plans and these special provisions.

Attention is directed to "Public Safety" of these special provisions.

GENERAL

Whenever the work or the Contractor's operations establishes a fixed obstacle, the exposed fixed obstacle shall be protected with a sand filled temporary crash cushion. The sand filled temporary crash cushion shall be in place prior to opening the lanes adjacent to the fixed obstacle to public traffic.

Sand filled temporary crash cushions shall be maintained in place at each location, including times when work is not actively in progress. Sand filled temporary crash cushions may be removed during a work period for access to the work provided that the exposed fixed obstacle is 4.6 m or more from a lane carrying public traffic and the temporary crash cushion is reset to protect the obstacle prior to the end of the work period in which the fixed obstacle was exposed. When no longer required, as determined by the Engineer, sand filled temporary crash cushions shall be removed from the site of the work.

MATERIALS

At the Contractor's option, the modules for use in sand filled temporary crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules manufactured after March 31, 1997, or equal:

Energite III Inertial Modules manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone 1-312-467-6750, FAX 1-800-770-6755.

Distributor (Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX 1-916-387-9734

Distributor (Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274, FAX 1-714-937-1070.

Fitch Inertial Modules, national distributor; Roadway Safety Service, Inc., 1050 North Rand Road, Wauconda, IL 60084, Telephone 1-800-426-0839, FAX 1-847-487-9820.

Distributor: Singletree Sales Company, 1533 Berger Drive, San Jose, CA 95112, Telephone 1-800-822-7735, FAX 1-408-287-1929.

Modules contained in each temporary crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color as furnished by the vendor, with black lids. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects. The modules need not be new. Good used undamaged modules conforming to color and quality of the types specified above may be utilized. If used Fitch modules requiring a seal are furnished, the top edge of the seal shall be securely fastened to the wall of the module by a continuous strip of heavy duty tape.

Modules shall be filled with sand in accordance with the manufacturer's directions, and to the sand capacity in kilograms for each module as shown on the plans. Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water, as determined by California Test 226.

Modules damaged due to the Contractor's operations shall be repaired immediately by the Contractor at the Contractor's expense. Modules damaged beyond repair, as determined by the Engineer, due to the Contractor's operations shall be removed and replaced by the Contractor at the Contractor's expense.

INSTALLATION

Temporary crash cushion modules shall be placed on movable pallets or frames conforming to the dimensions shown on the plans. The pallets or frames shall provide a full bearing base beneath the modules. The modules and supporting pallets or frames shall not be moved by sliding or skidding along the pavement or bridge deck.

A Type R or P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods approved by the Engineer.

At the completion of the project, temporary crash cushion modules, sand filling, pallets or frames, and marker panels shall become the property of the Contractor and shall be removed from the site of the work. Temporary crash cushion modules shall not be installed in permanent work.

MEASUREMENT AND PAYMENT

Temporary crash cushion modules placed in accordance with the provisions in "Public Safety" elsewhere in these special provisions will not be measured nor paid for.

10-1.18 EXISTING HIGHWAY FACILITIES

The work performed in connection with various existing highway facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

Attention is directed to "Bridge Removal" elsewhere in these special provisions.

Except as otherwise provided for damaged materials in Section 15-2.04, "Salvage," of the Standard Specifications, the materials to be salvaged shall remain the property of the State, and shall be cleaned, packaged, bundled, tagged, and hauled to the District Recycle Center at North Hollywood Yard, 11210 Moor Park, Los Angeles, CA 91602 and stockpiled.

The Contractor shall notify the Engineer and the District Recycle Coordinator, telephone (213) 620-6179 a minimum of 48 hours prior to hauling salvaged material to the Recycle Center.

Plans of the existing bridges may be requested by fax from the Office of Structure Maintenance and Investigations, 1801 30th Street, Sacramento, California, Fax (916) 227-8357, and are available at the Office of Structure Maintenance and Investigations, Los Angeles, California, Telephone (213) 897-6156.

Plans of existing bridges available to the Contractor are reproductions of the original contract plans with significant changes noted and working drawings and do not necessarily show normal construction tolerances and variances. Where dimensions of new construction required by this contract are dependent on the dimensions of existing bridges, the Contractor shall verify the controlling field dimensions and shall be responsible for adjusting dimensions of the work to fit existing conditions.

10-1.18A REMOVE TRAFFIC STRIPES AND PAVEMENT MARKINGS

Traffic stripes and pavement markings to be removed shall be removed at the locations shown on the plans and at the locations designated by the Engineer.

The first paragraph of Section 15-2.02B, "Traffic Stripes and Pavement Markings," of the Standard Specifications is amended to read:

15-2.02B Traffic Stripes and Pavement Markings.—Traffic stripes and pavement markings shall be removed by any method that does not materially damage the existing pavement. Pavement marking images shall be removed in such a manner that the old message cannot be identified. Where grinding is used, the pavement marking image shall be removed by grinding a rectangular area. The minimum dimensions of the rectangle shall be the height and width of the pavement marking. Residue resulting from removal operations shall be removed from pavement surfaces by sweeping or vacuuming before the residue is blown by the action of traffic or wind, migrates across lanes or shoulders, or enters into drainage facilities.

Section 15-2.07, "Payment," of the Standard Specifications is amended by adding the following paragraph:

Full compensation for any additional grinding outside the limits of the existing pavement marking image to obtain a rectangular area shall be considered as included in the contract price paid for the item of work involved and no additional compensation will be allowed therefor.

Nothing in these special provisions shall relieve the Contractor from the Contractor's responsibilities as provided in Section 7-1.09, "Public Safety," of the Standard Specifications.

The cost of removing traffic stripes and pavement markers on existing surfacing to be removed will be paid for by the item that removed the stripes and markers and no additional payment will be made therefor.

10-1.18B REMOVE PAVEMENT MARKERS

Pavement markers, including underlying adhesive, where shown on the plans to be removed and when no longer required for traffic lane delineation as directed by the Engineer, shall be removed and disposed of.

Attention is directed to "Remove Traffic Stripes and Pavement Markings" elsewhere in these special provisions.

Full compensation for removing and disposing of underlying adhesive shall be considered as included in the contract price paid for remove pavement marker and no separate payment will be made therefor.

10-1.18C REMOVE ROADSIDE SIGNS AND SIGN PANELS

Existing roadside signs, at locations shown on the plans to be removed, shall be removed and disposed of.

Sign panels, as shown on the plans to be removed, shall be removed and disposed of.

Existing roadside signs and sign panels shall not be removed until replacement signs have been installed or until the existing signs are no longer required for the direction of public traffic, unless otherwise directed by the Engineer.

10-1.18D REMOVE DRAINAGE FACILITIES

Existing pipes and inlets where shown on the plans to be removed, shall be completely removed and disposed of.

Frames and grates shall be removed and reused in the work as shown on the plans.

Full compensation for removing and reusing frames and grates shall be considered as included in the contract price paid for the item of work the frame and grate is reused on.

10-1.18E REMOVE PORTLAND CEMENT CONCRETE PAVEMENT

Removing portland cement concrete pavement shall conform to the provisions in Section 15-3, "Removing Concrete," of the Standard Specifications.

Where no joint exists in the pavement on the line at which concrete is to be removed, a straight, neat cut with a power-driven saw shall be made along the line to the full depth of the concrete before removing concrete.

Pavement removal shall be performed without damage to the base that is to remain in place. Damage to the base which is to remain in place shall be repaired to a condition satisfactory to the Engineer, or the damaged base shall be removed and replaced with new base if ordered by the Engineer. Repairing or removing and replacing damaged base shall be at the Contractor's expense and will not be measured nor paid for.

Transverse weakened plane joints shall be constructed to match the spacing and skew of existing transverse weakened plane joints in the adjacent concrete pavement. If transverse weakened plane joints are to be sawed, the exact time of sawing shall be the Contractor's responsibility, but in any event, the joints shall be sawed prior to opening the pavement to traffic.

The quantities of portland cement concrete pavement removed will be measured and paid for by the square meter.

No deduction will be made from any excavation quantities for the quantity of portland cement concrete pavement removed.

Full compensation for removing bituminous or other overlying material and sawing joints at removal lines, as required, shall be considered as included in the contract price paid per square meter for remove concrete pavement and no additional compensation will be allowed therefor.

10-1.18F RELOCATE ROADSIDE SIGNS

Existing roadside signs shall be removed and relocated at new locations shown on the plans.

Each roadside sign shall be installed at the new location on the same day that the sign is removed from its original location.

Two holes shall be drilled in each existing post as required to provide a breakaway feature as shown on the plans.

10-1.18G REMOVE CONCRETE BARRIER

Concrete barrier, designated on the plans to be removed, shall be removed.

The pay quantities of concrete barrier to be removed will be measured and paid for by the meter, measured along the centerline before removal operations.

Concrete removed shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications.

10-1.18H CAP INLETS

Existing pipe and drainage inlets where shown on the plans to be capped, shall be capped and the bottoms of the inlets shall be rounded with portland cement concrete as shown on the plans.

Portland cement concrete shall conform to the provisions in Section 90-10, "Minor Concrete," of the Standard Specifications, or may be produced from commercial quality aggregates and cement containing not less than 350 kg of cement per cubic meter.

Inlets shall be removed to a depth of at least 0.3-m below the grading plane.

Concrete removal shall be performed without damage to any portion that is to remain in place. All damage to the existing concrete, which is to remain in place, shall be repaired by the Contractor to a condition equal to that existing prior to the beginning of removal operations. The repair of existing concrete damaged by the Contractor's operations shall be at the Contractor's expense.

Existing reinforcement that is to be incorporated in new work shall be protected from damage and shall be thoroughly cleaned of all adhering material before being embedded in new concrete.

The quantity of capping inlets will be determined as units from actual count.

The contract unit price paid for cap inlet shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in capping inlets, including removing portions of inlets, rounding bottoms of inlets, constructing abandonment seals, bar reinforcing steel, and structure excavation and structure backfill, as shown on the plans, as specified in the Standard Specifications and these special provisions and as directed by the Engineer.

10-1.18I BRIDGE REMOVAL

Removing portions of bridge shall conform to the requirements in Section 15-4, "Bridge Removal," of the Standard Specifications and these special provisions.

Bridge removal (portion) shall consist of removing the overhangs, barrier, metal bridge railing and portions of wingwalls.

Metal bridge railing shall be salvaged.

All removed materials that are not to be salvaged or used in the reconstruction shall become the property of the Contractor and shall be disposed outside the highway right of way in accordance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

The following additional requirements apply to the removal of portions of bridges whenever the removal work is to be performed over traffic:

A protective cover supported by falsework or members of the existing structure shall be constructed before beginning bridge removal work.

The construction and removal of the protective cover and the installation and removal of temporary railings shall conform to the requirements under "Order of Work" "Maintaining Traffic" and "Temporary Railings" of these special provisions.

The protective cover shall prevent any materials, equipment or debris from falling onto the traffic. The protective cover shall have a minimum strength equivalent to that provided by good, sound Douglas fir planking having a nominal thickness of 50 mm. Additional layers of material shall be furnished as necessary to prevent fine materials or debris from sifting down upon the traveled way and shoulders.

The protective cover shall conform to the provisions for falsework in Section 51-1.06, "Falsework," of the Standard Specifications.

The Contractor shall be responsible for designing and constructing a safe and adequate protective cover, and shoring and falsework needed to support the protective cover, all with sufficient strength and rigidity to support the entire load to be imposed.

Bridge removal methods shall be described in the working drawings and calculations in sufficient detail to substantiate live loads used in the protective cover design. Dead and live load values assumed for designing the protective cover shall be shown on the working drawings.

At locations where the bridge railing is to be removed, the protective cover shall extend from, face of exterior girder or at least 0.6-m inside of the bridge railing to be removed whichever is less, to at least 1.2 m beyond the outside face of the bridge railing.

During the removal of bridge segments, and when portions of the bridge, such as deck slabs or box girder slabs, comply with the requirements for the protective cover, a separate protective cover need not be constructed.

Before removal, the protective cover shall be cleaned of all debris and fine material.

The protective cover shall provide the openings specified under "Maintaining Traffic" of these special provisions, except that when no openings are specified for bridge removal a vertical opening of 4.4 m and a horizontal opening of 3.7 m shall be provided for the passage of public traffic.

Falsework or supports for protective cover shall not extend below the vertical clearance level nor to the ground line at any location within the roadbed.

The construction of the protective cover as herein specified shall in no way be construed to relieve the Contractor of responsibilities specified in Sections 7-1.121, "Indemnification," and 7-1.122, "Insurance," of the Standard Specifications.

10-1.19 EARTHWORK

Earthwork shall conform to the provisions in Section 19, "Earthwork," of the Standard Specification and these special provisions.

Attention is directed to "Remove Traffic Stripes and Pavement Marking" elsewhere in these special provisions.

Surplus excavated material shall become the property of the Contractor and shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications.

Where a portion of existing surfacing is to be removed, the outline of the area to be removed shall be cut on a neat line with a power-driven saw to a minimum depth of 50 mm before removing the surfacing. Full compensation for cutting existing surfacing shall be considered as included in the contract price paid per cubic meter for roadway excavation and no additional compensation will be allowed therefor.

MEASUREMENT AND PAYMENT (EARTHWORK)

Measurement and payment for earthwork shall conform to all provisions for "Measurement" and "Payment" in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

Pervious backfill material in connection with the bridge work will be measured and paid for as structure backfill (bridge).

If structure excavation or structure backfill involved in bridges is not otherwise designated by type, and payment for the structure excavation or structure backfill has not otherwise been provided for in the Standard Specifications or these special provisions, the structure excavation or structure backfill will be paid for at the contract price per cubic meter for structure excavation (bridge) or structure backfill (bridge).

10-1.20 CONTROLLED LOW STRENGTH MATERIAL

Controlled low strength material shall consist of a workable mixture of aggregate, cementitious materials and water, and shall conform to the provisions in Section 19-3, "Structure Excavation and Backfill," of the Standard Specifications and these special provisions.

At the option of the Contractor, controlled low strength material may be used as structure backfill for pipe culverts, except that controlled low strength material shall not be used as structure backfill for culverts having a span greater than 6.1 m.

When controlled low strength material is used for structure backfill, the width of the excavation shown on the plans may be reduced so that the clear distance between the outside of the pipe and the side of the excavation, on each side of the pipe, is a minimum of 300 mm. This minimum may be reduced to 150 mm when, either the height of cover is less than or equal to 6.1 m or the pipe diameter or span is less than 1050 mm.

Controlled low strength material in new construction shall not be permanently placed higher than the basement soil. For trenches in existing pavements, permanent placement shall be no higher than the bottom of any existing pavement permeable drainage layer. If a drainage layer does not exist, permanent placement in existing pavements shall be no higher than 25 mm below the bottom of the existing asphalt concrete, or no higher than the top of base below the existing Portland cement concrete pavements. The minimum height that controlled low strength material shall be placed, relative to the pipe invert, is 0.5D (D=Diameter) for rigid pipe and 0.7D for flexible pipe.

When controlled low strength material is proposed for use, the Contractor shall submit a mix design and test data to the Engineer for approval prior to excavating the trench for which controlled low strength material is proposed for use. The test data shall demonstrate that the mix design provides:

- a) For pipe culverts having a height of cover of 6.1 m or less, a 28-day compressive strength between 345 and 690 kPa is required; for height of cover greater than 6.1 m, a minimum 28-day compressive strength of 690 kPa is required. Compressive strength shall be determined by ASTM Designation: D 4832, "Preparation and Testing of Soil-Cement Slurry Test Cylinders."
- b) When controlled low strength material is used as structure backfill for pipe culverts, the sections of pipe culvert in contact with the controlled low strength material shall meet the requirements of Chapter 850 of the Highway Design Manual using the minimum resistivity, pH, chloride content, and sulfate content of the hardened controlled low strength material. Minimum resistivity and pH shall be determined by California Test 643, the chloride content shall be determined by California Test 422 and the sulfate content shall be determined by California Test 417.
- c) Cement shall be any type of Portland cement conforming to the provisions of ASTM Designation: C 150; or any type of blended hydraulic cement conforming to either ASTM Designation: C 595M or the physical requirements of ASTM Designation: C 1157M. Testing of cement will not be required.
- d) Admixtures may be used in conformance with Section 90-4, "Admixtures," of the Standard Specifications. Chemical admixtures containing chlorides as Cl in excess of one percent by mass of admixture, as determined by California Test 415, shall not be used.

Materials for controlled low strength material shall be thoroughly machine-mixed in a pugmill, rotary drum, or other approved mixer. Mixing shall continue until the cementitious material and water are thoroughly dispersed throughout the material. Controlled low strength material shall be placed in the work within 3 hours after introduction of the cement to the aggregates.

Controlled low strength material shall be placed in a uniform manner that will prevent voids in, or segregation of, the backfill, and will not float or shift the culvert. Foreign material which falls into the trench prior to or during placing of the controlled low strength material shall be immediately removed.

When controlled low strength material is to be placed within the traveled way or otherwise to be covered by paving or embankment materials, the material shall achieve a maximum indentation diameter of 76 mm prior to covering and opening to traffic. Penetration resistance shall be as measured by ASTM Designation: C 6024, "Standard Test Method for Ball Drop on Controlled Low Strength Material to Determine Suitability for Load Application."

Controlled low strength material used as structure backfill for pipe culverts will be considered structure backfill for compensation purposes.

10-1.21 AGGREGATE BASE

Aggregate base shall be Class 3 and shall conform to the provisions in Section 26, "Aggregate Bases," of the Standard Specifications and these special provisions.

The first paragraph of Section 26-1.02B, "Class 3 Aggregate Base," of the Standard Specifications is amended by adding the following sentences:

Aggregate may include or consist of material processed from reclaimed asphalt concrete, portland cement concrete, lean concrete base, cement treated base, glass or a combination of any of these materials. Aggregate base incorporating reclaimed glass shall not be placed at locations where surfacing will not be placed over the aggregate base.

Aggregate for Class 3 aggregate base shall conform to the following requirements:

Sieve Sizes	Grading Requirements (Percentage Passing)			
	37.5-mm Maximum		19-mm Maximum	
	Operating Range	Contract Compliance	Operating Range	Contract Compliance
50-mm	100	100	-----	-----
37.5-mm	90 - 100	87 - 100	-----	-----
25-mm	-----	-----	100	100
19-mm	50 - 90	45 - 95	90 - 100	87 - 100
4.75-mm	25 - 60	20 - 65	40 - 70	35 - 75
600-µm	10 - 35	6 - 39	12 - 40	7 - 45
75-µm	3 - 15	0 - 19	3 - 15	0 - 19

Quality Requirements		
Tests	Operating Range	Contract Compliance
Sand Equivalent	21 Min.	18 Min.
Resistance (R-value)	-----	50 Min.

10-1.22 LEAN CONCRETE BASE

Lean concrete base shall conform to the provisions in Section 28, "Lean Concrete Base," of the Standard Specifications.

10-1.23 CONCRETE PAVEMENT

Portland cement concrete pavement shall conform to the provisions in Section 40, "Portland Cement Concrete Pavement," of the Standard Specifications and these special provisions.

Profile indexing and profile grinding of existing concrete pavement shall be performed prior to placing new concrete pavement and shall be performed in accordance with Section 40-1.10, "Final Finishing," of the Standard Specifications, except that the profile shall be run on the existing median and outside lanes at a distance of 0.3 meters from the edge of pavement and as directed by the Engineer. Full compensation for profile indexing and profile grinding of existing concrete pavement shall be considered as included in the contract price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

Transverse weakened plane joints in concrete pavement shall match existing pavement weakened plane joints and skew and shall be constructed as specified in Section 40-1.08B, "Weakened Plane Joints," and Section 40-1.08B(1), "Sawing Method," of the Standard Specification, using a power-driven concrete saw. The insert method shall not be used.

Tie bars shall be installed at longitudinal joints between portland cement concrete shoulders and adjacent traffic lanes and at transverse contact joints, as shown on the plans. Tie bars shall be deformed reinforcing steel bars conforming to the specifications of ASTM Designation: A 615/A 615M, Grade 300 or 400, ASTM Designation: A 616/A 616M, Grade 350 or 400, or ASTM Designation: A 706/A 706M, and shall be epoxy-coated as specified in Section 52-1.02B, "Epoxy-coated Bar Reinforcement," of the Standard Specifications.

The joint detail shown on the plans for transverse and longitudinal joints, including the foam backer rod and silicone joint sealant shown on the plans, shall not apply.

10-1.23A DRILL AND GROUT TIE BARS

Drilling and grouting tie bars shall conform to the details shown on the plans, the provisions in Section 51-1.13, "Bonding," of the Standard Specifications and these special provisions.

Tie bars shall conform to the provisions for bar reinforcement in "Reinforcement" elsewhere in these special provisions.

Epoxy-coated reinforcing steel tie bars shall be installed in all longitudinal joints between new concrete pavement and existing concrete pavement as shown on the plans,

Drilling and grouting tie bars will be measured by the unit.

The contract unit price paid for drill and grout tie bars shall include full compensation for furnishing all labor, materials, tools, equipment and incidentals, and for doing all work involved in furnishing and installing tie bars, complete in place, including epoxy-coated reinforcing steel, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.23B DOWEL (SMOOTH, EPOXY COATED)

Dowels shall conform to the provisions in Section 75, "Miscellaneous Metal", of the Standard Specifications and these special provisions.

Dowel bars shall be epoxy-coated in accordance with Section 52-1.02B, "Epoxy-coated Bar Reinforcement", of the Standard Specifications.

Dowel bars shall be required for transverse weakened plane joints where shown on the plans.

Dowel bars shall be placed parallel to the pavement surface and centerline within a tolerance of 12.7 mm in 457.2 mm.

The forward movement of the finishing beam or screed shall not be interrupted by the inserting of the dowel bars.

A positive means of marking the locations of the transverse joints shall be provided.

Dowel bars shall be plain, round, smooth, free from burrs or other deformations detrimental to free movement in the concrete. Dowel bars of the size and length shown on the plans and with at least one end sawed shall be provided. Dowel bars shall be Corrosion Resistant Dowel Bars meeting the requirements of AASHTO M254, Type B, except the core material shall be of steel meeting the requirements of AASHTO M31, grade 300 or 400, or the equivalent, except that the bend test will not be required. The coating material shall meet the coating material requirements of AASHTO M284. The cut ends of the dowel bars shall be coated. An approved parting compound shall be applied uniformly to the epoxy-coated bar before the insertion in the concrete. The type of parting compound used shall be as recommended by the coating manufacturer. Certified test results showing compliance with all requirements of AASHTO M254 shall be submitted to the Engineer for approval. In particular, the Contractor's attention is directed to the Pull-Out Test requirement of AASHTO M254. The Pull-Out Test shall be performed on bars to which the proposed bond breaker has been applied, and the test report shall identify the type of parting compound used.

Dowel bars shall be placed by one of the following methods:

1. Automatic Dowel Bar Inserter Method. The automatic dowel bar inserter shall have a successful performance history. The Contractor shall submit documentation regarding performance history of the dowel bar inserter for approval. The pavement shall be placed and consolidated to full depth before insertion of the dowel bars. Dowel bars shall be inserted into the concrete ahead of the finishing beam or screed.
2. Wire Basket Method. Wire basket type supports specifically manufactured for this purpose shall be used. The type of dowel supporting baskets as well as the method of anchoring shall be determined by the Contractor. The proposed method of using wire basket supports, including shop drawings of the proposed dowel baskets and proposed method of anchoring the dowel baskets shall be submitted by the Contractor to the Engineer for approval. Dowel bars may be tack welded at alternating ends, to the basket assemblies, to prevent slippage. No portion of the dowel support assembly shall cross the transverse joint. Dowel bar assemblies shall be securely anchored and constructed to firmly hold all the dowel bars at the specified depth and alignment. Spacer wires shall be removed after the assemblies are staked in position. Paving shall not be started until the assemblies are in place and approved at least 61 m in advance of the paving. Paving shall be stopped at any time that approved assemblies are not in place at least 61 m in advance of the concrete placement operation. This requirement may be waived by the Engineer upon written request by the Contractor and approval by the Department, in areas where access is restricted, or other construction limitations are encountered. Approval of the initial placement of basket assemblies shall not constitute acceptance of the final position of the dowel bars. The concrete shall be consolidated around the dowel bars such that no voids exist. Supplemental use of hand held vibrators will not be allowed.

Regardless of the placement method chosen by the Contractor, after the initial day's placement of the concrete pavement, the Contractor shall suspend his operations until the Engineer has sufficient time to inspect dowel positioning to insure proper placement of the dowels is being achieved.

The Contractor shall perform coring of the initial concrete placement, as directed by the Engineer, as part of the dowel placement tolerance verification. A minimum of six bars shall be cored. Additional coring shall be provided by the Contractor throughout the project to confirm dowel placement as directed by the Engineer.

Dowel and tie bar positioning will be randomly checked by the Engineer by coring or other methods. Each days paving will be checked by the Engineer within 2 calendar days by performing one test for every 1672 square meters of doweled pavement or fraction thereof. One test shall consist of drilling 2 cores, one on each end of a dowel bar to expose both ends and allow measurement. If the dowel bars are located incorrectly or air voids exist surrounding the dowel bars, additional cores will be required to determine the severity. The location of performing the test shall be selected by the Engineer. Joints containing dowels that do not meet specifications will be rejected. The Contractor shall replace rejected joints by an approved method. No additional payment will be made for replacement of slabs and joints required due to joints (dowel placement) not meeting the specified tolerances.

The positioning of dowels shall be controlled by the Contractor in a manner such that dowels meet the specified tolerances. If at any time dowels are found to be installed improperly, the paving operations will be suspended and operations shall not begin until the Contractor has demonstrated to the Engineer that the problem which caused the improper dowel positioning has been corrected.

Contact joints are those made by placing fresh concrete against hardened concrete at planned locations.

Concrete on both sides of longitudinal contact joints shall be connected with tie bars as shown on the plans.

When the plans require the construction of keyways, the groover portion of the keyway shall be constructed as part of the pavement width being placed.

Transverse weakened plane joints for plain jointed (non-doweled) concrete pavement sections, when adjacent to existing permanent pavements, shall be spaced to match abutting joints or random cracks. Joints shall be matched in location to joints in adjacent slabs or as directed by the Engineer.

Sawed joints shall be constructed before uncontrolled pavement cracking occurs; however, joints shall not be sawed until the concrete has hardened enough to prevent tearing or raveling during the sawing operations. The exact time when sawing will be done shall be determined by the Contractor, but in no case more than 2 hours after final finishing.

Any procedure used to saw joints which results in premature uncontrolled cracking shall be revised immediately. The Contractor shall repair damaged areas or random cracks as specified herein and as directed by the Engineer. Any spalled or chipped concrete along the joints shall be repaired as approved by the Engineer.

Volunteer cracks and spalls and raveling or tearing at sawed joints shall be repaired as hereinafter provided prior to opening the pavement to public traffic.

Volunteer cracks shall be classified as either plastic shrinkage cracks or random cracks.

Plastic shrinkage cracks are generally those which do not usually penetrate the depth of the slab. They may appear either as irregular "map cracking" or as short irregular cracks roughly parallel to each other. The crack length is generally from a few millimeters to a few meters and cracks are usually spaced from a few millimeters to 0.61 m apart. They are normally caused by too rapid evaporation of water from the surface. They occur soon after the concrete has been placed.

Plastic shrinkage cracks shall be repaired as hereinafter specified for volunteer cracks unless the cracks exceed 4 meters in cumulative length within a slab area. In such case the slab shall be removed and replaced. Only cracks measuring more than 0.3 meters in length shall be used to measure the cumulative length of cracks per slabs. The area of plastic shrinkage cracking in square meter shall be numerically equal to the total length in meter of all shrinkage cracks, except that a short shrinkage crack within 305 mm of a longer crack shall not be measured.

Random cracks are normally located approximately parallel to a sawed joint and extend the full width or length of the slab and usually penetrate the full depth of the slab.

Random cracks shall be repaired as hereinafter specified for volunteer cracks unless the extent of random cracking is so severe as to divide the slab into 3 or more pieces, in which case the slab shall be removed and replaced. If both plastic shrinkage and random cracks occur in the same slab, each type shall be considered separately.

For doweled concrete pavements, if a random transverse crack appears and is not at the proposed weakened plane joint location, the slab shall be removed and replaced.

For plain jointed (non-doweled) pavement, the Contractor will be required to repair all random cracks within 1.52 m of any sawed joint by injecting the total length of the crack with epoxy under pressure. All other random cracks, whether longitudinal or transverse to centerline, shall be sawed and sealed in accordance with the requirements of weakened plane joints for longitudinal weakened plane joint, single saw cut of these special provisions.

Where volunteer cracks cross or are partially coincident with sawed joints, either protective measures shall be taken to prevent entry of epoxy into saw cuts sufficient to reduce the calculated minimum groove depth or, at the option of the Contractor, accumulations of epoxy in saw cuts shall be removed by resawing to the calculated minimum depth prior to opening the pavement to any traffic.

Injecting cracks with epoxy shall be performed as directed by the Engineer. No cracks shall be injected with epoxy before a period of 10 days has elapsed after the concrete has been placed. Epoxy injection shall be performed before traffic is permitted on the pavement. When epoxy injection is not performed within 10 calendar days after the pavement is placed, the Engineer may order such work to be started and the Contractor shall complete the work within 10 calendar days after receiving said order.

In making epoxy injection repairs, a surface seal shall be applied to prevent escape of epoxy and entry ports shall be placed at intervals to allow filling the entire length of crack. Surface seal material, and injection procedures, shall be such as to prevent damaging the texture and appearance of the pavement surface after opening to public traffic. Epoxy shall be injected using in-line mixing equipment. Pressure pots shall not be used. Epoxy specifically designed for pressure injection and conforming to AASHTO M235 (ASTM C881), Type IV, shall be used. The Contractor shall submit a written proposal to the Engineer for approval, detailing the equipment, personnel, materials, and procedures to be used for epoxy injection.

The Contractor shall provide 101.6 mm diameter cores of epoxied cracks at the rate of 5 relatively evenly spaced cores for each 45.7 linear meters of epoxied crack. If the total length of cracks to be epoxied exceeds 45.7 linear meters, the rate of coring may be reduced to one core for each additional 30.5 linear meters of epoxied crack provided the Contractor's methods and equipment are producing satisfactory results. Cores shall extend through the entire depth of pavement and include the full depth of crack. Location of cores will be determined by the Engineer. Cracks where epoxy has penetrated to less than 80 percent of the crack depth shall have additional epoxy injected until a minimum of 80 percent of the crack depth has been filled. Such cracks may require additional cores for verification as determined by the Engineer. All holes resulting from coring shall be completely filled with epoxy of the same quality as used to inject the cracks.

For plastic shrinkage cracks, crack or surface sealing as approved by the Engineer may be performed in lieu of epoxy injection. The material used for crack sealing shall be a high molecular weight methacrylate resin as directed by the Engineer. The Contractor shall provide cores of cracks healed or sealed according to the frequency and requirements shown herein for epoxy injection. Cracks of such size or depth that cannot be filled to the depth required, shall be epoxy injected. Regardless of the method of crack repair chosen, verification of material penetration by coring as described above, is required.

Any joints or volunteer cracks with spalls more than 15.2 mm deep which exceed 12.2 mm in width and 91.4 mm in length that occur before pavement is open to public traffic, the sawed joints with excessive raveling or tearing shall be repaired, but only after removing all weak fractured concrete and cleaning surfaces to receive the patch. Patch material shall be determined by the Engineer. An insert, or other means, shall be used to prevent bonding both sides of planned joints together.

The contract unit price paid for dowel (smooth, epoxy coated) shall include full compensation for furnishing all labor, material, tools, equipment, and incidentals, and for doing all the work involved in dowel (smooth, epoxy coated), complete in place, including repairing cracks, as shown on the plans, as specified in these special provisions, and as directed by the Engineer.

10-1.24 PRESTRESSING CONCRETE

Prestressing concrete shall conform to the provisions in Section 50, "Prestressing Concrete," of the Standard Specifications and these special provisions.

The first paragraph in Section 50-1.02, "Drawings," of the Standard Specifications is amended to read:

The Contractor shall submit to the Office of Structure Design (OSD) for approval in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," working drawings of the prestressing system proposed for use. For initial review, 6 sets of the drawings shall be submitted for railroad bridges and 4 sets shall be submitted for other structures. After review, between 6 and 12 sets, as requested by the Engineer, shall be submitted to OSD for final approval and for use during construction.

The sixth paragraph in Section 50-1.02, "Drawings," of the Standard Specifications is amended to read:

At the completion of each structure on the contract, one set of reduced prints on 75-g/m² (minimum) bond paper, 279 mm x 432 mm in size, of the corrected original tracings of all working drawings for each structure shall be furnished to the Engineer. Reduced prints of drawings which are common to more than one structure shall be submitted for each structure. An index prepared specifically for the drawings for each structure containing sheet numbers and titles shall be included on the first reduced print in the set for each structure. Reduced prints for each structure shall be arranged in the order of drawing numbers shown in the index.

The seventh paragraph in Section 50-1.08, "Prestressing," of the Standard Specifications is amended to read:

Each jack used to stress tendons shall be equipped with either: (1) two pressure gages or (2) one pressure gage and a load cell, at the option of the Contractor. The jack body shall be permanently marked with the ram area. Each pressure gage shall be fully functional and have an accurately reading dial at least 150 mm in diameter. The jack and each gage shall be calibrated as a unit with the cylinder extension in the approximate position that it will be at final jacking force. The load cell, if used, shall be calibrated and shall be provided with an indicator which may be used to determine the prestressing force in the tendon. The range of the load cell shall be such that the lower 10 percent of the manufacturer's rated capacity will not be used in determining the jacking stress. The jacking equipment calibration procedure shall be as follows:

Each jack used to stress tendons, which are permanently anchored at 25 percent or more of the specified minimum ultimate tensile strength of the prestressing steel, shall be calibrated by the Transportation Laboratory within one year prior to use and after each repair, unless otherwise directed. The Contractor shall be responsible for:

1. scheduling the calibration of the jacking equipment with the Transportation Laboratory, telephone (916) 227-7251;
2. verifying that the jack and supporting systems are complete, with proper components, and are in good operating condition;
3. mechanically calibrating the gages with a dead weight tester or other approved means prior to calibration of the jacking equipment by the Transportation Laboratory,
4. providing sufficient labor, equipment, and material to install and support the jacking and calibration equipment and to remove the equipment after the calibration is complete, and;
5. plotting the calibration results.

Each jack used to stress tendons, which are permanently anchored at less than 25 percent of the specified minimum ultimate tensile strength of the prestressing steel, shall be calibrated by a private laboratory approved by the Transportation Laboratory within 6 months prior to use and after each repair, unless otherwise directed.

The details shown on the plans for cast-in-place prestressed box girder bridges are based on a bonded full length draped tendon prestressing system. For these bridges the Contractor may, in accordance with the provisions of Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications, propose an alternative prestressing system utilizing bonded partial length tendons providing the proposed system and associated details meet the following requirements:

The proposed system and details must provide moment and shear resistances at least equal to those used for the design of the structure shown on the plans.

The concrete strength shall not be less than that shown on the plans.

Not less than 35 percent of the total prestressing force at any section shall be provided by full length draped tendons.

Anchorage blocks for partial length tendons shall be located so that they will not interfere with the placement of any utility facilities shown on the plans or of any future utilities to be placed through openings shown on the plans.

Temporary prestressing tendons, if used, shall be detensioned and any temporary ducts shall be filled with grout before completion of the work. Temporary tendons shall be either removed or fully encased in grout before completion of the work.

All details of the proposed system, including supporting checked calculations, shall be included in the drawings submitted in accordance with Section 50-1.02, "Drawings," of the Standard Specifications.

Moments and shears for loads used in the design shown on the plans will be made available to the Contractor upon written request to the Engineer.

10-1.25 CONCRETE STRUCTURES

Portland cement concrete structures shall conform to the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Shotcrete shall not be used as an alternative construction method for reinforced concrete members unless otherwise specified.

The first sentence of the tenth paragraph in Section 51-1.05, "Forms," of the Standard Specifications is amended to read:

Form panels for exposed surfaces shall be plywood conforming to or exceeding the requirements of U.S. Product Standard PS 1 for Exterior B-B (Concrete Form) Class I Plywood or any material which will produce a smooth uniform concrete surface substantially equal to that which would result from the use of that plywood.

The third paragraph in Section 51-1.15, "Drains in Walls," of the Standard Specifications is amended to read:

In addition to the drain holes and weep holes specified in the preceding paragraph, holes approximately 75 mm in diameter for relief of hydrostatic pressure shall be provided at the bottom of walls, immediately above the footing, at approximately 4500-mm centers.

FALSEWORK

Falsework shall be designed and constructed in conformance with the requirements in Section 51-1.06, "Falsework," of the Standard Specifications and these special provisions.

The fourth and fifth sentences of the eighteenth paragraph of Section 51-1.06A, "Falsework Design and Drawings," of the Standard Specifications are deleted.

The fifth paragraph of Section 51-1.06A(1), "Design Loads," of the Standard Specifications is amended to read:

The minimum horizontal load to be allowed for wind on heavy-duty steel shoring or steel pipe column falsework having a vertical load carrying capacity exceeding 130 kN per leg or column shall be the sum of the products of the wind impact area, shape factor, and the applicable wind pressure value for each height zone. The wind impact area is the total projected area of all the elements in the tower face or falsework bent normal to the direction of the applied wind. The shape factor shall be taken as 2.2 for heavy-duty shoring and 1.0 for pipe column falsework. Wind pressure values shall be determined from the following table:

Height Zone (Meters above ground)	Wind Pressure Value (Pa)	
	Shores or Columns Adjacent to Traffic	At Other Locations
0-9	960	720
9-15	1200	960
15-30	1440	1200
over 30	1675	1440

The first 2 sentences of the sixth paragraph of Section 51-1.06A(1), "Design Loads," of the Standard Specifications are amended to read:

The minimum horizontal load to be allowed for wind on all other types of falsework, including falsework supported on heavy-duty shoring or pipe column falsework, shall be the sum of the products of the wind impact area and the applicable wind pressure value for each height zone. The wind impact area is the gross projected area of the falsework and any unrestrained portion of the permanent structure, excluding the areas between falsework bents or towers where diagonal bracing is not used.

The last paragraph under "Timber" in the second paragraph of Section 51-1.06A(2), "Design Stresses, Loadings, and Deflections," of the Standard Specifications is amended to read:

Timber connections shall be designed in conformance with the procedures, stresses and loads permitted in the Falsework Manual as published by the Department of Transportation, Division of Structures, Office of Structure Construction.

The first entry following the third paragraph under "Steel" in the second paragraph of Section 51-1.06A(2), "Design Stresses, Loadings, and Deflections," of the Standard Specifications is amended to read:

Compression, flexural... $\frac{83,000}{Ld/bt}$ MPa, but not to exceed 152 MPa for unidentified steel or steel conforming to ASTM Designation: A 36/A 36M nor 0.6Fy for other identified steel.

The third paragraph of Section 51-1.06B, "Falsework Construction," of the Standard Specifications is amended to read:

When falsework is supported on piles, the piles shall be driven and the actual bearing value assessed as specified in Section 49, "Piling."

For falsework piles with a calculated loading capacity greater than 900 kN, the Contractor shall conduct dynamic monitoring of pile driving and conduct penetration and bearing analyses based on a wave equation analysis. Said analysis shall be signed by an engineer who is registered as a Civil Engineer in the State of California and submitted to the Engineer prior to completion of falsework erection.

COST REDUCTION INCENTIVE PROPOSALS FOR CAST-IN-PLACE PRESTRESSED BOX GIRDER BRIDGES.—Except as provided herein, cast-in-place prestressed box girder bridges shall be constructed in accordance with the details shown on the plans and the provisions in Sections 50, "Prestressing Concrete," and 51, "Concrete Structures," of the Standard Specifications.

If the Contractor submits cost reduction incentive proposals for cast-in-place prestressed box girder bridges, the proposals shall be in accordance with the provisions of Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications and these special provisions.

The Engineer may reject any proposal which, in the Engineer's judgment, may not produce a structure which is at least equivalent to the planned structure.

At the time the cost reduction incentive proposal (CRIP) is submitted to the Engineer, the Contractor shall also submit 4 sets of the proposed revisions to the contract plans, design calculations, and calculations from an independent checker for all changes involved in the proposal, including revisions in camber, predicted deck profile at each construction stage, and falsework requirements to the Office of Structure Design, Documents Unit, P.O. Box 942874, Sacramento, CA 94274-0001 (1801 30th Street, Sacramento, CA 95816), telephone (916) 227-8230. When notified in writing by the Engineer, the Contractor shall submit 12 sets of the CRIP plan revisions and calculations to the Office of Structure Design for final approval and use during construction. The calculations must verify that all requirements are satisfied. The CRIP plans and calculations shall be signed by an engineer who is registered as a Civil Engineer in the State of California.

The CRIP plans shall be either 279 mm x 432 mm, or 559 mm x 864 mm in size and each CRIP plan sheet and calculation sheet shall include the State assigned designations for the contract number, bridge number, full name of the structure as shown on the contract plans, and District-County-Route-Kilometer Post. Each CRIP plan sheet shall be numbered in the lower right hand corner and shall contain a blank space in the upper right hand corner for future contract sheet numbers.

Within 3 weeks after final approval of the CRIP plan sheets, one set of the corrected good quality prints on 75-g/m² (minimum) bond paper, 559 mm x 864 mm in size, of all CRIP plan sheets prepared by the Contractor for each CRIP shall be furnished to the Office of Structure Design, Documents Unit.

Each CRIP shall be submitted prior to completion of 25 percent of contract working days and sufficiently in advance of the start of the work that is proposed to be revised by the CRIP to allow time for review by the Engineer and correction by the Contractor of the CRIP plans and calculations without delaying the work. The Contractor shall allow a minimum of 10 weeks for the review of a CRIP. In the event that several CRIPs are submitted simultaneously, or an additional CRIP is submitted for review before the review of a previously submitted CRIP has been completed, the Contractor shall designate the sequence in which the CRIPs are to be reviewed. In this event, the time to be provided for the review of any proposal in the sequence shall be not less than the review time specified herein for that proposal, plus two weeks for each CRIP of higher priority which is still under review.

Should the review not be complete by the date specified in the Contractor's CRIP, or such other date as the Engineer and Contractor may subsequently have agreed to in writing and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in review of CRIP plans and calculations, an extension of time commensurate with the delay in completion of the work thus caused will be granted as provided in Section 8-1.07, "Liquidated Damages," of the Standard Specifications except that the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications shall not apply.

Permits and approvals required of the State have been obtained for the structures shown on the plans. Any proposal which results in a deviation in configuration may require new permits or approvals. The Contractor shall be responsible for obtaining the new permits and approvals before the Engineer will reach a decision on the proposal. Delays in obtaining permits and approvals will not be reason for granting an extension of contract time.

All proposed modifications shall be designed in accordance with the bridge design specifications and procedures currently employed by the Department. The proposal shall include all related, dependent or incidental changes to the structure and other work affected by the proposal. The proposal will be considered only when it includes all aspects of the design changes for the entire structure. Any changes, such as but not limited to, additional reinforcement and changes in location of reinforcement, necessary to implement the CRIP after approval by the Engineer, shall be made at the Contractor's expense.

Modifications may be proposed in (1) the thickness of girder stems and deck slabs, (2) the number of girders, (3) the deck overhang dimensions as specified herein, (4) the amount and location of reinforcing steel, (5) the amount and location of prestressing force in the superstructure, and (6) the number of hinges, except that the number of hinges shall not be increased. The strength of the concrete used may be increased but the strength employed for design or analysis shall not exceed 42 MPa.

Modifications proposed to the minimum amount of prestressing force which must be provided by full length draped tendons are subject to the requirements in "Prestressing Concrete" of these special provisions.

No modifications will be permitted in (1) the foundation type, (2) the span lengths or (3) the exterior dimensions of columns or bridge superstructure, except that the overhang dimension from face of exterior girder to the outside edge of roadway deck may be uniformly increased or decreased by 25 percent on each side of the box girder section. Fixed connections at the tops and bottoms of columns shown on the plans shall not be eliminated.

The Contractor shall be responsible for determining construction camber and obtaining the final profile grade as shown on the plans.

The Contractor shall reimburse the State for the actual cost of investigating CRIPs for cast-in-place prestressed box girder bridges submitted by the Contractor. The Department will deduct this cost from any moneys due, or that may become due, the Contractor under the contract, regardless of whether or not the proposal is approved or rejected.

DECK CLOSURE POURS.—Where deck closure pour is shown on the plans, reinforcement protruding into the closure space and forms for the closure pour shall conform to the following:

During the time of placement of concrete in the deck, other than for the closure pour itself, reinforcing steel which protrudes into the closure space shall be completely free from any connection to the reinforcing steel, concrete, or other attachments of the adjacent structure, including forms. The reinforcing steel shall remain free of any connection for a period of not less than 24 hours following completion of the pour.

Forms for the closure pour shall be supported from the superstructure on both sides of the closure space.

10-1.26 STRUCTURE APPROACH SLABS (Type N)

This work shall consist of constructing reinforced concrete approach slabs and treated permeable base at structure approaches in accordance with the details shown on the plans, the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

GENERAL.--Attention is directed to the section, "Engineering Fabrics," of these special provisions.

ENGINEERING FABRICS.--Filter fabric to be placed between the structure approach embankment material and the treated permeable base shall conform to the provisions for filter fabric for edge drains in Section 88, "Engineering Fabrics," of the Standard Specifications and the following special provisions:

The subgrade to receive the filter fabric, immediately prior to placing, shall conform to the compaction and elevation tolerance specified for the material involved.

Filter fabric shall be aligned, handled and placed in a wrinkle-free manner in accordance with the manufacturer's recommendations.

Adjacent borders of the filter fabric shall be overlapped from 300 to 450 mm or stitched. The preceding roll shall overlap the following roll in the direction the material is being spread or shall be stitched. When the fabric is joined by stitching, it shall be stitched with yarn of a contrasting color. The size and composition of the yarn shall be as recommended by the fabric manufacturer. The stitches shall number 5 to 7 per 25 mm of seam.

Equipment or vehicles shall not be operated or driven directly on the filter fabric.

Woven tape fabric to be placed between the treated permeable base and the approach slab shall be a fabric made of woven strips or tapes and shall conform to the following:

Specification	ASTM Designation	Requirement
Weight, grams per square meter, min.	D 3776	100
Grab Tensile Strength, kilonewtons, min.	D 4632	0.22
Elongation, percent, max.	D 4632	35
Toughness, kilonewtons, min. (Percent elongation times grab tensile strength)	----	5

Woven tape fabric shall be treated to provide a minimum of 70 percent breaking strength retention after 500 hours exposure when tested in accordance with ASTM Designation: D 4355. The Contractor shall notify the Engineer, in writing, of the source of woven tape fabric at least 45 days prior to use.

TREATED PERMEABLE BASE UNDER APPROACH SLAB.--Treated permeable base under structure approach slabs shall consist of constructing either an asphalt treated permeable base or a cement treated permeable base in accordance with Section 29, "Treated Permeable Bases," of the Standard Specifications and the following special provisions:

The type of treatment, asphalt or cement, to be used shall be at the option of the Contractor.

Not less than 30 days prior to the start of placing treated permeable base the Contractor shall notify the Engineer, in writing, which type of treated permeable base will be furnished. Once the Contractor has notified the Engineer of his selection the Contractor will not be allowed to change the type to be furnished without a prior written request to do so and approval thereof in writing by the Engineer.

Asphalt treated permeable base shall be placed at a temperature of not less than 93°C nor more than 121°C. Material stored in excess of 2 hours shall not be used in the work.

Asphalt treated permeable base material may be spread in one layer. It shall be compacted with a vibrating shoe type compactor or rolled with a roller weighing not less than 1.3 tonnes nor more than 4.5 tonnes. Rolling shall begin as soon as the mixture has cooled sufficiently to support the weight of the rolling equipment without undue displacement.

Cement treated permeable material may be spread in one layer. The material shall be compacted with either a vibrating shoe type compactor or with a steel-drum roller weighing not less than 1.3 tonnes nor more than 4.5 tonnes. Compaction shall follow within one-half hour after the spreading operation and shall consist of 2-complete coverages of the treated material.

APPROACH SLABS:

Concrete for use in approach slabs shall contain not less than 400 kilograms of cement per cubic meter.

Miscellaneous steel parts and all steel components of abutment ties including plates, nuts, washers, and rods shall conform to the provisions in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

Structure approach slabs shall be cured for not less than 5 days prior to opening to traffic, unless, at the option of the Contractor, the structure approach slabs are constructed using concrete with a non-chloride Type C chemical admixture conforming to these special provisions.

Portland cement for use in concrete using a non-chloride Type C chemical admixture shall be Type II Modified, Type II Prestress, or Type III. Type II Modified and Type III cement shall conform to the provisions in Section 90-2.01, "Portland Cement," of the Standard Specifications. Type II Prestress cement shall conform to the requirements of Type II Modified cement, except the mortar containing the portland cement to be used and Ottawa sand, when tested in accordance with California Test 527, shall not contract in air more than 0.053-percent.

The non-chloride Type C chemical admixture, approved by the Engineer, shall conform to the requirements of ASTM Designation: C 494 and Section 90-4, "Admixtures," of the Standard Specifications.

The concrete with non-chloride Type C chemical admixture shall be prequalified prior to placement in accordance with the provisions for prequalification of concrete specified by compressive strength in Section 90-9.01, "General," of the Standard Specifications and the following:

Immediately after fabrication of the 5 test cylinders, the cylinders shall be stored in a temperature medium of $21 \pm 1.5^\circ\text{C}$ until the cylinders are tested.

The 6-hour average strength of the 5 test cylinders shall not be less than 5.85 MPa. No more than 2 test cylinders shall have a strength of less than 5.5 MPa.

Building paper shall be commercial quality No. 30 asphalt felt.

Polyvinyl chloride (PVC) conduit used to encase the abutment tie rod shall be of commercial quality.

The top surface of approach slabs shall be finished in conformance with the provisions in Section 51-1.17, "Finishing Bridge Decks," of the Standard Specifications. Edges of slabs shall be edger finished.

Approach slabs shall be cured with pigmented curing compound (1) in accordance with the provisions for curing structures in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications.

Structure approach slabs constructed using concrete with a non-chloride Type C chemical admixture shall be cured for not less than 6 hours prior to opening to traffic. The curing period shall be considered to begin at the start of discharge of the last truck load of concrete to be used in the slab.

If the ambient temperature is below 18°C during the curing period for approach slabs using concrete with a non-chloride Type C chemical admixture, an insulating layer or blanket shall cover the surface. The insulation layer or blanket shall have an R-value rating given in the table below. At the Contractor's option, a heating tent may be used in lieu of or in combination with the insulating layer or blanket.

Temperature range during curing period	R-value, minimum
13°C to 18°C	1
7°C to 13°C	2
4°C to 7°C	3

JOINTS.--Hardboard and expanded polystyrene shall conform to the provisions in Section 51-1.12D, "Sheet Packing, Preformed Pads and Board Fillers," of the Standard Specifications.

Type AL joint seals shall conform to the provisions in Section 51-1.12F, "Sealed Joints" of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods.

The pourable seal between the steel angle and concrete barrier shall conform to the requirements for Type A and AL seals in Section 51-1.12F(3), "Materials and Installation," of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods. Immediately prior to placing the seal, the joint shall be thoroughly cleaned, including abrasive blast cleaning of the concrete surfaces, so that all foreign material and concrete spillage are removed from all joint surfaces. Joint surfaces shall be dry at the time the seal is placed.

MEASUREMENT AND PAYMENT.--Structural concrete, approach slab (Type N) will be measured and paid for in accordance with the provisions in Sections 51-1.22, "Measurement," and 51-1.23, "Payment," of the Standard Specifications and these special provisions.

Full compensation for treated permeable base, filter fabric, woven tape fabric, miscellaneous metal, pourable seals, and waterstops shall be considered as included in the contract price paid per cubic meter for structural concrete, approach slab of the type shown in the Engineer's Estimate and no additional compensation will be allowed therefor.

10-1.27 STRUCTURE APPROACH SLABS (TYPE R)

Structure approach slabs (Type R) shall consist of removing existing pavement and base including reinforced concrete approach slabs, asphalt concrete surfacing, portland cement concrete pavement, subsealing material and cement treated base and constructing new reinforced concrete approach slabs at structure approaches as shown on the plans and in conformance with these special provisions.

GENERAL

The thickness shown on the plans for structure approach slabs is the minimum thickness. The thickness will vary depending on the thickness of the pavement and base materials removed.

Where pavement subsealing has been performed under existing approach slabs, the subsealing material shall be removed for its full depth. Where removal of cement treated base is required to construct the approach slab, the entire thickness of cement treated base shall be removed.

Voids between the new reinforced structure approach slab and the base material remaining in place that are caused by removal of subsealing material or cement treated base shall be filled, at the option of the Contractor, with aggregate base (approach slab) or structure approach slab concrete.

The Contractor shall establish a grade line for new approach slabs by setting stringlines on each side of the proposed approach slab. The stringlines shall start approximately 30 m from the structure and extend approximately 15 m onto the structure. The stringlines shall then be adjusted as necessary to provide a smooth profile grade for the new approach slab. The profile grade will be subject to the approval of the Engineer.

The Contractor shall schedule his operations so that the pavement and base materials removed during a work period shall be replaced, in that same work period, with approach slab concrete that shall be cured for at least 6 hours prior to the time the lane is to be opened to public traffic as designated in "Maintaining Traffic" of these special provisions. In the event the existing pavement and base materials are removed and the Contractor is unable, as determined by the Engineer, to construct, finish and cure the new approach slab by the time the lane is to be opened to public traffic, the excavation shall be filled with a temporary roadway structural section as specified in this section, "Structure Approach Slabs (Type R)."

TEMPORARY ROADWAY STRUCTURAL SECTION

The Contractor shall provide, at the job site, a sufficient standby quantity, as determined by the Engineer, of asphalt concrete and aggregate base for construction of a temporary roadway structural section where existing approaches to structures are being replaced. The temporary structural section shall be maintained, and later removed as a first order of work

when the Contractor is able to construct and cure the approach slab within the prescribed time limit. The temporary structural section shall consist of 90-mm thick layer of asphalt concrete over aggregate base.

The aggregate base for the temporary structural section shall conform to the requirements specified under "Aggregate Base (Approach Slab)" in these special provisions.

The asphalt concrete for the temporary structural section shall be produced from commercial quality aggregates and asphalt binder. The grading of the aggregate shall conform to the 19-mm maximum medium grading in Section 39-2.02, "Aggregate," of the Standard Specifications and the asphalt binder shall conform to the requirements of liquid asphalt SC-800 in Section 93, "Liquid Asphalts," of the Standard Specifications. The amount of asphalt binder to be mixed with the aggregate shall be approximately 0.3-percent less than the optimum bitumen content as determined by California Test 367.

Aggregate base and asphalt concrete for the temporary structural section shall be spread and compacted by methods that will produce a well-compacted, uniform base, free from pockets of coarse or fine material and a surfacing of uniform smoothness, texture, and density. The aggregate base may be spread and compacted in one layer and the asphalt concrete may be spread and compacted in one layer. The finished surface of the asphalt concrete shall not vary more than 15 mm from the lower edge of a 3.6-m straightedge placed parallel with the centerline and shall match the elevation of the existing concrete pavement and structure along the joints between the existing pavement and structure and the temporary surfacing.

The material from the removed temporary structural section shall be disposed of outside the highway right of way in conformance with Section 7-1.13 of the Standard Specifications except that removed aggregate base may be stockpiled at the job site and reused for construction of another temporary structural section. When no longer required, standby material or stockpiled material for construction of temporary structural sections shall be removed and disposed of outside the right of way in conformance with said Section 7-1.13.

REMOVING EXISTING PAVEMENT AND BASE MATERIALS

The outline of portland cement concrete to be removed shall be sawed full depth with a power-driven concrete saw.

The outlines of excavations in asphalt concrete shall be cut on a neat line to a minimum depth of 75 mm with a power-driven concrete saw or wheel-type rock cutting excavator before any asphalt concrete material is removed. These excavations shall be permanently or temporarily backfilled to conform to the grade of adjacent pavement prior to opening the lane to public traffic. Surplus excavated material may be used as temporary backfill material.

Regardless of the type of equipment used to remove concrete within the sawed outline, the surface of the concrete to be removed shall not be impacted within 0.5-m of the pavement to remain in place. Removing existing pavement and base materials shall be performed without damage to the adjacent structure or pavement that is to remain in place. Damage to the structure or to pavement that is to remain in place shall be repaired to a condition satisfactory to the Engineer. Damaged pavement shall be removed and replaced with new concrete pavement if ordered by the Engineer. Repairing damage to structures or repairing or removing and replacing damaged pavement outside the limits of structure approach slabs shall be at the Contractor's expense.

Materials removed shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13 of the Standard Specifications.

The base material remaining in-place, after removing the existing pavement and base materials to the required depth, shall be graded uniformly, watered, and compacted. The finished surface of the base material at any point shall not extend above the grade approved by the Engineer.

Areas of the base material that are low as a result of over excavation by the Contractor shall be filled, at the Contractor's expense, with structure approach slab concrete at the time and in the same operation that the new concrete is placed.

AGGREGATE BASE (APPROACH SLAB)

The aggregate base (approach slab) for filling voids below the reinforced structure approach slab concrete shall be produced from commercial quality aggregates consisting of broken stone, crushed gravel or natural rough-surfaced gravel, and sand, or any combination thereof. The grading of the aggregate base shall conform to the 19-mm maximum grading specified in Section 26-1.02A, "Class 2 Aggregate Base," of the Standard Specifications.

Aggregate base (approach slab) for filling voids below the reinforced structure approach slab concrete shall be spread and compacted by methods that will produce a well-compacted, uniform base, free from pockets of coarse or fine material. The aggregate base shall be watered and compacted to the grade approved by the Engineer. Where the required thickness of aggregate base is 200 mm or less, the base may be spread and compacted in one layer. Where the required thickness of aggregate base is more than 200 mm, the base shall be spread and compacted in 2 or more layers of approximately equal thickness, and the maximum compacted thickness of any one layer shall not exceed 200 mm. The finished surface of the base material at any point shall not extend above the grade approved by the Engineer. Areas of the base material that are lower than the grade approved by the Engineer, shall be filled with structure approach slab concrete at the time and in the same operation that the new concrete is placed.

STRUCTURE APPROACH SLAB

Reinforced concrete approach slabs shall conform to the provisions for approach slabs in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Concrete for use in approach slabs shall contain not less than 400 kg of cement per cubic meter.

Miscellaneous steel parts and all steel components of abutment ties including plates, nuts, washers, and rods shall conform to the provisions in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

Approach slab concrete that requires a minimum curing period of 6 hours shall be constructed using a non-chloride Type C chemical admixture. Mineral admixture will not be required in this concrete.

Portland cement for use in concrete using a non-chloride Type C chemical admixture shall be Type II Modified, Type II Prestress, or Type III. Type II Modified and Type III cement shall conform to the provisions in Section 90-2.01, "Portland Cement," of the Standard Specifications. Type II Prestress cement shall conform to the requirements of Type II Modified cement, except the mortar containing the portland cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not contract in air more than 0.053-percent.

The non-chloride Type C chemical admixture shall be approved by the Engineer and conform to the requirements of ASTM Designation: C 494 and Section 90-4, "Admixtures," of the Standard Specifications.

The concrete with non-chloride Type C chemical admixture shall be prequalified prior to placement in conformance with the provisions for prequalification of concrete specified by compressive strength in Section 90-9.01, "General," of the Standard Specifications and the following:

Immediately after fabrication of the 5 test cylinders, the cylinders shall be stored in a temperature medium of $21 \pm 1.5^\circ\text{C}$ until the cylinders are tested.

The 6-hour average strength of the 5 test cylinders shall not be less than 5.85 MPa. No more than 2 test cylinders shall have a strength of less than 5.5 MPa.

Building paper shall be commercial quality No. 30 asphalt felt.

Polyvinyl chloride (PVC) conduit used to encase the abutment tie rod shall be of commercial quality.

Bar reinforcement or abutment tie rods in drilled holes shall be bonded in conformance with the provisions for drilling and bonding dowels in Section 83-2.02D(1), "General," of the Standard Specifications.

The top surface of approach slabs shall be finished in conformance with the provisions in Section 51-1.17, "Finishing Bridge Decks," of the Standard Specifications. The finished top surface shall not vary more than 6 mm from the lower edge of a 3.6-m straightedge placed parallel with the centerline. Edges of slabs shall be edger finished.

The surface of the approach slab will not be profiled and the Profile Index requirements shall not apply.

Approach slabs shall be cured with pigmented curing compound (1) in conformance with the provisions for curing structures in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications. The minimum curing period as specified elsewhere in this section-"Structure Approach Slabs (Type R)" shall be considered to begin at the start of discharge of the last truck load of concrete to be used in the slab. Fogging of the surface with water after the curing compound has been applied will not be required. Should the film of curing compound be damaged from any cause before the approach slab is opened to public traffic, the damaged portion shall be repaired immediately with additional compound, at the Contractor's expense. Any damage to the curing compound after the approach slab is opened to public traffic shall not be repaired.

If the ambient temperature is below 18°C during the curing period, an insulating layer or blanket shall cover the surface. The insulation layer or blanket shall have an R-value rating given in the table below. At the Contractor's option, a heating tent may be used in lieu of or in combination with the insulating layer or blanket:

Temperature range during curing period	R-value, minimum
13°C to 18°C	1
7°C to 13°C	2
4°C to 7°C	3

Tests to determine the coefficient of friction of the final textured surface will be made only if the Engineer determines by visual inspection that the final texturing may not have produced a surface having the specified coefficient of friction. Any tests to determine the coefficient of friction will be made after the approach slab is opened to public traffic, but not later than 5 days after concrete placement. The coefficient of friction will be measured by California Test 342. Any portions of completed concrete surfaces that are found to have a coefficient of friction less than 0.35 shall be ground or grooved parallel to the center line in conformance with the requirements for bridge decks of Section 42, "Groove and Grind Pavement," of the Standard Specifications.

JOINTS

Hardboard and expanded polystyrene shall conform to the provisions in Section 51-1.12D, "Sheet Packing, Preformed Pads and Board Fillers," of the Standard Specifications.

Type AL joint seals shall conform to the provisions in Section 51-1.12F, "Sealed Joints" of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods.

The pourable seal between the steel angle and concrete barrier shall conform to the requirements for Type A and AL seals in Section 51-1.12F(3), "Materials and Installation," of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods. Immediately prior to placing the seal, the joint shall be thoroughly cleaned, including abrasive blast cleaning of the concrete surfaces, so that all foreign material and concrete spillage are removed from all joint surfaces. Joint surfaces shall be dry at the time the seal is placed.

MEASUREMENT AND PAYMENT

Structural concrete, approach slab (Type R) will be measured and paid for in conformance with the provisions in Sections 51-1.22, "Measurement," and 51-1.23, "Payment," of the Standard Specifications and these special provisions.

Full compensation for removing and disposing of portions of pavement materials, and for furnishing and placing miscellaneous metal, type AL joint seals and pourable seals shall be considered as included in the contract price paid per cubic meter for structural concrete, approach slab (Type R) and no separate payment will be made therefor.

The quantity of aggregate base (approach slab) to be paid for shall include the actual volume of aggregate base (approach slab) used to fill voids below the reinforced structure approach slab concrete, except for the volume of areas low as a result of over excavation by the Contractor. The volume to be paid for will be calculated on the basis of the constructed length, width and thickness of the filled voids. Structure approach slab concrete used to fill voids lower than the approved grade of the base, except for the areas low as a result of over excavation by the Contractor, will be measured and paid for as aggregate base (approach slab).

No adjustment of compensation will be made for any increase or decrease in the quantity of aggregate base (approach slab) required, regardless of the reason for such increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to the item of aggregate base (approach slab).

The contract price paid per cubic meter for aggregate base (approach slab) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing aggregate base (approach slab) complete in place, including excavation, and removing and disposing of base and subsealing materials, as shown on the plans, as specified in the Standard Specifications and these special provisions and as directed by the Engineer.

Full compensation for furnishing, stockpiling and disposing of standby material for construction of temporary structural sections; and for constructing, maintaining, removing and disposing of temporary structural sections shall be considered as included in the contract price paid per cubic meter for structural concrete, approach slab (Type R) and no separate payment will be made therefor.

Full compensation for drilling and bonding of bar reinforcement or abutment tie rods shall be considered as included in the contract price paid per cubic meter for structural concrete, approach slab (Type R) and no separate payment will be made therefor.

10-1.28 PAVING NOTCH EXTENSION

This work shall consist of extending existing paving notches in conformance with the details shown on the plans and in conformance with these special provisions.

Concrete for paving notch extension shall be a high-strength material consisting of either magnesium phosphate concrete, modified high alumina based concrete, or portland cement based concrete. Magnesium phosphate concrete shall conform to the provisions for magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications and these special provisions. Modified high alumina based concrete and portland cement based concrete shall be water activated and shall conform to the provisions for single component (water activated) magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications and these special provisions.

At least one hour shall elapse between the time of placing concrete for the paving notch extension and placing concrete for the structure approach slab.

A clean uniform rounded aggregate filler may be used to extend the concrete. The moisture content of the aggregate shall not exceed 0.5-percent. Grading of the aggregate shall conform to the following:

Sieve Sizes	Percentage Passing
12.5-mm	100
1.18-mm	0-5

The amount of aggregate filler shall conform to the manufacturer's recommendation, but in no case shall the concrete strengths be less than that specified for magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications.

The components of dual component (with a prepackaged liquid activator) magnesium phosphate shall be combined by mixing complete units supplied by the manufacturer. Portions of units shall not be used. Water shall not be added to dual component magnesium phosphate.

Magnesium phosphate concrete shall not be mixed in containers or worked with tools containing zinc, cadmium, aluminum or copper. Modified high alumina based concrete shall not be mixed in containers or worked with tools containing aluminum.

Concrete shall not be retempered. Finishing tools that are cleaned with water shall be thoroughly dried before working the concrete.

When placing concrete on slopes exceeding 5 percent, the Engineer may require the Contractor to provide a flow controlled modified material.

Modified high alumina based concrete and portland cement based concrete shall be cured in conformance with the provisions in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications. Magnesium phosphate concrete shall not be cured.

The surface temperature of the areas to receive the concrete shall be 5°C or above when the concrete is placed. The contact surface to receive the magnesium phosphate concrete shall be dry. The contact surfaces to receive the modified high alumina concrete or portland cement based concrete may be damp but not saturated.

The construction joint between the paving notch extension and the existing abutment shall conform to the provisions for horizontal construction joints in Section 51-1.13, "Bonding," of the Standard Specifications. Concrete shall be placed in the spalled portions of the existing paving notch concurrently with the concrete for the paving notch extension.

Bar reinforcing steel shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications.

Structure excavation and backfill shall conform to the provisions in Section 19-3, "Structure Excavation and Backfill," of the Standard Specifications.

Drilling of holes and bonding of reinforcing steel dowels shall conform to the provisions for drilling and bonding dowels in Section 83-2.02D(1), "General," of the Standard Specifications.

The quantity of concrete for paving notch extension will be measured by the cubic meter. The volume to be paid for will be calculated from the dimensions shown on the plans or other dimensions that may be ordered in writing by the Engineer.

The contract price paid per cubic meter for paving notch extension shall include full compensation for furnishing all labor, materials (including concrete for the paving notch spalled areas), tools, equipment, and incidentals, and for doing all the work involved in constructing the paving notch extension, complete in place, including structure excavation and backfill, reinforcement, and drilling and bonding dowels, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.29 SEALING JOINTS

Joints in concrete bridge decks and joints between concrete structures and concrete approach slabs shall be sealed in conformance with the details shown on the plans, the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Where polyurethane seals are shown on the plans, silicone sealant conforming to these specifications may be used.

The second through fourth paragraphs of Section 51-1.12F, "Sealed Joints," of the Standard Specifications are amended to read:

Type A and AL joint seals shall consist of a groove in the concrete which is filled with field mixed and placed polyurethane or silicone sealant.

Type B joint seals shall consist of a groove in the concrete which is filled with a preformed elastomeric joint seal.

Joint seal assemblies shall consist of metal or metal and elastomeric assemblies which are anchored or cast into a recess in the concrete over the joint.

The type of seal to be used for the Movement Rating (MR) shown on the plans shall be as follows:

MR	Seal Type
15 mm	Type A or Type B
30 mm	Type A (silicone only) or Type B
> 30 mm and 50 mm	Type B
> 50 mm	joint seal assembly

The first and second paragraphs of Section 51-1.12F(3), "Materials and Installation," of the Standard Specifications are amended to read:

(a) Type A and AL Seal.—The sealant shall consist of a 2 component polyurethane sealant, which will withstand up to ± 25 percent movement, or a 2 component silicone sealant, which will withstand up to ± 50 percent movement.

Polyurethane and silicone sealants shall be tested in accordance with California Test 435. The sealants shall conform to State Specification 8030-61J-01 and the following requirements:

SPECIFICATION	REQUIREMENT
Modulus at 150 percent elongation	35-520 kPa
Width of sealant after 7 days extension and one hour recovery	17 mm, max.
Condition 24 hours after notching	Notched or loss of bond 6 mm, max.
Condition of water immersed specimen at 7 days	Notched or loss of bond 6 mm, max.
Condition of specimen when tested in accordance with ASTM Designation: G 53 using FS 40 UV-B bulbs for a minimum of 25 cycles. The cycle shall be 4 hours UV exposure at 60°C and 4 hours condensate exposure at 40°C	No more than slight checking or cracking.
Grease cone penetration	4.5 - 12.0 mm.

State Specifications for polyurethane and silicone sealants may be obtained from the Transportation Laboratory.

Section 51-1.12F(3)(a), "Type A and AL Seal," of the Standard Specifications is amended by adding the following paragraphs after paragraph 8:

A Certificate of Compliance, accompanied by a certified test report, shall be furnished for each batch of polyurethane and silicone sealant in conformance with the provisions in Section 6-1.07, "Certificates of Compliance."

Samples of the two components, not less than one liter each, from each batch of sealant shall be submitted to the Transportation Laboratory. In addition, samples of manufacturer required primers, not less than one liter each, shall be submitted. The samples shall be furnished for testing, with the Certificate of Compliance, 30 days in advance of proposed use.

When ordered by the Engineer, a joint seal larger than called for by the Movement Rating shown on the plans shall be furnished and installed. Payment to the Contractor for furnishing the larger seal and for saw cutting the increment of additional depth of groove required will be determined as provided in Section 4-1.03, "Changes," of the Standard Specifications.

The fifth subparagraph of the second paragraph of Section 51-1.12F(3) (b), "Type B Seal," of the Standard Specifications is amended to read:

The seal shall be furnished full length for each joint with no more than one shop splice in any 18-m length of seal.

One field splice per joint may be made at locations and by methods approved by the Engineer. The seals are to be manufactured full length for the intended joint, then cut at the approved splice section and rematched before splicing. The Contractor shall submit splicing details, prepared by the joint seal manufacturer, to the Engineer for approval prior to beginning splicing work.

The Contractor shall demonstrate the adequacy of the procedures to be used in the work before installing seals in the joints.

Shop splices and field splices shall have no visible offset of exterior surfaces, and shall show no evidence of bond failure.

10-1.30 REINFORCEMENT

Reinforcement shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

The first paragraph of Section 52-1.02A, "Bar Reinforcement," of the Standard Specifications is amended to read:

52-1.02A Bar Reinforcement.—Reinforcing bars shall be low-alloy steel deformed bars conforming to the requirements in ASTM Designation: A 706/A 706M, except that deformed or plain billet-steel bars conforming to the requirements in ASTM Designation: A 615/A 615M, Grade 300 or 420, may be used as reinforcement in the following 5 categories:

1. Slope and channel paving;
2. Minor structures;
3. Sign and signal foundations (pile and spread footing types);
4. Roadside rest facilities; and
5. Concrete barrier Type 50 and Type 60 series and temporary railing.

Deformations specified in ASTM Designation: A 706/A 706M will not be required on bars used as spiral or hoop reinforcement in structures and concrete piles.

Section 52-1.02C, "Welded Wire Fabric," of the Standard Specifications is amended to read:

52-1.02C Welded Wire Fabric.—Welded wire fabric shall be either plain or deformed conforming to the requirements in ASTM Designation: A 185 or ASTM Designation: A 497, respectively.

The last paragraph of Section 52-1.07, "Placing," of the Standard Specifications is amended to read:

Whenever a portion of an assemblage of bar reinforcing steel that is not encased in concrete exceeds 6 m in height, the Contractor shall submit to the Engineer for approval, in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," working drawings and design calculations for the temporary support system to be used. The working drawings and design calculations shall be signed by an engineer who is registered as a Civil Engineer in the State of California. The temporary support system shall be designed to resist all expected loads and shall be adequate to prevent collapse or overturning of the assemblage. If the installation of forms or other work requires revisions to or temporary release of any portion of the temporary support system, the working drawings shall show the support system to be used during each phase of construction. The minimum horizontal wind load to be applied to the bar reinforcing steel assemblage, or to a combined assemblage of reinforcing steel and forms, shall be not less than 960 Pa on the gross projected area of the assemblage.

The first paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

52-1.08 Splicing.—Splicing of reinforcing bars shall be by lapping, butt welding, mechanical butt splicing, or mechanical lap splicing, at the option of the Contractor. Reinforcing bars Nos. 43 through 57 shall not be spliced by lapping.

The sixth paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

Except when otherwise specified, mechanical lap splicing shall conform to the details shown on the plans, the requirements for mechanical butt splices as specified in this Section 52-1.08, and Sections 52-1.08C, "Mechanical Butt Splices," 52-1.08D, "Qualification of Welding and Mechanical Splicing," and 52-1.08E, "Job Control Tests," and the following:

The mechanical lap splice shall be a unit consisting of a sleeve, in which the reinforcing bars are positioned, and a wedge driven through holes in the sleeve and between the reinforcing bars. The mechanical lap splice shall only be used for splicing non-epoxy-coated deformed reinforcing bars Nos. 13, 16 and 19.

The eighth and ninth paragraphs of Section 52-1.08, "Splicing," of the Standard Specifications are amended to read:

Unless otherwise shown on the plans or approved by the Engineer, splices in adjacent reinforcing bars at any particular section shall be staggered. The minimum distance between staggered lap splices or mechanical lap splices shall be the same length required for a lapped splice in the largest bar. The minimum distance between staggered butt splices shall be 600 mm. Distances shall be measured between the midpoints of the splices along a line which is centered between the axes of the adjacent bars.

Completed butt splices shall develop a minimum tensile strength, based on the nominal bar area, of 430 MPa for ASTM Designation: A 615/A 615M, Grade 300 bars, and 550 MPa for ASTM Designation: A 615/A 615M, Grade 420 and ASTM Designation: A 706/A 706M bars. If butt splices are made between 2 bars of dissimilar strengths, the minimum required tensile strength for the splice shall be that required for the weaker bar.

The second sentence of the eleventh paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

Job control tests shall be made on sample splices representing each lot of mechanical butt splices as provided in Section 52-1.08E, "Job Control Tests."

The third and fourth paragraphs of Section 52-1.08A, "Lapped Splices," of the Standard Specifications are amended to read:

Where ASTM Designations: A 615/A 615M, Grade 420 or A 706/A 706M reinforcing bars are required, the length of lapped splices shall be as follows: Reinforcing bars No. 25, or smaller, shall be lapped at least 45 diameters of the smaller bar joined, and reinforcing bars Nos. 29, 32 and 36 shall be lapped at least 60 diameters of the smaller bar joined, except when otherwise shown on the plans.

Where ASTM Designation: A 615/A 615M, Grade 300 reinforcing bars are permitted, the length of lapped splices shall be as follows: Reinforcing bars No. 25, or smaller, shall be lapped at least 30 diameters of the smaller bar joined, and reinforcing bars Nos. 29, 32 and 36 shall be lapped at least 45 diameters of the smaller bar joined, except when otherwise shown on the plans.

Section 52-1.08B, "Butt Welded Splices," of the Standard Specifications is amended to read:

52-1.08B Butt Welded Splices.—Butt welded splices in reinforcing bars shall be complete joint penetration butt welds conforming to the requirements in AWS D1.4, and the requirements of these specifications and the special provisions.

At the option of the Contractor, shop produced resistance butt welds, that are produced by a fabricator who is approved by the Transportation Laboratory, may be used. These welds shall conform to the requirements of these specifications and the special provisions.

Only the joint details and dimensions as shown in Figure 3.2, "Direct Butt Joints," of AWS D 1.4-92, shall be used for making complete joint penetration butt welds of bar reinforcement. Split pipe backing shall not be used.

Material used as backing for complete joint penetration butt welds of bar reinforcement shall be a flat plate conforming to the requirements in ASTM Designation: A 709/A 709M, Grade 36[250]. The flat plate shall be 6 mm thick with a width, as measured perpendicular to the axis of the bar, equal to the nominal diameter of the bar, and a length which does not exceed twice the nominal diameter of the bar. The flat plate backing shall be fitted tightly to the bar with the root of the weld centered on the plate. Any bar deformation or obstruction preventing a tight fit shall be ground smooth and flush with the adjacent surface. Tack welds used to fit backing plates shall be within the weld root area so that they are completely consumed by the finished weld. Backing plates shall not be removed.

Butt welds shall be made with multiple weld passes using a stringer bead without an appreciable weaving motion. The maximum stringer bead width shall be 2.5 times the diameter of the electrode and slagging shall be performed between each weld pass. Weld reinforcement shall not exceed 4 mm in convexity.

Before any electrodes or flux-electrode combinations are used, the Contractor, at the Contractor's expense, shall furnish certified copies of test reports for all the pertinent tests specified in AWS A5.1, AWS A5.5, AWS A5.18 or AWS A5.20, whichever is applicable, made on electrodes or flux-electrode combinations of the same class, brand and nearest specified size as the electrodes to be used. The tests may have been made for process qualification or quality control, and shall have been made within one year prior to manufacture of the electrodes and fluxes to be used. The report shall include the manufacturer's certification that the process and material requirements were the same for manufacturing the tested electrodes and the electrodes to be used. The forms and certificates shall be as directed by the Engineer.

Electrodes for manual shielded metal arc welding of ASTM Designation: A 615/A 615M, Grade 420 bars shall conform to the requirements in AWS A5.5 for E9018-M or E10018-M electrodes.

Electrodes for manual shielded metal arc welding of ASTM Designation: A 706/A 706M bars shall conform to the requirements of AWS A5.5 for E8016-C3 or E8018-C3 electrodes.

Solid and composite electrodes for semiautomatic gas metal-arc and flux-cored arc welding of Grade 300 reinforcing bars shall conform to the requirements of AWS A5.18 for ER70S-2, ER70S-3, ER70S-6 or ER70S-7 electrodes; or AWS A5.20 for E70T-1, E70T-5, E70T-6 or E70T-8 electrodes.

Electrodes for semiautomatic welding of ASTM Designation: A 615/A 615M, Grade 420 and ASTM Designation: A 706/A 706M bars shall produce a weld metal deposit with properties conforming to the requirements of Section 5.3.4 of AWS D1.1-96 for ER80S-Ni1, ER80S-Ni2, ER80S-Ni3, ER80S-D2, E90T1-K2 and E91T1-K2 electrodes.

Reinforcing bars shall be preheated for a distance of not less than 150 mm on each side of the joint prior to welding.

For all welding of ASTM Designation: A 615/A 615M, Grade 300 or Grade 420 bars, the requirements of Table 5.2, "Minimum Preheat and Interpass Temperatures," of AWS D1.4-92 are superseded by the following:

The minimum preheat and interpass temperatures shall be 200°C for Grade 300 bars and 300°C for Grade 420 bars. Immediately after completing the welding, at least 150 mm of the bar on each side of the splice shall be covered by an insulated wrapping to control the rate of cooling. The insulated wrapping shall remain in place until the bar has cooled below 90°C.

When welding different grades of reinforcing bars, the electrode shall conform to Grade 300 bar requirements and the preheat shall conform to the Grade 420 bar requirements.

In the event that any of the specified preheat, interpass and post weld cooling temperatures are not met, all weld and heat affected zone metal shall be removed and the splice rewelded.

Welding shall be protected from air currents, drafts, and precipitation to prevent loss of heat or loss of arc shielding. The method of protecting the welding area from loss of heat or loss of arc shielding shall be subject to approval by the Engineer.

Reinforcing bars shall not be direct butt spliced by thermite welding.

The first paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

52-1.08C Mechanical Butt Splices.—Mechanical butt splices shall be the sleeve-filler metal type, the sleeve-threaded type, the sleeve-swaged type, the sleeve-filler grout type, the sleeve-lockshear bolt type, the two-part sleeve-forged bar type, or the two-part sleeve-friction bar type, at the option of the Contractor.

The third paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

The total slip of the reinforcing bars within the splice sleeve after loading in tension to 200 MPa and relaxing to 20 MPa shall not exceed the following, measured between gage points clear of the splice sleeve: 250 µm for reinforcing bars No. 43, or smaller, or 750 µm for reinforcing bars No. 57.

The following is added after the third paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications:

Slip requirements shall not apply to mechanical lap splices.

The fourth subparagraph of the last paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

4. A statement that the splicing systems and materials used in accordance with the manufacturer's procedures will develop not less than the minimum tensile strengths, based on the nominal bar area, of 430 MPa for ASTM Designation: A 615/A 615M, Grade 300 bars and 550 MPa for ASTM Designations: A 615/A 615M, Grade 420 and A 706/A 706M bars, and will comply with the total slip requirements and the other requirements in these specifications.

Section 52-1.08C(5), "Sleeve-Extruded Mechanical Butt Splices," of the Standard Specifications is amended to read:

52-1.08C(5) Sleeve-Lockshear Bolt Mechanical Butt Splices.—The sleeve-lockshear bolt type of mechanical butt splices shall consist of a seamless steel sleeve, 2 serrated steel strips welded to the inside of the sleeve, center hole with centering pin, and bolts that are tightened until the bolt heads shear off and the bolt ends are embedded in the reinforcing bars.

52-1.08C(6) Two-Part Sleeve-Forged Bar Mechanical Butt Splices.—The two-part sleeve-forged bar type of mechanical butt splices shall consist of a shop machined two-part threaded steel sleeve that interlocks 2 hot-forged reinforcing bars ends. The forged bar ends may be either shop produced or field produced.

52-1.08C(7) Two-Part Sleeve-Friction Bar Mechanical Butt Splices.—The two-part sleeve-friction bar type of mechanical butt splices shall consist of a shop machined two-part threaded steel sleeve whose ends are friction welded, in the shop, to the reinforcing bars ends.

The fourth paragraph of Section 52-1.08D, "Qualification of Welding and Mechanical Splicing," of the Standard Specifications is amended to read:

Each operator qualification test for mechanical splices shall consist of 2 sample splices. Each mechanical splice procedure test shall consist of 2 sample splices.

For sleeve-filler, sleeve-threaded, sleeve-lockshear bolt and two-part sleeve friction bar mechanical butt splices, all sample splices shall be made on the largest reinforcing bar size to be spliced by the procedure or operator being tested except that No. 43 bars may be substituted for No. 57 bars.

For sleeve-swaged and two-part sleeve-forged mechanical butt splices, and mechanical lap splices, all sample splices shall be made on the largest reinforcing bar size of each deformation pattern to be spliced by the procedure or operator being tested. When joining new reinforcing bars to existing reinforcement, the qualification test sample bars shall be made using only the deformation patterns of the new reinforcement to be joined.

Section 52-1.08E, "Job Control Tests," of the Standard Specifications is amended to read:

52-1.08E Job Control Tests.—When mechanical butt splices, shop produced complete joint penetration butt welded splices, or shop produced resistance butt welded splices are used, the Contractor shall furnish job control tests from a local qualified testing laboratory. A job control test shall consist of the fabrication, under conditions used to produce the splice, and the physical testing of 3 sample splices for each lot of 150 splices.

A lot of mechanical butt splices is defined as 150, or fraction thereof, of the same type of mechanical butt splices used for each combination of bar size and bar deformation pattern that is used in the work.

A lot of shop produced complete joint penetration butt welded splices, or shop produced resistance butt welded splices, is defined as 150, or fraction thereof, of the same type of welds used for each combination of bar size and bar deformation pattern that is used in the work.

When joining new reinforcing bars to existing reinforcement, the job control test shall be made using only the deformation patterns of the new reinforcement to be joined.

A sample splice shall consist of a splice made at the job site to connect two 760 mm, or longer, bars using the same splice materials, position, location, and equipment, and following the same procedures as are being used to make splices in the work. Shorter sample splice bars may be used if approved by the Engineer.

Sample splices shall be made and tested in the presence of the Engineer or the Engineer's authorized representative.

Sample splices shall be suitably identified with weatherproof markings prior to shipment to the testing laboratory.

For sleeve-threaded mechanical butt splices, the reinforcing bars to be used for job control tests shall be fabricated on a random basis during the cutting of threads on the reinforcing bars of each lot and shipped to the job site with the material they represent.

For shop produced complete joint penetration butt welds, shop produced resistance butt welded splices and all types of mechanical butt splices, except the sleeve-threaded type, the Engineer will designate when samples for job control tests are to be fabricated, and will determine the limits of the lot represented by each job control test.

Should the average of the results of tests made on the 3 sample splices or should more than one sample splice in any job control test fail to meet the requirements for splices, all splices represented by that test will be rejected in accordance with the provisions in Section 6-1.04, "Defective Materials," of the Standard Specifications. This rejection shall prevail unless the Contractor, at the Contractor's expense, obtains and submits evidence, of a type acceptable to the Engineer, that the strength and quality of the splices in the work are acceptable.

Section 52-1.08F, "Nondestructive Splice Tests," of the Standard Specifications is amended to read:

52-1.08F Nondestructive Splice Tests.—All required radiographic examinations of complete joint penetration butt welded splices shall be performed by the Contractor in accordance with the requirements of AWS D 1.4 and these specifications.

Prior to radiographic examination, welds shall meet the requirements of Section 4.4, "Quality of Welds," of AWS D1.4-92.

Radiographic examinations shall be performed on 25 percent of all complete joint penetration butt welded splices from a production lot. The size of a production lot will be a maximum of 100 splices. The Engineer will select the splices which will compose the production lot and also the splices within each production lot to be radiographically examined.

Should more than 12 percent of the splices which have been radiographically examined in any production lot be defective, an additional 25 percent of the splices, selected by the Engineer from the same production lot, shall be radiographically examined. Should more than 12 percent of the cumulative total of splices tested from the same production lot be defective, all remaining splices in the lot shall be radiographically examined.

Additional radiographic examinations performed due to the identification of defective splices shall be at the Contractor's expense.

All defects shall be repaired in accordance with the requirements of AWS D1.4.

Radiographic examinations will not be required for either shop produced complete joint penetration butt welds or shop produced resistance butt welded splices of No. 25 or smaller bars used as spiral or hoop reinforcement.

In addition to radiographic examinations performed by the Contractor, any mechanical or welded splice may be subject to inspection or nondestructive testing by the Engineer. The Contractor shall provide sufficient access facilities in the shop and at the jobsite to permit the Engineer or his agent to perform the inspection or testing.

The Contractor shall notify the Engineer in writing 48 hours prior to performing any radiographic examinations.

The radiographic procedure used shall conform to the requirements of ASME Boiler and Pressure Vessels Code, Section V, Article 2 and the following:

Two exposures shall be made for each complete joint penetration butt welded splice. For each of the two exposures, the radiation source shall be centered on each bar to be radiographed. The first exposure shall be made with the radiation source placed at zero degrees from the top of the weld and perpendicular to the weld root and identified with a station mark of "0." When obstructions prevent a zero degree placement of the radiation source for the first exposure, and when approved in writing by the Engineer, the source may be rotated, around the centerline of the reinforcing bar, a maximum of 25 degrees. The second exposure shall be at 90 degrees to the "0" station mark and shall be identified with a station mark of "90."

For field produced complete joint penetration butt welds, no more than one weld shall be radiographed during one exposure. For shop produced complete joint penetration butt welds, if more than one weld is to be radiographed during one exposure, the angle between the root line of each weld and the direction to the radiation source shall be not less than 65 degrees.

Radiographs shall be made by either X-ray or gamma ray. Radiographs made by X-ray or gamma rays shall have densities of not less than 2.3 nor more than 3.5 in the area of interest. A tolerance of 0.05 in density is allowed for densitometer variations. Gamma rays shall be from the iridium 192 isotope and the emitting specimen shall not exceed 4.45 mm in the greatest diagonal dimension.

The radiographic film shall be placed perpendicular to the radiation source at all times; parallel to the root line of the weld unless source placement determines that the film must be turned; and as close to the root of the weld as possible.

The minimum source to film distance shall be maintained so as to insure that all radiographs maintain a maximum geometric unsharpness of 0.020 at all times, regardless of the size of the reinforcing bars.

Penetrameters shall be placed on the source side of the bar and perpendicular to the radiation source at all times. One penetrometer shall be placed in the center of each bar to be radiographed, perpendicular to the weld root, and adjacent to the weld. Penetrometer images shall not appear in the weld area.

When radiography of more than one weld is being performed per exposure, each exposure shall have a minimum of one penetrometer per bar, or 3 penetrameters per exposure. When 3 penetrameters per exposure are used, one penetrometer shall be placed on each of the 2 outermost bars of the exposure, and the remaining penetrometer shall be placed on a centrally located bar.

An allowable weld buildup of 4 mm may be added to the total material thickness when determining the proper penetrometer selection. No image quality indicator equivalency will be accepted. Wire penetrameters or penetrometer blocks shall not be used.

Penetrameters shall be sufficiently shimmed using a radiographically identical material. Penetrometer image densities shall be a minimum of 2.0 and a maximum of 3.6.

All radiographic film shall be Class 1, regardless of the size of reinforcing bars.

Radiographs shall be free of film artifacts and processing defects, including, but not limited to, streaks, scratches, pressure marks, or marks made for the purpose of identifying film or welding indications.

Each splice shall be clearly identified on each radiograph and the radiograph identification and marking system shall be established between the Contractor and the Engineer before radiographic inspection begins. Film shall be identified by lead numbers only; etching, flashing, or writing in identifications of any type will not be permitted. Each piece of film identification information shall be legible and shall include, as a minimum, the following information: Contractor's name, date, name of nondestructive testing firm, initials of radiographer, contract number, part number, and weld number. The letter "R" and repair number shall be placed directly after the weld number to designate a radiograph of a repaired weld.

Radiographic film shall be developed within a time range of one minute less to one minute more than the film manufacturer's recommended maximum development time. Sight development will not be allowed.

Processing chemistry shall be done with a consistent mixture and quality, and processing rinses and tanks shall be clean to ensure proper results. Records of all developing processes and any chemical changes to the developing processes shall be kept and furnished to the Engineer upon request. The Engineer may request, at any time, that a sheet of unexposed film be processed in the presence of the Engineer to verify processing chemical and rinse quality.

All radiographs shall be interpreted and graded by a Level II or Level III technician who is qualified in accordance with the American Society for Nondestructive Testing's Recommended Practice No. SNT-TC-1A. The results of these interpretations shall be recorded on a signed certification and a copy kept with the film packet.

Technique sheets prepared in accordance with ASME Boiler and Pressure Vessels Code, Section V, Article 2 Section T-291 shall also contain the developer temperature, developing time, fixing duration and all rinse times.

All radiographic envelopes shall have clearly written on the outside of the envelope the following information: name of the Contractor's Quality Control Manager (QCM), name of the nondestructive testing firm, name of the radiographer, date, contract number, complete part description, and all included weld numbers or a report number, as detailed in the Contractor's Quality Control Plan (QCP). In addition, all innerleaves shall have clearly written on them the part description and all included weld numbers, as detailed in the Contractor's QCP.

The third paragraph of Section 52-1.10, "Measurement," of the Standard Specifications is amended to read:

The lap of bars for all splices, including splices shown on the plans where a continuous bar is used, will be measured for payment. The mass calculated shall be based upon the following table:

BAR REINFORCING STEEL

Deformed Bar Designation Number	Mass Kilogram Per Meter	Nominal Diameter, Millimeters
10	0.560	9.5
13	0.994	12.7
16	1.552	15.9
19	2.235	19.1
22	3.042	22.2
25	3.973	25.4
29	5.060	28.7
32	6.404	32.3
36	7.907	35.8
43	11.38	43.0
57	20.24	57.3
Note: Bar numbers approximate the number of millimeters of the nominal diameter of the bars. The nominal diameter of a deformed bar is equivalent to the diameter of a plain round bar having the same mass per meter as the deformed bar.		

10-1.31 SIGN STRUCTURES

Sign structures and foundations for overhead signs shall conform to the provisions in Section 56-1, "Overhead Sign Structures," of the Standard Specifications and these special provisions.

Paragraph 3 in Section 56-1.01, "Description," of the Standard Specifications is amended to read:

Before commencing fabrication of sign structures, the Contractor shall submit 2 sets of working drawings to the Engineer in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings." The working drawings shall include sign panel dimensions, span lengths, post heights, anchorage layouts, proposed splice locations, a snugging and tensioning pattern for anchor bolts and high strength bolted connections, and details for permanent steel anchor bolt templates. The drawings shall be supplemented by a written quality control program listing methods, equipment, and personnel necessary to satisfy the requirements specified herein and in the special provisions.

Working drawings shall be 559 mm x 864 mm or 279 mm x 432 mm in size and each drawing and calculation sheet shall include the sign structure type and reference as shown on the contract plans, District-County-Route, and contract number.

The Engineer shall have 20 working days to review the sign structure working drawings after a complete submittal has been received. No fabrication or installation of sign structures shall be performed until the working drawings are approved in writing by the Engineer.

Should the Engineer fail to complete the review within the time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the sign structure working drawings, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays."

Section 56-1.02C, "Bolts, Nuts and Washers," of the Standard Specifications is amended to read:

56-1.02C Bolts, Nuts, and Washers.—Bolts, nuts, and washers for use in sign structures shall conform to the provisions in Section 55-2, "Materials."

A permanent steel template shall be used to maintain the proper anchor bolt spacing.

One top nut, one leveling nut, and two washers shall be provided for the upper threaded portion of each anchor bolt.

Paragraph 1 in Section 56-1.03, "Fabrication," of the Standard Specifications, with the exception of the title, is deleted.

Paragraph 3 in Section 56-1.03, "Fabrication," of the Standard Specifications is amended by adding the following:

Surfaces of base plates which are to come in contact with concrete, grout, or washers and leveling nuts shall be flat to within 3 mm tolerance in 305 mm, and to within 5 mm tolerance overall. Faying surfaces of plates in high-strength bolted connections including flange surfaces of field splices, chord joints, and frame junctures, and contact surfaces of plates used for breakaway slip base assemblies shall be flat to within 2 mm tolerance in 305 mm, and within 3 mm tolerance overall.

Thermally cut holes made in tubular members of sign supports, other than holes in base and flange plates, shall initially be made a minimum of 2 mm undersized, and then be mechanically enlarged by reaming or grinding to the final required size and shape. All edges shall have a surface roughness of not greater than 6.35 μm . Round holes may be drilled to the exact final diameter. No holes shall be made in members unless the holes are shown on the plans or are approved in writing by the Engineer.

Paragraphs 6 through 13 in Section 56-1.03, "Fabrication," of the Standard Specifications are amended to read:

High-strength bolted connections, where shown on the plans, shall conform to the provisions in Section 55-3.14, "Bolted Connections," except that only fastener assemblies consisting of a high-strength bolt, nut, hardened washer and direct tension indicator shall be used.

High-strength fastener assemblies, and any other bolts, nuts, and washers attached to sign structures shall be zinc-coated by the mechanical deposition process.

An alternating snugging and tensioning pattern for anchor bolts and high-strength bolted splices shall be used. Once tensioned, high-strength fastener components and DTI's shall not be reused.

For bolt diameters less than 10 mm, the diameter of the bolt hole shall be not more than 0.80-mm larger than the nominal bolt diameter. For bolt diameters greater than or equal to 10 mm, the diameter of the bolt hole shall be not more than 1.6 mm larger than the nominal bolt diameter.

Sign structures shall be fabricated into the largest practical sections prior to galvanizing.

Ribbed sheet metal panels for box beam closed truss sign structures shall be fastened to the truss members by cap screws or bolts as shown on the plans, or by 4.76 mm stainless steel blind rivets conforming to Industrial Fasteners Institute, Standard IFI-114, Grade 51. The outside diameter of the large flange rivet head shall be not less than 15.88 mm in diameter. Web splices in ribbed sheet metal panels may be made with similar type blind rivets of a size suitable for the thickness of material being connected.

Any spalling or chipping of concrete structures shall be repaired by the Contractor at the Contractor's expense.

Overhead sign supports shall have an aluminum identification plate permanently attached near the base, adjacent to the traffic side on one of the vertical posts, using either stainless steel rivets or stainless steel screws. As a minimum, the information on the plate shall include the name of the manufacturer, the date of manufacture and the contract number.

Section 56-1.04, "Welding," of the Standard Specifications is amended to read:

56-1.04 Welding.— Welding, nondestructive testing (NDT) of welds, and acceptance and repair criteria for NDT of steel overhead sign structure members shall conform to the requirements of AWS D1.1 and the special provisions.

Steel members used for overhead sign structures shall receive NDT in conformance with AWS D1.1 and the following:

Weld Location	Weld Type	Minimum Required NDT
Welds for butt joint welds in tubular sections, nontubular sections, and posts	CJP groove weld with backing ring	100% UT or RT
Longitudinal seam welds*	PJP groove weld	25% MT
	CJP groove weld	100% UT or RT
Welds for base plate, flange plate, or end cap to post or mast arm	CJP groove weld	25% UT or RT
	Fillet weld	25% MT
* Longitudinal seam welds shall have 60% minimum penetration, except that within 150 mm of any circumferential weld, longitudinal seam welds shall be CJP groove welds.		

A written procedure approved by the engineer shall be used when performing UT on material less than 8 mm thick. Contoured shoes shall be used when performing UT on round tubular sections under 1270 mm in diameter.

When less than 100 percent of a weld is specified for NDT, and if defects are found during this inspection, additional NDT shall be performed. This additional NDT shall be performed on 25% of the total weld for all similar welds, as determined by the Engineer, produced for sign structures in the project. If any portion of the additional weld inspected is found defective, 100% of all similar welds produced for sign structures in the project, as determined by the Engineer, shall be tested.

Circumferential welds and base plate to post welds may be repaired only one time without written permission from the Engineer.

Tubular sign structures shall be galvanized and not painted.

PAYMENT

Full compensation for furnishing anchor bolt templates and for testing of welds, shall be considered as included in the contract lump sum price paid per kilogram for furnish sign structure and no additional compensation will be allowed therefor.

10-1.32 ROADSIDE SIGNS

Roadside signs shall be installed at the locations shown on the plans or where directed by the Engineer, and shall conform to the provisions in Section 56-2, "Roadside Signs," of the Standard Specifications and these special provisions.

The first three paragraphs of Section 56-2.02B, "Wood Posts," of the Standard Specifications are amended to read:

The grades and species allowed for wood posts, 90 mm x 90 mm in size, are select heart redwood; No. 1 heart structural redwood (1050f); No. 2 heart structural redwood (900f); No. 1 structural light framing Douglas fir, free of heart center; No. 1 structural light framing Hem-Fir, free of heart center; or No. 1 structural light framing Southern yellow pine, free of heart center. The grades and species allowed for wood posts, 90 mm x 143 mm in size, are select heart grade redwood; select heart structural grade redwood (1100f); No. 1 heart structural redwood (950f); No. 2 structural joists and planks, Douglas fir, free of heart center; No. 1 structural joists and planks Hem-Fir, free of heart center; or No. 2 structural joists and planks Southern yellow pine. The grades and species allowed for wood posts larger than 90 mm x 143 mm in size are select heart redwood; No. 1 heart structural redwood (950f); No. 1 posts and timbers (also known as No. 1 structural) Douglas fir, free of heart center; select structural posts and timbers Hem-Fir, free of heart center; or No. 1 timbers Southern yellow pine, free of heart center.

Posts shall be graded in conformance with the provisions in Section 57-2, "Structural Timber." Sweep shall not exceed 25 mm in 3.0 m.

Before preservative treatment, the moisture content of Douglas fir, Hem-Fir, and Southern yellow pine posts shall be not more than 25 percent as measured at the midpoint of the post in the outer 25 mm, using an approved type of moisture meter, in conformance with the requirements of ASTM Designation: D 4444.

10-1.33 PLASTIC PIPE

Plastic pipe shall conform to the provisions in Section 64, "Plastic Pipe," of the Standard Specifications and these special provisions.

The first paragraph in Section 64-1.01, "Description," of the Standard Specifications is amended to read:

64-1.01 Description.—This work shall consist of furnishing and installing corrugated or ribbed plastic pipe for culverts, drains and conduits, with all necessary fittings and coupling systems, as shown on the plans or as determined by the Engineer in conformance with the provisions in these specifications and the special provisions.

The second paragraph in Section 64-1.01, "Description," of the Standard Specifications is amended to read:

Plastic pipe shall be either Type C, Type D or Type S corrugated polyethylene pipe, or ribbed profile wall polyethylene pipe or ribbed polyvinyl chloride (PVC) drain pipe.

The fourth paragraph in Section 64-1.01, "Description," of the Standard Specifications is amended to read:

Where designated on the plans as smooth interior wall type, plastic pipe shall be, at the Contractor's option, either Type D or Type S corrugated polyethylene pipe, or ribbed profile wall polyethylene pipe or ribbed PVC drain pipe.

The first subparagraph of the first paragraph in Section 64-1.02, "Materials" of the Standard Specifications is amended to read:

Type C, Type D and Type S corrugated polyethylene pipe shall conform to the requirements in AASHTO Designation: M 294 and MP6-95, except as otherwise specified.

The first paragraph in Section 64-1.03, "Pipe Thickness, Stiffness and Unit Mass," of the Standard Specifications is amended to read:

64-1.03 Pipe Thickness, Stiffness and Unit Mass.—Wall thickness of Type C corrugated polyethylene pipe shall be measured at the inside valley of the corrugation. Wall thickness of Type D corrugated polyethylene pipe shall be measured as the thickness of the inner liner. Wall thickness of Type S corrugated polyethylene pipe shall be the thickness of the inner liner measured between corrugation valleys. Wall thickness of ribbed profile wall polyethylene pipe shall be measured in the gap between ribs. The wall thickness of the various types of polyethylene pipe, measured as specified above, shall equal or exceed the minimum wall thickness values in Table 1. The wall thickness of ribbed profile wall PVC pipe measured in the gap between ribs shall equal or exceed the minimum wall thickness values in Table 3.

Tables 1, 2 and 3 in Section 64-1.03, "Pipe Thickness, Stiffness and Unit Mass," are amended to read:

TABLE 1
HDPE Pipe

Nominal Diameter (millimeters)	Minimum Wall Thickness (millimeters)	Minimum Pipe Stiffness (kPa)
300	0.89	345
375	0.89	290
450	1.27	275
525	1.27	260
600	1.27	235
675	1.27	215
750	1.27	195
825	1.27	170
900	1.27	150
1050	1.80	140
1200	1.80	125

TABLE 2
HDPE Pipe

Nominal Diameter (millimeters)	Minimum Unit Mass			
	Type C Corrugated (Kilograms per meter)	Type D Corrugated (Kilograms per meter)	Type S Corrugated (Kilograms per meter)	Ribbed (Kilograms per meter)
300	4.2	na	4.0	na
375	6.0	na	6.0	na
450	8.6	na	8.9	14.3
525	na	na	na	19.6
600	14.3	na	15.2	26.2
675	na	na	na	na
750	na	na	22.3	na
825	na	na	na	na
900	na	na	26.9	na
1050	na	33.0	33.0	na
1200	na	47.5	40.1	na

Note: "na" in the above table indicates that the pipe size of that type of pipe either is not available from manufacturers or has not been approved for use.

TABLE 3
Ribbed PVC Pipe

Nominal Diameter (millimeters)	Minimum Wall Thickness (millimeters)	Minimum Pipe Stiffness (kPa)	Minimum Pipe Unit Mass (kilograms per meter)
450	2.41	220	11.9
525	2.67	190	16.4
600	2.92	165	19.3
675	3.18	150	25.3
750	3.43	130	29.8
900	3.94	110	40.2
1050	4.32	95	56.6
1200	4.83	80	77.4

Section 64-1.04, "Joints," of the Standard Specifications is amended to read:

64-1.04 Joints.—Plastic pipe culvert joints shall conform to either standard or positive joint requirements in Section 61-1.02, "Performance Requirements for Culvert and Drainage Pipe Joints," except that where sleeve joint connections are utilized, the sleeve minimum width shall be 195 mm, and at least two corrugations from each pipe to be joined are engaged by the sleeve.

Where watertight joints are not specified, Type S corrugated polyethylene pipe shall incorporate, on each side of the joint, a closed-cell expanded rubber gasket meeting the requirements of ASTM Designation: D 1056, Grade 2A2. Type D corrugated polyethylene pipe shall incorporate a rubber gasket in a groove on the spigot end of the pipe. The gasket for Type D polyethylene pipe shall meet the requirements of ASTM Designation: F 477 or D 1056, Grade 2A2. The gaskets described in this paragraph shall be installed by the pipe manufacturer. Pipe shall be stored in a manner that protects the gaskets from weather. Cracks or splits occurring on gaskets will be cause for rejection.

Corrugated polyethylene pipe joints manufactured to conform to the integral joint provisions in Section 61-1.02, "Performance Requirements for Culvert and Drainage Pipe Joints," shall be laid to line and grade with the sections jointed closely. Corrugated polyethylene pipe to be joined by sleeve joints shall be laid to line and grade with the separate sections not more than 40 mm apart and then joined together firmly with at least 2 corrugations from each pipe section engaged in the coupler.

Joints for pipe designated on the plans as watertight, shall be watertight under pressure and all conditions of expansion, contraction, and settlement, and shall conform to the provisions for watertightness in Section 61-1.02, "Performance Requirements for Culvert and Drainage Pipe Joints."

10-1.34 REINFORCED CONCRETE PIPE

Reinforced concrete pipe shall conform to the provisions in Section 65, "Reinforced Concrete Pipe," of the Standard Specifications and these special provisions.

The relative compaction required below the pipe spring line for pipe in Method 1 backfill in trench, where the pipe is not within the traveled way or under embankment, shall be 85 percent, minimum.

Except as otherwise designated by classification on the plans or in the specifications, joints for culvert and drainage pipes shall conform to the plans or specifications for standard joints.

10-1.35 MISCELLANEOUS IRON AND STEEL

Miscellaneous iron and steel shall conform to the provisions in Section 75, "Miscellaneous Metal," of the Standard Specifications.

10-1.36 CHAIN LINK WALK GATES

Chain link walk gates shall be Type CL-1.8 conforming to the provisions in Section 80, "Fences," of the Standard Specifications and these special provisions.

Gates shall be installed in existing fences at the locations shown on the plans. Gate installations shall be complete with gate post, latch post, concrete footings, braces, truss rods, and hardware. Gate and latch posts shall be braced to the next existing line post.

At gate location, an existing line post shall be removed and the new gate installed so it is centered on the post hole of the removed post. Holes resulting from the removal of line posts shall be backfilled.

Gate mounting and latching hardware shall not contain open-end slots for the fastening bolts.

Chain link fabric for gates shall be of the same mesh size as the existing fence in which the gates are installed.

Openings made in existing fences for installation of gates shall be closed during the working day in which the openings are made and when work is not in progress. Temporary closures shall be made with the existing fence fabric or with additional 1.83-m chain link fabric as directed by the Engineer.

Full compensation for making the openings in existing fences, for temporary closing of the openings (including furnishing additional fence fabric if necessary), and for new posts, footings, hardware, braces, and truss rods shall be considered as included in the contract lump sum price paid for traffic monitoring station and no additional compensation will be allowed therefor.

10-1.37 INSTALL MEDIAN MILEAGE PANEL

Median mileage panels shall be installed as shown on the plans and where directed by the Engineer, and in conformance with these special provisions.

Target plates for median mileage panel will be furnished by the State as provided under "State-Furnished Materials" of these special provisions. Installation holes in target plates shall be drilled or punched by the Contractor and as directed by the Engineer, after determination of type of installation. Target plates shall have only the necessary holes for the specified installation indicated.

Appropriate letters and numerals shall be affixed to the target plates by the Contractor as directed by the Engineer and in conformance to the requirements in Section 82-1.04, "Marker Information," of the Standard Specifications.

Wood posts for installing median mileage panels shall conform to the provisions in Section 56-2.02B, "Wood Posts," of the Standard Specifications.

Installing median mileage panels will be measured as units determined from actual count of median mileage panels in place.

The contract unit price paid for install median mileage panel shall include full compensation for furnishing all labor, (including the affixing of the appropriate letters and numerals to the target plates and providing traffic control when necessary to allow accurate and safe determination of median mileage panel locations), materials (except State-furnished target plates), hardware, tools, equipment, and incidentals, and for doing all the work involved in installing median mileage panels, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.38 CONCRETE BARRIER

Concrete barriers shall conform to the provisions in Section 83-2, "Barriers," of the Standard Specifications and these special provisions.

The provisions of the third paragraph in Section 83-2.02D(4), "Finishing," of the Standard Specifications, as amended herein, shall not apply.

Concrete barrier markers shall be as specified in "Approved Traffic Products" of these special provisions. At the locations designated on the plans, concrete barrier markers shall be cemented to the barrier in conformance with the manufacturer's recommendations.

The subparagraphs in the second paragraph in Section 83-2.02D(1), "General," of the Standard Specifications are amended to read:

- a. For concrete barriers Type 50 series and Type 60 series, the top shall not vary more than 6 mm from the edge of the straightedge and the faces shall not vary more than 12 mm from the edge of the straightedge.
- b. For concrete barriers other than Type 50 series and Type 60 series, both the top and faces shall not vary more than 6 mm from the edge of the straightedge.

The eighth paragraph in Section 83-2.02D(1), "General," of the Standard Specifications is amended to read:

Granular material for backfill between the 2 walls of concrete barriers (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE), as shown on the plans, shall be placed without compaction.

The first, second, third, and eighth paragraphs in Section 83-2.02D(2), "Materials," of the Standard Specifications are amended to read:

83-2.02D(2) Materials.—Type 50 and Type 60 series concrete barriers shall be constructed of minor concrete conforming to the provisions in Section 90-10, "Minor Concrete," except as follows:

- a. The maximum size of aggregate used for extruded or slip-formed concrete barriers shall be at the option of the Contractor, but in no case shall the maximum size be larger than 37.5 mm nor smaller than 9.5 mm.
- b. If the 9.5-mm maximum size aggregate grading is used to construct extruded or slip-formed concrete barriers, the cement content of the minor concrete shall be not less than 400 kg/m³.

Concrete barriers other than Type 50 and Type 60 series shall be constructed of Class 2 concrete conforming to the provisions in Section 90, "Portland Cement Concrete."

The concrete paving between the tops of the 2 walls of concrete barrier (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE) and the optional concrete slab at the base between the 2 walls of concrete barrier (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE) shall be constructed of minor concrete conforming to the provisions of Section 90-10, "Minor Concrete," except that the minor concrete shall contain not less than 300 kg of cement per cubic meter.

Granular material for backfill between the 2 walls of concrete barrier (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE) shall be earthy material suitable for the purpose intended, having no rocks, lumps or clods exceeding 37.5 mm in greatest dimension.

The first and second paragraphs in Section 83-2.02D(3), "Construction Methods," of the Standard Specifications are amended to read:

83-2.02D(3) Construction Methods.—Type 50 series and Type 60 series concrete barriers shall be constructed by either the "cast-in-place with fixed forms" method or the "extrusion or slip-form" method or a combination thereof, at the Contractor's option.

Concrete barriers other than Type 50 series and Type 60 series shall be constructed by the "cast-in-place with fixed forms" method.

Section 83-2.02D(4), "Finishing," of the Standard Specifications is amended to read:

83-2.02D(4) Finishing.—The surface finish of concrete barriers Type 50 series and Type 60 series, prior to the application of the curing compound, shall be free from surface pits larger than 25 mm in diameter and shall be given a final soft brush finish with strokes parallel to the line of the barriers. Finishing with a brush application of grout will not be permitted.

To facilitate finishing, fixed forms for cast-in-place concrete barriers Type 50 series and Type 60 series, shall be removed as soon as possible after the concrete has set enough to maintain the shape of the barrier without support.

Not less than 7 days after placing, exposed surfaces of concrete barriers, Type 50 series and Type 60 series, shall receive a light abrasive blast finish so that a uniform appearance is achieved.

The final surface finish of concrete barriers other than Type 50 series and Type 60 series shall be Class 1 Surface Finish as specified in Section 51-1.18B, "Class 1 Surface Finish." Alternative final surface finish methods proposed by the Contractor shall be submitted in writing and shall not be used unless approved by the Engineer.

Section 83-2.02D(5), "Curing," of the Standard Specifications is amended to read:

83-2.02D(5) Curing.—Exposed surfaces of concrete barriers shall be cured with the non-pigmented curing compound (6) as provided in Section 90-7.01B, "Curing Compound Method." At the Contractor's option, the formed surfaces of concrete barriers, which are on bridges or walls but which do not support soundwalls, may be cured as provided in Section 90-7.01D, "Forms-In-Place Method," except the forms shall be retained in place for a minimum period of 12 hours after the concrete has been placed. When curing Type 50 series and Type 60 series concrete barriers, curing compound shall be applied by a mechanical sprayer capable of applying the curing compound to at least one entire side and the top of the concrete barrier in one application at a uniform rate of coverage. The spray shall be adequately protected against wind.

The ninth and tenth paragraphs in Section 83-2.03, "Measurement," of the Standard Specifications are amended to read:

Concrete barriers, except (Type 50E), (Type 60E), (Type 60GE) and (Type 60SE), will be measured along the top of the barrier.

Concrete barriers (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE) will be measured once along the center-line between the 2 walls of the barrier.

Transition sections will be measured and paid for as the type of barrier it transitions to.

The fourth paragraph in Section 83-2.04, "Payment," of the Standard Specifications is amended to read:

The contract prices paid per meter for concrete barrier of the type or types listed in the Engineer's Estimate shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the concrete barriers, complete in place, including bar reinforcing steel, steel dowels and drilling and bonding dowels in structures, hardware for steel plate barrier, miscellaneous metal, concrete barrier markers, excavation, backfill (including concrete paving, granular material and concrete slab used as backfill in concrete barriers (Type 50E), (Type 60E), (Type 60GE), and (Type 60SE)), and disposing of surplus material and for furnishing, placing, removing and disposing of the temporary railing for closing the gap between existing barrier and the concrete barrier being constructed, as shown on the plans, as specified in these specifications and the special provisions, and as directed by the Engineer.

10-1.39 THERMOPLASTIC TRAFFIC STRIPES AND PAVEMENT MARKINGS

Thermoplastic traffic stripes (traffic lines) and pavement markings shall conform to the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

Thermoplastic material shall conform to the requirements of State Specification 8010-21C-19.

The second and third sentences of Section 84-2.02, "Materials," of the Standard Specifications are amended to read:

Glass beads to be applied to the surface of the molten thermoplastic material shall conform to the requirements of State Specification 8010-004 (Type II).

State Specifications for thermoplastic material and glass beads may be obtained from the Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, CA 95819-4612, Telephone 916-227-7289.

At the option of the Contractor, permanent striping tape as specified in "Approved Traffic Products" of these special provisions, may be placed instead of the thermoplastic traffic stripes and pavement markings specified herein, except that 3M, "Stamark" Series A320 Bisymmetric Grade, manufactured by the 3M Company, shall not be used. Pavement tape, if used, shall be installed in conformance with the manufacturer's specifications. If pavement tape is placed instead of thermoplastic traffic stripes and pavement markings, the pavement tape will be measured and paid for as thermoplastic traffic stripe and thermoplastic pavement marking.

10-1.40 PAINT TRAFFIC STRIPES

Painting traffic stripes (traffic lines) and pavement markings shall be applied where shown on the plans and as directed by the Engineer and shall conform to the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

The subparagraphs of the first paragraph in Section 84-3.02, "Materials," of the Standard Specifications are amended to read:

	State Specification No.
Solvent Borne, Acrylic Copolymer Traffic Line.—White, Yellow and Black	PT-170-A
Water Borne, Traffic Line.—White, Yellow and Black	8010-20A

The second and third paragraphs in Section 84-3.02, "Materials," of the Standard Specifications are amended to read:

Glass beads shall conform to State Specification 8010-004 (Type II).

State Specifications for traffic paint and glass beads may be obtained from the Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, CA 95819-4612, Telephone 916-227-7289.

10-1.41 PAVEMENT MARKERS

Pavement markers shall conform to the provisions in Section 85, "Pavement Markers," of the Standard Specifications and these special provisions.

Attention is directed to "Traffic Control System For Lane Closure" in these special provisions regarding the use of moving lane closures during placement of pavement markers with bituminous adhesive.

Reflective pavement markers shall comply with the specific intensity provisions for reflectance after abrading the lens surface in conformance with the "Steel Wool Abrasion Procedure" specified for pavement markers placed in pavement recesses in Section 85-1.05, "Reflective Pavement Markers," of the Standard Specifications.

SECTION 10-2. (BLANK)

SECTION 10-3. LIGHTING AND ELECTRICAL SYSTEMS

10-3.01 DESCRIPTION

Modifying sign illumination and traffic monitoring stations shall conform to the provisions in Section 86, "Signals, Lighting and Electrical Systems," of the Standard Specifications and these special provisions.

10-3.02 COST BREAK-DOWN

The Contractor shall furnish to the Engineer a cost break-down for each contract lump sum item of work described in this Section 10-3.

The Contractor shall determine the quantities required to complete the work shown on the plans. The quantities and values shall be included in the cost break-down submitted to the Engineer for approval. The Contractor shall be responsible for the accuracy of the quantities and values used in the cost break-down submitted for approval.

No adjustment in compensation will be made in the contract lump sum prices paid for the various electrical work items due to any differences between the quantities shown in the cost break-down furnished by the Contractor and the quantities required to complete the work as shown on the plans and as specified in these special provisions.

The sum of the amounts for the units of work listed in the cost break-down for electrical work shall be equal to the contract lump sum price bid for the work. Overhead and profit shall be included in each individual unit listed in the cost break-down, however, costs for traffic control system shall not be included. Bond premium, temporary construction facilities, plant and other items will not be paid for under the various electrical work items and shall be included in the mobilization bid item for the entire project.

The cost break-down shall be submitted to the Engineer for approval within 10 days after the contract has been approved. The cost break-down shall be approved, in writing, by the Engineer before any partial payment for the items of electrical work will be made.

At the Engineer's discretion the approved cost break-down may be used to determine partial payments during the progress of the work and as the basis of calculating the adjustment in compensation for the item or items of electrical work due to changes ordered by the Engineer. When an ordered change increases or decreases the quantities of an approved cost break-down, the adjustment in compensation may be determined at the Engineer's discretion in the same manner specified for increases and decreases in the quantity of a contract item of work in accordance with Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications.

The cost breakdown shall, as a minimum, include the following items:

- foundations - each type
- conduit - list by each size and installation method
- pull boxes
- conductors - each size and type
- service equipment enclosure and circuit breakers
- inductive loop detectors

10-3.03 MAINTAINING EXISTING AND TEMPORARY ELECTRICAL SYSTEMS

Traffic monitoring station and sign lighting system shutdowns shall be limited to periods between the hours of 9:00 a.m. and 3:00 p.m.

Sign illumination systems shall be maintained in effective operation at all other times.

The Contractor shall obtain written approval from the Engineer, not less than 72 hours prior to any testing, disconnection or disruption of service from the existing lighting, sign illumination and ramp metering systems.

10-3.04 CONDUIT

Conduit to be installed underground shall be Type 1.

Detector termination conduits shall be Type 1.

The conduit in a foundation and between a foundation and the nearest pull box shall be Type 1.

When a standard coupling cannot be used for joining Type 1 conduit, a UL listed threaded union coupling, as specified in the third paragraph in Section 86-2.05C, "Installation," of the Standard Specifications, or a concrete-tight split coupling or concrete-tight set screw coupling shall be used.

After conductors have been installed, the ends of conduits terminating in pull boxes, and in service equipment enclosure and controller cabinets shall be sealed with an approved type of sealing compound.

Trenching method is not allowed across freeway lanes, connectors and ramps.

Conduit installation on city streets shall be by "Trenching in Pavement Method" only.

At locations where conduit is required to be installed under pavement and if delay to any vehicle will not exceed 5 minutes, conduit may be installed by the "Trenching in Pavement Method."

10-3.05 PULL BOXES

Grout shall not be placed in bottom of pull boxes.

10-3.06 CONDUCTORS AND WIRING

Splices shall be insulated by "Method B" or, at the Contractor's option, splices of conductors shall be insulated with heat-shrink tubing of the appropriate size after thoroughly painting the spliced conductors with electrical insulating coating.

The minimum insulation thickness, at any point, for Type USE, RHH or RHW wire shall be 1.0 mm for conductor sizes No. 14 to No. 10, inclusive, and 1.3 mm for No. 8 to No. 2, inclusive. The minimum insulation thickness, at any point, for Type THW and TW wires shall be 0.69 mm for conductor sizes No. 14 to No. 10, inclusive, 1.02 mm for No. 8, and 1.37 mm for No. 6 to No. 2, inclusive.

In addition to the requirements for splices in detector circuits, the open end of cable jackets or tubing shall be sealed in a manner similar to the splicing requirements to prevent the entrance of water.

10-3.07 SERVICE

Continuous welding of exterior seams in service equipment enclosures is not required.

Circuit breakers shall be the cable-in/cable-out type, mounted on non-energized clips. All circuit breakers shall be mounted vertically with the up position of the handle being the "ON" position.

Dead front panel or panels, and corresponding exterior door, shall be hinged on one side and shall be operable without the use of tools.

A barrier type terminal block rated for 40 A, minimum, shall be provided in each service equipment enclosure. The terminal block shall have a minimum of 12 positions with terminals rated at Size No. 8 or larger, to accept the field wires indicated on the plans. Field wires shall be terminated using crimped, insulated loop connectors.

An engraved phenolic nameplate shall be installed with stainless steel rivets on the exterior of the front panel indicating the identification number and the service address of the service cabinet enclosure. Character size shall be 5 mm.

Service conduits between the utility owned power poles and the service equipment enclosures shall not be installed until service locations have been verified by the serving utility.

Where a new service is to be installed, the Contractor shall notify the Engineer in writing at least fifteen working days prior to the date service is required.

10-3.08 NUMBERING ELECTRICAL EQUIPMENT

The Contractor shall place the numbers and edge sealer on the equipment as directed by the Engineer.

Reflective numbers shall be applied to a clean surface. Only the edges of the numbers shall be treated with edge sealer.

Five digit, self-adhesive equipment numbers shall be placed for all service pedestal. On service pedestal, the numbers shall be placed on the front door.

10-3.09 STATE-FURNISHED TRAFFIC MONITORING STATION CONTROLLER ASSEMBLY

The Model 170 controller assembly including controller unit, completely wired Type 334 controller cabinet and inductive loop detector sensor units, but without anchor bolts, will be State-furnished as provided under "Materials" of these special provisions.

The Contractor shall construct the controller cabinet foundation as shown on Standard Plan ES-4B for Model 332 and 334 cabinets (including furnishing and installing anchor bolts), shall install the controller cabinet on the foundation, and shall make all field wiring connections to the terminal block in the controller cabinet.

A listing of field conductor terminations, in the State-furnished controller cabinet, will be furnished free of charge to the Contractor at the site of the work.

State forces will maintain the controller assembly. The Contractor's responsibility shall be limited to that provided for in Section 6-1.02, "State-Furnished Materials," of the Standard Specifications.

10-3.10 INDUCTIVE LOOP DETECTORS

Loop detector sensor units will be State-furnished as provided under "Materials" of these special provisions.

Loop detector lead-in cable shall be Type B.

Inductive loop detector shall be Type E. For Type E detector loop, sides of the slot shall be vertical and the minimum radius of the slot entering and leaving the circular part of the loop shall be 40 mm. Slot width shall be a maximum of 20 mm. Loop wire for circular loop shall be Type 2. Depth of slots of circular loop shall not to exceed the depth of pavement as shown on the plans and shall be filled with hot-melt rubberized asphalt sealant. Inductive loop detector shall be installed only after pavement stripping is completed.

The depth of loop sealant above the top of the uppermost loop wire in the sawed slots shall be as shown on the plans. The saw cut depth shall have a maximum as shown in the plans.

10-3.11 DISPOSING OF ELECTRICAL EQUIPMENT

All ballasts and transformers and all fluorescent and mercury lamps shall be disposed of in accordance with California Department of Health Services Regulations set forth in Title 22, Division 4, Chapter 30, of the California Code of Regulations (CCR).

Ballasts and transformers which contain polychlorinated biphenyl (PCB) are designated extremely hazardous wastes, and fluorescent tubing and mercury lamps are designated hazardous wastes under Article 9, Section 66680 of Title 22, Chapter 30 (CCR).

The following electrical material on the project is known to contain PCB:

Transformers and ballasts for fluorescent lamps.

The Contractor shall package and ship recyclable hazardous waste via a currently certified hauler in conformance with Article 12, Chapter 30 of Title 22 (CCR) and other applicable local, State, and Federal regulations.

The Contractor shall furnish the Engineer with a statement as to which certified hauler and which certified recycler he proposes to utilize, together with a copy of the recycler's interim status document or a copy of the variance letter from the Department of Health Services. The statement shall be furnished within 15 calendar days after the contract has been approved by the Attorney General.

The State assumes generator responsibility for these wastes. The Engineer will prepare the Hazardous Waste Manifest for Shipment.

Full compensation for hauling, stockpiling, and disposal of fluorescent tubing and lamps shall be considered as included in the contract price paid for the electrical item involved and no additional compensation will be allowed therefor.

Handling and disposing of electrical material containing PCB, after removal, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

SECTION 11. (BLANK)

SECTION 12. (BLANK)

SECTION 13. (BLANK)

SECTION 14 FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION PROJECTS

GENERAL.—The work herein proposed will be financed in whole or in part with Federal funds, and therefore all of the statutes, rules and regulations promulgated by the Federal Government and applicable to work financed in whole or in part with Federal funds will apply to such work. The "Required Contract Provisions, Federal-Aid Construction Contracts, "Form FHWA 1273, are included in this Section 14. Whenever in said required contract provisions references are made to "SHA contracting officer", "SHA resident engineer", or "authorized representative of the SHA", such references shall be construed to mean "Engineer" as defined in Section 1-1.18 of the Standard Specifications.

PERFORMANCE OF PREVIOUS CONTRACT.—In addition to the provisions in Section II, "Nondiscrimination," and Section VII, "Subletting or Assigning the Contract," of the required contract provisions, the Contractor shall comply with the following:

The bidder shall execute the CERTIFICATION WITH REGARD TO THE PERFORMANCE OF PREVIOUS CONTRACTS OR SUBCONTRACTS SUBJECT TO THE EQUAL OPPORTUNITY CLAUSE AND THE FILING OF REQUIRED REPORTS located in the proposal. No request for subletting or assigning any portion of the contract in excess of \$10,000 will be considered under the provisions of Section VII of the required contract provisions unless such request is accompanied by the CERTIFICATION referred to above, executed by the proposed subcontractor.

NON-COLLUSION PROVISION.—The provisions in this section are applicable to all contracts except contracts for Federal Aid Secondary projects.

Title 23, United States Code, Section 112, requires as a condition precedent to approval by the Federal Highway Administrator of the contract for this work that each bidder file a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with the submitted bid. A form to make the non-collusion affidavit statement required by Section 112 as a certification under penalty of perjury rather than as a sworn statement as permitted by 28, USC, Sec. 1746, is included in the proposal.

PARTICIPATION BY MINORITY BUSINESS ENTERPRISES IN SUBCONTRACTING.—Part 23, Title 49, Code of Federal Regulations applies to this Federal-aid project. Pertinent sections of said Code are incorporated in part or in its entirety within other sections of these special provisions.

Schedule B—Information for Determining Joint Venture Eligibility

(This form need not be filled in if all joint venture firms are minority owned.)

1. Name of joint venture _____
2. Address of joint venture _____
3. Phone number of joint venture _____
4. Identify the firms which comprise the joint venture. (The MBE partner must complete Schedule A.) _____

 - a. Describe the role of the MBE firm in the joint venture. _____
 - b. Describe very briefly the experience and business qualifications of each non-MBE joint venturer: _____

5. Nature of the joint venture's business _____

6. Provide a copy of the joint venture agreement.
7. What is the claimed percentage of MBE ownership? _____
8. Ownership of joint venture: (This need not be filled in if described in the joint venture agreement, provided by question 6.).
 - a. Profit and loss sharing.
 - b. Capital contributions, including equipment.
 - c. Other applicable ownership interests.

9. Control of and participation in this contract. Identify by name, race, sex, and "firm" those individuals (and their titles) who are responsible for day-to-day management and policy decision making, including, but not limited to, those with prime responsibility for:

a. Financial decisions _____

b. Management decisions, such as:

(1) Estimating _____

(2) Marketing and sales _____

(3) Hiring and firing of management personnel _____

(4) Purchasing of major items or supplies _____

c. Supervision of field operations _____

Note.—If, after filing this Schedule B and before the completion of the joint venture's work on the contract covered by this regulation, there is any significant change in the information submitted, the joint venture must inform the grantee, either directly or through the prime contractor if the joint venture is a subcontractor.

Affidavit

"The undersigned swear that the foregoing statements are correct and include all material information necessary to identify and explain the terms and operation of our joint venture and the intended participation by each joint venturer in the undertaking. Further, the undersigned covenant and agree to provide to grantee current, complete and accurate information regarding actual joint venture work and the payment therefor and any proposed changes in any of the joint venture arrangements and to permit the audit and examination of the books, records and files of the joint venture, or those of each joint venturer relevant to the joint venture, by authorized representatives of the grantee or the Federal funding agency. Any material misrepresentation will be grounds for terminating any contract which may be awarded and for initiating action under Federal or State laws concerning false statements."

_____ Name of Firm	_____ Name of Firm
_____ Signature	_____ Signature
_____ Name	_____ Name
_____ Title	_____ Title
_____ Date	_____ Date

Date _____

State of _____

County of _____

On this ____ day of _____, 19 __, before me appeared (Name) _____, to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

Date _____

State of _____

County of _____

On this ____ day of _____, 19 __, before me appeared (Name) _____ to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

**REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS**

I. GENERAL

1. These contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.
2. Except as otherwise provided for in each section, the contractor shall insert in each subcontract all of the stipulations contained in these Required Contract Provisions, and further require their inclusion in any lower tier subcontract or purchase order that may in turn be made. The Required Contract Provisions shall not be incorporated by reference in any case. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with these Required Contract Provisions.
3. A breach of any of the stipulations contained in these Required Contract Provisions shall be sufficient grounds for termination of the contract.
4. A breach of the following clauses of the Required Contract Provisions may also be grounds for debarment as provided in 29 CFR 5.12:

Section I, paragraph 2;
Section IV, paragraphs 1, 2, 3, 4, and 7;
Section V, paragraphs 1 and 2a through 2g.

5. Disputes arising out of the labor standards provisions of Section IV (except paragraph 5) and Section V of these Required Contract Provisions shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the U.S. Department of Labor (DOL) as set forth in 29 CFR 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the DOL, or the contractor's employees or their representatives.
6. **Selection of Labor:** During the performance of this contract, the contractor shall not:
 - a. discriminate against labor from any other State, possession, or territory of the United States (except for employment preference for Appalachian contracts, when applicable, as specified in Attachment A), or
 - b. employ convict labor for any purpose within the limits of the project unless it is labor performed by convicts who are on parole, supervised release, or probation.

II. NONDISCRIMINATION

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

1. **Equal Employment Opportunity:** Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, and 41 CFR 60) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The Equal Opportunity Construction Contract Specifications set forth under 41 CFR 60-4.3 and the provisions of the American Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:
 - a. The contractor will work with the State highway agency (SHA) and the Federal Government in carrying out EEO obligations and in their review of his/her activities under the contract.
 - b. The contractor will accept as his operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall

include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, preapprenticeship, and/or on-the-job training."

2. **EEO Officer:** The contractor will designate and make known to the SHA contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active contractor program of EEO and who must be assigned adequate authority and responsibility to do so.
3. **Dissemination of Policy:** All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:
 - a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
 - b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
 - c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minority group employees.
 - d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
 - e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.
4. **Recruitment:** When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minority groups in the area from which the project work force would normally be derived.
 - a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minority group applicants. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority group applicants may be referred to the contractor for employment consideration.
 - b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, he is expected to observe the provisions of that agreement to the extent that the system permits the contractor's compliance with EEO contract provisions. (The DOL has held that where implementation of such agreements have the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Executive Order 11246, as amended.)
 - c. The contractor will encourage his present employees to refer minority group applicants for employment. Information and procedures with regard to referring minority group applicants will be discussed with employees.
5. **Personnel Actions:** Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:
 - a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

- b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
 - c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.
 - d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with his obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of his avenues of appeal.
6. Training and Promotion:
- a. The contractor will assist in locating, qualifying, and increasing the skills of minority group and women employees, and applicants for employment.
 - b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. Where feasible, 25 percent of apprentices or trainees in each occupation shall be in their first year of apprenticeship or training. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision.
 - c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
 - d. The contractor will periodically review the training and promotion potential of minority group and women employees and will encourage eligible employees to apply for such training and promotion.
7. **Unions:** If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use his/her best efforts to obtain the cooperation of such unions to increase opportunities for minority groups and women within the unions, and to effect referrals by such unions of minority and female employees. Actions by the contractor either directly or through a contractor's association acting as agent will include the procedures set forth below:
- a. The contractor will use best efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minority group members and women for membership in the unions and increasing the skills of minority group employees and women so that they may qualify for higher paying employment.
 - b. The contractor will use best efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
 - c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the SHA and shall set forth what efforts have been made to obtain such information.
 - d. In the event the union is unable to provide the contractor with a reasonable flow of minority and women referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minority group persons and women. (The DOL has held that it shall be no excuse that the union with which the contractor has a collective bargaining agreement providing for exclusive referral failed to refer minority employees.) In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the SHA.

- 8. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment:** The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment.
- a. The contractor shall notify all potential subcontractors and suppliers of his/her EEO obligations under this contract.
 - b. Disadvantaged business enterprises (DBE), as defined in 49 CFR 23, shall have equal opportunity to compete for and perform subcontracts which the contractor enters into pursuant to this contract. The contractor will use his best efforts to solicit bids from and to utilize DBE subcontractors or subcontractors with meaningful minority group and female representation among their employees. Contractors shall obtain lists of DBE construction firms from SHA personnel.
 - c. The contractor will use his best efforts to ensure subcontractor compliance with their EEO obligations.
- 9. Records and Reports:** The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following completion of the contract work and shall be available at reasonable times and places for inspection by authorized representatives of the SHA and the FHWA.
- a. The records kept by the contractor shall document the following:
 - (1) The number of minority and non-minority group members and women employed in each work classification on the project;
 - (2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women;
 - (3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minority and female employees; and
 - (4) The progress and efforts being made in securing the services of DBE subcontractors or subcontractors with meaningful minority and female representation among their employees.
 - b. The contractors will submit an annual report to the SHA each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data.

III. NONSEGREGATED FACILITIES

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

- a. By submission of this bid, the execution of this contract or subcontract, or the consummation of this material supply agreement or purchase order, as appropriate, the bidder, Federal-aid construction contractor, subcontractor, material supplier, or vendor, as appropriate, certifies that the firm does not maintain or provide for its employees any segregated facilities at any of its establishments, and that the firm does not permit its employees to perform their services at any location, under its control, where segregated facilities are maintained. The firm agrees that a breach of this certification is a violation of the EEO provisions of this contract. The firm further certifies that no employee will be denied access to adequate facilities on the basis of sex or disability.
- b. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and washrooms, restaurants and other eating areas, time clocks, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive, or are, in fact, segregated on the basis of race, color, religion, national origin, age or disability, because of habit, local custom, or otherwise. The only exception will be for the disabled when the demands for accessibility override (e.g. disabled parking).

- c. The contractor agrees that it has obtained or will obtain identical certification from proposed subcontractors or material suppliers prior to award of subcontracts or consummation of material supply agreements of \$10,000 or more and that it will retain such certifications in its files.

IV. PAYMENT OF PREDETERMINED MINIMUM WAGE

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural minor collectors, which are exempt.)

1. General:

- a. All mechanics and laborers employed or working upon the site of the work will be paid unconditionally and not less often than once a week and without subsequent deduction or rebate on any account [except such payroll deductions as are permitted by regulations (29 CFR 3)] issued by the Secretary of Labor under the Copeland Act (40 U.S.C. 276c) the full amounts of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment. The payment shall be computed at wage rates not less than those contained in the wage determination of the Secretary of Labor (hereinafter "the wage determination") which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor or its subcontractors and such laborers and mechanics. The wage determination (including any additional classifications and wage rates conformed under paragraph 2 of this Section IV and the DOL poster (WH-1321) or Form FHWA-1495) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers. For the purpose of this Section, contributions made or costs reasonably anticipated for bona fide fringe benefits under Section 1(b)(2) of the Davis-Bacon Act (40 U.S.C. 276a) on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of Section IV, paragraph 3b, hereof. Also, for the purpose of this Section, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs, which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in paragraphs 4 and 5 of this Section IV.
- b. Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein, provided, that the employer's payroll records accurately set forth the time spent in each classification in which work is performed.
- c. All rulings and interpretations of the Davis-Bacon Act and related acts contained in 29 CFR 1, 3, and 5 are herein incorporated by reference in this contract.

2. Classification:

- a. The SHA contracting officer shall require that any class of laborers or mechanics employed under the contract, which is not listed in the wage determination, shall be classified in conformance with the wage determination.
- b. The contracting officer shall approve an additional classification, wage rate and fringe benefits only when the following criteria have been met:
 - (1) the work to be performed by the additional classification requested is not performed by a classification in the wage determination;
 - (2) the additional classification is utilized in the area by the construction industry;
 - (3) the proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination; and
 - (4) with respect to helpers, when such a classification prevails in the area in which the work is performed.
- c. If the contractor or subcontractors, as appropriate, the laborers and mechanics (if known) to be employed in the additional classification or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the DOL, Administrator of the Wage and Hour Division, Employment Standards Administration, Washington, D.C. 20210. The Wage and Hour Administrator, or an authorized

representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

- d. In the event the contractor or subcontractors, as appropriate, the laborers or mechanics to be employed in the additional classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. Said Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary
- e. The wage rate (including fringe benefits where appropriate) determined pursuant to paragraph 2c or 2d of this Section IV shall be paid to all workers performing work in the additional classification from the first day on which work is performed in the classification.

3. Payment of Fringe Benefits:

- a. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor or subcontractors, as appropriate, shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly case equivalent thereof.
- b. If the contractor or subcontractor, as appropriate, does not make payments to a trustee or other third person, he/she may consider as a part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, provided, that the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

4. Apprentices and Trainees (Programs of the U.S. DOL) and Helpers:

- a. Apprentices:
 - (1) Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the DOL, Employment and Training Administration, Bureau of Apprenticeship and Training, or with a State apprenticeship agency recognized by the Bureau, or if a person is employed in his/her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Bureau of Apprenticeship and Training or a State apprenticeship agency (where appropriate) to be eligible for probationary employment as an apprentice.
 - (2) The allowable ratio of apprentices to journeyman-level employees on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any employee listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate listed in the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor or subcontractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman-level hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.
 - (3) Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeyman-level hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator for the Wage and Hour Division determines that a different

practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

- (4) In the event the Bureau of Apprenticeship and Training, or a State apprenticeship agency recognized by the Bureau, withdraws approval of an apprenticeship program, the contractor or subcontractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the comparable work performed by regular employees until an acceptable program is approved.

b. Trainees:

- (1) Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the DOL, Employment and Training Administration.
- (2) The ratio of trainees to journeyman-level employees on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.
- (3) Every trainee must be paid at not less than the rate specified in the approved program for his/her level of progress, expressed as a percentage of the journeyman-level hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman-level wage rate on the wage determination which provides for less than full fringe benefits for apprentices, in which case such trainees shall receive the same fringe benefits as apprentices.
- (4) In the event the Employment and Training Administration withdraws approval of a training program, the contractor or subcontractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. Helpers:

Helpers will be permitted to work on a project if the helper classification is specified and defined on the applicable wage determination or is approved pursuant to the conformance procedure set forth in Section IV.2. Any worker listed on a payroll at a helper wage rate, who is not a helper under an approved definition, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed.

5. Apprentices and Trainees (Programs of the U.S. DOT):

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

6. Withholding:

The SHA shall upon its own action or upon written request of an authorized representative of the DOL withhold, or cause to be withheld, from the contractor or subcontractor under this contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to Davis-Bacon prevailing wage requirements which is held by the same prime contractor, as much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or

part of the wages required by the contract, the SHA contracting officer may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

7. Overtime Requirements:

No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers, mechanics, watchmen, or guards (including apprentices, trainees, and helpers described in paragraphs 4 and 5 above) shall require or permit any laborer, mechanic, watchman, or guard in any workweek in which he/she is employed on such work, to work in excess of 40 hours in such workweek unless such laborer, mechanic, watchman, or guard receives compensation at a rate not less than one-and-one-half times his/her basic rate of pay for all hours worked in excess of 40 hours in such workweek.

8. Violation:

Liability for Unpaid Wages; Liquidated Damages: In the event of any violation of the clause set forth in paragraph 7 above, the contractor and any subcontractor responsible thereof shall be liable to the affected employee for his/her unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory) for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer, mechanic, watchman, or guard employed in violation of the clause set forth in paragraph 7, in the sum of \$10 for each calendar day on which such employee was required or permitted to work in excess of the standard work week of 40 hours without payment of the overtime wages required by the clause set forth in paragraph 7.

9. Withholding for Unpaid Wages and Liquidated Damages:

The SHA shall upon its own action or upon written request of any authorized representative of the DOL withhold, or cause to be withheld, from any monies payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph 8 above.

V. STATEMENTS AND PAYROLLS

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural collectors, which are exempt.)

1. Compliance with Copeland Regulations (29 CFR 3):

The contractor shall comply with the Copeland Regulations of the Secretary of Labor which are herein incorporated by reference.

2. Payrolls and Payroll Records:

a. Payrolls and basic records relating thereto shall be maintained by the contractor and each subcontractor during the course of the work and preserved for a period of 3 years from the date of completion of the contract for all laborers, mechanics, apprentices, trainees, watchmen, helpers, and guards working at the site of the work.

b. The payroll records shall contain the name, social security number, and address of each such employee; his or her correct classification; hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalent thereof the types described in Section 1(b)(2)(B) of the Davis Bacon Act); daily and weekly number of hours worked; deductions made; and actual wages paid. In addition, for Appalachian contracts, the payroll records shall contain a notation indicating whether the employee does, or does not, normally reside in the labor area as defined in Attachment A, paragraph 1. Whenever the Secretary of Labor, pursuant to Section IV, paragraph 3b, has found that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in Section 1(b)(2)(B) of the Davis Bacon Act, the contractor and each subcontractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, that the plan or program has been communicated in writing to the laborers or mechanics affected, and show the cost anticipated or the actual cost incurred in providing benefits. Contractors or subcontractors employing

apprentices or trainees under approved programs shall maintain written evidence of the registration of apprentices and trainees, and ratios and wage rates prescribed in the applicable programs.

- c. Each contractor and subcontractor shall furnish, each week in which any contract work is performed, to the SHA resident engineer a payroll of wages paid each of its employees (including apprentices, trainees, and helpers, described in Section IV, paragraphs 4 and 5, and watchmen and guards engaged on work during the preceding weekly payroll period). The payroll submitted shall set out accurately and completely all of the information required to be maintained under paragraph 2b of this Section V. This information may be submitted in any form desired. Optional Form WH-347 is available for this purpose and may be purchased from the Superintendent of Documents (Federal stock number 029-005-0014-1), U.S. Government Printing Office, Washington, D.C. 20402. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors.
- d. Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his/her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:
 - (1) that the payroll for the payroll period contains the information required to be maintained under paragraph 2b of this Section V and that such information is correct and complete;
 - (2) that such laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in the Regulations, 29 CFR 3;
 - (3) that each laborer or mechanic has been paid not less than the applicable wage rate and fringe benefits or cash equivalent for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.
- e. The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 2d of this Section V.
- f. The falsification of any of the above certifications may subject the contractor to civil or criminal prosecution under 18 U.S.C. 1001 and 31 U.S.C. 231.
- g. The contractor or subcontractor shall make the records required under paragraph 2b of this Section V available for inspection, copying, or transcription by authorized representatives of the SHA, the FHWA, or the DOL, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the SHA, the FHWA, the DOL, or all may, after written notice to the contractor, sponsor, applicant, or owner, take such actions as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

VI. RECORD OF MATERIALS, SUPPLIES, AND LABOR

1. On all Federal-aid contracts on the National Highway System, except those which provide solely for the installation of protective devices at railroad grade crossings, those which are constructed on a force account or direct labor basis, highway beautification contracts, and contracts for which the total final construction cost for roadway and bridge is less than \$1,000,000 (23 CFR 635) the contractor shall:
 - a. Become familiar with the list of specific materials and supplies contained in Form FHWA-47, "Statement of Materials and Labor Used by Contractor of Highway Construction Involving Federal Funds," prior to the commencement of work under this contract.
 - b. Maintain a record of the total cost of all materials and supplies purchased for and incorporated in the work, and also of the quantities of those specific materials and supplies listed on Form FHWA-47, and in the units shown on Form FHWA-47.

- c. Furnish, upon the completion of the contract, to the SHA resident engineer on Form FHWA-47 together with the data required in paragraph 1b relative to materials and supplies, a final labor summary of all contract work indicating the total hours worked and the total amount earned.
2. At the prime contractor's option, either a single report covering all contract work or separate reports for the contractor and for each subcontract shall be submitted.

VII. SUBLETTING OR ASSIGNING THE CONTRACT

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the State. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635).
 - a. "Its own organization" shall be construed to include only workers employed and paid directly by the prime contractor and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor, assignee, or agent of the prime contractor.
 - b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid on the contract as a whole and in general are to be limited to minor components of the overall contract.
2. The contract amount upon which the requirements set forth in paragraph 1 of Section VII is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.
3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the SHA contracting officer determines is necessary to assure the performance of the contract.
4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the SHA contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the SHA has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

VIII. SAFETY: ACCIDENT PREVENTION

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the SHA contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).
3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).

IX. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, the following notice shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

Notice To All Personnel Engaged On Federal-Aid Highway Projects

18 U.S.C. 1020 READS AS FOLLOWS:

"Whoever being an officer, agent, or employee of the United States, or any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined not more than \$10,000 or imprisoned not more than 5 years or both."

X. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$100,000 or more.)

By submission of this bid or the execution of this contract, or subcontract, as appropriate, the bidder, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any facility that is or will be utilized in the performance of this contract, unless such contract is exempt under the Clean Air Act, as amended (42 U.S.C. 1857 et seq., as amended by Pub.L. 91-604), and under the Federal Water Pollution Control Act, as amended (33 U.S.C. 1251 et seq., as amended by Pub.L. 92-500), Executive Order 11738, and regulations in implementation thereof (40 CFR 15) is not listed, on the date of contract award, on the U.S. Environmental Protection Agency (EPA) List of Violating Facilities pursuant to 40 CFR 15.20.
2. That the firm agrees to comply and remain in compliance with all the requirements of Section 114 of the Clean Air Act and Section 308 of the Federal Water Pollution Control Act and all regulations and guidelines listed thereunder.
3. That the firm shall promptly notify the SHA of the receipt of any communication from the Director, Office of Federal Activities, EPA, indicating that a facility that is or will be utilized for the contract is under consideration to be listed on the EPA List of Violating Facilities.
4. That the firm agrees to include or cause to be included the requirements of paragraph 1 through 4 of this Section X in every nonexempt subcontract, and further agrees to take such action as the government may direct as a means of enforcing such requirements.

XI. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

1. Instructions for Certification - Primary Covered Transactions:

(Applicable to all Federal-aid contracts - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective primary participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective primary participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the department or agency determined to enter into this transaction. If it is later determined that the prospective primary participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause of default.
- d. The prospective primary participant shall provide immediate written notice to the department or agency to whom this proposal is submitted if any time the prospective primary participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "lower tier covered transaction," "participant," "person," "primary covered transaction," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the department or agency to which this proposal is submitted for assistance in obtaining a copy of those regulations.
- f. The prospective primary participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective primary participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," provided by the department or agency entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the nonprocurement portion of the "Lists of Parties Excluded From Federal Procurement or Nonprocurement Programs" (Nonprocurement List) which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- j. Except for transactions authorized under paragraph f of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Primary Covered Transactions

1. The prospective primary participant certifies to the best of its knowledge and belief, that it and its principals:

- a. Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
 - b. Have not within a 3-year period preceding this proposal been convicted of or had a civil judgement rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
 - c. Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph 1b of this certification; and
 - d. Have not within a 3-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
2. Where the prospective primary participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Covered Transactions:

(Applicable to all subcontracts, purchase orders and other lower tier transactions of \$25,000 or more - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.
- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "primary covered transaction," "participant," "person," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations.
- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.
- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the Nonprocurement List.
- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is

not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

- i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Lower Tier Covered Transactions

1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participation in this transaction by any Federal department or agency.
2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

XII. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

(Applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 - 49 CFR 20)

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
 - a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
 - b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.
2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.
3. The prospective participant also agrees by submitting his or her bid or proposal that he or she shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

FEDERAL-AID FEMALE AND MINORITY GOALS

In accordance with Section II, "Nondiscrimination," of "Required Contract Provisions Federal-aid Construction Contracts" the following are the goals for female utilization:

Goal for Women (applies nationwide).....(percent) 6.9

The following are goals for minority utilization:

CALIFORNIA ECONOMIC AREA

		Goal (Percent)
174	Redding, CA: Non-SMSA Counties CA Lassen; CA Modoc;CA Plumas;CA Shasta; CA Siskiyou; CA Tehama.	6.8
175	Eureka, CA Non-SMSA Counties CA Del Norte; CA Humboldt; CA Trinity.	6.6
176	San Francisco-Oakland-San Jose, CA: SMSA Counties: 7120 Salinas-Seaside-Monterey, CA CA Monterey. 7360 San Francisco-Oakland CA Alameda; CA Contra Costa; CA Marin; CA San Francisco; CA San Mateo. 7400 San Jose, CA CA Santa Clara. 7485 Santa Cruz, CA. CA Santa Cruz. 7500 Santa Rosa, CA CA Sonoma. 8720 Vallejo-Fairfield- Napa, CA CA Napa; CA Solano Non-SMSA Counties CA Lake; CA Mendocino; CA San Benito	28.9 25.6 19.6 14.9 9.1 17.1 23.2
177	Sacramento, CA: SMSA Counties: 6920 Sacramento, CA CA Placer; CA Sacramento; CA Yolo. Non-SMSA Counties CA Butte; CA Colusa; CA El Dorado; CA Glenn; CA Nevada; CA Sierra; CA Sutter; CA Yuba.	16.1 14.3
178	Stockton-Modesto, CA: SMSA Counties: 5170 Modesto, CA CA Stanislaus. 8120 Stockton, CA CA San Joaquin. Non-SMSA Counties CA Alpine; CA Amador; CA Calaveras; CA Mariposa;CA Merced; CA Tuolumne.	12.3 24.3 19.8

	Goal (Percent)
179 Fresno-Bakersfield, CA	
SMSA Counties:	
0680 Bakersfield, CA CA Kern.	19.1
2840 Fresno, CA CA Fresno.	26.1
Non-SMSA Counties CA Kings; CA Madera; CA Tulare.	23.6
180 Los Angeles, CA:	
SMSA Counties:	
0360 Anaheim-Santa Ana-Garden Grove, CA CA Orange.	11.9
4480 Los Angeles-Long Beach, CA CA Los Angeles.	28.3
6000 Oxnard-Simi Valley-Ventura, CA CA Ventura.	21.5
6780 Riverside-San Bernardino-Ontario, CA. CA Riverside; CA San Bernardino.	19.0
7480 Santa Barbara-Santa Maria-Lompoc, CA CA Santa Barbara.	19.7
Non-SMSA Counties CA Inyo; CA Mono; CA San Luis Obispo.	24.6
181 San Diego, CA:	
SMSA Counties	
7320 San Diego, CA. CA San Diego.	16.9
Non-SMSA Counties CA Imperial.	18.2

In addition to the reporting requirements set forth elsewhere in this contract the Contractor and subcontractors holding subcontracts, not including material suppliers, of \$10,000 or more, shall submit for every month of July during which work is performed, employment data as contained under Form FHWA PR-1391 (Appendix C to 23 CFR, Part 230), and in accordance with the instructions included thereon.

FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS

As part of the Contractor's equal employment opportunity affirmative action program, training shall be provided as follows:

The Contractor shall provide on-the-job training to develop full journeymen in the types of trades or job classification involved.

The goal for the number of trainees or apprentices to be trained under the requirements of this special provision will be 6.

In the event the Contractor subcontracts a portion of the contract work, he shall determine how many, if any, of the trainees or apprentices are to be trained by the subcontractor, provided however, that the Contractor shall retain the primary responsibility for meeting the training requirements imposed by this special provision. The Contractor shall also insure that this Training Special Provision is made applicable to such subcontract. Where feasible, 25 percent of trainees or apprentices in each occupation shall be in their first year of apprenticeship or training.

The number of trainees or apprentices shall be distributed among the work classifications on the basis of the Contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment. Prior to commencing work, the Contractor shall submit to the Department for approval the number of trainees or apprentices to be trained in each selected classification and training program to be used. Furthermore, the Contractor shall specify the starting time for training in each of the classifications. The Contractor will be credited for each trainee or apprentice employed by him on the contract work who is currently enrolled or becomes enrolled in an approved program and will be reimbursed for such trainees or apprentices as provided hereinafter.

Training and upgrading of minorities and women toward journeymen status is a primary objective of this Training Special Provision. Accordingly, the Contractor shall make every effort to enroll minority and women trainees or apprentices (e.g., by conducting systematic and direct recruitment through public and private sources likely to yield minority and women trainees or apprentices) to the extent such persons are available within a reasonable area of recruitment. The Contractor will be responsible for demonstrating the steps that he has taken in pursuance thereof, prior to a determination as to whether the Contractor is in compliance with this Training Special Provision. This training commitment is not intended, and shall not be used, to discriminate against any applicant for training, whether a member of a minority group or not.

No employee shall be employed as a trainee or apprentice in any classification in which he has successfully completed a training course leading to journeyman status or in which he has been employed as a journeyman. The Contractor should satisfy this requirement by including appropriate questions in the employee application or by other suitable means. Regardless of the method used the Contractor's records should document the findings in each case.

The minimum length and type of training for each classification will be as established in the training program selected by the Contractor and approved by both the Department and the Federal Highway Administration. The Department and the Federal Highway Administration will approve a program if it is reasonably calculated to meet the equal employment opportunity obligations of the Contractor and to qualify the average trainee or apprentice for journeyman status in the classification concerned by the end of the training period. Furthermore, apprenticeship programs registered with the U.S. Department of Labor, Bureau of Apprenticeship and Training, or with the State of California, Department of Industrial Relations, Division of Apprenticeship Standards recognized by the Bureau and training programs approved but not necessarily sponsored by the U.S. Department of Labor, Manpower Administration, Bureau of Apprenticeship and Training shall also be considered acceptable provided it is being administered in a manner consistent with the equal employment obligations of Federal-aid highway construction contracts. Approval or acceptance of a training program shall be obtained from the State prior to commencing work on the classification covered by the program. It is the intention of these provisions that training is to be provided in the construction crafts rather than clerk-typists or secretarial-type positions. Training is permissible in lower level management positions such as office engineers, estimators, timekeepers, etc., where the training is oriented toward construction applications. Training in the laborer classification may be permitted provided that significant and meaningful training is provided and approved by the division office. Some offsite training is permissible as long as the training is an integral part of an approved training program and does not comprise a significant part of the overall training.

Except as otherwise noted below, the Contractor will be reimbursed 80 cents per hour of training given an employee on this contract in accordance with an approved training program. As approved by the Engineer, reimbursement will be made for training of persons in excess of the number specified herein. This reimbursement will be made even though the Contractor receives additional training program funds from other sources, provided such other source does not specifically prohibit the Contractor from receiving other reimbursement. Reimbursement for offsite training indicated above may only be made to the Contractor where he does one or more of the following and the trainees or apprentices are concurrently employed on a Federal-aid project; contributes to the cost of the training, provides the instruction to the trainee or apprentice or pays the trainee's or apprentice's wages during the offsite training period.

No payment shall be made to the Contractor if either the failure to provide the required training, or the failure to hire the trainee or apprentice as a journeyman, is caused by the Contractor and evidences a lack of good faith on the part of the Contractor in meeting the requirements of this Training Special Provision. It is normally expected that a trainee or apprentice will begin his training on the project as soon as feasible after start of work utilizing the skill involved and remain on the project as long as training opportunities exist in his work classification or until he has completed his training program. It is not required that all trainees or apprentices be on board for the entire length of the contract. A Contractor will have fulfilled his responsibilities under this Training Special Provision if he has provided acceptable training to the number of trainees or apprentices specified. The number trained shall be determined on the basis of the total number enrolled on the contract for a significant period.

Only trainees or apprentices registered in a program approved by the State of California's State Administrator of Apprenticeship may be employed on the project and said trainees or apprentices shall be paid the standard wage specified under the regulations of the craft or trade at which they are employed.

The Contractor shall furnish the trainee or apprentice a copy of the program he will follow in providing the training. The Contractor shall provide each trainee or apprentice with a certification showing the type and length of training satisfactorily completed.

The Contractor will provide for the maintenance of records and furnish periodic reports documenting his performance under this Training Special Provision.