


**** WARNING ** WARNING ** WARNING ** WARNING ****
This document is intended for informational purposes only.

Users are cautioned that Caltrans does not assume any liability or responsibility based on these electronic files or for any defective or incomplete copying, excerpting, scanning, faxing or downloading of the contract documents. As always, for the official paper versions of the bidders and non-bidder packages, write to the California Department of Transportation, Plans and Bid Documents, Room 0200, P.O. Box 942874, Sacramento, CA 94272-0001, telephone (916) 654-4490 or fax (916) 654-7028. Office hours are 7:30 a.m. to 4:15 p.m. When ordering bidder or non-bidder packages it is important that you include a telephone and fax number, P.O. Box and street address so that you can receive addenda.

Note: Addenda information is NOT included with the electronic documents available via electronic file transfer. Only bidder or non-bidder package holders listed with the Caltrans Plans and Bid Documents section as described above will receive addenda information.

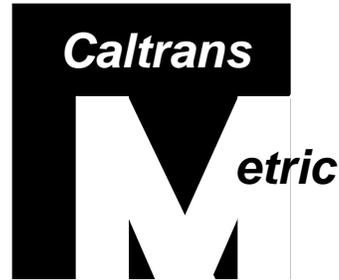

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS
AND
SPECIAL PROVISIONS
FOR CONSTRUCTION ON STATE HIGHWAY IN
LOS ANGELES COUNTY IN LA VERNE FROM WHEELER AVENUE
OVERCROSSING TO DAWN AVENUE

DISTRICT 07, ROUTE 30

**For Use in Connection with Standard Specifications Dated JULY 1995, Standard Plans Dated JULY 1997, and
Labor Surcharge and Equipment Rental Rates.**

CONTRACT NO. 07-172164
07-LA-30-R5.3/R7.3

**Federal Aid Project
ACNH-S030(040)E**

**Bids Open: June 22, 2000
Dated: April 24, 2000**

OSD

IMPORTANT SPECIAL NOTICES

- The Special Provisions for Federal-aid projects (with and without DBE goals) have been revised to incorporate changes made by new regulations governing the DBE Program (49 CFR Part 26).

Sections 2 and 5 incorporate the changes. Bidders should read these sections to become familiar with them. Attention is directed to the following significant changes:

Section 2, "Disadvantaged Business Enterprise (DBE)" revises the counting of participation by DBE primes, and the counting of trucking performed by DBE firms. The section also revises the information that must be submitted to the Department in order to receive credit for trucking.

Section 2, "Submission of DBE Information" revises the information required to be submitted to the Department to receive credit toward the DBE goal. It also revises the criteria to demonstrate good faith efforts.

Section 5, "Subcontractor and DBE Records" revises the information required to be reported at the end of the project, and information related to trucking that must be submitted throughout the project.

Section 5, "DBE Certification Status" adds new reporting requirements related to DBE certification.

Section 5, "Subcontracting" describes the efforts that must be made in the event a DBE subcontractor is terminated or fails to complete its work for any reason.

Section 5, "Prompt Progress Payment to Subcontractors" requires prompt payment to all subcontractors.

Section 5, "Prompt Payment of Withheld Funds to Subcontractors" requires the prompt payment of retention to all subcontractors.

TABLE OF CONTENTS

NOTICE TO CONTRACTORS.....	1
COPY OF ENGINEER'S ESTIMATE.....	3
SPECIAL PROVISIONS.....	5
SECTION 1. SPECIFICATIONS AND PLANS.....	5
SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS.....	5
2-1.01 GENERAL.....	5
2-1.015 FEDERAL LOBBYING RESTRICTIONS.....	5
2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE).....	6
2-1.02A DBE GOAL FOR THIS PROJECT.....	7
2-1.02B SUBMISSION OF DBE INFORMATION.....	8
SECTION 3. AWARD AND EXECUTION OF CONTRACT.....	9
SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES.....	9
SECTION 5. GENERAL.....	9
SECTION 5-1. MISCELLANEOUS.....	9
5-1.00 PLANS AND WORKING DRAWINGS.....	9
5-1.003 LABORATORY.....	10
5-1.005 CONTRACT BONDS.....	10
5-1.01 LABOR NONDISCRIMINATION.....	10
5-1.02 LABOR CODE REQUIREMENTS.....	10
5-1.023 INDEMNIFICATION AND INSURANCE.....	13
5-1.025 ARBITRATION.....	15
5-1.03 PAYMENT OF WITHHELD FUNDS.....	15
5-1.04 INTEREST ON PAYMENTS.....	16
5-1.05 PUBLIC SAFETY.....	16
5-1.06 SURFACE MINING AND RECLAMATION ACT.....	17
5-1.07 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES.....	17
5-1.08 YEAR 2000 COMPLIANCE.....	18
5-1.085 BUY AMERICA REQUIREMENTS.....	18
5-1.09 SUBCONTRACTOR AND DBE RECORDS.....	18
5-1.093 DBE CERTIFICATION STATUS.....	19
5-1.095 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS.....	19
5-1.097 SUBCONTRACTING.....	19
5-1.098 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS.....	20
5-1.099 PROMPT PAYMENT OF WITHHELD FUNDS TO SUBCONTRACTORS.....	20
5-1.10 PARTNERING.....	20
5-1.11 AREAS FOR CONTRACTOR'S USE.....	20
5-1.12 PAYMENTS.....	21
5-1.13 SOUND CONTROL REQUIREMENTS.....	21
SECTION 6. (BLANK).....	21
SECTION 7. (BLANK).....	21
SECTION 8. MATERIALS.....	21
SECTION 8-1. MISCELLANEOUS.....	21
8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS.....	21
8-1.02 APPROVED TRAFFIC PRODUCTS.....	26
8-1.03 SLAG AGGREGATE.....	31
8-1.04 MEASUREMENT OF QUANTITIES.....	32
SECTION 8-2. CONCRETE.....	32
8-2.01 PORTLAND CEMENT CONCRETE.....	32
SECTION 8-3. WELDING.....	42
8-3.01 WELDING ELECTRODES.....	42
8-3.02 WELDING QUALITY CONTROL.....	42
SECTION 9. DESCRIPTION OF STRUCTURE WORK.....	46
SECTION 10. CONSTRUCTION DETAILS.....	46
SECTION 10-1. GENERAL.....	46
10-1.01 ORDER OF WORK.....	46
10-1.02 WATER POLLUTION CONTROL.....	46

10-1.03	TEMPORARY FENCES.....	49
10-1.04	PRESERVATION OF PROPERTY.....	50
10-1.05	TEMPORARY SAND BAG BARRIER.....	50
10-1.06	COOPERATION.....	51
10-1.07	PROGRESS SCHEDULE.....	51
10-1.08	OBSTRUCTIONS.....	51
10-1.09	MOBILIZATION.....	51
10-1.10	CONSTRUCTION AREA SIGNS.....	51
10-1.11	MAINTAINING TRAFFIC.....	52
10-1.12	BARRICADES.....	53
10-1.13	TEMPORARY CRASH CUSHION MODULE.....	53
10-1.14	EXISTING HIGHWAY FACILITIES.....	54
10-1.14A	REMOVE WOOD FENCE.....	54
10-1.14B	REMOVE CHAIN LINK FENCE.....	54
10-1.14C	REMOVE CONCRETE.....	54
10-1.14D	REMOVE SOUND WALL (PLYWOOD SHEET).....	55
10-1.15	CLEARING AND GRUBBING.....	55
10-1.16	EARTHWORK.....	55
10-1.17	EROSION CONTROL (TYPE D).....	55
10-1.18	PILING.....	58
10-1.19	CONCRETE STRUCTURES.....	62
10-1.20	SOUND WALL.....	62
10-1.21	REINFORCEMENT.....	66
10-1.22	MISCELLANEOUS CONCRETE CONSTRUCTION.....	72
10-1.23	MISCELLANEOUS METAL (BRIDGE).....	72
10-1.24	CHAIN LINK FENCE.....	74
10-1.25	CHAIN LINK GATES.....	74
10-1.26	CHAIN LINK FENCE (MODIFIED).....	74
SECTION 11.	(BLANK).....	75
SECTION 12.	(BLANK).....	75
SECTION 13.	(BLANK).....	75
SECTION 14	FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION PROJECTS.....	76
	FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS.....	95

STANDARD PLANS LIST

The Standard Plan sheets applicable to this contract include, but are not limited to those indicated below. The Revised Standard Plans (RSP) and New Standard Plans (NSP) which apply to this contract are included as individual sheets of the project plans.

A10A	Abbreviations
A10B	Symbols
A62A	Excavation and Backfill - Miscellaneous Details
A62B	Limits of Payment for Excavation and Backfill - Bridge Surcharge and Wall
A85	Chain Link Fence
<i>NSP T1A</i>	<i>Temporary Crash Cushion, Sand Filled (Unidirectional)</i>
<i>NSP T1B</i>	<i>Temporary Crash Cushion, Sand Filled (Bidirectional)</i>
<i>RSP T2</i>	<i>Temporary Crash Cushion, Sand Filled (Shoulder Installations)</i>
B0-3	Bridge Details
B2-3	400 mm Cast-In-Drilled-Hole Concrete Pile
<i>RSP B3-8</i>	<i>Retaining Wall Details No. 1</i>
RS1	Roadside Signs - Typical Installation Details No. 1
RS2	Roadside Signs - Wood Post, Typical Installation Details No. 2
RS4	Roadside Signs - Typical Installation Details No. 4

DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS

CONTRACT NO. 07-172164

07-LA-30-R5.3/R7.3

Sealed proposals for the work shown on the plans entitled:

**STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROJECT PLANS FOR
CONSTRUCTION ON STATE HIGHWAY IN LOS ANGELES COUNTY IN LA VERNE FROM WHEELER
AVENUE OVERCROSSING TO DAWN AVENUE**

will be received at the Department of Transportation, 3347 Michelson Drive, Suite 100, Irvine, CA 92612-1692, until 2 o'clock p.m. on June 22, 2000, at which time they will be publicly opened and read in Room C - 1116 at the same address.

Proposal forms for this work are included in a separate book entitled:

**STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROPOSAL AND CONTRACT FOR
CONSTRUCTION ON STATE HIGHWAY IN LOS ANGELES COUNTY IN LA VERNE FROM WHEELER
AVENUE OVERCROSSING TO DAWN AVENUE**

General work description: Construct Sound Walls.

This project has a goal of 15 percent disadvantaged business enterprise (DBE) participation. No prebid meeting is scheduled for this project.

**THIS PROJECT IS SUBJECT TO THE "BUY AMERICA" PROVISIONS OF THE SURFACE
TRANSPORTATION ASSISTANCE ACT OF 1982 AS AMENDED BY THE INTERMODAL SURFACE
TRANSPORTATION EFFICIENCY ACT OF 1991.**

Bids are required for the entire work described herein.

At the time this contract is awarded, the Contractor shall possess either a Class A license or a Class C-29 license.

This contract is subject to state contract nondiscrimination and compliance requirements pursuant to Government Code, Section 12990.

Project plans, special provisions, and proposal forms for bidding this project can only be obtained at the Department of Transportation, Plans and Bid Documents, Room 0200, MS #26, Transportation Building, 1120 N Street, Sacramento, California 95814, FAX No. (916) 654-7028, Telephone No. (916) 654-4490. Use FAX orders to expedite orders for project plans, special provisions and proposal forms. FAX orders must include credit card charge number, card expiration date and authorizing signature. Project plans, special provisions, and proposal forms may be seen at the above Department of Transportation office and at the offices of the District Directors of Transportation at Irvine, Oakland, and the district in which the work is situated. Standard Specifications are available through the State of California, Department of Transportation, Publications Unit, 1900 Royal Oaks Drive, Sacramento, CA 95815, Telephone No. (916) 445-3520.

Cross sections for this project are not available.

The successful bidder shall furnish a payment bond and a performance bond.

The Department of Transportation hereby notifies all bidders that it will affirmatively insure that in any contract entered into pursuant to this advertisement, disadvantaged business enterprises will be afforded full opportunity to submit bids in response to this invitation.

The U.S. Department of Transportation (DOT) provides a toll-free "hotline" service to report bid rigging activities. Bid rigging activities can be reported Mondays through Fridays, between 8:00 a.m. and 5:00 p.m., eastern time, Telephone No. 1-800-424-9071. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use

Contract No. 07-172164

the "hotline" to report these activities. The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

Pursuant to Section 1773 of the Labor Code, the general prevailing wage rates in the county, or counties, in which the work is to be done have been determined by the Director of the California Department of Industrial Relations. These wages are set forth in the General Prevailing Wage Rates for this project, available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated, and available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>. The Federal minimum wage rates for this project as predetermined by the United States Secretary of Labor are set forth in the books issued for bidding purposes entitled "Proposal and Contract," and in copies of this book that may be examined at the offices described above where project plans, special provisions, and proposal forms may be seen. Addenda to modify the Federal minimum wage rates, if necessary, will be issued to holders of "Proposal and Contract" books. Future effective general prevailing wage rates which have been predetermined and are on file with the California Department of Industrial Relations are referenced but not printed in the general prevailing wage rates.

Attention is directed to the Federal minimum wage rate requirements in the books entitled "Proposal and Contract." If there is a difference between the minimum wage rates predetermined by the Secretary of Labor and the general prevailing wage rates determined by the Director of the California Department of Industrial Relations for similar classifications of labor, the Contractor and subcontractors shall pay not less than the higher wage rate. The Department will not accept lower State wage rates not specifically included in the Federal minimum wage determinations. This includes "helper" (or other classifications based on hours of experience) or any other classification not appearing in the Federal wage determinations. Where Federal wage determinations do not contain the State wage rate determination otherwise available for use by the Contractor and subcontractors, the Contractor and subcontractors shall pay not less than the Federal minimum wage rate which most closely approximates the duties of the employees in question.

DEPARTMENT OF TRANSPORTATION

Deputy Director Transportation Engineering

Dated April 24, 2000

ASF

**COPY OF ENGINEER'S ESTIMATE
(NOT TO BE USED FOR BIDDING PURPOSES)**

07-172164

Item	Item Code	Item	Unit of Measure	Estimated Quantity
1	018109	TEMPORARY SAND BAG BARRIER	EA	180
2	071322	TEMPORARY FENCE (TYPE CL-1.8)	M	3190
3 (S)	120090	CONSTRUCTION AREA SIGNS	LS	LUMP SUM
4	120120	TYPE III BARRICADE	EA	24
5	150604	REMOVE WOOD FENCE	M	160
6	150608	REMOVE CHAIN LINK FENCE	M	380
7	153210	REMOVE CONCRETE	M3	500
8	018110	REMOVE SOUND WALL (PLYWOOD SHEET)	M2	420
9	160101	CLEARING AND GRUBBING	LS	LUMP SUM
10	190101	ROADWAY EXCAVATION	M3	1370
11 (F)	192037	STRUCTURE EXCAVATION (RETAINING WALL)	M3	137
12 (F)	193013	STRUCTURE BACKFILL (RETAINING WALL)	M3	112
13 (S)	203003	STRAW (EROSION CONTROL)	TON	4
14 (S)	203014	FIBER (EROSION CONTROL)	KG	1040
15 (S)	203024	COMPOST (EROSION CONTROL)	KG	4250
16 (S)	203045	PURE LIVE SEED (EROSION CONTROL)	KG	45
17 (S)	203061	STABILIZING EMULSION (EROSION CONTROL)	KG	300
18	490655	400 MM CAST-IN-DRILLED-HOLE CONCRETE PILING	M	156
19 (S)	048220	CAST-IN-DRILLED-HOLE CONCRETE PILING (FENCE)	M	112
20 (F)	510060	STRUCTURAL CONCRETE, RETAINING WALL	M3	67

Item	Item Code	Item	Unit of Measure	Estimated Quantity
21 (S-F)	517960	SOUND WALL (RETAINING WALL)	M2	186
22 (F)	518002	SOUND WALL (MASONRY BLOCK)	M2	6445
23 (S-F)	520103	BAR REINFORCING STEEL (RETAINING WALL)	KG	5400
24	731502	MINOR CONCRETE (MISCELLANEOUS CONSTRUCTION)	M3	3.8
25 (S)	800391	CHAIN LINK FENCE (TYPE CL-1.8)	M	30
26 (S)	802672	4.9 M CHAIN LINK GATE (TYPE CL-1.8)	EA	1
27 (S)	802675	6.1 M CHAIN LINK GATE (TYPE CL-1.8)	EA	1
28 (S-F)	048221	CHAIN LINK FENCE MODIFIED	M	145
29	999990	MOBILIZATION	LS	LUMP SUM

**STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION**

SPECIAL PROVISIONS

Annexed to Contract No. 07-172164

SECTION 1. SPECIFICATIONS AND PLANS

The work embraced herein shall conform to the provisions in the Standard Specifications dated July 1995, and the Standard Plans dated July 1997, of the Department of Transportation insofar as the same may apply, and these special provisions.

Amendments to the Standard Specifications set forth in these special provisions shall be considered as part of the Standard Specifications for the purposes set forth in Section 5-1.04, "Coordination and Interpretation of Plans, Standard Specifications and Special Provisions," of the Standard Specifications. Whenever either the term "Standard Specifications is amended" or the term "Standard Specifications are amended" is used in the special provisions, the indented text following said term shall be considered an amendment to the Standard Specifications. In case of conflict between such amendments and the Standard Specifications, the amendments shall take precedence over and be used in lieu of the conflicting portions.

In case of conflict between the Standard Specifications and these special provisions, the special provisions shall take precedence over and be used in lieu of the conflicting portions.

SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS

2-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 2, "Proposal Requirements and Conditions," of the Standard Specifications and these special provisions for the requirements and conditions which the bidder must observe in the preparation of the Proposal form and the submission of the bid.

In addition to the subcontractors required to be listed in conformance with Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications, each proposal shall have listed therein the portion of work that will be performed by each subcontractor listed.

The Bidder's Bond form mentioned in the last paragraph in Section 2-1.07, "Proposal Guaranty," of the Standard Specifications will be found following the signature page of the Proposal.

Submit request for substitution of an "or equal" item, and the data substantiating the request to the Department of Transportation, Construction Division Chief, 120 S. Spring Street, Room 232, Los Angeles, CA 90012, so that the request is received by the Department by close of business on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening.

In conformance with Public Contract Code Section 7106, a Noncollusion Affidavit is included in the Proposal. Signing the Proposal shall also constitute signature of the Noncollusion Affidavit.

The contractor, sub recipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate. Each subcontract signed by the bidder must include this assurance.

2-1.015 FEDERAL LOBBYING RESTRICTIONS

Section 1352, Title 31, United States Code prohibits Federal funds from being expended by the recipient or any lower tier subrecipient of a Federal-aid contract to pay for any person for influencing or attempting to influence a Federal agency or Congress in connection with the awarding of any Federal-aid contract, the making of any Federal grant or loan, or the entering into of any cooperative agreement.

If any funds other than Federal funds have been paid for the same purposes in connection with this Federal-aid contract, the recipient shall submit an executed certification and, if required, submit a completed disclosure form as part of the bid documents.

A certification for Federal-aid contracts regarding payment of funds to lobby Congress or a Federal agency is included in the Proposal. Standard Form - LLL, "Disclosure of Lobbying Activities," with instructions for completion of the Standard Form is also included in the Proposal. Signing the Proposal shall constitute signature of the Certification.

The above-referenced certification and disclosure of lobbying activities shall be included in each subcontract and any lower-tier contracts exceeding \$100,000. All disclosure forms, but not certifications, shall be forwarded from tier to tier until received by the Engineer.

The Contractor, subcontractors and any lower-tier contractors shall file a disclosure form at the end of each calendar quarter in which there occurs any event that requires disclosure or that materially affects the accuracy of the information contained in any disclosure form previously filed by the Contractor, subcontractors and any lower-tier contractors. An event that materially affects the accuracy of the information reported includes:

- A. A cumulative increase of \$25,000 or more in the amount paid or expected to be paid for influencing or attempting to influence a covered Federal action; or
- B. A change in the person(s) or individual(s) influencing or attempting to influence a covered Federal action; or,
- C. A change in the officer(s), employee(s), or Member(s) contacted to influence or attempt to influence a covered Federal action.

2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE)

This project is subject to Part 26, Title 49, Code of Federal Regulations entitled "Participation by Disadvantaged Business Enterprises in Department of Transportation Financial Assistance Programs." The Regulations in their entirety are incorporated herein by this reference.

Bidders shall be fully informed respecting the requirements of the Regulations and the Department's Disadvantaged Business Enterprise (DBE) program developed pursuant to the Regulations; particular attention is directed to the following matters:

- A. A DBE must be a small business concern as defined pursuant to Section 3 of U.S. Small Business Act and relevant regulations promulgated pursuant thereto.
- B. A DBE may participate as a prime contractor, subcontractor, joint venture partner with a prime or subcontractor, vendor of material or supplies, or as a trucking company.
- C. A DBE bidder, not bidding as a joint venture with a non-DBE, will be required to document one or a combination of the following:
 - 1. The bidder will meet the goal by performing work with its own forces.
 - 2. The bidder will meet the goal through work performed by DBE subcontractors, suppliers or trucking companies.
 - 3. The bidder, prior to bidding, made adequate good faith efforts to meet the goal.
- D. A DBE joint venture partner must be responsible for specific contract items of work, or portions thereof. Responsibility means actually performing, managing and supervising the work with its own forces. The DBE joint venture partner must share in the capital contribution, control, management, risks and profits of the joint venture. The DBE joint venturer must submit the joint venture agreement with the proposal or the DBE Information form required in the Section entitled "Submission of DBE Information" of these special provisions.
- E. A DBE must perform a commercially useful function, i.e., must be responsible for the execution of a distinct element of the work and must carry out its responsibility by actually performing, managing and supervising the work.
- F. DBEs must be certified by either the California Department of Transportation, or by a participating State of California or local agency which certifies in conformance with Title 49, Code of Federal Regulations, Part 26, as of the date of bid opening. It is the Contractor's responsibility to verify that DBEs are certified. Listings of DBEs certified by the Department are available from the following sources:
 - 1. The Department's DBE Directory, which is published quarterly. This Directory may be obtained from the Department of Transportation, Materiel Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520.
 - 2. The Department's Electronic Information Bulletin Board Service, which is accessible by modem and is updated weekly. The Bulletin Board may be accessed by first contacting the Department's Business Enterprise Program at Telephone: (916) 227-8937 and obtaining a user identification and password.
 - 3. The Department's web site at <http://www.dot.ca.gov/hq/bep/index.htm>.
 - 4. The organizations listed in the Section entitled "DBE Goal for this Project" of these special provisions.

G. Credit for materials or supplies purchased from DBEs will be as follows:

1. If the materials or supplies are obtained from a DBE manufacturer, 100 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE manufacturer is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications.
2. If the materials or supplies are purchased from a DBE regular dealer, 60 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE regular dealer is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a DBE regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question. A person may be a DBE regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone, or asphalt without owning, operating, or maintaining a place of business as provided in this paragraph G.2. if the person both owns and operates distribution equipment for the products. Any supplementing of regular dealers' own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Packagers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not DBE regular dealers within the meaning of this paragraph G.2.
3. Credit for materials or supplies purchased from a DBE which is neither a manufacturer nor a regular dealer will be limited to the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site, provided the fees are reasonable and not excessive as compared with fees charged for similar services.

H. Credit for DBE trucking companies will be as follows:

1. The DBE must be responsible for the management and supervision of the entire trucking operation for which it is responsible on a particular contract, and there cannot be a contrived arrangement for the purpose of meeting the DBE goal.
2. The DBE must itself own and operate at least one fully licensed, insured, and operational truck used on the contract.
3. The DBE receives credit for the total value of the transportation services it provides on the contract using trucks it owns, insures, and operates using drivers it employs.
4. The DBE may lease trucks from another DBE firm, including an owner-operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the contract.
5. The DBE may also lease trucks from a non-DBE firm, including an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The DBE does not receive credit for the total value of the transportation services provided by the lessee, since these services are not provided by a DBE.
6. For the purposes of this paragraph H, a lease must indicate that the DBE has exclusive use of and control over the truck. This does not preclude the leased truck from working for others during the term of the lease with the consent of the DBE, so long as the lease gives the DBE absolute priority for use of the leased truck. Leased trucks must display the name and identification number of the DBE.

I. Noncompliance by the Contractor with the requirements of the regulations constitutes a breach of this contract and may result in termination of the contract or other appropriate remedy for a breach of this contract.

J. Bidders are encouraged to use services offered by financial institutions owned and controlled by DBEs.

2-1.02A DBE GOAL FOR THIS PROJECT

The Department has established the following goal for Disadvantaged Business Enterprise (DBE) participation for this project:

Disadvantaged Business Enterprise (DBE): 15 percent

Bidders may use the services of the following firms to contact interested DBEs. These firms are available to assist DBEs in preparing bids for subcontracting or supplying materials.

The following firms may be contacted for projects in the following locations:

Districts 04, 05 (except San Luis Obispo and Santa Barbara Counties), 06 (except Kern County) and 10:
Triaxial Management Services, Inc. - Oakland 1545 Willow Street, 1st Floor Oakland, CA 94607 Telephone - (510) 286-1313 FAX No. - (510) 286-6792

Districts 08, 11 and 12:
Triaxial Management Services, Inc. - San Diego 2725 Congress Street, Suite 1-D San Diego, CA 92110 Telephone - (619) 543-5109 FAX No. - (619) 543-5108

Districts 07 and 08; in San Luis Obispo and Santa Barbara Counties in District 05; and in Kern County in District 06:
Triaxial Management Services, Inc. - Los Angeles 2594 Industry Way, Suite 101 Lynwood, CA 90262 Telephone - (310) 537-6677 FAX No. - (310) 637-0128

Districts 01, 02, 03 and 09:
Triaxial Management Services, Inc. - Sacramento 930 Alhambra Blvd., #205 Sacramento, CA 95816 Telephone - (916) 553-4172 FAX No. - (916) 553-4173

2-1.02B SUBMISSION OF DBE INFORMATION

The required DBE information shall be submitted on the "CALTRANS BIDDER - DBE INFORMATION" form included in the Proposal. If the DBE information is not submitted with the bid, the DBE Information form shall be removed from the documents prior to submitting the bid.

It is the bidder's responsibility to make enough work available to DBEs and to select those portions of the work or material needs consistent with the available DBEs to meet the goal for DBE participation or to provide information to establish that, prior to bidding, the bidder made adequate good faith efforts to do so.

If DBE information is not submitted with the bid, the apparent successful bidder (low bidder), the second low bidder and the third low bidder shall submit DBE information to the Department of Transportation, 1120 N Street, Room 0200, MS #26, Sacramento, California 95814 so the information is received by the Department no later than 4:00 p.m. on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening. DBE information sent by U.S. Postal Service certified mail with return receipt and certificate of mailing and mailed on or before the third day, not including Saturdays, Sundays and legal holidays, following bid opening will be accepted even if it is received after the fourth day following bid opening. Failure to submit the required DBE information by the time specified will be grounds for finding the bid or proposal nonresponsive. Other bidders need not submit DBE information unless requested to do so by the Department.

The bidder's DBE information shall establish that good faith efforts to meet the DBE goal have been made. To establish good faith efforts, the bidder shall demonstrate that the goal will be met or that, prior to bidding, adequate good faith efforts to meet the goal were made.

Bidders are cautioned that even though their submittal indicates they will meet the stated DBE goal, their submittal should also include their adequate good faith efforts information along with their DBE goal information to protect their eligibility for award of the contract in the event the Department, in its review, finds that the goal has not been met.

The bidder's DBE information shall include the names, addresses and phone numbers of DBE firms that will participate, with a complete description of work or supplies to be provided by each, the dollar value of each DBE transaction, and a written confirmation from the DBE that it is participating in the contract. A copy of the DBE's quote will serve as written confirmation that the DBE is participating in the contract. When 100 percent of a contract item of work is not to be performed or furnished by a DBE, a description of the exact portion of that work to be performed or furnished by that DBE shall be included in the DBE information, including the planned location of that work. The work that a DBE prime contractor has committed to performing with its own forces as well as the work that it has committed to be performed by DBE subcontractors, suppliers and trucking companies will count toward the goal.

The information necessary to establish the bidder's adequate good faith efforts to meet the DBE goal should include:

- A. The names and dates of each publication in which a request for DBE participation for this project was placed by the bidder.
- B. The names and dates of written notices sent to certified DBEs soliciting bids for this project and the dates and methods used for following up initial solicitations to determine with certainty whether the DBEs were interested.
- C. The items of work which the bidder made available to DBE firms, including, where appropriate, any breaking down of the contract work items (including those items normally performed by the bidder with its own forces) into economically feasible units to facilitate DBE participation. It is the bidder's responsibility to demonstrate that sufficient work to meet the DBE goal was made available to DBE firms.
- D. The names, addresses and phone numbers of rejected DBE firms, the firms selected for that work, and the reasons for the bidder's choice.
- E. Efforts made to assist interested DBEs in obtaining bonding, lines of credit or insurance, and any technical assistance or information related to the plans, specifications and requirements for the work which was provided to DBEs.
- F. Efforts made to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services, excluding supplies and equipment the DBE subcontractor purchases or leases from the prime contractor or its affiliate.
- G. The names of agencies contacted to provide assistance in contacting, recruiting and using DBE firms.
- H. Any additional data to support a demonstration of good faith efforts.

SECTION 3. AWARD AND EXECUTION OF CONTRACT

The bidder's attention is directed to the provisions in Section 3, "Award and Execution of Contract," of the Standard Specifications and these special provisions for the requirements and conditions concerning award and execution of contract.

The award of the contract, if it be awarded, will be to the lowest responsible bidder whose proposal complies with all the requirements prescribed and who has met the goal for DBE participation or has demonstrated, to the satisfaction of the Department, adequate good faith efforts to do so. Meeting the goal for DBE participation or demonstrating, to the satisfaction of the Department, adequate good faith efforts to do so is a condition for being eligible for award of contract.

A "Payee Data Record" form will be included in the contract documents to be executed by the successful bidder. The purpose of the form is to facilitate the collection of taxpayer identification data. The form shall be completed and returned to the Department by the successful bidder with the executed contract and contract bonds. For the purposes of the form, vendor shall be deemed to mean the successful bidder. The form is not to be completed for subcontractors or suppliers. Failure to complete and return the "Payee Data Record" form to the Department as provided herein will result in the retention of 31 percent of payments due the contractor and penalties of up to \$20,000. This retention of payments for failure to complete the "Payee Data Record" form is in addition to any other retention of payments due the Contractor.

SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES

Attention is directed to the provisions in Section 8-1.03, "Beginning of Work," in Section 8-1.06, "Time of Completion," and in Section 8-1.07, "Liquidated Damages," of the Standard Specifications and these special provisions.

The Contractor shall begin work within 15 calendar days after the contract has been approved by the Attorney General or the attorney appointed and authorized to represent the Department of Transportation.

This work shall be diligently prosecuted to completion before the expiration of **100 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$1300 per day, for each and every calendar day's delay in finishing the work in excess of the number of working days prescribed above.

SECTION 5. GENERAL

SECTION 5-1. MISCELLANEOUS

5-1.00 PLANS AND WORKING DRAWINGS

When the specifications require working drawings to be submitted to the Division of Structure Design, the drawings shall be submitted to: Division of Structure Design, Documents Unit, Mail Station 9, 1801 30th Street, Sacramento, CA 95816, Telephone (916) 227-8252.

5-1.003 LABORATORY

Section 1-1.25, "Laboratory," of the Standard Specifications is amended to read:

1-1.25 Laboratory.—The Division of Materials Engineering and Testing Services and the Division of Structural Foundations of the Department of Transportation, or established laboratories of the various Districts of the Department, or other laboratories authorized by the Department to test materials and work involved in the contract. When a reference is made in the specifications to the "Transportation Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations, located at 5900 Folsom Boulevard, Sacramento, CA 95819, Telephone (916) 227-7000.

5-1.005 CONTRACT BONDS

Attention is directed to Section 3-1.02, "Contract Bonds," of the Standard Specifications and these special provisions. The payment bond shall be in a sum not less than the following:

1. One hundred percent of the total amount payable by the terms of the contract when the total amount payable does not equal or exceed five million dollars (\$5,000,000).
2. Fifty percent of the total amount payable by the terms of the contract when the total amount payable is not less than five million dollars (\$5,000,000) and does not exceed ten million dollars (\$10,000,000).
3. Twenty-five percent of the total amount payable by the terms of the contract when the total amount payable exceeds ten million dollars (\$10,000,000).

5-1.01 LABOR NONDISCRIMINATION

Attention is directed to the following Notice that is required by Chapter 5 of Division 4 of Title 2, California Code of Regulations.

NOTICE OF REQUIREMENT FOR NONDISCRIMINATION PROGRAM (GOV. CODE, SECTION 12990)

Your attention is called to the "Nondiscrimination Clause", set forth in Section 7-1.01A(4), "Labor Nondiscrimination," of the Standard Specifications, which is applicable to all nonexempt state contracts and subcontracts, and to the "Standard California Nondiscrimination Construction Contract Specifications" set forth therein. The Specifications are applicable to all nonexempt state construction contracts and subcontracts of \$5000 or more.

5-1.02 LABOR CODE REQUIREMENTS

Section 7-1.01A(1), "Hours of Labor," of the Standard Specifications is amended to read:

7-1.01A(1) Hours of Labor.— Eight hours labor constitutes a legal day's work. The Contractor or any subcontractor under the Contractor shall forfeit, as a penalty to the State of California, \$25 for each worker employed in the execution of the contract by the respective Contractor or subcontractor for each calendar day during which that worker is required or permitted to work more than 8 hours in any one calendar day and 40 hours in any one calendar week in violation of the provisions of the Labor Code, and in particular, Section 1810 to Section 1815, thereof, inclusive, except that work performed by employees of Contractors in excess of 8 hours per day, and 40 hours during any one week, shall be permitted upon compensation for all hours worked in excess of 8 hours per day at not less than one and one-half times the basic rate of pay, as provided in Section 1815 thereof.

Section 7-1.01A(2), "Prevailing Wage," of the Standard Specifications is amended to read:

7-1.01A(2) Prevailing Wage.— The Contractor and any subcontractor under the Contractor shall comply with Labor Code Sections 1774 and 1775. Pursuant to Section 1775, the Contractor and any subcontractor under the Contractor shall forfeit to the State or political subdivision on whose behalf the contract is made or awarded a penalty of not more than fifty dollars (\$50) for each calendar day, or portion thereof, for each worker paid less than the prevailing rates as determined by the Director of Industrial Relations for the work or craft in which the worker is employed for any public work done under the contract by the Contractor or by any subcontractor under the Contractor in violation of the provisions of the Labor Code and in particular, Labor Code Sections 1770 to 1780, inclusive. The amount of this forfeiture shall be determined by the Labor Commissioner and shall be based on consideration of the mistake, inadvertence, or neglect of the Contractor or subcontractor in failing to pay the correct rate of prevailing wages, or the previous record of the Contractor or subcontractor in meeting their respective prevailing wage obligations, or the willful failure by the Contractor or subcontractor to pay the correct rates of prevailing wages. A mistake, inadvertence, or neglect in failing to pay the correct rate of prevailing wages is not excusable if the Contractor or subcontractor had knowledge of the obligations under the Labor Code. In addition to the penalty and pursuant to Labor Code Section

1775, the difference between the prevailing wage rates and the amount paid to each worker for each calendar day or portion thereof for which each worker was paid less than the prevailing wage rate shall be paid to each worker by the Contractor or subcontractor. If a worker employed by a subcontractor on a public works project is not paid the general prevailing per diem wages by the subcontractor, the prime contractor of the project is not liable for the penalties described above unless the prime contractor had knowledge of that failure of the subcontractor to pay the specified prevailing rate of wages to those workers or unless the prime contractor fails to comply with all of the following requirements:

1. The contract executed between the contractor and the subcontractor for the performance of work on the public works project shall include a copy of the provisions of Sections 1771, 1775, 1776, 1777.5, 1813, and 1815 of the Labor Code.
2. The contractor shall monitor the payment of the specified general prevailing rate of per diem wages by the subcontractor to the employees, by periodic review of the certified payroll records of the subcontractor.
3. Upon becoming aware of the subcontractor's failure to pay the specified prevailing rate of wages to the subcontractor's workers, the contractor shall diligently take corrective action to halt or rectify the failure, including, but not limited to, retaining sufficient funds due the subcontractor for work performed on the public works project.
4. Prior to making final payment to the subcontractor for work performed on the public works project, the contractor shall obtain an affidavit signed under penalty of perjury from the subcontractor that the subcontractor has paid the specified general prevailing rate of per diem wages to the subcontractor's employees on the public works project and any amounts due pursuant to Section 1813 of the Labor Code.

Pursuant to Section 1775 of the Labor Code, the Division of Labor Standards Enforcement shall notify the Contractor on a public works project within 15 days of the receipt by the Division of Labor Standards Enforcement of a complaint of the failure of a subcontractor on that public works project to pay workers the general prevailing rate of per diem wages. If the Division of Labor Standards Enforcement determines that employees of a subcontractor were not paid the general prevailing rate of per diem wages and if the Department did not retain sufficient money under the contract to pay those employees the balance of wages owed under the general prevailing rate of per diem wages, the contractor shall withhold an amount of moneys due the subcontractor sufficient to pay those employees the general prevailing rate of per diem wages if requested by the Division of Labor Standards Enforcement. The Contractor shall pay any money retained from and owed to a subcontractor upon receipt of notification by the Division of Labor Standards Enforcement that the wage complaint has been resolved. If notice of the resolution of the wage complaint has not been received by the Contractor within 180 days of the filing of a valid notice of completion or acceptance of the public works project, whichever occurs later, the Contractor shall pay all moneys retained from the subcontractor to the Department. These moneys shall be retained by the Department pending the final decision of an enforcement action.

Pursuant to the provisions of Section 1773 of the Labor Code, the Department has obtained the general prevailing rate of wages (which rate includes employer payments for health and welfare, pension, vacation, travel time, and subsistence pay as provided for in Section 1773.8 of the Labor Code, apprenticeship or other training programs authorized by Section 3093 of the Labor Code, and similar purposes) applicable to the work to be done, for straight time, overtime, Saturday, Sunday and holiday work. The holiday wage rate listed shall be applicable to all holidays recognized in the collective bargaining agreement of the particular craft, classification or type of workmen concerned. The general prevailing wage rates and any applicable changes to these wage rates are available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated. For work situated in District 9, the wage rates are available at the Labor Compliance Office at the offices of the District Director of Transportation for District 6, located at Fresno. General prevailing wage rates are also available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>.

The wage rates determined by the Director of Industrial Relations for the project refer to expiration dates. Prevailing wage determinations with a single asterisk after the expiration date are in effect on the date of advertisement for bids and are good for the life of the contract. Prevailing wage determinations with double asterisks after the expiration date indicate that the wage rate to be paid for work performed after this date has been determined. If work is to extend past this date, the new rate shall be paid and incorporated in the contract. The Contractor shall contact the Department of Industrial Relations as indicated in the wage rate determinations to obtain predetermined wage changes.

Pursuant to Section 1773.2 of the Labor Code, general prevailing wage rates shall be posted by the Contractor at a prominent place at the site of the work.

Changes in general prevailing wage determinations which conform to Labor Code Section 1773.6 and Title 8 California Code of Regulations Section 16204 shall apply to the project when issued by the Director of Industrial Relations at least 10 days prior to the date of the Notice to Contractors for the project.

The State will not recognize any claim for additional compensation because of the payment by the Contractor of any wage rate in excess of the prevailing wage rate set forth in the contract. The possibility of wage increases is one of the elements to be considered by the Contractor in determining the bid, and will not under any circumstances be considered as the basis of a claim against the State on the contract.

7-1.01A(2)(a) Travel and Subsistence Payments.— Attention is directed to the requirements of Section 1773.8 of the Labor Code. The Contractor shall make travel and subsistence payments to each workman, needed to execute the work, in accordance with the requirements in Labor Code Section 1773.8.

The first and second paragraphs of Section 7-1.01A(3), "Payroll Records," of the Standard Specifications are amended to read:

7-1.01A(3) Payroll Records.— Attention is directed to the provisions of Labor Code Section 1776, a portion of which is quoted below. Regulations implementing Labor Code Section 1776 are located in Sections 16016 through 16019 and Sections 16207.10 through 16207.19 of Title 8, California Code of Regulations.

"1776. (a) Each contractor and subcontractor shall keep accurate payroll records, showing the name, address, social security number, work classification, straight time and overtime hours worked each day and week, and the actual per diem wages paid to each journeyman, apprentice, worker, or other employee employed by him or her in connection with the public work. Each payroll record shall contain or be verified by a written declaration that it is made under penalty of perjury, stating both of the following:

(1) The information contained in the payroll record is true and correct.

(2) The employer has complied with the requirements of Sections 1771, 1811, and 1815 for any work performed by his or her employees on the public works project.

"(b) The payroll records enumerated under subdivision (a) shall be certified and shall be available for inspection at all reasonable hours at the principal office of the contractor on the following basis:

(1) A certified copy of an employee's payroll record shall be made available for inspection or furnished to the employee or his or her authorized representative on request.

(2) A certified copy of all payroll records enumerated in subdivision (a) shall be made available for inspection or furnished upon request to a representative of the body awarding the contract, the Division of Labor Standards Enforcement, and the Division of Apprenticeship Standards of the Department of Industrial Relations.

(3) A certified copy of all payroll records enumerated in subdivision (a) shall be made available upon request by the public for inspection or for copies thereof. However, a request by the public shall be made through either the body awarding the contract, the Division of Apprenticeship Standards, or the Division of Labor Standards Enforcement. If the requested payroll records have not been provided pursuant to paragraph (2), the requesting party shall, prior to being provided the records, reimburse the costs of preparation by the contractor, subcontractors, and the entity through which the request was made. The public shall not be given access to the records at the principal office of the contractor.

"(c) The certified payroll records shall be on forms provided by the Division of Labor Standards Enforcement or shall contain the same information as the forms provided by the division.

"(d) A contractor or subcontractor shall file a certified copy of the records enumerated in subdivision (a) with the entity that requested the records within 10 days after receipt of a written request.

"(e) Any copy of records made available for inspection as copies and furnished upon request to the public or any public agency by the awarding body, the Division of Apprenticeship Standards, or the Division of Labor Standards Enforcement shall be marked or obliterated in a manner so as to prevent disclosure of an individual's name, address, and social security number. The name and address of the contractor awarded the contract or the subcontractor performing the contract shall not be marked or obliterated.

"(f) The contractor shall inform the body awarding the contract of the location of the records enumerated under subdivision (a), including the street address, city and county, and shall, within five working days, provide a notice of a change of location and address.

"(g) The contractor or subcontractor shall have 10 days in which to comply subsequent to receipt of a written notice requesting the records enumerated in subdivision (a). In the event that the contractor or subcontractor fails to comply within the 10-day period, he or she shall, as a penalty to the state or political subdivision on whose behalf the contract is made or awarded, forfeit twenty-five dollars (\$25) for each calendar day, or portion thereof, for each worker, until strict compliance is effectuated. Upon the request of the Division of Apprenticeship Standards or the Division of Labor Standards Enforcement, these penalties shall be withheld from progress payments then due. A contractor is not subject to a penalty assessment pursuant to this section due to the failure of a subcontractor to comply with this section."

The penalties specified in subdivision (g) of Labor Code Section 1776 for noncompliance with the provisions of Section 1776 may be deducted from any moneys due or which may become due to the Contractor.

5-1.023 INDEMNIFICATION AND INSURANCE

Section 7-1.12, "Responsibility for Damage," of the Standard Specifications is deleted. All references to Section 7-1.12 in the Contract documents shall be deemed to mean Sections 7-1.121, "Indemnification," and 7-1.122, "Insurance," as added below.

The Standard Specifications is amended by adding the following Section 7-1.121, "Indemnification," and Section 7-1.122, "Insurance," before Section 7-1.125, "Legal Action Against the Department":

7-1.121 Indemnification.—With the exception that this section shall in no event be construed to require indemnification by the Contractor to a greater extent than permitted by law, the Contractor shall defend, indemnify and save harmless the State, including its officers, directors, agents (excluding agents who are design professionals), and employees, and each of them (Indemnitees), from any and all claims, demands, causes of action, damages, costs, expenses, actual attorneys' fees, losses or liabilities, in law or in equity, of every kind and nature whatsoever (Claims), arising out of or in connection with the Contractor's performance of this contract for:

- A. Bodily injury including, but not limited to, bodily injury, sickness or disease, emotional injury or death to persons, including, but not limited to, the public, any employees or agents of the Contractor, State, Department, or any other contractor and;
- B. Damage to property of anyone including loss of use thereof;

caused or alleged to be caused in whole or in part by any negligent or otherwise legally actionable act or omission of the Contractor or anyone directly or indirectly employed by the Contractor or anyone for whose acts the Contractor may be liable.

Except as otherwise provided by law, the indemnification provisions above shall apply regardless of the existence or degree of fault of Indemnitees. The Contractor, however, shall not be obligated to indemnify Indemnitees for Claims arising from conduct delineated in Civil Code section 2782. Further, the Contractor's indemnity obligation shall not extend to Claims to the extent they arise from any defective or substandard condition of the roadway which existed at or prior to the time the Contractor commenced work, unless this condition has been changed by the work or the scope of the work requires the Contractor to maintain existing Roadway facilities and the claim arises from the Contractor's failure to maintain. The Contractor's indemnity obligation shall extend to Claims arising after the work is completed and accepted only if these Claims are directly related to alleged acts or omissions of the Contractor which occurred during the course of the work. No inspection by the Department, its employees or agents shall be deemed a waiver by the Department of full compliance with the requirements of this section.

The Contractor's obligation to defend and indemnify shall not be excused because of the Contractor's inability to evaluate liability or because the Contractor evaluates liability and determines that the Contractor is not liable to the claimant. The Contractor will respond within 30 days to the tender of any claim for defense and indemnity by the State, unless this time has been extended by the State. If the Contractor fails to accept or reject a tender of defense and indemnity within 30 days, in addition to any other remedy authorized by law, so much of the money due the Contractor under and by virtue of the contract as shall reasonably be considered necessary by the Department, may be retained by the State until disposition has been made of the claim or suit for damages, or until the Contractor accepts or rejects the tender of defense, whichever occurs first.

With respect to third party claims against the Contractor, the Contractor waives any and all rights of any type to express or implied indemnity against the State, its directors, officers, employees, or agents (excluding agents who are design professionals).

7-1.122 Insurance.—Insurance shall conform to the following requirements:

7-1.122A Casualty Insurance.—The Contractor shall, at the Contractor's expense, procure and maintain insurance on all of its operations with companies acceptable to the Department as follows. All insurance shall be kept in full force and effect from the beginning of the work through final acceptance by the State. In addition, the Contractor shall maintain completed operations coverage with a carrier acceptable to the Department through the expiration of the patent deficiency in construction statute of repose set forth in Section 337.1 of the Code of Civil Procedure.

7-1.122A(1) Workers' Compensation and Employer's Liability Insurance.—Workers' Compensation insurance shall be provided as specified in Section 7-1.01A(6), "Workers' Compensation." Employer's Liability Insurance shall be provided in amounts not less than:

- (a) \$1 000 000 for each accident for bodily injury by accident.
- (b) \$1 000 000 policy limit for bodily injury by disease.
- (c) \$1 000 000 for each employee for bodily injury by disease.

If there is an exposure of injury to the Contractors' employees under the U.S. Longshoremen's and Harbor Workers' Compensation Act, the Jones Act or under laws, regulations or statutes applicable to maritime employees, coverage shall be included for such injuries or claims.

7-1.122A(2) Liability Insurance.—The Contractor shall carry General Liability and Umbrella or Excess Liability Insurance covering all operations by or on behalf of the Contractor providing insurance for bodily injury liability, and property damage liability for the limits of liability indicated below and including coverage for:

- (a) premises, operations and mobile equipment
- (b) products and completed operations
- (c) broad form property damage (including completed operations)
- (d) explosion, collapse and underground hazards
- (e) personal injury
- (f) contractual liability

7-1.122A(3) Liability Limits/Additional Insureds.—The limits of liability shall be at least:

- (a) \$1 000 000 for each occurrence (combined single limit for bodily injury and property damage).
- (b) \$2 000 000 aggregate for products-completed operations.
- (c) \$2 000 000 general aggregate. This general aggregate limit shall apply separately to the Contractor's work under this Agreement.
- (d) \$5 000 000 umbrella or excess liability. For projects over \$25 000 000 only, an additional \$10 000 000 umbrella or excess liability (for a total of \$15 000 000). Umbrella or excess policy shall include products liability completed operations coverage and may be subject to \$5 000 000 or \$15 000 000 aggregate limits. Further, the umbrella or excess policy shall contain a clause stating that it takes effect (drops down) in the event the primary limits are impaired or exhausted.

The State and the Department, including their officers, directors, agents (excluding agents who are design professionals), and State employees, shall be named as additional insureds under the General Liability and Umbrella Liability Policies with respect to liability arising out of or connected with work or operations performed by or on behalf of the Contractor under this contract. Coverage for such additional insureds shall not extend to liability:

- (1) arising from any defective or substandard condition of the Roadway which existed at or prior to the time the Contractor commenced work, unless such condition has been changed by the work or the scope of the work requires the Contractor to maintain existing Roadway facilities and the claim arises from the Contractor's failure to maintain; or
- (2) for claims occurring after the work is completed and accepted unless these claims are directly related to alleged acts or omissions of the Contractor which occurred during the course of the work; or
- (3) to the extent prohibited by Section 11580.04 of the Insurance Code.

The policy shall stipulate that the insurance afforded the additional insureds shall apply as primary insurance. Any other insurance or self insurance maintained by the Department or State will be excess only and shall not be called upon to contribute with this insurance. Such additional insured coverage shall be provided by a policy provision or by an endorsement providing coverage at least as broad as Additional Insured (Form B) endorsement form CG 2010, as published by the Insurance Services Office (ISO).

7-1.122B Automobile Liability Insurance.—The Contractor shall carry automobile liability insurance, including coverage for all owned, hired and non-owned automobiles. The primary limits of liability shall be not less than \$1 000 000 combined single limit each accident for bodily injury and property damage. The umbrella or excess liability coverage required under Section 7-1.122A(3), "Liability Limits/Additional Insureds," shall also apply to automobile liability.

7-1.122C Policy Forms, Endorsements and Certificates.—The Contractor's General Liability Insurance shall be provided under Commercial General Liability policy form no. CG0001 as published by the Insurance Services Office (ISO) or under a policy form at least as broad as policy form no. CG0001.

Evidence of insurance in a form acceptable to the Department, including the required "additional insured" endorsements, shall be furnished by the Contractor to the Department at or prior to the pre-construction conference. The evidence of insurance shall provide that there will be no cancellation, lapse, or reduction of coverage without thirty (30) days' prior written notice to the Department. Certificates of Insurance, as evidence of required insurance, for the General Liability, Auto Liability and Umbrella-Excess Liability policies shall set forth deductible amounts applicable to each policy and all exclusions which are added by endorsement to each policy. The Department may expressly allow deductible clauses, which it does not consider excessive, overly broad, or harmful to the interests of the State. Standard ISO form CG 0001 or similar exclusions will be allowed provided they are not inconsistent with the requirements of this section. Allowance of any additional exclusions is at the discretion of the Department. Regardless of the allowance of exclusions or deductions by the Department, the Contractor shall be responsible for any deductible amount and shall warrant that the coverage provided to the Department is consistent with the requirements of this section.

7-1.122D Enforcement.—The Department may take any steps as are necessary to assure Contractor's compliance with its obligations. Should any insurance policy lapse or be canceled during the contract period the Contractor shall, within thirty (30) days prior to the effective expiration or cancellation date, furnish the Department with evidence of renewal or replacement of the policy. Failure to continuously maintain insurance coverage as herein provided is a material breach of contract. In the event the Contractor fails to maintain any insurance coverage required, the Department may, but is not required to, maintain this coverage and charge the expense to the Contractor or terminate this Agreement. The required insurance shall be subject to the approval of Department, but any acceptance of insurance certificates by the Department shall in no way limit or relieve the Contractor of the Contractor's duties and responsibilities under the Contract to indemnify, defend and hold harmless the State, its officers, agents, and employees. Insurance coverage in the minimum amounts set forth herein shall not be construed to relieve the Contractor for liability in excess of such coverage, nor shall it preclude the State from taking other actions as is available to it under any other provision of the contract or law. Failure of the Department to enforce in a timely manner any of the provisions of this section shall not act as a waiver to enforcement of any of these provisions at a later date.

7-1.122E Self-Insurance.—Self-insurance programs and self-insured retentions in insurance policies are subject to separate annual review and approval by the State of evidence of the Contractor's financial capacity to respond. Additionally, self-insurance programs or retentions must provide the State with at least the same protection from liability and defense of suits as would be afforded by first-dollar insurance.

7-1.122F Miscellaneous.—Nothing contained in the Contract is intended to make the public or any member thereof a third party beneficiary of the Insurance or Indemnity provisions of these Standard Specifications, nor is any term, condition or other provision of the Contract intended to establish a standard of care owed to the public or any member thereof.

5-1.025 ARBITRATION

The last paragraph in Section 9-1.10, "Arbitration," of the Standard Specifications, is amended to read:

Arbitration shall be initiated by a Complaint in Arbitration made in compliance with the requirements of those regulations. A Complaint in Arbitration by the Contractor shall be made not later than 90 days after the date of service in person or by mail on the Contractor of the final written decision by the Department on the claim.

5-1.03 PAYMENT OF WITHHELD FUNDS

Section 9-1.065, "Payment of Withheld Funds," of the Standard Specifications, is amended by adding the following after the third paragraph:

Alternatively, and subject to the approval of the Department, the payment of retentions earned may be deposited directly with a person licensed under Division 6 (commencing with Section 17000) of the Financial Code as the escrow agent. Upon written request of an escrow agent that has not been approved by the Department under subdivision (c) of Section 10263 of the Public Contract Code, the Department will provide written notice to that escrow agent within 10 business days of receipt of the request indicating the reason or reasons for not approving that escrow agent. The payments will be deposited in a trust account with a Federally chartered bank or savings association within 24 hours of receipt by the escrow agent. The Contractor shall not place any retentions with the escrow agent in excess of the coverage provided to that escrow agent pursuant to subdivision (b) of Section 17314 of the Financial Code. In all respects not inconsistent with subdivision (c) of Section 10263 of the Public Contract Code, the remaining provisions of Section 10263 of the Public Contract Code shall apply to escrow agents acting pursuant to subdivision (c) of Section 10263 of the Public Contract Code.

5-1.04 INTEREST ON PAYMENTS

Interest shall be payable on progress payments, payments after acceptance, final payments, extra work payments and claim payments as follows:

1. Unpaid progress payments, payment after acceptance and final payments shall begin to accrue interest 30 days after the Engineer prepares the payment estimate.
2. Unpaid extra work bills shall begin to accrue interest 30 days after preparation of the first pay estimate following the receipt of a properly submitted and undisputed extra work bill. To be properly submitted, the bill must be submitted within 7 days of the performance of the extra work and in accordance with the requirements of Section 9-1.03C, "Records," and Section 9-1.06, "Partial Payments," of the Standard Specifications. An undisputed extra work bill not submitted within 7 days of performance of the extra work will begin to accrue interest 30 days after the preparation of the second pay estimate following submittal of the bill.
3. The rate of interest payable for unpaid progress payments, payments after acceptance, final payments and extra work payments shall be 10 percent per annum.
4. The rate of interest payable on a claim, protest or dispute ultimately allowed under this contract shall be 6 percent per annum. Interest shall begin to accrue 61 days after the Contractor submits to the Engineer information in sufficient detail to enable the Engineer to ascertain the basis and amount of said claim, protest or dispute.

The rate of interest payable on any award in arbitration shall be 6 percent per annum if allowed under the provisions of Civil Code Section 3289.

5-1.05 PUBLIC SAFETY

The Contractor shall provide for the safety of traffic and the public in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications and these special provisions.

The Contractor shall install temporary railing (Type K) between a lane open to public traffic and an excavation, obstacle, or storage area when the following conditions exist:

- (1) Excavations.—The near edge of the excavation is 3.6 m or less from the edge of the lane, except:
 - (a) Excavations covered with sheet steel or concrete covers of adequate thickness to prevent accidental entry by traffic or the public.
 - (b) Excavations less than 0.3-m deep.
 - (c) Trenches less than 0.3-m wide for irrigation pipe or electrical conduit, or excavations less than 0.3-m in diameter.
 - (d) Excavations parallel to the lane for the purpose of pavement widening or reconstruction.
 - (e) Excavations in side slopes, where the slope is steeper than 1:4 (vertical:horizontal).
 - (f) Excavations protected by existing barrier or railing.
- (2) Temporarily Unprotected Permanent Obstacles.—The work includes the installation of a fixed obstacle together with a protective system, such as a sign structure together with protective railing, and the Contractor elects to install the obstacle prior to installing the protective system; or the Contractor, for the Contractor's convenience and with permission of the Engineer, removes a portion of an existing protective railing at an obstacle and does not replace such railing complete in place during the same day.
- (3) Storage Areas.—Material or equipment is stored within 3.6 m of the lane and the storage is not otherwise prohibited by the provisions of the Standard Specifications and these special provisions.

The approach end of temporary railing (Type K), installed in conformance with the provisions in this section "Public Safety" and in Section 7-1.09, "Public Safety," of the Standard Specifications, shall be offset a minimum of 4.6 m from the edge of the traffic lane open to public traffic. The temporary railing shall be installed on a skew toward the edge of the traffic lane of not more than 0.3-m transversely to 3 m longitudinally with respect to the edge of the traffic lane. If the 4.6-m minimum offset cannot be achieved, the temporary railing shall be installed on the 10 to 1 skew to obtain the maximum available offset between the approach end of the railing and the edge of the traffic lane, and an array of temporary crash cushion modules shall be installed at the approach end of the temporary railing.

Temporary railing (Type K) shall conform to the provisions in Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications. Temporary railing (Type K), conforming to the details shown on 1995 Standard Plan T3 or 1992 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

The fourteenth paragraph of Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications is amended to read:

Each rail unit placed within 3 m of a traffic lane shall have a reflector installed on top of the rail as directed by the Engineer. A Type P marker panel shall also be installed at each end of railing installed adjacent to a two-lane, two-way highway and at the end facing traffic of railing installed adjacent to a one-way roadbed. If the railing is placed on a skew, the marker shall be installed at the end of the skew nearest the traveled way. Type P marker panels shall conform to the provisions in Section 82, "Markers and Delineators," except that the Contractor shall furnish the marker panels.

Reflectors on temporary railing (Type K) shall conform to the provisions in "Approved Traffic Products" of these special provisions.

Temporary crash cushion modules shall conform to the provisions in "Temporary Crash Cushion Module" of these special provisions.

Except for installing, maintaining and removing traffic control devices, whenever work is performed or equipment is operated in the following work areas the Contractor shall close the adjacent traffic lane unless otherwise provided in the Standard Specifications and these special provisions:

Approach speed of public traffic (Posted Limit) (Kilometers Per Hour)	Work Areas
Over 72 (45 Miles Per Hour)	Within 1.8 m of a traffic lane but not on a traffic lane
56 to 72 (35 to 45 Miles Per Hour)	Within 0.9-m of a traffic lane but not on a traffic lane

The lane closure provisions of this section shall not apply if the work area is protected by permanent or temporary railing or barrier.

When traffic cones or delineators are used to delineate a temporary edge of traffic lane, the line of cones or delineators shall be considered to be the edge of traffic lane, however, the Contractor shall not reduce the width of an existing lane to less than 3 m without written approval from the Engineer.

When work is not in progress on a trench or other excavation that required closure of an adjacent lane, the traffic cones or portable delineators used for the lane closure shall be placed off of and adjacent to the edge of the traveled way. The spacing of the cones or delineators shall be not more than the spacing used for the lane closure.

Suspended loads or equipment shall not be moved nor positioned over public traffic or pedestrians.

Full compensation for conforming to the provisions in this section "Public Safety," including furnishing and installing temporary railing (Type K) and temporary crash cushion modules, shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

5-1.06 SURFACE MINING AND RECLAMATION ACT

Attention is directed to the Surface Mining and Reclamation Act of 1975, commencing in Public Resources Code, Mining and Geology, Section 2710, which establishes regulations pertinent to surface mining operations.

Material from mining operations furnished for this project shall only come from permitted sites in compliance with the Surface Mining and Reclamation Act of 1975.

The requirements of this section shall apply to all materials furnished for the project, except for acquisition of materials in conformance with Section 4-1.05, "Use of Materials Found on the Work," of the Standard Specifications.

5-1.07 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES

When the presence of asbestos or hazardous substances are not shown on the plans or indicated in the specifications and the Contractor encounters materials which the Contractor reasonably believes to be asbestos or a hazardous substance as defined in Section 25914.1 of the Health and Safety Code, and the asbestos or hazardous substance has not been rendered harmless, the Contractor may continue work in unaffected areas reasonably believed to be safe, and shall immediately cease work in the affected area and report the condition to the Engineer in writing.

In accordance with Section 25914.1 of the Health and Safety Code, all such removal of asbestos or hazardous substances including any exploratory work to identify and determine the extent of the asbestos or hazardous substance will be performed by separate contract.

If delay of work in the area delays the current controlling operation, the delay will be considered a right of way delay and the Contractor will be compensated for the delay as provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

5-1.08 YEAR 2000 COMPLIANCE

This contract is subject to Year 2000 Compliance for automated devices in the State of California. Year 2000 compliance is defined as follows:

Year 2000 compliance for automated devices in the State of California is achieved when embedded functions have or create no logical or mathematical inconsistencies when dealing with dates prior to and beyond 1999. The year 2000 is recognized and processed as a leap year. The product must also operate accurately in the manner in which it was intended for date operation without requiring manual intervention.

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer in accordance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for all automated devices furnished for the project.

5-1.085 BUY AMERICA REQUIREMENTS

Attention is directed to the "Buy America" requirements of the Surface Transportation Assistance Act of 1982 (Section 165) and the Intermodal Surface Transportation Efficiency Act of 1991 (ISTEA) Sections 1041(a) and 1048(a), and the regulations adopted pursuant thereto. In accordance with the law and regulations, all manufacturing processes for steel and iron materials furnished for incorporation into the work on this project shall occur in the United States; with the exception that pig iron and processed, pelletized and reduced iron ore manufactured outside of the United States may be used in the domestic manufacturing process for such steel and iron materials. The application of coatings, such as epoxy coating, galvanizing, painting and any other coating that protects or enhances the value of steel or iron materials shall be considered a manufacturing process subject to the "Buy America" requirements.

A Certificate of Compliance, conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications, shall be furnished for steel and iron materials. The certificates, in addition to certifying that the materials comply with the specifications, shall also specifically certify that all manufacturing processes for the materials occurred in the United States, except for the above exceptions.

The requirements imposed by the law and regulations do not prevent a minimal use of foreign steel and iron materials if the total combined cost of the materials used does not exceed one-tenth of one percent (0.1%) of the total contract cost or \$2500, whichever is greater. The Contractor shall furnish the Engineer acceptable documentation of the quantity and value of any foreign steel and iron prior to incorporating the materials into the work.

5-1.09 SUBCONTRACTOR AND DBE RECORDS

The Contractor shall maintain records showing the name and business address of each first-tier subcontractor. The records shall also show the name and business address of every DBE subcontractor, DBE vendor of materials and DBE trucking company, regardless of tier. The records shall show the date of payment and the total dollar figure paid to all of these firms. DBE prime contractors shall also show the date of work performed by their own forces along with the corresponding dollar value of the work.

Upon completion of the contract, a summary of these records shall be prepared on Form CEM-2402 (F) and certified correct by the Contractor or the Contractor's authorized representative, and shall be furnished to the Engineer. The form shall be furnished to the Engineer within 90 days from the date of contract acceptance. \$10,000 will be withheld from payment until the Form CEM-2402 (F) is submitted. The amount will be returned to the Contractor when a satisfactory Form CEM-2402 (F) is submitted.

Prior to the fifteenth of each month, the Contractor shall submit documentation to the Engineer showing the amount paid to DBE trucking companies listed in the Contractor's DBE information. This monthly documentation shall indicate the portion of the revenue paid to DBE trucking companies which is claimed toward DBE participation. The Contractor shall also obtain and submit documentation to the Engineer showing the amount paid by DBE trucking companies to all firms, including owner-operators, for the leasing of trucks. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The records must confirm that the amount of credit claimed toward DBE participation conforms with Section 2-1.02, "Disadvantaged Business Enterprise," of these special provisions.

The Contractor shall also obtain and submit documentation to the Engineer showing the truck number, owner's name, California Highway Patrol CA number, and if applicable, the DBE certification number of the owner of the truck for all trucks used during that month for which DBE participation will be claimed. This documentation shall be submitted on Form CEM-2404 (F).

5-1.093 DBE CERTIFICATION STATUS

If a DBE subcontractor is decertified during the life of the project, the decertified subcontractor shall notify the Contractor in writing with the date of decertification. If a subcontractor becomes a certified DBE during the life of the project, the subcontractor shall notify the Contractor in writing with the date of certification. The Contractor shall furnish the written documentation to the Engineer.

Upon completion of the contract, Form CEM-2403 (F) indicating the DBE's existing certification status shall be signed and certified correct by the Contractor. The certified form shall be furnished to the Engineer within 90 days from the date of contract acceptance.

5-1.095 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS

The DBEs listed by the Contractor in response to the provisions in Section 2-1.02B, "Submission of DBE Information," and Section 3, "Award and Execution of Contract," of these special provisions, which are determined by the Department to be certified DBEs, shall perform the work and supply the materials for which they are listed, unless the Contractor has received prior written authorization to perform the work with other forces or to obtain the materials from other sources.

Authorization to use other forces or sources of materials may be requested for the following reasons:

- A. The listed DBE, after having had a reasonable opportunity to do so, fails or refuses to execute a written contract, when such written contract, based upon the general terms, conditions, plans and specifications for the project, or on the terms of such subcontractor's or supplier's written bid, is presented by the Contractor.
- B. The listed DBE becomes bankrupt or insolvent.
- C. The listed DBE fails or refuses to perform the subcontract or furnish the listed materials.
- D. The Contractor stipulated that a bond was a condition of executing a subcontract and the listed DBE subcontractor fails or refuses to meet the bond requirements of the Contractor.
- E. The work performed by the listed subcontractor is substantially unsatisfactory and is not in substantial conformance with the plans and specifications, or the subcontractor is substantially delaying or disrupting the progress of the work.
- F. It would be in the best interest of the State.

The Contractor shall not be entitled to any payment for such work or material unless it is performed or supplied by the listed DBE or by other forces (including those of the Contractor) pursuant to prior written authorization of the Engineer.

5-1.097 SUBCONTRACTING

Attention is directed to the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, and Section 2, "Proposal Requirements and Conditions," and Section 3, "Award and Execution of Contract," of these special provisions.

Section 8-1.01 of the Standard Specifications is amended by adding the following before the sixth paragraph:

Pursuant to the provisions of Section 6109 of the Public Contract Code, the Contractor shall not perform work on a public works project with a subcontractor who is ineligible to perform work on the public works project pursuant to Section 1777.1 or 1777.7 of the Labor Code.

Pursuant to the provisions of Section 1777.1 of the Labor Code, the Labor Commissioner publishes and distributes a list of contractors ineligible to perform work as a subcontractor on a public works project. This list of debarred contractors is available from the Department of Industrial Relations web site at:

http://www.dir.ca.gov/dir/Labor_law/DLSE/Debar.html.

The provisions in the third paragraph of Section 8-1.01, "Subcontracting," of the Standard Specifications, that the Contractor shall perform with the Contractor's own organization contract work amounting to not less than 50 percent of the original contract price, is not changed by the Federal Aid requirement specified under "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions that the Contractor perform not less than 30 percent of the original contract work with the Contractor's own organization.

Each subcontract and any lower tier subcontract that may in turn be made shall include the "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions. This requirement shall be enforced as follows:

- A. Noncompliance shall be corrected. Payment for subcontracted work involved will be withheld from progress payments due, or to become due, until correction is made. Failure to comply may result in termination of the contract.

The DBE information furnished under Section 2-1.02B, "Submission of DBE Information," of these special provisions is in addition to the subcontractor information required to be furnished under Section 8-1.01, "Subcontracting," and Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications.

In conformance with the Federal DBE regulations Sections 26.53(f)(1) and 26.53(f)(2) Part 26, Title 49 CFR:

- A. The Contractor shall not terminate for convenience a DBE subcontractor listed in response to Section 2-1.02B, "Submission of DBE Information," and then perform that work with its own forces, or those of an affiliate without the written consent of the Department, and
- B. If a DBE subcontractor is terminated or fails to complete its work for any reason, the Contractor will be required to make good faith efforts to substitute another DBE subcontractor for the original DBE subcontractor, to the extent needed to meet the contract goal.

The requirement in Section 2-1.02, "Disadvantaged Business Enterprise (DBE)," of these special provisions that DBEs must be certified on the date bids are opened does not apply to DBE substitutions after award of the contract.

5-1.098 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS

Attention is directed to the provisions in Sections 10262 and 10262.5 of the Public Contract Code and Section 7108.5 of the Business and Professions Code concerning prompt payment to subcontractors.

5-1.099 PROMPT PAYMENT OF WITHHELD FUNDS TO SUBCONTRACTORS

The Contractor shall return all moneys withheld in retention from the subcontractor within 30 days after receiving payment for work satisfactorily completed, even if the other contract work is not completed and has not been accepted in conformance with Section 7-1.17, "Acceptance of Contract," of the Standard Specifications. This requirement shall not be construed to limit or impair any contractual, administrative, or judicial remedies otherwise available to the Contractor or subcontractor in the event of a dispute involving late payment or nonpayment by the Contractor or deficient subcontract performance or noncompliance by a subcontractor.

5-1.10 PARTNERING

The State will promote the formation of a "Partnering" relationship with the Contractor in order to effectively complete the contract to the benefit of both parties. The purpose of this relationship will be to maintain cooperative communication and mutually resolve conflicts at the lowest possible management level.

The Contractor may request the formation of such a "Partnering" relationship by submitting a request in writing to the Engineer after approval of the contract. If the Contractor's request for "Partnering" is approved by the Engineer, scheduling of a "Partnering" workshop, selecting the "Partnering" facilitator and workshop site, and other administrative details shall be as agreed to by both parties.

The costs involved in providing a facilitator and a workshop site will be borne equally by the State and the Contractor. The Contractor shall pay all compensation for the wages and expenses of the facilitator, and of the expenses for obtaining the workshop site. The State's share of such costs will be reimbursed to the Contractor in a change order written by the Engineer. Markups will not be added. All other costs associated with the "Partnering" relationship will be borne separately by the party incurring the costs.

The establishment of a "Partnering" relationship will not change or modify the terms and conditions of the contract and will not relieve either party of the legal requirements of the contract.

5-1.11 AREAS FOR CONTRACTOR'S USE

Attention is directed to the requirements specified in Section 7-1.19, "Rights in Land and Improvements," of the Standard Specifications and these special provisions.

The highway right of way shall be used only for purposes that are necessary to perform the required work. The Contractor shall not occupy the right of way, or allow others to occupy the right of way, for purposes which are not necessary to perform the required work.

There are no State-owned parcels adjacent to the right of way for the exclusive use of the Contractor within the contract limits. The Contractor shall secure, at the Contractor's own expense, any area required for plant sites, storage of equipment or materials, or for other purposes.

No area is available within the contract limits for the exclusive use of the Contractor. However, temporary storage of equipment and materials on State property may be arranged with the Engineer, subject to the prior demands of State maintenance forces and to all other contract requirements. Use of the Contractor's work areas and other State-owned property shall be at the Contractor's own risk, and the State shall not be held liable for any damage to or loss of materials or equipment located within such areas.

5-1.12 PAYMENTS

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications and these special provisions.

For the purpose of making partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications, the amount set forth for the contract items of work hereinafter listed shall be deemed to be the maximum value of the contract item of work which will be recognized for progress payment purposes:

Clearing and Grubbing \$ 3,500.00 After acceptance of the contract pursuant to Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, the amount, if any, payable for a contract item of work in excess of the maximum value for progress payment purposes hereinabove listed for the item, will be included for payment in the first estimate made after acceptance of the contract. In determining the partial payments to be made to the Contractor, only the following listed materials will be considered for inclusion in the payment as materials furnished but not incorporated in the work:

Sound Wall (Masonry Block)
Bar Reinforcing Steel
Chain Link Fence and Gate

5-1.13 SOUND CONTROL REQUIREMENTS

Sound control shall conform to the provisions in Section 7-1.01I, "Sound Control Requirements," of the Standard Specifications and these special provisions.

The noise level from the Contractor's operations, between the hours of 9:00 p.m. and 7:00 a.m., shall not exceed 86 dbA at a distance of 15 m. This requirement in no way relieves the Contractor from responsibility for complying with local ordinances regulating noise level.

The noise level requirement shall apply to the equipment on the job or related to the job, including but not limited to trucks, transit mixers or transient equipment that may or may not be owned by the Contractor. The use of loud sound signals shall be avoided in favor of light warnings except those required by safety laws for the protection of personnel.

Full compensation for conforming to the requirements of this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

SECTION 6. (BLANK)

SECTION 7. (BLANK)

SECTION 8. MATERIALS

SECTION 8-1. MISCELLANEOUS

8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the inch-pound (imperial) system which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following provisions:

Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.

Before other non-metric materials and products will be considered for use the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish necessary information as required by the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision will be final.

When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, the list of sources of material as specified in Section 6-1.01, "Source of Supply and Quality of Materials," of the Standard Specification shall include a list of substitutions to be made and contract items involved. In addition, for a change in design or details the Contractor shall submit plans and working drawings in conformance with Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications.

Unless otherwise specified, the following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR SIZES OF HIGH STRENGTH STEEL FASTENERS

ASTM Designation: A 325M

METRIC SIZE SHOWN ON THE PLANS mm x thread pitch	IMPERIAL SIZE TO BE SUBSTITUTED inch
M16 x 2	5/8
M20 x 2.5	3/4
M22 x 2.5	7/8
M24 x 3	1
M27 x 3	1-1/8
M30 x 3.5	1-1/4
M36 x 4	1-1/2

SUBSTITUTION TABLE FOR PLAIN WIRE REINFORCEMENT, ASTM Designation: A 82

METRIC SIZE SHOWN ON THE PLANS mm ²	US CUSTOMARY UNITS SIZE TO BE SUBSTITUTED inch ² x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

SUBSTITUTION TABLE FOR BAR REINFORCEMENT

METRIC BAR DESIGNATION NUMBER SHOWN ON THE PLANS	EQUIVALENT IMPERIAL BAR DESIGNATION NUMBER TO BE SUBSTITUTED
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

No adjustment will be required in spacing or total number of reinforcing bars due to a difference in minimum yield strength between metric and non-metric bars.

The sizes in the following tables of materials and products are exact conversions of metric sizes of materials and products and are listed as acceptable equivalents:

CONVERSION TABLE FOR SIZES OF:

- (1) STEEL FASTENERS FOR GENERAL APPLICATIONS, ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55, and
- (2) HIGH STRENGTH STEEL FASTENERS, ASTM Designation: A 325 or A 449

METRIC SIZE SHOWN ON THE PLANS mm	EQUIVALENT IMPERIAL SIZE inch
6, or 6.35	1/4
8 or 7.94	5/16
10, or 9.52	3/8
11, or 11.11	7/16
13 or 12.70	1/2
14, or 14.29	9/16
16, or 15.88	5/8
19, or 19.05	3/4
22, or 22.22	7/8
24, 25, or 25.40	1
29, or 28.58	1-1/8
32, or 31.75	1-1/4
35, or 34.93	1-3/8
38 or 38.10	1-1/2
44, or 44.45	1-3/4
51, or 50.80	2
57, or 57.15	2-1/4
64, or 63.50	2-1/2
70 or 69.85	2-3/4
76, or 76.20	3
83, or 82.55	3-1/4
89 or 88.90	3-1/2
95, or 95.25	3-3/4
102, or 101.60	4

CONVERSION TABLE FOR NOMINAL THICKNESS OF SHEET METAL

UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED SHEETS (GALVANIZED)	
METRIC THICKNESS SHOWN ON THE PLANS	EQUIVALENT US STANDARD GAGE	METRIC THICKNESS SHOWN ON THE PLANS	EQUIVALENT GALVANIZED SHEET GAGE
mm	inch	mm	inch
7.94	0.3125	4.270	0.1681
6.07	0.2391	3.891	0.1532
5.69	0.2242	3.510	0.1382
5.31	0.2092	3.132	0.1233
4.94	0.1943	2.753	0.1084
4.55	0.1793	2.372	0.0934
4.18	0.1644	1.994	0.0785
3.80	0.1495	1.803	0.0710
3.42	0.1345	1.613	0.0635
3.04	0.1196	1.461	0.0575
2.66	0.1046	1.311	0.0516
2.28	0.0897	1.158	0.0456
1.90	0.0747	1.006 or 1.016	0.0396
1.71	0.0673	0.930	0.0366
1.52	0.0598	0.853	0.0336
1.37	0.0538	0.777	0.0306
1.21	0.0478	0.701	0.0276
1.06	0.0418	0.627	0.0247
0.91	0.0359	0.551	0.0217
0.84	0.0329	0.513	0.0202
0.76	0.0299	0.475	0.0187
0.68	0.0269	-----	-----
0.61	0.0239	-----	-----
0.53	0.0209	-----	-----
0.45	0.0179	-----	-----
0.42	0.0164	-----	-----
0.38	0.0149	-----	-----

CONVERSION TABLE FOR WIRE

METRIC THICKNESS SHOWN ON THE PLANS mm	EQUIVALENT USA STEEL WIRE THICKNESS inch	GAGE NO.
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

CONVERSION TABLE FOR PIPE PILES

METRIC SIZE SHOWN ON THE PLANS mm x mm	EQUIVALENT IMPERIAL SIZE inch x inch
PP 360 x 4.55	NPS 14 x 0.179
PP 360 x 6.35	NPS 14 x 0.250
PP 360 x 9.53	NPS 14 x 0.375
PP 360 x 11.12	NPS 14 x 0.438
PP 406 x 12.70	NPS 16 x 0.500
PP 460 x T	NPS 18 x T"
PP 508 x T	NPS 20 x T"
PP 559 x T	NPS 22 x T"
PP 610 x T	NPS 24 x T"
PP 660 x T	NPS 26 x T"
PP 711 x T	NPS 28 x T"
PP 762 x T	NPS 30 x T"
PP 813 x T	NPS 32 x T"
PP 864 x T	NPS 34 x T"
PP 914 x T	NPS 36 x T"
PP 965 x T	NPS 38 x T"
PP 1016 x T	NPS 40 x T"
PP 1067 x T	NPS 42 x T"
PP 1118 x T	NPS 44 x T"
PP 1219 x T	NPS 48 x T"
PP 1524 x T	NPS 60 x T"

The thickness in inches (T") represents an exact conversion of the metric thickness in millimeters (T).

CONVERSION TABLE FOR STRUCTURAL TIMBER AND LUMBER

METRIC MINIMUM DRESSED DRY, SHOWN ON THE PLANS mm x mm	METRIC MINIMUM DRESSED GREEN, SHOWN ON THE PLANS mm x mm	EQUIVALENT NOMINAL US SIZE inch x inch
19x89	20x90	1x4
38x89	40x90	2x4
64x89	65x90	3x4
89x89	90x90	4x4
140x140	143x143	6x6
140x184	143x190	6x8
184x184	190x190	8x8
235x235	241x241	10x10
286x286	292x292	12x12

CONVERSION TABLE FOR NAILS AND SPIKES

METRIC COMMON NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC BOX NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC SPIKE, SHOWN ON THE PLANS Length, mm Diameter, mm	EQUIVALENT IMPERIAL SIZE Penny-weight
50.80 2.87	50.80 2.51	————	6d
63.50 3.33	63.50 2.87	————	8d
76.20 3.76	76.20 3.25	76.20 4.88	10d
82.55 3.76	82.55 3.25	82.55 4.88	12d
88.90 4.11	88.90 3.43	88.90 5.26	16d
101.60 4.88	101.60 3.76	101.60 5.72	20d
114.30 5.26	114.30 3.76	114.30 6.20	30d
127.00 5.72	127.00 4.11	127.00 6.68	40d
————	————	139.70 7.19	50d
————	————	152.40 7.19	60d

8-1.02 APPROVED TRAFFIC PRODUCTS

The Department maintains a List of Approved Traffic Products. The Engineer shall not be precluded from sampling and testing products on the List of Approved Traffic Products.

The manufacturer of products on the List of Approved Traffic Products shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each type of traffic product supplied.

The following is the List of Approved Traffic Products:

PAVEMENT MARKERS, PERMANENT TYPE

RETROREFLECTIVE

- Apex, Model 921 (100 mm x 100 mm)
- Ray-O-Lite, Models SS (100 mm x 100 mm), RS (100 mm x 100 mm) and AA (100 mm x 100 mm)
- Stimsonite, Models 88 (100 mm x 100 mm), 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
- 3M Series 290 (89 mm x 100 mm)

RETROREFLECTIVE WITH ABRASION RESISTANT SURFACE (ARS)

Ray-O-Lite "AA" ARS (100 mm x 100 mm)
Stimsonite, Models 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
3M Series 290 (89 mm x 100 mm)

RETROREFLECTIVE WITH ABRASION RESISTANT SURFACE (ARS)
(Used for recessed applications)

Stimsonite, Model 948 (58 mm x 119 mm)
Ray-O-Lite, Model 2002 (58 mm x 117 mm)
Stimsonite, Model 944SB (51 mm x 100 mm)*
Ray-O-Lite, Model 2004 ARS (51 mm x 100 mm)*

*For use only in 114 mm wide (older) recessed slots

NON-REFLECTIVE FOR USE WITH EPOXY ADHESIVE, 100 mm Round

Apex Universal (Ceramic)
Highway Ceramics, Inc. (Ceramic)

NON-REFLECTIVE FOR USE WITH BITUMEN ADHESIVE, 100 mm Round

Apex Universal (Ceramic)
Apex Universal, Model 929 (ABS)
Elgin Molded Plastics, "Empco-Lite" Model 900 (ABS)
Highway Ceramics, Inc. (Ceramic)
Hi-Way Safety, Inc., Models P20-2000W and 2001Y (ABS)
Interstate Sales, "Diamond Back" (ABS) and (Polypropylene)
Alpine Products, D-Dot (ABS)
Road Creations, Model RCB4NR (Acrylic)

PAVEMENT MARKERS, TEMPORARY TYPE

TEMPORARY MARKERS FOR LONG TERM DAY/NIGHT USE (6 months or less)

Apex Universal, Model 924 (100 mm x 100 mm)
Davidson Plastics Corp., Model 3.0 (100 mm x 100 mm)
Elgin Molded Plastics, "Empco-Lite" Model 901 (100 mm x 100 mm)
Road Creations, Model R41C (100 mm x 100 mm)
Vega Molded Products "Temporary Road Marker" (75 mm x 100 mm)

TEMPORARY MARKERS FOR SHORT TERM DAY/NIGHT USE (14 days or less)
(For seal coat or chip seal applications, clear protective covers are required)

Apex Universal, Model 932
Davidson Plastics, Models T.O.M., T.R.P.M., and "HH" (High Heat)
Hi-Way Safety, Inc., Model 1280/1281

STRIPING AND PAVEMENT MARKING MATERIALS

PERMANENT TRAFFIC STRIPING AND PAVEMENT MARKING TAPE

Advanced Traffic Marking, Series 300 and 400
Brite-Line, Series 1000
Swarco Industries, "Director 35" (For transverse application only)
Swarco Industries, "Director 60"
3M, "Stamark" Series 380 and 5730
3M, "Stamark" Series A320 Bisymmetric (For use on low-volume roadways only)
3M, "Stamark" Series A420, A440, N420, and N440 (For transverse application only)

TEMPORARY (REMOVABLE) STRIPING AND PAVEMENT MARKING TAPE
(6 months or less)

Brite-Line, Series 100
P.B. Laminations, Aztec, Grade 102
Swarco Industries, "Director-2"
3M, "Stamark," Series A620
3M Series A145 Removable Black Line Mask
(Black Tape: For use only on Asphalt Concrete Surfaces)
Advanced Traffic Marking Black "Hide-A-Line"
(Black Tape: For use only on Asphalt Concrete Surfaces)

PREFORMED THERMOPLASTIC (Heated in place)

Flint Trading, "Premark" and "Premark 20/20 Flex"
Pavemark, "Hotape"

REMOVABLE TRAFFIC PAINT

Belpro, Series 250/252 and No. 93 Remover

CLASS 1 DELINEATORS

ONE-PIECE DRIVEABLE FLEXIBLE TYPE, 1700 mm

Carsonite, Curve-Flex CFRM-400
Carsonite, Roadmarker CRM-375
Davidson Plastics, "Flexi-Guide Models 400 and 566"
FlexStake, Model 654TM
GreenLine Models HWD1-66 and CGD1-66
J. Miller Industries, Model JMI-375 (with soil anchor)

SPECIAL USE FLEXIBLE TYPE, 1700 mm

Carsonite, "Survivor" with 450 mm U-Channel base
FlexStake, Model 604
GreenLine Models HWD and CGD (with 450 mm U-Channel base)
Safe-Hit with 200 mm pavement anchor (SH248-GP1)
Safe-Hit with 380 mm soil anchor (SH248-GP2) and with 450 mm soil anchor (SH248-GP3)

SURFACE MOUNT FLEXIBLE TYPE, 1200 mm

Bent Manufacturing Company, "Masterflex" Model MF-180EX-48
Carsonite, "Super Duck II"
FlexStake, Surface Mount, Models 704 and 754TM

CHANNELIZERS

SURFACE MOUNT TYPE, 900 mm

Bent Manufacturing Company, "Masterflex" Models MF-360-36 (Round) and MF-180-36 (Flat)
Carsonite, "Super Duck" (Flat SDF-436, Round SDR-336)
Carsonite, Super Duck II Model SDCF203601MB "The Channelizer"
Davidson Plastics, Flex-Guide Models FG300LD and FG300UR
FlexStake, Surface Mount, Models 703 and 753TM
GreenLine, Model SMD-36
The Line Connection, "Dura-Post" Model DP36-3 (Permanent)
The Line Connection, "Dura-Post" Model DP36-3C (Temporary)
Repo, Models 300 and 400
Safe-Hit, Guide Post, Model SH236SMA

CONICAL DELINEATORS, 1070 mm

(For 700 mm Traffic Cones, see Standard Specifications)

Bent Manufacturing Company "T-Top"
Plastic Safety Systems "Navigator-42"
Roadmaker Company "Stacker"
TraFFix Devices "Grabber"

OBJECT MARKERS

TYPE "K", 450 mm

Carsonite, Model SMD-615
FlexStake, Model 701KM
Repo, Models 300 and 400
Safe-Hit, Model SH718SMA
The Line Connection, Model DP21-4K

TYPE "K-4", 450-600 mm
(Shown as Type "Q" in the Traffic Manual)

Carsonite, Super Duck II
FlexStake, Model 701KM
Repo, Models 300 and 400
Safe-Hit, Models SH8 24SMA_WA and SH8 24GP3_WA
The Line Connection, Model DP21-4Q

TEMPORARY RAILING (TYPE K) REFLECTORS AND CONCRETE BARRIER MARKERS

IMPACTABLE TYPE

ARTUK, "FB"
Davidson Plastics, Model PCBM-12
Duraflex Corp., "Flexx 2020" and "Electriflexx"

NON-IMPACTABLE TYPE

ARTUK, JD Series
Stimsonite, Model 967 (with 83 mm Acrylic cube corner reflector)
Stimsonite, Model 967LS
Vega Molded Products, Models GBM and JD

THREE BEAM BARRIER MARKERS

(For use to the left of traffic)

Duraflex Corp., "Railrider"
Davidson Plastics, "Mini" (75 mm x 254 mm)

CONCRETE BARRIER DELINEATORS, 400 mm

(For use to the right of traffic. When mounted on top of barrier, places top of reflective element at 1200 mm)

Davidson Plastics, Model PCBM T-16
Safe-Hit, Model SH216RBM

CONCRETE BARRIER-MOUNTED MINI-DRUM (260 mm x 360 mm x 570 mm)

Stinson Equipment Company "SaddleMarker"

SOUND WALL DELINEATOR

(Applied to a vertical surface. Top of reflective element at 1200 mm)

Davidson Plastics, PCBM S-36

GUARD RAILING DELINEATOR

(Top of reflective element at 1200 mm above plane of roadway)

WOOD POST TYPE, 686 mm

Carsonite, Model 427
Davidson Plastics FG 427 and FG 527
FlexStake, Model 102 GR
GreenLine GRD 27
J. Miller Model JMI-375G
Safe-Hit, Model SH227GRD

STEEL POST TYPE

Carsonite, Model CFGR-327 with CFGRBK300 Mounting Bracket

RETROREFLECTIVE SHEETING FOR:

CHANNELIZERS, BARRIER MARKERS, AND DELINEATORS

3M, High Intensity
Reflexite, PC-1000 Metalized Polycarbonate
Reflexite, AC-1000 Acrylic
Reflexite, AP-1000 Metalized Polyester
Reflexite, AR-1000 Abrasion Resistant Coating
Stimsonite, Series 6200 (For rigid substrate devices only)

TRAFFIC CONES, 330 mm Sleeves

Reflexite SB (Polyester), Vinyl or "TR" (Semi-transparent)

TRAFFIC CONES, 100 mm and 150 mm Sleeves

3M Series 3840
Reflexite Vinyl, "TR" (Semi-transparent) or "Conformalite"

BARRELS AND DRUMS

Reflexite, "Super High Intensity" or "High Impact Drum Sheeting"
3M Series 3810

BARRICADES: Type I, Engineering Grade

American Decal, Adcolite
Avery Dennison, 1500 and 1600
3M, Scotchlite, Series CW

BARRICADES: Type II, Super Engineering Grade

Avery Dennison, "Fasign" 2500 Series
Kiwalite Type II
Nikkalite 1800 Series

SIGNS: Type II, Super Engineering Grade

Avery Dennison, "Fasign" 2500 Series
Kiwalite, Type II
Nikkalite 1800 Series

SIGNS: Type III, High-Intensity Grade

3M Series 3800
Nippon Carbide, Nikkalite Brand Ultralite Grade II

SIGNS: Type IV, High-Intensity Prismatic Grade

Stimsonite Series 6200

SIGNS: Type VII, High-Intensity Prismatic Grade

3M Series 3900

SIGNS: Type VI, Roll-Up Signs

Reflexite, Vinyl (Orange), Reflexite "SuperBright" (Fluorescent orange)
3M Series RS34 (Orange) and RS20 (Fluorescent orange)

SIGN SUBSTRATE FOR CONSTRUCTION AREA SIGNS

ALUMINUM

FIBERGLASS REINFORCED PLASTIC (FRP)

Sequentia, "Polyplate"
Fiber-Brite

8-1.03 SLAG AGGREGATE

Air-cooled iron blast furnace slag shall not be used to produce aggregate for:

1. Structure backfill material.
2. Pervious backfill material.
3. Any reinforced or prestressed portland cement concrete component or structure.
4. Any nonreinforced portland cement concrete component or structure for which a Class 1 Surface Finish is required by the provisions in Section 51-1.18B, "Class 1 Surface Finish," of the Standard Specifications.

Any supplier of steel slag aggregate shall provide separate stockpiles for controlled aging of the slag. An individual stockpile shall contain not less than 9075 nor more than 45 350 tonnes of slag. The material in each individual stockpile shall be assigned a unique lot number and each stockpile shall be identified with a permanent system of signs. The supplier shall maintain a permanent record of the dates on which stockpiles are completed and controlled aging begun, of the dates when controlled aging was completed, and of the dates tests were made and the results of these tests. Moisture tests shall be made at least once per week. No credit for aging will be given for the time period covered by any tests which show a moisture content of 6 percent or less. The stockpiles and records shall be available to the Engineer during normal working hours for inspection, check testing and review.

The supplier shall notify the Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, California 95819, when each stockpile is completed and controlled aging begun. No more aggregate shall be added to the stockpile unless a new aging period is initiated. A further notification shall be sent when controlled aging is completed.

The supplier shall provide a Certificate of Compliance in conformance with the requirements in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. Each stockpile or portion of a stockpile that is used in the work will be considered a lot. The Certificates of Compliance shall state that the steel slag aggregate has been aged in a stockpile for at least 3 months at a moisture content in excess of 6 percent of the dry mass of the aggregate.

Air-cooled iron blast furnace slag or natural aggregate may be blended in proper combinations with steel slag aggregate to produce the specified gradings, for those items for which steel slag aggregate is permitted, unless otherwise provided.

Aggregate containing slag shall meet all of the applicable quality requirements for the items in which the aggregate is used.

The combined slag aggregate shall conform to the specified grading for the item in which it is used. The grading will be determined by California Test 202, modified by California Test 105 when there is a difference in specific gravity of 0.2 or more between the coarse and fine portion of the aggregate or between blends of different aggregates.

No aggregate produced from slag shall be placed within 0.3-m, measured in any direction, of any non-cathodically protected pipe or structure unless the aggregate is incorporated in portland cement concrete pavement, in asphalt concrete, or in treated base.

Slag aggregate used for embankment construction shall not be placed within 0.46-m of finished slope lines, measured normal to the plane of the slope.

In addition to the requirements of Section 39-3.01, "Storage," of the Standard Specifications, steel slag aggregate shall be stored separately from iron blast furnace slag aggregate and each type of slag aggregate shall also be stored separately from natural aggregate.

8-1.04 MEASUREMENT OF QUANTITIES

Attention is directed to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications and these special provisions.

The following is added after the third paragraph in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications:

All elements of the material plant controller which affect the accuracy or delivery of data shall be made available for the application of security seals. These devices will be inspected and adjusting elements sealed prior to the first production of materials for the contract. The security seals will be furnished by the Engineer. Material production shall cease when alteration, disconnection, or otherwise manipulation of the security seals occur and production shall not resume until the device is inspected and resealed by the Engineer.

SECTION 8-2. CONCRETE

8-2.01 PORTLAND CEMENT CONCRETE

Portland cement concrete shall conform to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

Unless the use of mineral admixture is prohibited, whenever the word "cement" is found in the Standard Specifications or the special provisions, it shall be understood to mean "cementitious material" when both of the following conditions are met:

- A. The cement content of portland cement concrete is specified, and
- B. Section 90, "Portland Cement Concrete," of the Standard Specifications is referenced.

Unless otherwise specified, Type C accelerating chemical admixture conforming to the requirements of ASTM Designation: C 494, may be used in portland cement concrete for precast steam cured concrete members.

Section 90-1.01, "Description," of the Standard Specifications is amended to read:

90-1.01 Description.—Portland cement concrete shall be composed of cementitious material, fine aggregate, coarse aggregate, admixtures if used, and water, proportioned and mixed as specified in these specifications.

Unless otherwise specified, cementitious material to be used in portland cement concrete shall conform to the requirements for cement and mineral admixtures in Section 90-2, "Materials" and shall be either: 1) "Type IP (MS) Modified" cement; or 2) a combination of "Type II Modified" portland cement and mineral admixture.

Concrete for each portion of the work shall comply with the requirements for the Class, cementitious material content in kilograms per cubic meter, 28-day compressive strength, minor concrete, or commercial quality concrete, as shown on the plans or specified in these specifications or the special provisions.

Class 1 concrete shall contain not less than 400 kg of cementitious material per cubic meter.

Class 2 concrete shall contain not less than 350 kg of cementitious material per cubic meter.

Class 3 concrete shall contain not less than 300 kg of cementitious material per cubic meter.

Class 4 concrete shall contain not less than 250 kg of cementitious material per cubic meter.

Minor concrete shall contain not less than 325 kg of cementitious material per cubic meter unless otherwise specified in these specifications or the special provisions.

Unless otherwise designated on the plans or specified in these specifications or the special provisions, the amount of cementitious material used per cubic meter of concrete in structures or portions of structures shall conform to the following:

Use	Cementitious Material Content (kg/m ³)
Concrete which is designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min., 475 max.
Roof sections of exposed top box culverts	400 min., 475 max.
Other portions of structures	350 min., 475 max.
Concrete not designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min.
Roof sections of exposed top box culverts	400 min.
Prestressed members	400 min.
Seal courses	400 min.
Other portions of structures	350 min.
Concrete for precast members	350 min., 550 max.

Whenever the 28-day compressive strength shown on the plans is greater than 25 MPa, the concrete shall be considered to be designated by compressive strength. If the plans show a 28-day compressive strength which is 31 MPa or greater, an additional 7 days will be allowed to obtain the specified strength. The 28-day compressive strengths shown on the plans which are 25 MPa or less, are shown for design information only and are not to be considered a requirement for acceptance of the concrete.

Concrete designated by compressive strength shall be proportioned such that the concrete will conform to the strength shown on the plans or specified in the special provisions.

The Contractor shall determine the mix proportions for all concrete except pavement concrete. The Engineer will determine the mix proportions for pavement concrete.

Before using concrete for which the mix proportions have been determined by the Contractor, or in advance of revising those mix proportions, the Contractor shall submit in writing to the Engineer a copy of the mix design.

Compliance with cementitious material content requirements will be verified in conformance with procedures described in California Test 518 for cement content. For testing purposes, mineral admixture shall be considered to be cement. Batch proportions shall be adjusted as necessary to produce concrete having the specified cementitious material content.

If any concrete used in the work has a cementitious material content, consisting of cement, mineral admixture, or cement plus mineral admixture, which is less than the minimum required for the work, the concrete shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place and the Contractor shall pay to the State \$0.55 for each kilogram of cement, mineral admixture, or cement plus mineral admixture which is less than the minimum required for the work. The Department may deduct the amount from any monies due, or that may become due, the Contractor under the contract. The deductions will not be made unless the difference between the contents required and those actually provided exceeds the batching tolerances permitted by Section 90-5, "Proportioning." No deductions for cementitious material content will be made based on the results of California Test 518.

The requirements of the preceding paragraph shall not apply to minor concrete nor commercial quality concrete.

All concrete for which the mix proportions are determined either by the Contractor or the Engineer shall conform to the requirements of this Section 90.

The first paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

90-2.01 Portland Cement.—Unless otherwise specified, portland cement shall be either "Type IP (MS) Modified" cement or "Type II Modified" portland cement.

"Type IP (MS) Modified" cement shall conform to the specifications for Type IP (MS) cement in ASTM Designation: C 595, and shall be comprised of an intimate mixture of Type II cement and not more than 25 percent of a mineral admixture. The type and minimum amount of mineral admixture used in the manufacture of "Type IP (MS) Modified" cement shall be in conformance with the provisions of Section 90-4.08, "Required Use of Mineral Admixtures."

"Type II Modified" portland cement shall conform to the specifications for Type II portland cement in ASTM Designation: C 150.

In addition, "Type IP (MS) Modified" cement and "Type II Modified" portland cement shall conform to the following requirements:

- A. The cement shall not contain more than 0.60 percent by mass of alkalis, calculated as the percentage of Na₂O plus 0.658 times the percentage of K₂O, when determined by either direct intensity flame photometry or by the atomic absorption method. The instrument and procedure used shall be qualified as to precision and accuracy in conformance with the requirements of ASTM Designation: C 114.
- B. The autoclave expansion shall not exceed 0.50 percent.
- C. Mortar, containing the cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not expand in water more than 0.010 percent and shall not contract in air more than 0.048 percent except that when cement is to be used for precast prestressed concrete piling, precast prestressed concrete members or steam cured concrete products, the mortar shall not contract in air more than 0.053 percent.

The second paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

Type III and Type V portland cements shall conform to the specifications in ASTM Designation: C 150, and the additional requirements listed above for Type II Modified portland cement, except that when tested in conformance with California Test 527, mortar containing Type III portland cement shall not contract in air more than 0.075 percent.

The third paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is deleted.

The twelfth paragraph in Section 90-2.02, "Aggregates," of the Standard Specifications is deleted.

The first paragraph in Section 90-2.03, "Water," of the Standard Specifications is amended to read:

90-2.03 Water.—In conventionally reinforced concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 1,000 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In prestressed concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 650 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In no case shall the water contain an amount of impurities that will cause either: 1) a change in the setting time of cement of more than 25 percent when tested in conformance with ASTM Designation: C 191 or ASTM Designation: C 266; or 2) a reduction in the compressive strength of mortar at 14 days of more than 5 percent, when tested in conformance with ASTM Designation: C 109, when compared to the results obtained with distilled water or deionized water, tested in conformance with ASTM Designation: C 109.

The following section is added to Section 90-2, "Materials," of the Standard Specifications:

90-2.04 Admixture Materials.—Admixture materials shall conform to the requirements of the ASTM Designations shown below:

Chemical Admixtures—ASTM Designation: C 494.

Air-entraining Admixtures—ASTM Designation: C 260.

Calcium Chloride—ASTM Designation: D 98.

Mineral Admixtures—Coal fly ash, raw or calcined natural pozzolan as specified in ASTM Designation: C 618, except that the loss on ignition shall not exceed 4 percent, or, silica fume as specified in ASTM Designation: C 1240, with reduction of mortar expansion of 80 percent, minimum, using the cement from the proposed mix design.

Mineral admixtures shall be used in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."

Section 90-4.02, "Materials," of the Standard Specifications is amended to read:

90-4.02 Materials.—Admixture materials shall be as specified in Section 90-2.04, "Admixture Materials."

Section 90-4.05, "Optional Use of Chemical Admixtures," of the Standard Specifications is amended to read:

90-4.05 Optional Use of Chemical Admixtures.—The Contractor will be permitted to use Type A or F, water-reducing; Type B, retarding; or Type D or G, water-reducing and retarding admixtures as described in ASTM Designation: C 494 to conserve cementitious material or to facilitate any concrete construction application subject to the following conditions:

When a water-reducing admixture or a water-reducing and retarding admixture is used, the cementitious material content specified or ordered may be reduced by a maximum of 5 percent by mass except that the resultant cementitious material content shall be not less than 300 kilograms per cubic meter.

When a reduction in cementitious material content is made, the dosage of admixture used shall be the dosage used in determining approval of the admixture.

Section 90-4.07, "Optional Use of Air-entraining Admixtures," of the Standard Specifications is amended to read:

90-4.07 Optional Use of Air-entraining Admixtures.—When air-entrainment has not been specified or ordered by the Engineer, the Contractor will be permitted to use an air-entraining admixture to facilitate the use of any construction procedure or equipment provided that the average air content, as determined by California Test 504, of 3 successive tests does not exceed 4 percent and no single test value exceeds 5.5 percent. If the Contractor elects to use an air-entraining admixture in concrete for pavement, the Contractor shall so indicate at the time the Contractor designates the source of aggregate as provided in Section 40-1.015, "Cement Content."

Section 90-4.08, "Required Use of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.08 Required Use of Mineral Admixtures.—Unless otherwise specified, mineral admixture shall be combined with cement to make cementitious material for use in portland cement concrete.

The calcium oxide content of mineral admixtures shall not exceed 10 percent and the available alkali, as sodium oxide equivalent, shall not exceed 1.5 percent when measured in conformance with the requirements of ASTM Designation: C 618.

The amounts of cement and mineral admixture used in cementitious material for portland cement concrete shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," and shall conform to the following:

The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content.

The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:

- A. When the calcium oxide content of a mineral admixture, measured in conformance with the requirements of ASTM Designation: C 618 and Section 90-2.04, "Admixture Materials," is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix.
- B. When the calcium oxide content of a mineral admixture, measured in conformance with the requirements of ASTM Designation: C 618 and Section 90-2.04, "Admixture Materials," is greater than 2 percent, the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix.
- C. When a mineral admixture is used, which conforms to the requirements for silica fume in Section 90-2.04, "Admixture Materials," is used, the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix.

If more than the required amount of cementitious material is used, the additional cementitious material in the mix may be either cement, any mineral admixture conforming to the requirements of Section 90-2.04, "Admixture Materials," or a combination of both; however, the maximum total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

Section 90-4.09, "Optional Use of Mineral Admixture," of the Standard Specifications is deleted.

Section 90-4.11, "Storage, Proportioning, and Dispensing of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.11 Storage, Proportioning, and Dispensing of Mineral Admixtures.—Mineral admixtures shall be protected from exposure to moisture until used. Sacked material shall be piled to permit access for tally, inspection and identification for each shipment.

Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.

Mineral admixtures shall be incorporated into concrete using equipment conforming to the requirements for cement weigh hoppers, and charging and discharging mechanisms in ASTM Designation: C 94, in Section 90-5.03, "Proportioning," and in this Section 90-4.11.

When interlocks are required for cement and mineral admixture charging mechanisms by Section 90-5.03A, "Proportioning for Pavement," and cement and mineral admixtures are weighed cumulatively, their charging mechanisms shall be interlocked to prevent the introduction of mineral admixture until the mass of cement in the cement weigh hopper is within the tolerances specified in Section 90-5.02, "Proportioning Devices."

Mineral admixture used in concrete for exposed surfaces of like elements of a structure shall be from the same source and of the same percentage.

Section 90-5.02, "Proportioning Devices," of the Standard Specifications is amended to read:

90-5.02 Proportioning Devices.—All weighing, measuring or metering devices used for proportioning materials shall conform to the requirements in Section 9-1.01, "Measurement of Quantities," and this Section 90-5.02. In addition, any automatic weighing systems used shall comply with the requirements for automatic proportioning devices in Section 90-5.03A, "Proportioning for Pavement." These automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, and mineral admixture for one batch of concrete is a single operation of a switch or starter.

Proportioning devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.

Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the plant is in operation, the mass of each batch of material shall not vary from the mass designated by the Engineer by more than the tolerances specified herein.

Equipment for cumulative weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. For systems with individual weigh hoppers for the various sizes of aggregate, the zero tolerance shall be ± 0.5 percent of the individual batch mass designated for each size of aggregate. Equipment for cumulative weighing of cement and mineral admixtures shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the cement and mineral admixture. Equipment for weighing cement or mineral admixture separately shall have a zero tolerance of ± 0.5 percent of their designated individual batch masses. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.

The mass indicated for any batch of material shall not vary from the preselected scale setting by more than the following:

- A. Aggregate weighed cumulatively shall be within 1.0 percent of the designated total batch mass of the aggregate. Aggregates weighed individually shall be within 1.5 percent of their respective designated batch masses.
- B. Cement shall be within 1.0 percent of its designated batch mass. When weighed individually, mineral admixture shall be within 1.0 percent of its designated batch mass. When mineral admixture and cement are permitted to be weighed cumulatively, cement shall be weighed first to within 1.0 percent of its designated batch mass, and the total for cement and mineral admixture shall be within 1.0 percent of the sum of their designated batch masses.
- C. Water shall be within 1.5 percent of its designated mass or volume.

Each scale graduation shall be approximately 0.001 of the total capacity of the scale. The capacity of scales for weighing cement, mineral admixture, or cement plus mineral admixture and aggregates shall not exceed that of commercially available scales having single graduations indicating a mass not exceeding the maximum permissible mass variation above, except that no scale shall be required having a capacity of less than 500 kg, with 0.5 kg graduations.

Section 90-5.03, "Proportioning," excluding Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03 Proportioning.—Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture and water as provided in these specifications. Aggregates shall be proportioned by mass.

At the time of batching, all aggregates shall have been dried or drained sufficiently to result in a stable moisture content such that no visible separation of water from aggregate will take place during transportation from the proportioning plant to the point of mixing. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.

Bulk "Type IP (MS) Modified" cement, that conforms to the requirements in Section 90-2.01, "Portland Cement," shall be weighed in an individual hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer.

Bulk cement to be blended with mineral admixture for use in portland cement concrete for pavement and structures may be weighed in separate, individual weigh hoppers or may be weighed in the same weigh hopper with mineral admixture and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer. If the cement and mineral admixture are weighed cumulatively, the cement shall be weighed first.

When cement and mineral admixtures are weighed in separate weigh hoppers, the weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material weighing device. The cement and the mineral admixture shall be discharged into the mixer simultaneously with the aggregate.

The scale and weigh hopper for bulk weighing cement, mineral admixture, and cement plus mineral admixture shall be separate and distinct from the aggregate weighing equipment.

When the source of any aggregate is changed for concrete structures, the Contractor shall adjust the mix proportions and submit in writing to the Engineer a copy of the mix design before using such aggregates. When the source of any aggregate is changed for other concrete, the Engineer shall be allowed sufficient time to adjust the mix and such aggregates shall not be used until necessary adjustments are made.

For all batches with a volume of one cubic meter or more, the batching equipment shall conform to one of the following combinations:

- A. Separate boxes and separate scale and indicator for weighing each size of aggregate.
- B. Single box and scale indicator for all aggregates.
- C. Single box or separate boxes and automatic weighing mechanism for all aggregates.

In order to check the accuracy of batch masses, the gross mass and tare mass of batch trucks, truck mixers, truck agitators, and non-agitating hauling equipment shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03A Proportioning for Pavement.—Aggregates and bulk cement, mineral admixture, and cement plus mineral admixture for use in pavement shall be proportioned by mass by means of automatic proportioning devices of approved type conforming to the requirements specified in this Section 90-5.03A.

The Contractor shall install and maintain in operating condition an electrically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.

The batching of cement, mineral admixture, or cement plus mineral admixture and aggregate shall be interlocked so that a new batch cannot be started until all weigh hoppers are empty, the proportioning devices are within zero tolerance, and the discharge gates are closed. The interlock shall permit no part of the batch to be discharged until all aggregate hoppers and the cement and mineral admixture hoppers or the cement plus mineral admixture hopper are charged with masses which are within the tolerances specified in Section 90-5.02, "Proportioning Devices."

The discharge gate on the cement and mineral admixture hoppers or the cement plus mineral admixture hopper shall be designed to permit regulating the flow of cement, mineral admixture, or cement plus mineral admixture into the aggregate as directed by the Engineer.

When separate weigh boxes are used for each size of aggregate, the discharge gates shall permit regulating the flow of each size of aggregate as directed by the Engineer.

Material discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of withdrawal from the several bins, and of discharge from the weigh box, shall be interlocked so that not more than one bin can discharge at a time, and that the weigh box cannot be tripped until the required quantity from each of the several bins has been deposited therein. Should a separate weigh box be used for each size of aggregate, all may be operated and discharged simultaneously.

When the discharge from the several bins is controlled by gates, each gate shall be actuated automatically so that the required mass is discharged into the weigh box, after which the gate shall automatically close and lock.

The automatic weighing system shall be designed so that all proportions required may be set on the weighing controller at the same time.

The third paragraph in Section 90-6.01, "General," of the Standard Specifications is amended to read:

All concrete shall be homogeneous and thoroughly mixed, and there shall be no lumps or evidence of undispersed cement, mineral admixture, or cement plus mineral admixture.

The third and fourth paragraphs in Section 90-6.02, "Machine Mixing," of the Standard Specifications are amended to read:

The batch shall be so charged into the mixer that some water will enter in advance of cementitious materials and aggregates. All water shall be in the drum by the end of the first one-fourth of the specified mixing time.

Cementitious materials shall be batched and charged into the mixer by means that will not result either in loss of cementitious materials due to the effect of wind, or in accumulation of cementitious materials on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cementitious material in the concrete mixture.

The sixth paragraph in Section 90-6.02, "Machine Mixing," of the Standard Specifications is amended to read:

The total elapsed time between the intermingling of damp aggregates and all cementitious materials and the start of mixing shall not exceed 30 minutes.

The seventh through tenth paragraphs in Section 90-6.03, "Transporting Mixed Concrete," of the Standard Specifications are amended to read:

When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be completed within 1.5 hours, or before 250 revolutions of the drum or blades, whichever comes first, after the introduction of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30° C, or above, a time less than 1.5 hours may be required.

When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be completed within one hour after the addition of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30° C, or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.

Each load of concrete delivered at the jobsite shall be accompanied by a weight certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load and for transit-mixed concrete, the reading of the revolution counter at the time the truck mixer is charged with cement. This weight certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.

Weight certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on 90 mm diskette with a capacity of at least 1.4 megabytes. Captured data, for the ingredients represented by each batch shall be LFCR (one line, separate record) with allowances for sufficient fields to satisfy the amount of data required by these specifications.

The Contractor may furnish a weight certificate that is accompanied by a separate certificate which lists the actual batch masses or measurements for a load of concrete provided that both certificates are 1) imprinted with the same non-repeating load number that is unique to the contract and 2) delivered to the jobsite with the load.

All weight certificates furnished by the Contractor shall conform to the requirements of Section 9-1.01, "Measurement of Quantities."

Section 90-6.05, "Hand-Mixing," of the Standard Specifications is amended to read:

90-6.05 Hand-Mixing.—Hand-mixed concrete shall be made in batches not more than one-fourth cubic meter and shall be mixed on a watertight, level platform. The proper amount of coarse aggregate shall be measured in measuring boxes and spread on the platform and the fine aggregate shall be spread on this layer, the 2 layers being not more than 0.3 meters in total depth. On this mixture shall be spread the dry cement and mineral admixture and the whole mass turned no fewer than 2 times dry; then sufficient clean water shall be added, evenly distributed, and the whole mass again turned no fewer than 3 times, not including placing in the carriers or forms.

The table in the first paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

Type of Work	Nominal Penetration (mm)	Maximum Penetration (mm)
Concrete pavement	0-25	40
Non-reinforced concrete facilities	0-35	50
Reinforced concrete structures:		
Sections over 300 mm thick	0-35	65
Sections 300 mm thick or less	0-50	75
Concrete placed under water	75-100	115
Cast-in-place concrete piles	65-90	100

The first paragraph following the table of penetration ranges in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

The amount of free water used in concrete shall not exceed 183 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 325 kg/m³.

The fourth paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

Where there are adverse or difficult conditions which affect the placing of concrete, the above specified penetration and free water content limitations may be exceeded providing the Contractor is granted permission by the Engineer in writing to increase the cementitious material content per cubic meter of concrete. The increase in water and cementitious material shall be at a ratio not to exceed 30 kg of water per added 100 kg of cementitious material per cubic meter. The cost of additional cementitious material and water added under these conditions shall be at the Contractor's expense and no additional compensation will be allowed therefor.

Section 90-9.01, "General," of the Standard Specifications is amended to read:

90-9.01 General.—Concrete compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified elsewhere or are shown on the plans.

The compressive strength of concrete will be determined from test cylinders which have been fabricated from concrete sampled in conformance with California Test 539. Test cylinders will be molded and initial field cured in conformance with California Test 540. Test cylinders will be cured and tested after receipt at the testing laboratory in conformance with California Test 521. A strength test shall consist of the average strength of 2 cylinders fabricated from material taken from a single load of concrete, except that, if any cylinder should show evidence of improper sampling, molding, or testing, that cylinder shall be discarded and the strength test shall consist of the strength of the remaining cylinder.

When concrete compressive strength is specified as a prerequisite to applying loads or stresses to a concrete structure or member, test cylinders for other than steam cured concrete will be cured in conformance with Method 1 of California Test 540. The compressive strength of concrete determined for these purposes will be evaluated on the basis of individual tests.

When concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete strength to be used as a basis for acceptance of other than steam cured concrete will be determined from cylinders cured in conformance with Method 1 of California Test 540. If the result of a single compressive strength test at the maximum age specified or allowed is below the specified strength but is 95 percent or more of the specified strength, the Contractor shall, at the Contractor's expense, make corrective changes, subject to approval of the Engineer, in the mix proportions or in the concrete fabrication procedures, before placing additional concrete, and shall pay to the State \$14.00 for each in-place cubic meter of concrete represented by the deficient test. If the result of a single compressive strength test at the maximum age specified or allowed is below 95 percent of the specified strength, but is 85 percent or more of the specified strength, the Contractor shall make the corrective changes specified above, and shall pay to the State \$20.00 for each in place cubic meter of concrete represented by the deficient test. In addition, such corrective changes shall be made when the compressive strength of concrete tested at 7 days indicates, in the judgment of the Engineer, that the concrete will not attain the required compressive strength at the maximum age specified or allowed. All concrete represented by a single test which indicates a compressive strength of less than 85 percent of the specified 28-day compressive strength will be rejected in conformance with the provisions in Section 6-1.04, "Defective Materials."

If the test result indicates that the compressive strength at the maximum curing age specified or allowed is below the specified strength, but 85 percent or more of the specified strength, payments to the State as required above shall be made, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength of the concrete placed in the work meets or exceeds the specified 28-day compressive strength. If the test result indicates a compressive strength at the maximum curing age specified or allowed below 85 percent, the concrete represented by that test will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the concrete placed in the work are acceptable. If the evidence consists of tests made on cores taken from the work, the cores shall be obtained and tested in conformance with the specifications of ASTM Designation: C 42.

No single compressive strength test shall represent more than 250 cubic meters.

When a precast concrete member is steam cured, the compressive strength of the concrete will be determined from test cylinders which have been handled and stored in conformance with Method 3 of California Test 540. The compressive strength of steam cured concrete will be evaluated on the basis of individual tests representing specific portions of production. When the concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete shall be considered to be acceptable whenever its compressive strength reaches the specified 28-day compressive strength provided that strength is reached in not more than the maximum number of days specified or allowed after the member is cast.

When concrete is specified by compressive strength, prequalification of materials, mix proportions, mixing equipment, and procedures proposed for use, will be required prior to placement of the concrete. Prequalification shall be accomplished by the submission of acceptable certified test data or trial batch reports by the Contractor. Prequalification data shall be based on the use of materials, mix proportions, mixing equipment, procedures, and size of batch proposed for use in the work.

Certified test data, in order to be acceptable, must indicate that not less than 90 percent of at least 20 consecutive tests exceed the specified strength at the maximum number of cure days specified or allowed, and none of those tests are less than 95 percent of specified strength. Strength tests included in the data shall be the most recent tests made on concrete of the proposed mix design and all shall have been made within one year of the proposed use of the concrete.

Trial batch test reports, in order to be acceptable, must indicate that the average compressive strength of 5 consecutive concrete cylinders, taken from a single batch, at not more than 28 days (or the maximum age allowed) after molding shall be at least 4 MPa greater than the specified 28-day compressive strength, and no individual cylinder shall have a strength less than the specified strength at the maximum age specified or allowed. Data contained in the report shall be from trial batches which were produced within one year of the proposed use of specified strength concrete in the project. Whenever air-entrainment is required, the air content of trial batches shall be equal to or greater than the air content specified for the concrete without reduction due to tolerances.

All tests shall be performed in conformance with either the appropriate California Test methods or the comparable ASTM test methods. All equipment employed in testing shall be in good condition and shall be properly calibrated. If the tests are performed during the life of the contract, the Engineer shall be notified sufficiently in advance of performing the tests in order to witness the test procedures.

The certified test data and trial batch test reports shall include the following information:

- A. Date of mixing.
- B. Mixing equipment and procedures used.
- C. The size of batch in cubic meters and the mass, type and source of all ingredients used.
- D. Penetration of the concrete.
- E. The air content of the concrete if an air-entraining admixture is used.
- F. The age at time of testing and strength of all concrete cylinders tested.

All certified test data and trial batch test reports shall be signed by an official of the firm which performed the tests.

When approved by the Engineer, concrete from trial batches may be used in the work at locations where concrete of a lower quality is required and the concrete will be paid for as the type or class of concrete required at that location.

After materials, mix proportions, mixing equipment, and procedures for concrete have been prequalified for use, additional prequalification by testing of trial batches will be required prior to making any changes which, in the judgment of the Engineer, could result in a lowering of the strength of the concrete below that specified.

The Contractor's attention is directed to the time required to test trial batches and the Contractor shall be responsible for production of trial batches at a sufficiently early date so that the progress of the work is not delayed.

When precast concrete members are manufactured at the plant of an established manufacturer of precast concrete members, the mix proportions of the concrete shall be determined by the Contractor, and a trial batch and prequalification of the materials, mix proportions, mixing equipment, and procedures will not be required.

Section 90-10.02A, "Portland Cement," of the Standard Specifications is renamed "Cementitious Material" and is amended to read:

90-10.02A Cementitious Material.—Cementitious material shall conform to the provisions in Section 90-1.01, "Description." Compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified elsewhere or are shown on the plans.

The fifth paragraph in Section 90-10.02B, "Aggregate," of the Standard Specifications is deleted.
Section 90-10.03, "Production," of the Standard Specifications is amended to read:

90-10.03 Production.—Cementitious material, water, aggregate, and admixtures shall be stored, proportioned, mixed, transported, and discharged in conformance with recognized standards of good practice, which will result in concrete that is thoroughly and uniformly mixed, that is suitable for the use intended, and which conforms to requirements specified herein. "Recognized standards of good practice" are outlined in various industry publications such as are issued by American Concrete Institute, AASHTO, or California Department of Transportation.

The cementitious material content of minor concrete shall conform to the provisions in Section 90-1.01, "Description."

The amount of water used shall result in a consistency of concrete conforming to the provisions in Section 90-6.06, "Amount of Water and Penetration." Additional mixing water shall not be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer.

Discharge of ready-mixed concrete from the transporting vehicle shall be made while the concrete is still plastic and before any stiffening occurs. An elapsed time of 1.5 hours (one hour in non-agitating hauling equipment), or more than 250 revolutions of the drum or blades, after the introduction of the cementitious material to the aggregates, or a temperature of concrete of more than 32° C. will be considered as conditions contributing to the quick stiffening of concrete. The Contractor shall take whatever action is necessary to eliminate quick stiffening, except that the addition of water will not be permitted.

The required mixing time in stationary mixers shall be not less than 50 seconds nor more than 5 minutes.

The minimum required revolutions at mixing speed for transit-mixed concrete shall be not less than that recommended by the mixer manufacturer, and shall be increased, if necessary, to produce thoroughly and uniformly mixed concrete.

Each load of ready-mixed concrete shall be accompanied by a weight certificate which shall be delivered to the Engineer at the discharge location of the concrete, unless otherwise directed by the Engineer. The weight certificate shall be clearly marked with the date and time of day when the load left the batching plant and, if hauled in truck mixers or agitators, the time the mixing cycle started.

A Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer, prior to placing minor concrete from a source not previously used on the contract, stating that minor concrete to be furnished meets all contract requirements, including minimum cementitious material content specified.

The third and fourth paragraphs in Section 90-11.02, "Payment," of the Standard Specifications are amended to read:

Should the Engineer order the Contractor to incorporate any admixtures in the concrete when their use is not required by these specifications or the special provisions, furnishing the admixtures and adding them to the concrete will be paid for as extra work as provided in Section 4-1.03D.

Should the Contractor use admixtures as permitted under Sections 90-4.05, "Optional Use of Chemical Admixtures;" or 90-4.07, "Optional Use of Air-entraining Admixtures;" or should the Contractor request and obtain permission to use other admixtures for the Contractor's benefit, the Contractor shall furnish those admixtures and incorporate them in the concrete at the Contractor's expense and no additional compensation will be allowed therefor.

SECTION 8-3. WELDING

8-3.01 WELDING ELECTRODES

Flux core welding electrodes conforming to the requirements of AWS A5.20 E6XT-4 or E7XT-4 shall not be used to perform any type of welding for this project.

8-3.02 WELDING QUALITY CONTROL

Welding quality control shall conform to the requirements in the AWS welding codes, the Standard Specifications and these special provisions.

Welding quality control shall apply when any work is welded in conformance with the provisions in Section 49, "Piling," Section 52, "Reinforcement," Section 55, "Steel Structures," Section 56-1, "Overhead Sign Structures," Section 75-1.035, "Bridge Joint Restrainer Units," or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

Wherever reference is made to the following AWS welding codes in the Standard Specifications, on the plans or in these special provisions, the year of adoption for these codes shall be as listed:

AWS Code	Year of Adoption
D1.1	1998
D1.4	1992
D1.5	1995
D1.5 (metric only)	1996

All requirements of the AWS welding codes shall apply unless specified otherwise in the Standard Specifications, on the plans or in these special provisions. Wherever the abbreviation AWS is used, it shall be equivalent to the abbreviations ANSI/AWS or ANSI/AASHTO/AWS.

The welding of all fracture critical members (FCMs) shall conform to the provisions specified in the Fracture Control Plan (FCP) and herein.

The Contractor shall designate in writing a welding Quality Control Manager (QCM). The QCM shall be responsible directly to the Contractor for the quality of welding, including materials and workmanship, performed by the Contractor and all subcontractors.

The QCM shall be the sole individual responsible to the Contractor for submitting, receiving, and approving all correspondence, required submittals, and reports to and from the Engineer.

The QCM shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project. The QCM may be an employee of the Contractor.

Welding inspection personnel or nondestructive testing (NDT) firms to be used in the work shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project, except for the following conditions:

1. The welding is performed at a permanent fabrication facility which is certified under the AISC Quality Certification Program, Category Cbr, Major Steel Bridges.
2. The welding is performed at a permanent fabrication facility which is certified under the AISC Quality Certification Program, Category Sbd, Conventional Steel Building Structures. This condition shall apply only for work welded in conformance with the provisions in Section 56-1, "Overhead Sign Structures" or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

For welding performed at such certified facilities, the inspection personnel or NDT firms may be employed or compensated by the fabrication facility performing the welding.

Prior to submitting the Welding Quality Control Plan (WQCP) required herein, a pre-welding meeting between the Engineer, Contractor and any welding subcontractors or entities hired by these subcontractors to be used in the work, shall be held to discuss the requirements for the WQCP.

Prior to performing any welding, the Contractor shall submit to the Engineer, in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, 3 copies of a separate WQCP for each item of work for which welding is to be performed. As a minimum, each WQCP shall include the following:

1. The name of the welding firm and the NDT firm to be used;
2. A manual prepared by the NDT firm that shall include equipment, testing procedures, code of safe practices, the Written Practice of the NDT firm, and the names, qualifications and documentation of certifications for all personnel to be used;
3. The name of the QCM and the names, qualifications and documentation of certifications for all Quality Control (QC) Inspectors and Assistant Quality Control Inspectors to be used;
4. An organizational chart showing all QC personnel and their assigned QC responsibilities;
5. The methods and frequencies for performing all required quality control procedures, including QC inspection forms to be used, as required by the specifications including:
 - (a) all visual inspections;
 - (b) all NDT including radiographic geometry, penetrometer and shim selection, film quality, film processing, radiograph identification and marking system, and film interpretation and reports; and
 - (c) calibration procedures and calibration frequency for all NDT equipment.
6. A system for the identification and tracking of all welds, NDT and any required repairs, and a procedure for the reinspection of any repaired welds. The system shall have provisions for 1) permanently identifying each weld and the person who performed the weld, 2) placing all identification and tracking information on each radiograph and 3) a method of reporting nonconforming welds to the Engineer;
7. Standard procedures for performing noncritical repair welds. Noncritical repair welds are defined as welds to deposit additional weld beads or layers to compensate for insufficient weld size and to fill limited excavations that were performed to remove unacceptable edge or surface discontinuities, rollover or undercut. The depth of these excavations shall not exceed 65 percent of the specified weld size;
8. The welding procedure specification (WPS), including documentation of all supporting Procedure Qualification Record (PQR) tests performed, and the name of the testing laboratory who performed the tests, to verify the acceptability of the WPS. The submitted WPS shall be within the allowable period of effectiveness;
9. Documentation of all certifications for welders for each weld process and position that will be used. Certifications shall list the electrodes used, test position, base metal and thickness, tests performed, and the witnessing authority. All certifications shall be within the allowable period of effectiveness; and
10. One copy each of all AWS welding codes and the FCP which are applicable to the welding to be performed. These codes and the FCP shall become the permanent property of the Department.
11. Example forms to be used for Certificates of Compliance, daily production logs, and daily reports.

The Engineer shall have 10 working days to review the WQCP submittal after a complete plan has been received. No welding shall be performed until the WQCP is approved in writing by the Engineer. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the WQCP, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

An amended WQCP or addendum shall be submitted to, and approved in writing by the Engineer, for any proposed revisions to the approved WQCP. An amended WQCP or addendum will be required for any revisions to the WQCP, including but not limited to a revised WPS, additional welders, changes in NDT firms or procedures, QC or NDT personnel, or updated systems for tracking and identifying welds. The Engineer shall have 3 working days to complete the review of the amended WQCP or addendum. Work that is affected by any of the proposed revisions shall not be performed until the amended WQCP or addendum has been approved. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the amended WQCP or addendum, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

After final approval of the WQCP, amended WQCP or addendum, the Contractor shall submit to the Engineer 7 copies each of these approved documents.

It is expressly understood that the Engineer's approval of the Contractor's WQCP shall not relieve the Contractor of any responsibility under the contract for the successful completion of the work in conformity with the requirements of the plans and specifications. The Engineer's approval shall not constitute a waiver of any of the requirements of the plans and specifications nor relieve the Contractor of any obligation thereunder, and defective work, materials and equipment may be rejected notwithstanding approval of the WQCP.

A daily production log for welding shall be kept by the QCM for each day that welding is performed. The log shall clearly indicate the locations of all welding, and shall include the welders' names, amount of welding performed, any problems or deficiencies discovered, and any testing or repair work performed, at each location. The daily report from each Quality Control Inspector shall also be included in the log.

The following items shall be included in a Welding Report that is to be submitted to the Engineer within 7 days following the performance of any welding:

1. Reports of all visual weld inspections and NDT;
2. Radiographs and radiographic reports, and other required NDT reports;
3. Documentation that the Contractor has evaluated all radiographs and other nondestructive tests, corrected all rejectable deficiencies, and all repaired welds have been reexamined by the required NDT and found acceptable; and
4. Daily production log.

All radiographic envelopes shall have clearly written on the outside of the envelope the following information: name of the QCM, name of the nondestructive testing firm, name of the radiographer, date, contract number, complete part description, and all included weld numbers or a report number, as detailed in the WQCP. In addition, all innerleaves shall have clearly written on them the part description and all included weld numbers, as detailed in the WQCP.

All reports regarding NDT, including radiographs, shall be signed by both the NDT technician and the person that performed the review, and then submitted directly to the QCM for review and signature prior to submittal to the Engineer. Corresponding names shall be clearly printed or typewritten next to all signatures.

The Engineer will review the Welding Report to determine if the Contractor is in conformance with the WQCP. Except for steel piling, the Engineer shall be allowed 7 days to review the report and respond in writing after a complete Welding Report has been received. The review time for steel piling shall be as specified in "Piling" of these special provisions. Prior to receiving notification from the Engineer of the Contractor's conformance with the WQCP, the Contractor may encase in concrete or cover any welds for which a Welding Report has been submitted. However, should the Contractor elect to encase or cover those welds prior to receiving notification from the Engineer, it is expressly understood that the Contractor shall not be relieved of the responsibility for incorporating material in the work that conforms to the requirements of the plans and specifications. Any material not conforming to these requirements will be subject to rejection. Should the Contractor elect to wait to encase or cover any welds pending notification by the Engineer, and should the Engineer fail to complete the review and provide notification within this time allowance, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in notification, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Sections 6.1.2 through 6.1.4.3 of AWS D 1.1, Sections 7.1.1 and 7.1.2 of AWS D 1.4, and Sections 6.1.1.1 through 6.1.3.3 of AWS D 1.5 are replaced with the following:

Quality Control (QC) shall be the responsibility of the Contractor. As a minimum, the Contractor shall perform inspection and testing prior to welding, during welding and after welding as specified in this section and additionally as necessary to ensure that materials and workmanship conform to the requirements of the contract documents.

The Quality Control (QC) Inspector shall be the duly designated person who performs inspection, testing, and quality matters for all welding.

Quality Assurance (QA) is the prerogative of the Engineer. The QA Inspector is the duly designated person who acts for and on behalf of the Engineer.

All QC Inspectors shall be responsible for quality control acceptance or rejection of materials and workmanship, and shall be currently certified as AWS Certified Welding Inspectors (CWI) in conformance with the requirements in AWS QC1, "Standard and Guide for Qualification of Welding Inspectors."

The QC Inspector may be assisted by an Assistant QC Inspector provided that this individual is currently certified as an AWS Certified Associate Welding Inspector (CAWI) in conformance with the requirements in AWS QC1, "Standard and Guide for Qualification of Welding Inspectors," or has equivalent qualifications. The QC Inspector shall monitor the Assistant QC Inspector's work, and shall be responsible for signing all reports.

When the term "Inspector" is used without further qualification, it shall refer to the QC Inspector.

Section 6.14.6, "Personnel Qualification," of AWS D 1.1, Section 7.7.6, "Personnel Qualification," of AWS D 1.4 and Section 6.1.3.4, "Personnel Qualification," of AWS D 1.5 are replaced with the following:

Personnel performing NDT shall be qualified in conformance with the requirements in the current edition of the American Society for Nondestructive Testing (ASNT) Recommended Practice No. SNT-TC-1A and the Written Practice of the NDT firm. The Written Practice of the NDT firm shall meet or exceed the requirements of the current edition of the ASNT Recommended Practice No. SNT-TC-1A. Only individuals who are 1) qualified for NDT Level II, or 2) Level III technicians who have been directly certified by the ASNT and are authorized to perform the work of Level II technicians, shall perform NDT, review the results, and prepare the written reports.

Section 6.5.4, "Scope of Examination," of AWS D 1.1 and Section 7.5.4 of AWS D 1.4 are replaced with the following:

The QC Inspector shall inspect and approve the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder to make certain that the applicable requirements of this code and the approved WPS are met.

Section 6.5.4 of AWS D 1.5 is replaced with the following:

The QC Inspector shall inspect and approve the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder to make certain that the applicable requirements of this code and the approved WPS are met. The QC Inspector shall examine the work to make certain that it meets the requirements of section 3 and 9.21. The size and contour of welds shall be measured using suitable gages. Visual inspection for cracks in welds and base metal, and for other discontinuities should be aided by strong light magnifiers, or such other devices as may be helpful. Acceptance criteria different from those specified in this code may be used when approved by the Engineer.

The Engineer shall have the authority to verify the qualifications or certifications of any welder, Quality Control Inspector, or NDT personnel to specified levels by retests or other means.

A sufficient number of QC Inspectors shall be provided to ensure continuous inspection when any welding is being performed. Continuous inspection, as a minimum, shall include (1) having QC Inspectors continually present on all shifts when any welding is being performed, or (2) having a QC Inspector within such close proximity of all welding operations that inspections by the QC Inspector of each operation, at each welding location, shall not lapse for a period exceeding 30 minutes.

Inspection and approval of the joint preparation, assembly practice, welding techniques, and performance of each welder, welding operator, and tack welder shall be documented by the QC Inspector on a daily basis for each day that welding is performed.

The QC Inspector shall provide reports to the QCM on a daily basis for each day that welding is performed.

Except for noncritical weld repairs, base metal repairs, or any other type of repairs not submitted in the WQCP, the Engineer shall be notified immediately in writing when any welding problems or deficiencies are discovered and also of the proposed repair procedures to correct them. The Engineer shall have 5 working days to review these procedures. No remedial work shall begin until the repair procedures are approved in writing by the Engineer. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the proposed repair procedures, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

When joint details that are not prequalified by the applicable AWS codes are proposed for use in the work, all welders using these details shall perform a qualification test plate using the approved WPS variables and the joint detail to be used in production. The test plate shall be the maximum thickness to be used in production. The test plate shall be mechanically or radiographically tested as directed by the Engineer. Mechanical and radiographic testing and acceptance criteria shall be as specified in the applicable AWS codes.

The period of effectiveness for a welder's or welding operator's qualification shall be a maximum of 3 years for the same weld process, welding position, and weld type. A valid qualification at the beginning of work on a contract will be acceptable for the entire period of the contract, as long as the welder's work remains satisfactory.

All qualification tests for welders, welding operators, and WPSs used in welding operations will be witnessed by the Engineer.

Section 6.6.5, "Nonspecified Nondestructive Testing Other Than Visual," of AWS D 1.1, Section 6.6.5 of AWS D 1.4 and Section 6.6.5 of AWS D 1.5 shall not apply.

For any welding, the Engineer may direct the Contractor to perform NDT that is in addition to the visual inspection or NDT specified in the AWS welding codes, in the Standard Specifications or in these special provisions. Additional NDT required by the Engineer, will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications. Should any welding deficiencies be discovered by this additional NDT, the cost of the testing will not be paid for as extra work, and shall be at the Contractor's expense.

All required repair work to correct welding deficiencies, whether discovered by the required visual inspection or NDT, or by additional NDT directed by the Engineer, and any associated delays or expenses caused to the Contractor by performing these repairs, shall be at the Contractor's expense.

At the completion of all welding, the QCM shall sign and furnish to the Engineer, a certificate of compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each item of work for which welding was performed. The certificate shall state that all of the materials and workmanship incorporated in the work, and all required tests and inspections of this work, have been performed in conformance with the details shown on the plans and the provisions of the Standard Specifications and these special provisions.

Full compensation for conforming to all of the requirements of this section, Welding Quality Control, shall be considered as included in the contract prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

SECTION 9. DESCRIPTION OF STRUCTURE WORK

The work to be done consists, in general, of constructing the following structures:

LAVERNE HEIGHTS ELEMENTARY SCHOOL FENCE

A modified chain link fence supported on cast-in-drilled-hole piling adjacent to Sound Wall No. 53.

RETAINING WALL/SOUND WALL NO. 70

A masonry block sound wall supported on a retaining wall with cast-in-drilled-hole piling.

SECTION 10. CONSTRUCTION DETAILS

SECTION 10-1. GENERAL

10-1.01 ORDER OF WORK

Order of work shall conform to the provisions in Section 5-1.05, "Order of Work," of the Standard Specifications and these special provisions.

Attention is directed to the Contractor for abandoned existing utilities at Yuma Street between Stations 68+41.30 and 68+55.54, as shown on the plans, that may require excavation, removal and disposal, for the construction of the sound wall.

The Contractor is allowed to work between the hours of 7:00 a.m. through 7:00 p.m., Monday through Saturday.

The existing Sound Wall (Plywood Sheet) shall be removed only after the Sound Wall No. 53 is completed.

The Contractor shall contact the Superintendent of the Bonita Unified School District at (909) 599-6787 prior to conducting any work within and adjacent to the school.

The Contractor shall inform the property owners 10 days in advance prior to entering and conducting any work to the properties for the sound wall construction.

The Contractor shall schedule his operations in the removal of the property concrete masonry block wall so that the concrete masonry block wall removed will be replaced within 20 working days from the time of removal.

Not less than 20 days after the contract has been approved, the Contractor shall furnish the Engineer a statement from the vendor that the order for the seed, compost, fiber, stabilizing emulsion, and straw, required for this contract has been received and accepted by the vendor. The statement from the vendor shall include the names and quantity of seed ordered and the anticipated date of delivery.

Attention is directed to the provisions under "Erosion Control Type D" elsewhere in these special provisions, regarding the application of Erosion Control Type D and the time restrictions for seed application.

10-1.02 WATER POLLUTION CONTROL

Water pollution control work shall conform to the requirements in Section 7-1.01G, "Water Pollution," of the Standard Specifications, and these special provisions.

Water pollution control work shall conform to the requirements in the Construction Contractor's Guide and Specifications of the Caltrans Storm Water Quality Handbooks, dated April 1997, and addenda thereto issued up to and including the date of advertisement of the project, hereafter referred to as the "Handbook." Copies of the Handbook may be obtained from the Department of Transportation, Material Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520.

Copies of the Handbook are also available for review at Department of Transportation, Construction Office, Room 244, 120 South Spring Street, Los Angeles, California 90012.

The Contractor shall become fully informed of, and comply with the applicable provisions of the Handbook and Federal, State and local regulations that govern the Contractor's operations and storm water discharges from both the project site and areas of disturbance outside the project limits during construction.

Unless arrangements for disturbance of areas outside the project limits are made by the Department and made part of the contract, it is expressly agreed that the Department assumes no responsibility to the Contractor or property owner whatsoever with respect to any arrangements made between the Contractor and property owner to allow disturbance of areas outside the project limits.

The Contractor shall be responsible for the costs and for any liability imposed by law as a result of the Contractor's failure to comply with the requirements set forth in this section "Water Pollution Control" including, but not limited to, compliance with the applicable provisions of the Handbook and Federal, State and local regulations. For the purposes of this paragraph, costs and liabilities include but are not limited to fines, penalties and damages whether assessed against the State or the Contractor, including those levied under the Federal Clean Water Act and the State Porter Cologne Water Quality Act.

In addition to any remedy authorized by law, so much of the money due the Contractor under the contract that shall be considered necessary by the Department may be retained by the State of California until disposition has been made of the costs and liabilities.

The retention of money due the Contractor shall be subject to the following:

1. The Department will give the Contractor 30 days notice of its intention to retain funds from any partial payment which may become due to the Contractor prior to acceptance of the contract. Retention of funds from any payment made after acceptance of the contract may be made without prior notice to the Contractor.
2. No retention of additional amounts out of partial payments will be made if the amount to be retained does not exceed the amount being withheld from partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications.
3. If the Department has retained funds and it is subsequently determined that the State is not subject to the costs and liabilities in connection with the matter for which the retention was made, the Department shall be liable for interest on the amount retained at the legal rate of interest for the period of the retention.

Conformance with the requirements of this section "Water Pollution Control," shall not relieve the Contractor from the Contractor's responsibilities, as provided in Sections 7-1.11, "Preservation of Property," 7-1.121, "Indemnification," and 7-1.122, "Insurance," of the Standard Specifications.

WATER POLLUTION CONTROL PROGRAM PREPARATION, APPROVAL AND UPDATES

As part of the water pollution control work, a Water Pollution Control Program, hereafter referred to as the "WPCP," is required for this contract. The WPCP shall conform to the requirements in Section 7-1.01G, "Water Pollution," of the Standard Specifications, the requirements in the Handbook, and these special provisions.

No work having potential to cause water pollution, as determined by the Engineer, shall be performed until the WPCP has been approved by the Engineer.

Within 30 days after the approval of the contract, the Contractor shall submit 3 copies of the WPCP to the Engineer. The Contractor shall allow 7 days for the Engineer to review the WPCP. If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the WPCP within 7 days of receipt of the Engineer's comments and shall allow 7 days for the Engineer to review the revisions. Upon the Engineer's approval of the WPCP, 3 additional copies of the WPCP incorporating the required changes shall be submitted to the Engineer. Minor changes or clarifications to the initial submittal may be made and attached as amendments to the WPCP. In order to allow construction activities to proceed, the Engineer may conditionally approve the WPCP while minor revisions or amendments are being completed.

The objectives of the WPCP shall be to identify pollution sources that may adversely affect the quality of storm water discharges associated with the project and to identify, construct, implement and maintain water pollution control measures, hereafter referred to as control measures, to reduce to the extent feasible pollutants in storm water discharges from the construction site during construction under this contract.

The WPCP shall incorporate control measures in the following categories:

1. Soil stabilization practices;
2. Sediment control practices;
3. Sediment tracking control practices;
4. Wind erosion control practices; and
5. Nonstorm water management and waste management and disposal control practices.

Specific objectives and minimum requirements for each category of control measures are contained in the Handbook.

The Contractor shall consider the objectives and minimum requirements presented in the Handbook for each of the above categories. When minimum requirements are listed for any category, the Contractor shall incorporate into the WPCP and implement on the project, one or more of the listed minimum controls required in order to meet the pollution control objectives for the category. In addition, the Contractor shall consider other control measures presented in the Handbook and shall incorporate into the WPCP and implement on the project the control measures necessary to meet the objectives of the WPCP. The Contractor shall document the selection process in accordance with the procedure specified in the Handbook.

The following contract items of work, as shown on the project plans, shall be incorporated into the WPCP as critical temporary control measures: temporary sand bag barrier. The Contractor shall consider other control measures to supplement these critical temporary control measures when necessary to meet the pollution control objectives of the WPCP.

The WPCP shall include, but not be limited to, the following items as described in the Handbook:

1. Project description and Contractor's certification;
2. Project information;
3. Pollution sources, control measures, and water pollution control drawings; and
4. Amendments, if any.

The Contractor shall amend the WPCP, graphically and in narrative form, whenever there is a change in construction activities or operations which may affect the discharge of significant quantities of pollutants to surface waters, ground waters, municipal storm drain systems, or when deemed necessary by the Engineer. The WPCP shall also be amended if the WPCP has not achieved the objective of reducing pollutants in storm water discharges. Amendments shall show additional control measures or revised operations, including those in areas not shown in the initially approved WPCP, which are required on the project to control water pollution effectively. Amendments to the WPCP shall be submitted for review and approval by the Engineer in the same manner specified for the initially approved WPCP. Amendments shall be dated and attached to the on-site WPCP document.

The Contractor shall keep a copy of the WPCP, together with updates, revisions and amendments at the project site.

WPCP IMPLEMENTATION

Upon approval of the WPCP, the Contractor shall be responsible throughout the duration of the project for installing, constructing, inspecting and maintaining the control measures included in the WPCP and any amendments thereto and for removing and disposing of temporary control measures. Unless otherwise directed by the Engineer or specified in these special provisions, the Contractor's responsibility for WPCP implementation shall continue throughout any temporary suspension of work ordered in accordance with Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. Requirements for installation, construction, inspection, maintenance, removal and disposal of control measures are specified in the Handbook and these special provisions.

Soil stabilization practices and sediment control measures, including minimum requirements, shall be provided throughout the winter season, defined as between November 1 and March 15.

Implementation of soil stabilization practices and sediment control measures for soil-disturbed areas of the project site shall be completed, except as provided for below, no later than 20 days prior to the beginning of the winter season or upon start of applicable construction activities for projects which begin either during or within 20 days of the winter season.

Throughout the winter season, the active, soil-disturbed area of the project site shall be no more than 1.9 hectares. The Engineer may approve, on a case-by-case basis, expansions of the active, soil-disturbed area limit. The Contractor shall demonstrate the ability and preparedness to fully deploy soil stabilization practices and sediment control measures to protect soil-disturbed areas of the project site before the onset of precipitation. The Contractor shall maintain a quantity of soil stabilization and sediment control materials on site equal to 100 percent of that sufficient to protect unprotected, soil-disturbed areas on the project site and shall maintain a detailed plan for the mobilization of sufficient labor and equipment to fully deploy control measures required to protect unprotected, soil-disturbed areas on the project site prior to the onset of precipitation. The Contractor shall include a current inventory of control measure materials and the detailed mobilization plan as part of the WPCP.

Throughout the winter season, soil-disturbed areas of the project site shall be considered to be nonactive whenever soil disturbing activities are expected to be discontinued for a period of 20 or more days and the areas are fully protected. Areas that will become nonactive either during the winter season or within 20 days thereof shall be fully protected with soil stabilization practices and sediment control measures within 10 days of the discontinuance of soil disturbing activities or prior to the onset of precipitation, whichever is first to occur.

Throughout the winter season, active soil-disturbed areas of the project site shall be fully protected at the end of each day with soil stabilization practices and sediment control measures unless fair weather is predicted through the following work day. The weather forecast shall be monitored by the Contractor on a daily basis. The National Weather Service forecast shall be used, or an alternative weather forecast proposed by the Contractor may be used if approved by the Engineer. If precipitation is predicted prior to the end of the following work day, construction scheduling shall be modified, as required, and the Contractor shall deploy functioning control measures prior to the onset of the precipitation.

The Contractor shall implement, year-round and throughout the duration of the project, control measures included in the WPCP for sediment tracking, wind erosion, nonstorm water management and waste management and disposal.

The Engineer may order the suspension of construction operations which create water pollution if the Contractor fails to conform to the requirements of this section "Water Pollution Control" as determined by the Engineer.

MAINTENANCE

To ensure the proper implementation and functioning of control measures, the Contractor shall regularly inspect and maintain the construction site for the control measures identified in the WPCP. The Contractor shall identify corrective actions and time frames to address any deficient measures or reinstate any measures that have been discontinued.

The construction site inspection checklist provided in the Handbook shall be used to ensure that the necessary measures are being properly implemented, and to ensure that the control measures are functioning adequately. The Contractor shall submit one copy of each site inspection record to the Engineer.

During the winter season, inspections of the construction site shall be conducted by the Contractor to identify deficient measures, as follows:

1. Prior to a forecast storm;
2. After all precipitation which causes runoff capable of carrying sediment from the construction site;
3. At 24 hour intervals during extended precipitation events; and
4. Routinely, at a minimum of once every 2 weeks.

If the Contractor or the Engineer identifies a deficiency in the deployment or functioning of an identified control measure, the deficiency shall be corrected by the Contractor immediately, or by a later date and time if requested by the Contractor and approved by the Engineer in writing, but not later than the onset of subsequent precipitation events. The correction of deficiencies shall be at no additional cost to the State.

PAYMENT

Full compensation for conforming to the requirements of this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

Those control measures which are shown on the project plans and for which there is a contract item of work will be measured and paid for as that item of work.

The Engineer will retain an amount equal to 25 percent of the estimated value of the contract work performed during estimate periods in which the Contractor fails to conform to the requirements of this section "Water Pollution Control" as determined by the Engineer.

Retentions for failure to conform to the requirements of this section "Water Pollution Control" shall be in addition to the other retentions provided for in the contract. The amounts retained for failure of the Contractor to conform to the requirements of this section will be released for payment on the next monthly estimate for partial payment following the date that a WPCP has been implemented and maintained, and water pollution is adequately controlled, as determined by the Engineer.

10-1.03 TEMPORARY FENCES

Temporary fences shall be furnished and constructed, maintained, and later removed as shown on the plans, as specified in these special provisions, and as directed by the Engineer.

Except as otherwise specified in this section, temporary fences shall conform to the plan details and the specifications for permanent fences of similar character as provided in Section 80, "Fences," of the Standard Specifications.

Used materials may be installed providing the used materials are good, sound, and are suitable for the purpose intended, as determined by the Engineer.

Materials may be commercial quality providing the dimensions and sizes of the materials are equal to, or greater than, the dimensions and sizes shown on the plans or specified herein.

Posts shall be metal.

Galvanizing and painting of steel items will not be required.

Concrete footings for metal posts will not be required.

Temporary fences that are damaged from any cause during the progress of the work shall be repaired or replaced by the Contractor at the Contractor's expense.

When no longer required for the work as determined by the Engineer, temporary fences shall be removed. Removed facilities shall become the property of the Contractor and shall be removed from the site of the work, except as otherwise provided in this section.

Removed temporary fence materials that are not damaged may be reused in the permanent work providing such materials conform to all of the requirements specified for the permanent work and such materials are new when used for the temporary fences.

Holes caused by the removal of temporary fences shall be backfilled in accordance with the provisions in the second paragraph of Section 15-1.02, "Preservation of Property," of the Standard Specifications.

The temporary fences will be measured and paid for in the same manner specified for permanent fences of similar character as provided in Section 80, "Fences," of the Standard Specifications.

Full compensation for maintaining, removing, and disposing of temporary fences shall be considered as included in the prices paid for the various contract items for temporary fences and no additional compensation will be allowed therefor.

10-1.04 PRESERVATION OF PROPERTY

Attention is directed to the provisions in Section 7-1.11, "Preservation of Property," of the Standard Specifications and these special provisions.

Existing trees, shrubs and other plants, that are not to be removed and are injured or damaged by reason of the Contractor's operations, shall be replaced by the Contractor. The minimum size of tree replacement and the minimum size of shrub replacement shall be No.15 container. Replacement of other existing natural or native vegetation other than tree or shrubs shall be No.1 container or as specified by the Engineer. Replacement planting shall conform to the requirements in Section 20-4.07, "Replacement," of the Standard Specifications.

Damaged or injured plants shall be removed and disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications. At the option of the Contractor, removed trees and shrubs may be reduced to chips. The chipped material shall be spread within the highway right of way at locations designated by the Engineer.

Replacement planting of injured or damaged trees, shrubs and other plants shall be completed not less than 20 working days prior to acceptance of the contract. Replacement plants shall be watered as necessary to maintain the plants in a healthy condition until acceptance of the contract.

10-1.05 TEMPORARY SAND BAG BARRIER

Temporary sand bag barrier shall conform to the details shown on the plans and these special provisions.

Temporary sand bag barriers shall be furnished, installed, maintained and removed at the Marshall Creek Channel Flume as shown on the plans.

Preparation shall conform to the requirements in Section 20-3.02, "Preparation," of the Standard Specifications.

Attention is directed to "Water Pollution Control" elsewhere in these special provisions.

MATERIALS.—Materials shall conform to Section 20-2, "Materials," of the Standard Specifications and the following:

Sand bag fabric shall be woven polypropylene, polyethylene or Polyamide with a minimum unit weight of 135 g/m². The fabric shall have a mullen burst strength of at least 2067 kPa, per ASTM Designation: D3786 and an ultraviolet (UV) stability exceeding 70 percent.

Sand bags shall have a length of 600 mm to 800 mm, width of 400 mm to 450 mm, thickness of 150 mm to 200 mm, and mass of 40 kg to 55 kg.

Sand bag fill material shall be non-cohesive, coarse sand or gravel, free from deleterious material.

INSTALLATION.—Temporary sand bag barriers consist of sand bags placed in two layers and shall be installed as shown on the plans. The last 2 meters of the sand bag row shall be turned toward the soundwall.

Temporary sand bag barriers shall be maintained to provide for adequate sediment holding capacity. Sediment deposits shall be removed when the deposit reaches one-third of the temporary sand bag barrier height. Removed sediment shall be deposited within the project in such a way that it is not subject to erosion by wind or water, or as directed by the Engineer.

When no longer required for the intended purpose, as determined by the Engineer, temporary sand bag barriers shall be removed from the site of the work.

Holes, depressions or any other ground disturbance caused by the removal of the temporary sand bag barriers shall be backfilled and repaired in accordance with the provisions in the second paragraph of Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MEASUREMENT AND PAYMENT.—Temporary sand bag barrier will be measured and paid for by the unit of temporary sand bag from actual count in place.

The contract unit price paid for temporary sand bag shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in installing temporary sand bag barriers and PVC pipe complete in place, including maintenance and removal of materials, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Temporary sand bag barriers placed at locations other than as shown on the project plans or directed by the Engineer, in accordance with the Contractor's Water Pollution Control Program, will not be measured and will be paid for as specified in "Water Pollution Control" elsewhere in these special provisions.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary sand bag required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," shall not apply to temporary sand bag.

10-1.06 COOPERATION

Attention is directed to Sections 7-1.14, "Cooperation," and 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications and these special provisions.

It is anticipated that the following contracts will be underway during the duration of this project:

1. Contract No. 07-172124, Route 30, KP 5.2/8.5, Flume construction.
2. Contract No. 07-172114, Route 30, KP 8.8/11/7, Bridge construction

10-1.07 PROGRESS SCHEDULE

Progress schedules will be required for this contract and shall conform to the provisions in Section 8-1.04, "Progress Schedule," of the Standard Specifications.

10-1.08 OBSTRUCTIONS

Attention is directed to Sections 8-1.10, "Utility and Non-Highway Facilities," and 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

The Contractor's attention is directed to the existence of certain underground facilities that may require special precautions be taken by the Contractor to protect the health, safety and welfare of workers and of the public. Facilities requiring special precautions include, but are not limited to: conductors of petroleum products, oxygen, chlorine, and toxic or flammable gases; natural gas in pipelines greater than 150 mm in diameter or pipelines operating at pressures greater than 415 kPa (gage); underground electric supply system conductors or cables, with potential to ground of more than 300 V, either directly buried or in duct or conduit which do not have concentric grounded or other effectively grounded metal shields or sheaths.

The Contractor shall notify the Engineer and the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to performing any excavation or other work close to any underground pipeline, conduit, duct, wire or other structure. Regional notification centers include but are not limited to the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444
	1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133
	1-800-227-2600

10-1.09 MOBILIZATION

Mobilization shall conform to the provisions in Section 11, "Mobilization," of the Standard Specifications.

10-1.10 CONSTRUCTION AREA SIGNS

Construction area signs shall be furnished, installed, maintained, and removed when no longer required in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to "Barricades", elsewhere in these special provisions regarding construction area signs mounted on type III barricades .

The Contractor shall notify the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to commencing excavation for construction area sign posts. The regional notification centers include but are not limited to the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444
	1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133
	1-800-227-2600

Excavations required to install construction area signs shall be performed by hand methods without the use of power equipment, except that power equipment may be used if it is determined there are no utility facilities in the area of the proposed post holes.

The second sentence of the third paragraph in Section 12-3.02, "Barricades," of the Standard Specifications is amended to read:

The entire area of orange and white stripes shall be Type I, engineering grade, or Type II, super engineering grade, retroreflective sheeting conforming to the requirements of ASTM Designation: D 4956-95.

The third paragraph in Section 12-3.06A, "Stationary Mounted Signs," of the Standard Specifications is amended to read:

Sign panels for stationary mounted signs shall consist of Type III or Type IV reflective sheeting applied to an aluminum substrate conforming to the requirements in the Department's "Specifications for Reflective Sheeting Aluminum Signs." The type of reflective sheeting, Type III or Type IV, shall be at the Contractor's option and sign substrates fabricated from materials other than aluminum may be used when specified in the special provisions.

Legend and border may be applied by a screening process or by use of pressure sensitive cut-out sheeting. Size and spacing of letters and symbols shall be as depicted on the sign specification sheets published by the Department.

Rectangular signs over 1375 mm measured along the horizontal axis, and diamond-shaped signs 1500 mm and larger shall be framed unless otherwise specified. Frames shall be constructed in conformance with the requirements of the Department's "Framing Details for Sheet Aluminum Signs," Sheets 1 through 4 and Table 1 on Sheet 5.

Copies of the Department's "Specifications for Reflective Sheeting Aluminum Signs," "Framing Details for Sheet Aluminum Signs," and sign specification sheets may be obtained from the Department's Office of Business Management, Materiel Operations Branch, 1900 Royal Oaks Drive, Sacramento, CA 95815.

The second paragraph in Section 12-3.06B, "Portable Signs," of the Standard Specifications is amended to read:

Sign panels for portable signs shall conform to the provisions of sign panels for stationary mounted signs in Section 12-3.06A, "Stationary Mounted Signs," or shall be Type VI reflective sheeting as specified in the special provisions, or shall be cotton drill fabric, flexible industrial nylon fabric, or other approved fabric. Fabric signs shall not be used during the hours of darkness. Size, color, and legend requirements for portable signs shall be as described for stationary mounted sign panels in Section 12-3.06A. The height to the bottom of the sign panel above the edge of traveled way shall be at least 0.3-m.

The third paragraph in Section 12-3.06B, "Portable Signs," of the Standard Specifications is deleted.

Sign substrates for stationary mounted construction area signs may be fabricated from fiberglass reinforced plastic as specified under "Approved Traffic Products" of these special provisions.

Type VI reflective sheeting for sign panels for portable construction area signs shall conform to the provisions in "Approved Traffic Products" of these special provisions.

10-1.11 MAINTAINING TRAFFIC

Attention is directed to Sections 7-1.08, "Public Convenience," 7-1.09, "Public Safety," and 12, "Construction Area Traffic Control Devices," of the Standard Specifications and to the Section entitled "Public Safety" elsewhere in these special provisions, and these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7-1.09.

No work that would require a lane closure shall be performed.

Personal vehicles of the Contractor's employees shall not be parked on the traveled way of local streets, including any section closed to public traffic.

The Contractor shall notify local authorities of the Contractor's intent to begin work at least 5 days before work is begun. The Contractor shall cooperate with local authorities relative to handling traffic through the area and shall make all arrangements relative to keeping the working area clear of parked vehicles.

Whenever vehicles or equipment are parked on the shoulder within 1.8 m of a traffic lane, the shoulder area shall be closed with fluorescent traffic cones or portable delineators placed on a taper in advance of the parked vehicles or equipment and along the edge of the pavement at 7.5 m

No work that interferes with public traffic shall be performed between 7:00 a.m. and 7:00 p.m., Monday through Friday, except work required under said Sections 7-1.08 and 7-1.09.

Minor deviations from the requirements of this section concerning hours of work which do not significantly change the cost of the work may be permitted upon the written request of the Contractor if, in the opinion of the Engineer, public traffic will be better served and the work expedited. These deviations shall not be adopted by the Contractor until the Engineer has approved them in writing. All other modifications will be made by contract change order.

10-1.12 BARRICADES

Barricades shall be furnished, placed, and maintained at locations shown on the plans, specified in the Standard Specifications or in these special provisions or designated by the Engineer. Barricades shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Type II reflective sheeting for stripes on barricade rail faces shall conform to the provisions in "Approved Traffic Products" of these special provisions.

Construction area sign and marker panels conforming to the provisions in Section 12-3.06, "Construction Area Signs," of the Standard Specifications shall be installed on barricades as directed by the Engineer at the locations shown on the plans.

Sign panels for construction area signs and marker panels installed on barricades shall conform to the provisions in Section 12-3.06A, "Stationary Mounted Signs," of the Standard Specifications.

Full compensation for furnishing, installing, maintaining, and removing construction area signs on barricades shall be considered as included in the contract lump sum price paid for construction area signs and no separate payment will be made therefor.

Barricades shown on the plans as part of a traffic control system will be paid for as provided in "Traffic Control System for Lane Closure," of these special provisions, and will not be included in counts for payment for barricades.

10-1.13 TEMPORARY CRASH CUSHION MODULE

This work shall consist of furnishing, installing and maintaining sand filled temporary crash cushion modules in groupings or arrays at each location shown on the plans, specified in the special provisions or directed by the Engineer. The grouping or array of sand filled modules shall form a complete sand filled temporary crash cushion in accordance with the details shown on the plans and these special provisions.

Attention is directed to "Public Safety" of these special provisions.

GENERAL

Whenever the work or the Contractor's operations establishes a fixed obstacle, the exposed fixed obstacle shall be protected with a sand filled temporary crash cushion. The sand filled temporary crash cushion shall be in place prior to opening the lanes adjacent to the fixed obstacle to public traffic.

Sand filled temporary crash cushions shall be maintained in place at each location, including times when work is not actively in progress. Sand filled temporary crash cushions may be removed during a work period for access to the work provided that the exposed fixed obstacle is 4.6 m or more from a lane carrying public traffic and the temporary crash cushion is reset to protect the obstacle prior to the end of the work period in which the fixed obstacle was exposed. When no longer required, as determined by the Engineer, sand filled temporary crash cushions shall be removed from the site of the work.

MATERIALS

At the Contractor's option, the modules for use in sand filled temporary crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules manufactured after March 31, 1997, or equal:

Energite III Inertial Modules manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone 1-312-467-6750, FAX 1-800-770-6755.

Distributor (Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX 1-916-387-9734

Distributor (Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274, FAX 1-714-937-1070.

Fitch Inertial Modules, national distributor; Roadway Safety Service, Inc., 1050 North Rand Road, Wauconda, IL 60084, Telephone 1-800-426-0839, FAX 1-847-487-9820.

Distributor: Singletree Sales Company, 1533 Berger Drive, San Jose, CA 95112, Telephone 1-800-822-7735, FAX 1-408-287-1929.

Modules contained in each temporary crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color as furnished by the vendor, with black lids. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects. The modules need not be new. Good used undamaged modules conforming to color and quality of the types specified above may be utilized. If used Fitch modules requiring a seal are furnished, the top edge of the seal shall be securely fastened to the wall of the module by a continuous strip of heavy duty tape.

Modules shall be filled with sand in accordance with the manufacturer's directions, and to the sand capacity in kilograms for each module as shown on the plans. Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water, as determined by California Test 226.

Modules damaged due to the Contractor's operations shall be repaired immediately by the Contractor at the Contractor's expense. Modules damaged beyond repair, as determined by the Engineer, due to the Contractor's operations shall be removed and replaced by the Contractor at the Contractor's expense.

INSTALLATION

Temporary crash cushion modules shall be placed on movable pallets or frames conforming to the dimensions shown on the plans. The pallets or frames shall provide a full bearing base beneath the modules. The modules and supporting pallets or frames shall not be moved by sliding or skidding along the pavement or bridge deck.

A Type R or P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods approved by the Engineer.

At the completion of the project, temporary crash cushion modules, sand filling, pallets or frames, and marker panels shall become the property of the Contractor and shall be removed from the site of the work. Temporary crash cushion modules shall not be installed in permanent work.

MEASUREMENT AND PAYMENT

Temporary crash cushion modules placed in accordance with the provisions in "Public Safety" elsewhere in these special provisions will not be measured nor paid for.

10-1.14 EXISTING HIGHWAY FACILITIES

The work performed in connection with various existing highway facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

10-1.14A REMOVE WOOD FENCE

Existing wood fence shall be removed and disposed of as shown on the plans.

Attention is directed to "Remove Concrete", elsewhere in these special provisions regarding the removal of the concrete footings for wood fence.

Full compensation for backfilling and compacting holes resulting from the removal of the concrete footings, shall be considered as included in the contract price paid per meter for remove wood fence and no additional compensation will be allowed therefor.

10-1.14B REMOVE CHAIN LINK FENCE

Existing chain link fence shall be removed as shown on the plans.

The existing chain link gate and iron gate, where shown on the plans to be removed shall be removed and disposed of. Full compensation for removing and disposing the chain link gate and iron gate, shall be considered as included in the contract price paid per meter for remove chain link fence and no separate payment will be made therefor.

Fence removed in excess of that required for removing chain link fence shall be disposed of. The removed excess fence shall then be replaced immediately when directed by the Engineer at the Contractor's expense. Full compensation for removing and disposing of excess fence shall be considered as included in the contract price paid per meter for remove chain link fence and no separate payment will be made therefor.

10-1.14C REMOVE CONCRETE

Concrete, which include concrete masonry block wall and concrete footings, concrete masonry retaining wall and concrete footings, portland cement concrete pavement and concrete footings for wood fence, designated on the plans to be removed, shall be removed.

The Contractor shall schedule his work operations so that the existing concrete masonry block wall to be removed will remain in place until the time is ready to start the construction of the new wall.

The pay quantities of concrete to be removed will be measured by the cubic meter, measured before and during removal operations.

Concrete removed shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications.

Concrete within construction limits, both inside and outside the highway right of way, shall be removed, except for curbs and sidewalks adjacent to frontage roads and through city streets.

Where no joint exists between concrete to be removed and concrete to remain in place, the concrete shall be cut in a neat line to a minimum depth of 50 mm with a power driven saw before concrete is removed.

Where concrete has been removed outside the roadway prism, the backfilled areas shall be graded to drain and blend in with the surrounding terrain.

Concrete to be removed which has portions of the same structure both above and below ground will be considered as concrete above ground for compensation.

10-1.14D REMOVE SOUND WALL (PLYWOOD SHEET)

Existing sound wall (plywood sheet), including concrete footings, where shown on the plans, shall be removed and disposed of.

Attention is directed to "Order of Work", elsewhere in these special provisions, regarding the removal of the existing sound wall (plywood sheet).

Full compensation for backfilling and compacting holes, resulting from the removal of concrete footings, shall be considered as included in the contract price paid per meter for remove sound wall (plywood sheet) and no additional compensation will be allowed therefor.

10-1.15 CLEARING AND GRUBBING

Clearing and grubbing shall conform to the provisions in Section 16, "Clearing and Grubbing," of the Standard Specifications and these special provisions.

Vegetation shall be cleared and grubbed only within the areas of soundwall construction.

At locations where there is no grading adjacent to a bridge or other structure, clearing and grubbing of vegetation shall be limited to 1.5 meters outside the physical limits of the bridge or structure.

Existing vegetation outside the areas to be cleared and grubbed, shall be protected from injury or damage resulting from the Contractor's operations.

Activities controlled by the Contractor, except cleanup or other required work, shall be confined within the graded areas of the roadway.

Nothing herein shall be construed as relieving the Contractor of the Contractor's responsibility for final cleanup of the highway as provided in Section 4-1.02, "Final Cleaning Up," of the Standard Specifications.

10-1.16 EARTHWORK

Earthwork shall conform to the provisions in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

The finished grade shall be left in a rough grade a minimum of 0.20 m in depth. The rough grade shall then be tracked walked parallel to the toe of slope, right of way fence, or soundwalls. The use of cutting edges, such as motorgrader blades, shall not be used for the final cutting of the slopes.

Where a portion of existing surfacing is to be removed, the outline of the area to be removed shall be cut on a neat line with a power-driven saw to a minimum depth of 50 mm before removing the surfacing. Full compensation for cutting existing surfacing shall be considered as included in the contract price paid per cubic meter for roadway excavation and no additional compensation will be allowed therefor.

MEASUREMENT AND PAYMENT (EARTHWORK)

Measurement and payment for earthwork shall conform to all provisions for "Measurement" and "Payment" in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

Pervious backfill material within the limits of payment for retaining walls will be measured and paid for as structure backfill (retaining wall).

10-1.17 EROSION CONTROL (TYPE D)

Erosion control (Type D) shall conform to the provisions in Section 20-3, "Erosion Control," of the Standard Specifications and these special provisions.

Erosion control (Type D) work shall consist of applying erosion control materials to all re-graded areas on either side of the soundwalls, and other areas designated by the Engineer. Erosion control (Type D) shall be applied during the period starting July 1 and ending December 31; or, if the slope on which the erosion control is to be placed is finished during the winter season as specified in "Water Pollution Control" elsewhere in these special provisions the erosion control shall be applied immediately; or, if the slope on which the erosion control is to be placed is finished outside both specified periods and the contract work will be completed before July 1, the erosion control shall be applied as a last item of work..

Prior to installing erosion control materials, soil surface preparation shall conform to the provisions in Section 19-2.05, "Slopes," of the Standard Specifications, except that rills and gullies exceeding 50 mm in depth or width shall be leveled. Vegetative growth, temporary erosion control materials and other debris shall be removed from areas to receive erosion control.

MATERIALS.—Materials shall conform to Section 20-2, "Materials," of the Standard Specifications and the following:

SEED.—Seed shall conform to the provisions in Section 20-2.10, "Seed," of the Standard Specifications. Individual seed species shall be measured and mixed in the presence of the Engineer.

Seed not required to be labeled under the California Food and Agricultural Code shall be tested for purity and germination by a seed laboratory certified by the Association of Official Seed Analysts, or a seed technologist certified by the Society of Commercial Seed Technologists.

Seed shall have been tested for purity and germination not more than one year prior to application of seed.

Results from testing seed for purity and germination shall be furnished to the Engineer prior to applying seed.

LEGUME SEED.—Legume seed shall be pellet-inoculated or industrial-inoculated.

Pellet-inoculated seed shall be inoculated in accordance with the provisions in Section 20-2.10, "Seed," of the Standard Specifications.

Inoculated seed shall have a calcium carbonate coating.

Pellet-inoculated seed shall be sown within 90 days after inoculation.

Industrial-inoculated seed shall be inoculated with Rhizobia and coated using an industrial process by a manufacturer whose principal business is seed coating and seed inoculation.

Industrial-inoculated seed shall be sown within 180 calendar days after inoculation.

Legume seed shall consist of the following:

LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Lotus Purshianus (Purshings Lotus)	30	1.0
Lotus Scoparius (Deerweed)	30	1.5
Lupinus Bicolor (Pygmy Leafed Lupine)	40	3.5
Lupinus Densiflorus ("Ed Gedling" (Ed Gedling Lupine)	40	4.5

NON-LEGUME SEED.—Non-legume seed shall consist of the following:

NON-LEGUME SEED		
Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms pure live seed per hectare (Slope measurement)
Eriophyllum Confertiflorum (Golden Yarrow)	30	1.0
Eriogonum Fasciculatum (California Buckwheat)	30	2.0
Eschscholzia Californica (California Poppy)	40	3.5
Hemizonia Ramossissima (Slender Tarweed)	20	0.3
Lasthenia Glabrata (Goldenfields)	40	0.6
Nassella Pulchra (Purple Needlegrass)	30	10.0
Penstemon Spectabilis (Showy Penstemon)	30	1.0
Phacelia Campanularia (California Blue Bells)	40	1.0
Salvia Millifera (Black Sage)	30	1.7
Vulpia Microstachys (Small Fescue)	40	5.5

Seed shall be delivered to the job site in unopened separate containers with the seed tag attached. Containers without a seed tag will not be accepted.

A sample of approximately 30 g of seed will be taken from each seed container by the Engineer.

STRAW.—Straw shall be derived from rice.

COMPOST.--Compost shall be derived from green material consisting of chipped, shredded or ground vegetation or clean processed recycled wood products or a Class A, exceptional quality biosolids composts, as required by the United States Environmental Protection Agency (EPA), 40 CFR, Part 503c regulations or a combination of green material and biosolids compost. The compost shall be processed or completed to reduce weed seeds, pathogens and deleterious material, and shall not contain paint, petroleum products, herbicides, fungicides or other chemical residues that would be harmful to plant or animal life. Other deleterious material, plastic, glass, metal or rocks shall not exceed 0.1 percent by weight or volume. A minimum internal temperature of 57°C shall be maintained for at least 15 continuous days during the composting process. The compost shall be thoroughly turned a minimum of 5 times during the composting process and shall go through a minimum 90-day curing period after the 15-day thermophilic compost process has been completed. Compost shall be screened through a maximum 6 mm screen. The moisture content of the compost shall not exceed 35 percent. Moisture content shall be determined by California Test 226. Compost products with a higher moisture content may be used provided the weight of the compost is increased to equal the compost with a moisture content of 35 percent. Compost will be tested for maturity and stability with a solvita test kit. The compost shall measure a minimum of 6 on the maturity and stability scale.

STABILIZING EMULSION .—Stabilizing emulsion shall conform to the provisions in Section 20-2.11, "Stabilizing Emulsion," of the Standard Specifications and these special provisions.

The requirement of an effective life of at least one year for stabilizing emulsion shall not apply.

Stabilizing emulsion shall be in a dry powder form, may be reemulsifiable, and shall be a processed organic adhesive used as a soil binder.

APPLICATION.—Erosion control materials shall be applied in 3 separate applications in the following sequence:

The following mixture in the proportions indicated shall be applied with hydro-seeding equipment within 60 minutes after the seed has been added to the mixture:

Material	Kilograms per hectare (Slope measurement)
Fiber	350
Legume Seed	10.5
Non-Legume Seed	26.6
Compost	1500

Straw shall be applied at the rate of 3.5 tonnes per hectare based on slope measurements. Incorporation of straw will not be required.

The following mixture in the proportions indicated shall be applied with hydro-seeding equipment:

Material	Kilograms per hectare (Slope measurement)
Fiber	510
Compost	2040
Stabilizing emulsion (solids)	250

The ratio of total water to total stabilizing emulsion in the mixture shall be as recommended by the manufacturer.

The proportions of erosion control materials may be changed by the Engineer to meet field conditions.

MEASUREMENT AND PAYMENT.—The quantity of pure live seed (erosion control) to be paid for by the kilogram will be determined by multiplying the percentage of purity by the percentage of germination by the marked mass on the sack.

Pure live seed (erosion control) will be paid for by the kilogram in the same manner specified for seed in Section 20-3.07 of the Standard Specifications.

The contract price paid per kilogram for compost (erosion control) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in applying compost for erosion control, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.18 PILING

Piling shall conform to the provisions in Section 49, "Piling," of the Standard Specifications, and these special provisions.

Foundation recommendations are included in the "Information Handout" available to the Contractor as provided for in Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," of the Standard Specifications.

Attention is directed to "Public Safety" of these special provisions. Before performing any pile handling or pile installation operations at a location that is closer than the length of the pile being handled or installed to the edge of areas open to public traffic or public use, the Contractor shall submit to the Engineer in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, a detailed plan describing measures that will be employed to provide for the safety of traffic and the public.

The second paragraph in Section 49-1.03, "Determination of Length," of the Standard Specifications is amended to read:

At the Contractor's option, the Contractor may conduct additional foundation investigation, including installing and axial load testing additional non-production indicator piling. The Engineer shall approve locations of additional foundation testing. The Contractor shall notify the Engineer at least 5 working days prior to beginning additional foundation investigation.

Additional foundation investigation shall be completed prior to requesting revised specified pile tip elevations or modification to the installation methods specified herein. Revisions to specified tip elevations and modifications to the specified installation methods will be subject to the provisions of Section 5-1.14, "Cost Reduction Incentive."

Modification to the specified installation methods and specified pile tip elevation will not be considered at locations where lateral load demands control design pile tip elevations or when the plans state that specified pile tip elevation shall not be revised.

The pile structural capacity design is based on the nominal strength as defined in Caltrans Bridge Design Specifications (Article 8.1.3) or the nominal resistance as defined in the LRFD Bridge Design Specifications (Article 1.3.2.1). The nominal resistance of the pile, as shown on the plans, is the design capacity required to resist the factored axial load demands.

Indicator compression pile load testing shall conform to the requirements of ASTM Designation: D 1143. The acceptance criteria for compression pile load testing shall be as follows:

The pile shall sustain the first compression test load applied which is equal to the nominal compression resistance, as shown on the plans, with no more than 13 mm total vertical movement at the top of the pile measured relative to the top of the pile prior to the start of compression load testing.

Indicator tension pile load testing shall conform to the requirements of ASTM Designation: D 3689. The loading apparatus described as "Load Applied to Pile by Hydraulic Jack(s) Acting at One End of Test Beam(s) Anchored to the Pile" shall not be used. The acceptance criteria for tension pile load testing shall be as follows:

The pile shall sustain the first tension test load applied which is equal to the nominal tension resistance, as shown on the plans, with no more than 13 mm total vertical movement at the top of the pile measured relative to the top of the pile prior to the start of tension load testing.

Indicator piling shall be removed in conformance with the requirements in Section 15-4.02, "Removal Methods," and the remaining holes shall be backfilled with earth or other suitable material approved by the Engineer.

For driven piling, the Contractor shall furnish piling of sufficient length to obtain both the specified tip elevation and design load shown on the plans or specified in the special provisions. For cast-in-drilled-hole concrete piling, the Contractor shall construct piling of such length to develop the compression nominal resistance and to obtain the specified tip elevation shown on the plans or specified in the special provisions.

The fifth paragraph in Section 49-1.04, "Load Test Piles," of the Standard Specifications is amended to read:

Load test anchorages in piles used as anchor piles shall conform to the following requirements:

High strength threaded steel rods shall conform to the provisions for bars in Section 50-1.05, "Prestressing Steel," except Type II bars shall be used.

High strength steel plates shall conform to the requirements in ASTM Designation: A 709, Grade 50.

Anchor nuts shall conform to the provisions in the second paragraph in Section 50-1.06, "Anchorages and Distribution."

The eighth, ninth and tenth paragraphs in Section 49-1.04, "Load Test Piles," of the Standard Specifications are amended to read:

Should the Engineer fail to complete the load tests within the time specified in the special provisions and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in load testing of piles, the delay will be considered a right of way delay as specified in Section 8-1.09, "Right of Way Delays."

The Contractor shall furnish labor, materials, tools, equipment, and incidentals as required to assist the Engineer in the installation, operation and removal of State-furnished steel load test beams, State-furnished jacks, bearing plates, drills, and other test equipment. This work will be paid for as extra work as provided in Section 4-1.03D.

The first and second paragraphs in Section 49-1.05, "Driving Equipment," of the Standard Specifications are amended to read:

49-1.05 Driving Equipment.—Driven piles shall be installed with impact hammers that are approved in writing by the Engineer. Impact hammers shall be steam, hydraulic, air, or diesel hammers. Impact hammers shall develop sufficient energy to drive the piles at a penetration rate of not less than 3 mm per blow at the specified bearing value.

Vibratory hammers shall not be used for installation of piles, unless otherwise shown on the plans or specified in the special provisions.

Hammers with an external combustion engine that are not single action, shall have a transducer that records ram velocity.

Double acting diesel hammers with internal combustion engines shall have a transducer that records bounce chamber pressure.

For hammers with no visual way of observing the ram stroke, a printed readout showing hammer energy during driving operation shall be provided to the Engineer by the Contractor.

Difficult pile installation is anticipated due to the presence of loose to medium dense subsurface sand and silty sand materials. The installation of a temporary casings may be required.

The third paragraph in Section 49-4.04, "Steel Shells," of the Standard Specifications is amended to read:

Steel shells shall conform to the provisions for steel pipe piles specified in Section 49-5, "Steel Piles."

Section 49-5.01, "Description," of the Standard Specifications is amended to read:

49-5.01 Description.—Steel piles shall include structural shape piles and pipe piles. Structural shape steel piles shall be of the rolled section shown on the plans or of the section specified in the special provisions and shall be structural steel conforming to the specifications of ASTM Designation: A 36/A 36M, or at the option of the Contractor, structural steel conforming to the specifications of ASTM Designation: A 572/A 572M.

Steel pipe piling shall conform to the following requirements:

1. Piles shall be of the nominal diameter and the nominal wall thickness as the pipe piles shown on the plans unless otherwise specified in the special provisions.
2. The carbon equivalency (CE) as defined in AWS D 1.1, Section XI5.1, shall not exceed 0.45.
3. The sulfur content shall not exceed 0.05 percent.
4. Piles shall conform to any additional requirements in the special provisions, including but not limited to, tolerances for diameter, edge alignment, end match marking, roundness, and straightness, that are required in order to conform with steel pile splice welding and welding inspection provisions.
5. Steel pipe pile seams shall be complete penetration welds and shall conform to the requirements of AWS D1.1 and any additional amendments to AWS D1.1 listed herein and in the special provisions. Incomplete penetration welds and defective welds of steel pipe piles shall be repaired or restored to achieve complete joint penetration groove welds.
6. Steel pipe piles that are less than 360 mm in diameter shall conform to the specifications of ASTM Designation: A 252, Grade 2 or 3, and steel pipe piles that are 360 mm and greater in diameter shall conform to the specifications of ASTM Designation: A 252, Grade 3, as amended by the above requirements.

Steel piles shall not be joined by welded lap splicing.

The manufacturer or fabricator of steel piling shall furnish a Certificate of Compliance stating that the piling being supplied conforms to these specifications and to the special provisions. The Certificate of Compliance shall include test reports for tensile, chemical, and any specified nondestructive tests. Samples for testing shall be taken from the base metal, steel, coil or from the manufactured or fabricated piling.

Section 49-5.02, "Splicing," of the Standard Specifications is amended to read:

49-5.02 Splicing.—Steel pile splices shall conform to the requirements of AWS D 1.1 and the special provisions. Structural shape steel piling splices shall be complete joint penetration groove welds. Steel pipe pile splices that are made at a permanent manufacture or fabrication facility, and that are made prior to furnishing the Certificate of Compliance shall be complete penetration welds. Steel pipe pile splices that are made in the field shall be complete joint penetration groove welds.

Ends of steel pipe piling to be spliced that have been damaged during driving shall be removed to a sound and uniform section conforming to the tolerances for diameter, edge alignment and roundness required to meet the steel pipe splice welding requirements. Pipe ends shall be field cut using automated guided cutting equipment. Manual flame cutting shall not be used.

CAST-IN-DRILLED-HOLE CONCRETE PILES

Cast-in-drilled-hole concrete piling shall conform to the provisions in Section 49-4, "Cast-In-Place Concrete Piles," of the Standard Specifications and these special provisions.

The sixth sentence of the sixth paragraph of Section 49-4.03, "Drilled Holes," of the Standard Specifications is amended to read:

Casing may be vibrated or hammered when required to assist in removal of the casing from the hole, to prevent lifting of the reinforcement, and to prevent concrete contamination.

Materials

At the Contractor's option, the Contractor may use either the 12.5-mm maximum combined aggregate grading or the 9.5-mm maximum combined aggregate grading. The grading requirements for the 12.5-mm maximum coarse aggregate and the 9.5-mm maximum coarse aggregate are shown in the following table:

Sieve Sizes	Percentage Passing Primary Aggregate Nominal Size			
	12.5 mm x 4.75 mm		9.5 mm x 2.36 mm	
	Operating Range	Contract Compliance	Operating Range	Contract Compliance
19 mm	100	100		
12.5 mm	82 - 100	80 - 100	100	
9.5 mm	X ± 15	X ± 22	X ± 15	X ± 20
4.75 mm	0 - 15	0 - 18	0 - 25	0 - 28
2.36 mm	0 - 6	0 - 7	0 - 6	0 - 7

In the table above, the symbol X is the gradation which the Contractor proposes to furnish for the 9.5-mm sieve size.

The gradation proposed by the Contractor for the 12.5-mm x 4.75-mm primary aggregate or for the 9.5-mm x 2.36-mm primary aggregate shall be within the following percentage passing limits:

Primary Aggregate Nominal Size	Sieve Sizes	Limits of Proposed Gradation
12.5 mm x 4.75 mm	9.5 mm	40 - 78
9.5 mm x 2.36 mm	9.5 mm	50 - 85

The combined aggregate grading for the 12.5-mm x 4.75-mm primary aggregate nominal size or for the 9.5-mm x 2.36-mm primary aggregate nominal size shall be within the following limits:

Grading Limits of Combined Aggregate		
Sieve Sizes	Percentage Passing	
	12.5-mm Max.	9.5-mm Max.
19 mm	100	100
12.5 mm	90 - 100	90 - 100
9.5 mm	55 - 86	50 - 100
4.75 mm	45 - 63	45 - 63
2.36 mm	35 - 49	35 - 49
1.18 mm	25 - 37	25 - 37
600 µm	15 - 25	15 - 25
300 µm	5 - 15	5 - 15
150 µm	1 - 8	1 - 8
75 µm	0 - 4	0 - 4

Construction

The Contractor shall submit a placing plan to the Engineer for approval prior to producing the test batch for cast-in-drilled-hole concrete piling and at least 10 working days prior to constructing piling. The plan shall include complete description, details, and supporting calculations as listed below:

Requirements for all cast-in-drilled hole concrete piling:

1. Concrete mix design, certified test data, and trial batch reports.
2. Drilling methods and equipment.
3. Proposed method for casing installation and removal when necessary.
4. Plan view drawing of pile showing reinforcement and inspection pipes, if required.
5. Methods for placing, positioning and supporting bar reinforcement.
6. Methods and equipment for accurately determining the depth of concrete and actual and theoretical volume placed, including effects on volume of concrete when any casings are withdrawn.

MEASUREMENT AND PAYMENT (PILING)

Measurement and payment for the various types and classes of piles shall conform to the provisions in Sections 49-6.01, "Measurement," and 49-6.02, "Payment," of the Standard Specifications and these special provisions.

Full compensation for furnishing and placing additional testing reinforcement, load test anchorages, and for cutting off test piles as specified shall be considered as included in the contract price paid for piling of the type or class shown in the Engineer's Estimate, and no additional compensation will be allowed.

No additional compensation or extension of time will be made for additional foundation investigation, installation and testing of indicator piling, cutting off piling and restoring the foundation investigation and indicator pile sites, and review of request by the Engineer.

Full compensation for drilling oversized cast-in-drilled-hole concrete piling, filling cave-ins and oversized piles with concrete, and re-drilling through concrete shall be considered as included in the contract prices paid per meter for cast-in-drilled-hole concrete piling of the sizes listed in the Engineer's Estimate and no additional compensation will be allowed therefor.

10-1.19 CONCRETE STRUCTURES

Portland cement concrete structures shall conform to the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Shotcrete shall not be used as an alternative construction method for reinforced concrete members unless otherwise specified.

The first sentence of the tenth paragraph in Section 51-1.05, "Forms," of the Standard Specifications is amended to read:

Form panels for exposed surfaces shall be plywood conforming to or exceeding the requirements of U.S. Product Standard PS 1 for Exterior B-B (Concrete Form) Class I Plywood or any material which will produce a smooth uniform concrete surface substantially equal to that which would result from the use of that plywood.

The third paragraph in Section 51-1.15, "Drains in Walls," of the Standard Specifications is amended to read:

In addition to the drain holes and weep holes specified in the preceding paragraph, holes approximately 75 mm in diameter for relief of hydrostatic pressure shall be provided at the bottom of walls, immediately above the footing, at approximately 4500-mm centers.

10-1.20 SOUND WALL

DESCRIPTION.--This work shall consist of constructing sound walls of masonry block. Sound walls shall be supported on retaining walls and pile caps as shown on the plans.

Types of sound wall shall not be mixed in any one installation.

The Contractor shall submit 2 sets of elevation and plan layout drawings to the Engineer, as provided in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The drawings shall be to scale and shall show the proposed top and bottom elevation lines. The top and bottom elevation lines shown on the plans are minimum and they shall be fully contained in the proposed layout drawings. The drawings shall include, within the limits shown on the plans, the panel sizes, pile spacing, post spacing, footing steps, aesthetic features, locations of expansion joints and access gates. The Contractor shall allow two weeks after complete drawings are submitted for review.

SOUND WALL (MASONRY BLOCK)

Sound wall (masonry block), consisting of a reinforced hollow unit masonry block stem, shall conform to the provisions in Sections 19, "Earthwork," 52, "Reinforcement," and 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

Sound wall masonry unit stems shall be constructed with joints of portland cement mortar. Wall stems shall be constructed with hand laid block. Wall stems shall not be constructed with preassembled panels.

Concrete for sound wall footings, pile caps and grade beams, if required, shall conform to the provisions in Section 90-10, "Minor Concrete," of the Standard Specifications.

Reinforcing bars shall conform to the requirements in ASTM Designation: A 706/A 706M.

Concrete masonry units shall be hollow, load bearing, conforming to the requirements in ASTM Designation: C 90, medium weight classification, Type II. Standard or open end units may be used. Open end units, if used, shall not reduce the spacing of the bar reinforcement as shown on the plans.

The masonry units shall be nominal size and texture and of uniform color. The color shall be Angelus #207, selected from the manufacturer's standards.

When high strength concrete masonry units with $f'_m=17.2$ MPa are shown on the plans, the high strength masonry units shall have a minimum compressive strength of 26 MPa based on net area. Each high strength concrete masonry unit shall be identified with a groove embedded in an interior corner. The groove shall extend from a mortar surface for a length of about 50 mm and shall have a depth of about 5 mm.

Expansion joint filler shall conform to the requirements in ASTM Designation: D 1751 or ASTM Designation: D 2000 2AA-805.

Portland cement mortar shall be colored to match the units. Coloring shall be chemically inert, fade resistant mineral oxide or synthetic type.

Portland cement for wall stems shall conform to the provisions in Section 90-2.01, "Portland Cement," of the Standard Specifications.

Hydrated lime shall conform to the requirements in ASTM Designation: C 207, Type S.

Mortar sand shall be commercial quality.

Mortar for laying masonry units shall consist, by volume, of one part portland cement, 0 to 0.5 parts of hydrated lime, and 2.25 to 3 parts of mortar sand. Sufficient water shall be added to make a workable mortar. Each batch of mortar shall be accurately measured and thoroughly mixed. Mortar shall be freshly mixed as required. Mortar shall not be retempered more than one hour after mixing.

Prepackaged mortar materials and mortar containing admixtures may be used when approved in writing by the Engineer, provided the mortar shall not contain more than 0.05 percent soluble chlorides in conformance with California Test 422 or 0.25 percent soluble sulfates, as SO_4 , in conformance with California Test 417.

Prior to laying masonry units using prepackaged mortar materials or mortar containing admixtures, the Contractor shall submit to the Engineer the proposed sources of the materials together with test data from an independent testing laboratory for mortar tested in conformance with California Test 551. The test data shall be from specimens having a moist cure, except, the sample shall not be immersed in lime water. The average 28-day compressive strength of the mortar shall be not less than 17.2 MPa.

Aggregate for grout used to fill masonry units shall consist of fine aggregate and coarse aggregate conforming to the provisions in Section 90-2.02, "Aggregates," of the Standard Specifications. At least 20 percent of the aggregate shall be coarse aggregate. The Contractor shall determine the grading except that 100 percent of the combined grading shall pass the 12.5-mm sieve.

At the option of the Contractor, grout for filling masonry units may be proportioned either by volume or mass. Grout shall contain only enough water to cause it to flow and fill the voids without segregation. The maximum amount of free water shall not exceed 0.7 times the weight of the cement for regular strength masonry. The maximum amount of free water shall not exceed 0.6 times the mass of the cement for high strength masonry.

Grout proportioned by volume for regular strength masonry shall consist of at least one part portland cement and 4.5 parts aggregate. Grout proportioned by volume for high strength masonry shall consist of at least one part portland cement and 3.5 parts aggregate. Aggregate volumes shall be based on a loose, air-dry condition.

Grout proportioned by mass for regular strength masonry shall contain at least 325 kilograms of portland cement per cubic meter. Grout proportioned by mass for high strength masonry shall contain at least 400 kilograms of portland cement per cubic meter.

Construction of reinforced concrete masonry unit wall stems with portland cement mortar joints shall conform to the following:

Concrete masonry unit construction shall be true and plumb in the lateral direction and shall conform to the grade shown on the plans in the longitudinal direction. Bond beam units or recesses for horizontal reinforcement shall be provided.

Mortar joints shall be approximately 10 mm wide. Walls and cross webs forming cells to be filled with grout shall be full bedded in mortar to prevent leakage of grout. All head and bed joints shall be solidly filled with mortar for a distance in from the face of the wall or unit not less than the thickness of the longitudinal face shells. Head joints shall be shoved tight.

Mortared joints around cells to be filled shall be placed so as to preserve the unobstructed vertical continuity of the grout filling. Any overhanging mortar or other obstruction or debris shall be removed from the inside of such cells.

Reinforcement shall be securely held in position at top and bottom with either wire ties or spacing devices and at intervals not exceeding 192 bar diameters prior to placing any grout. Wire shall be 16-gage or heavier. Wooden, aluminum, or plastic spacing devices shall not be used.

Splices in vertical reinforcement will be allowed only where shown on the plans.

Only those cells containing reinforcement shall be filled solidly with grout. All grout in the cells shall be consolidated at the time of placement by vibrating, and reconsolidated after excess moisture has been absorbed, but before plasticity is lost. Slicing with a trowel is not acceptable.

Walls shall be constructed in 1.2-m maximum height lifts. Grouting of each lift shall be completed before beginning masonry unit construction for the next lift. The top course of each lift shall consist of a bond beam.

A construction joint is required at the top of the top course to permit placement of the mortar cap. The mix design for the mortar cap shall be as approved by the Engineer.

Construction joints shall be made when the placing of grout, in grout filled cells, is stopped for more than one hour. The construction joint shall be 12 mm below the top of the last course filled with grout.

Bond beams shall be continuous. The top of unfilled cells under horizontal bond beams shall be covered with metal or plastic lath.

When fresh masonry joins masonry that is partially or totally set, the contact surface shall be cleaned, roughened and lightly wetted.

Surfaces of the concrete on which the masonry walls are to be placed shall be roughened and cleaned, exposing the stone aggregate, and shall be flushed with water and allowed to dry to a surface dry condition immediately prior to laying the masonry units.

Where masonry unit cutting is necessary, all cuts shall be made with a masonry saw to neat and true lines. Masonry units with cracking or chipping of the finished exposed surfaces will not be acceptable.

Masonry shall be protected as specified for concrete structures in Section 90-8, "Protecting Concrete," of the Standard Specifications and these special provisions.

During erection, all cells shall be kept dry in inclement weather by covering partially completed walls. The covering shall be waterproof fabric, plastic or paper sheeting, or other approved material. Wooden boards and planks are not acceptable as covering materials. The covering shall extend down each side of masonry walls approximately 0.6-m.

Splashes, stains or spots on the exposed faces of the wall shall be removed.

ACCESS GATES.--Access gates shall conform to the details shown on the plans and these special provisions.

Timber members shall be tongue and groove Douglas fir sub-flooring free of knotholes. The location of knots of adjoining boards shall be staggered. The construction of the gate shall be with the tongue placed in the up position. The tongue of the top board and the groove of the bottom board shall be removed.

Timber members, steel frames, channels, anchorage devices, mounting hardware, gate rollers, corrugated steel pipe, nylon washers and neoprene tubing shall be of commercial quality.

The 25-mm round ladder rungs with non-skid surface shall consist of No. 25 deformed, diamond pattern, bar reinforcing steel of commercial quality.

Gate rollers shall be rigid casters with self-lubricating bearings and hard rubber wheels.

All metal parts and hardware shall be hot-dip galvanized.

Timber surfaces of the access gates shall be primed and then stained with 2 coats of stain to match the adjacent sound wall. Primer and stain shall be of the top grade primer and stain from an established manufacturer. An established manufacturer is one who has manufactured industrial paints and stains to meet custom specifications for at least 10 years.

Where the back side of the masonry wall is to be split faced, or rough surface blocks, the bond beam above the gate opening upon which the upper gate guide is to be mounted shall have smooth sided blocks.

The contract price paid per square meter for sound wall (masonry block), designated in the Engineer's Estimate, shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the sound wall (masonry block), complete in place, including all supports, anchorages, access gates, , scupper and vine openings, , excavation, backfill, reinforcement, and grade beams, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for protecting the tree house, equipment shed, batting cage, pool pump and pool deck in place, extending and matching iron fence and wood fence, including polystyrene, connections, steel post, strap anchors, hex bolts, pipe post, post caps, tension bars and welding the iron fence to existing, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the engineer shall be considered as included in the contract price paid per square meter for sound wall (masonry block) and no separate payment will be made therefor.

MEASUREMENT AND PAYMENT.--Sound wall (retaining wall) will be measured by the square meter of wall projected on a vertical plane between the top of retaining wall elevation line and the upper elevation line of the sound wall as shown on the plans and length of wall.

The contract prices paid per square meter for sound wall (retaining wall) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the sound wall complete in place, including all reinforcement, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Retaining walls supporting sound walls (retaining wall) will be measured and paid for as separate items of work.

Concrete block wall (masonry block) for property fence, consisting of a reinforced hollow unit masonry block stem, shall conform to the provisions in Sections 19, "Earthwork," 52, "Reinforcement," and 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

Concrete block wall masonry unit stems shall be constructed with joints of portland cement mortar. Wall stems shall be constructed with hand laid block. Wall stems shall not be constructed with preassembled panels.

Concrete for masonry block wall footings, if required, shall conform to the provisions in Section 90-10, "Minor Concrete," of the Standard Specifications.

Reinforcing bars shall conform to the requirements in ASTM Designation: A 706/A 706M.

Concrete masonry units shall be hollow, load bearing, conforming to the requirements in ASTM Designation: C 90, lightweight or medium weight classification, Type II. Standard or open end units may be used. Open end units, if used, shall not reduce the spacing of the bar reinforcement as shown on the plans.

The masonry units shall be nominal size and texture and of uniform color. The color shall match the existing adjacent wall.

When high strength concrete masonry units with $f'_m=17.2$ MPa are shown on the plans, the high strength masonry units shall have a minimum compressive strength of 26 MPa based on net area. Each high strength concrete masonry unit shall be identified with a groove embedded in an interior corner. The groove shall extend from a mortar surface for a length of about 50 mm and shall have a depth of about 5 mm.

Expansion joint filler shall conform to the requirements in ASTM Designation: D 1751 or ASTM Designation: D 2000 2AA-805.

Portland cement mortar shall be colored to match the units. Coloring shall be chemically inert, fade resistant mineral oxide or synthetic type.

Portland cement for wall stems shall conform to the provisions in Section 90-2.01, "Portland Cement," of the Standard Specifications.

Hydrated lime shall conform to the requirements in ASTM Designation: C 207, Type S.

Mortar sand shall be commercial quality.

Mortar for laying masonry units shall consist, by volume, of one part portland cement, 0 to 0.5 parts of hydrated lime, and 2.25 to 3 parts of mortar sand. Sufficient water shall be added to make a workable mortar. Each batch of mortar shall be accurately measured and thoroughly mixed. Mortar shall be freshly mixed as required. Mortar shall not be retempered more than one hour after mixing.

Prepackaged mortar materials and mortar containing admixtures may be used when approved in writing by the Engineer, provided the mortar shall not contain more than 0.05 percent soluble chlorides in conformance with California Test 422 or 0.25 percent soluble sulfates, as SO_4 , in conformance with California Test 417.

Prior to laying masonry units using prepackaged mortar materials or mortar containing admixtures, the Contractor shall submit to the Engineer the proposed sources of the materials together with test data from an independent testing laboratory for mortar tested in conformance with California Test 551. The test data shall be from specimens having a moist cure, except, the sample shall not be immersed in lime water. The average 28-day compressive strength of the mortar shall be not less than 17.2 MPa.

Aggregate for grout used to fill masonry units shall consist of fine aggregate and coarse aggregate conforming to the provisions in Section 90-2.02, "Aggregates," of the Standard Specifications. At least 20 percent of the aggregate shall be coarse aggregate. The Contractor shall determine the grading except that 100 percent of the combined grading shall pass the 12.5-mm sieve.

At the option of the Contractor, grout for filling masonry units may be proportioned either by volume or mass. Grout shall contain only enough water to cause it to flow and fill the voids without segregation. The maximum amount of free water shall not exceed 0.7 times the weight of the cement for regular strength masonry. The maximum amount of free water shall not exceed 0.6 times the mass of the cement for high strength masonry.

Grout proportioned by volume for regular strength masonry shall consist of at least one part portland cement and 4.5 parts aggregate. Grout proportioned by volume for high strength masonry shall consist of at least one part portland cement and 3.5 parts aggregate. Aggregate volumes shall be based on a loose, air-dry condition.

Grout proportioned by mass for regular strength masonry shall contain at least 325 kilograms of portland cement per cubic meter. Grout proportioned by mass for high strength masonry shall contain at least 400 kilograms of portland cement per cubic meter.

Construction of reinforced concrete masonry unit wall stems with portland cement mortar joints shall conform to the following:

Concrete masonry unit construction shall be true and plumb in the lateral direction and shall conform to the grade shown on the plans in the longitudinal direction. Bond beam units or recesses for horizontal reinforcement shall be provided.

Mortar joints shall be approximately 10 mm wide. Walls and cross webs forming cells to be filled with grout shall be full bedded in mortar to prevent leakage of grout. All head and bed joints shall be solidly filled with mortar for a distance in from the face of the wall or unit not less than the thickness of the longitudinal face shells. Head joints shall be shoved tight.

Mortared joints around cells to be filled shall be placed so as to preserve the unobstructed vertical continuity of the grout filling. Any overhanging mortar or other obstruction or debris shall be removed from the inside of such cells.

Reinforcement shall be securely held in position at top and bottom with either wire ties or spacing devices and at intervals not exceeding 192 bar diameters prior to placing any grout. Wire shall be 16-gage or heavier. Wooden, aluminum, or plastic spacing devices shall not be used.

Splices in vertical reinforcement will be allowed only where shown on the plans.

Only those cells containing reinforcement shall be filled solidly with grout. All grout in the cells shall be consolidated at the time of placement by vibrating, and reconsolidated after excess moisture has been absorbed, but before plasticity is lost. Slicing with a trowel is not acceptable.

Walls shall be constructed in 1.2-m maximum height lifts. Grouting of each lift shall be completed before beginning masonry unit construction for the next lift. The top course of each lift shall consist of a bond beam.

A construction joint is required at the top of the top course to permit placement of the mortar cap. The mix design for the mortar cap shall be as approved by the Engineer.

Construction joints shall be made when the placing of grout, in grout filled cells, is stopped for more than one hour. The construction joint shall be 12 mm below the top of the last course filled with grout.

Bond beams shall be continuous. The top of unfilled cells under horizontal bond beams shall be covered with metal or plastic lath.

When fresh masonry joins masonry that is partially or totally set, the contact surface shall be cleaned, roughened and lightly wetted.

Surfaces of the concrete on which the masonry walls are to be placed shall be roughened and cleaned, exposing the stone aggregate, and shall be flushed with water and allowed to dry to a surface dry condition immediately prior to laying the masonry units.

Where masonry unit cutting is necessary, all cuts shall be made with a masonry saw to neat and true lines. Masonry units with cracking or chipping of the finished exposed surfaces will not be acceptable.

Masonry shall be protected as specified for concrete structures in Section 90-8, "Protecting Concrete," of the Standard Specifications and these special provisions.

During erection, all cells shall be kept dry in inclement weather by covering partially completed walls. The covering shall be waterproof fabric, plastic or paper sheeting, or other approved material. Wooden boards and planks are not acceptable as covering materials. The covering shall extend down each side of masonry walls approximately 0.6-m.

Splashes, stains or spots on the exposed faces of the wall shall be removed.

DRILL AND GROUT DOWELS

Drilling and grouting dowels shall conform to the details shown on the plans, and the provisions in Section 51-1.13, "Bonding," of the Standard Specifications and these special provisions.

The reinforcing steel dowels shall conform to the provisions in "Reinforcement" of these special provisions.

Full compensation for furnishing and installing the concrete block wall (masonry block) for property fence, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer, including excavation, backfill, all reinforcement, drilling and grouting dowels, and matching to the existing property block wall, shall be considered as included in the contract price paid per square meter for sound wall (masonry block) and no separate payment will be made therefor.

10-1.21 REINFORCEMENT

Reinforcement shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

The first paragraph of Section 52-1.02A, "Bar Reinforcement," of the Standard Specifications is amended to read:

52-1.02A Bar Reinforcement.—Reinforcing bars shall be low-alloy steel deformed bars conforming to the requirements in ASTM Designation: A 706/A 706M, except that deformed or plain billet-steel bars conforming to the requirements in ASTM Designation: A 615/A 615M, Grade 300 or 420, may be used as reinforcement in the following 5 categories:

1. Slope and channel paving;
2. Minor structures;
3. Sign and signal foundations (pile and spread footing types);
4. Roadside rest facilities; and
5. Concrete barrier Type 50 and Type 60 series and temporary railing.

Deformations specified in ASTM Designation: A 706/A 706M will not be required on bars used as spiral or hoop reinforcement in structures and concrete piles.

Section 52-1.02C, "Welded Wire Fabric," of the Standard Specifications is amended to read:

52-1.02C Welded Wire Fabric.—Welded wire fabric shall be either plain or deformed conforming to the requirements in ASTM Designation: A 185 or ASTM Designation: A 497, respectively.

The last paragraph of Section 52-1.07, "Placing," of the Standard Specifications is amended to read:

Whenever a portion of an assemblage of bar reinforcing steel that is not encased in concrete exceeds 6 m in height, the Contractor shall submit to the Engineer for approval, in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," working drawings and design calculations for the temporary support system to be used. The working drawings and design calculations shall be signed by an engineer who is registered as a Civil Engineer in the State of California. The temporary support system shall be designed to resist all expected loads and shall be adequate to prevent collapse or overturning of the assemblage. If the installation of forms or other work requires revisions to or temporary release of any portion of the temporary support system, the working drawings shall show the support system to be used during each phase of construction. The minimum horizontal wind load to be applied to the bar reinforcing steel assemblage, or to a combined assemblage of reinforcing steel and forms, shall be not less than 960 Pa on the gross projected area of the assemblage.

The first paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

52-1.08 Splicing.—Splicing of reinforcing bars shall be by lapping, butt welding, mechanical butt splicing, or mechanical lap splicing, at the option of the Contractor. Reinforcing bars Nos. 43 through 57 shall not be spliced by lapping.

The sixth paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

Except when otherwise specified, mechanical lap splicing shall conform to the details shown on the plans, the requirements for mechanical butt splices as specified in this Section 52-1.08, and Sections 52-1.08C, "Mechanical Butt Splices," 52-1.08D, "Qualification of Welding and Mechanical Splicing," and 52-1.08E, "Job Control Tests," and the following:

The mechanical lap splice shall be a unit consisting of a sleeve, in which the reinforcing bars are positioned, and a wedge driven through holes in the sleeve and between the reinforcing bars. The mechanical lap splice shall only be used for splicing non-epoxy-coated deformed reinforcing bars Nos. 13, 16 and 19.

The eighth and ninth paragraphs of Section 52-1.08, "Splicing," of the Standard Specifications are amended to read:

Unless otherwise shown on the plans or approved by the Engineer, splices in adjacent reinforcing bars at any particular section shall be staggered. The minimum distance between staggered lap splices or mechanical lap splices shall be the same length required for a lapped splice in the largest bar. The minimum distance between staggered butt splices shall be 600 mm. Distances shall be measured between the midpoints of the splices along a line which is centered between the axes of the adjacent bars.

Completed butt splices shall develop a minimum tensile strength, based on the nominal bar area, of 430 MPa for ASTM Designation: A 615/A 615M, Grade 300 bars, and 550 MPa for ASTM Designation: A 615/A 615M, Grade 420 and ASTM Designation: A 706/A 706M bars. If butt splices are made between 2 bars of dissimilar strengths, the minimum required tensile strength for the splice shall be that required for the weaker bar.

The second sentence of the eleventh paragraph of Section 52-1.08, "Splicing," of the Standard Specifications is amended to read:

Job control tests shall be made on sample splices representing each lot of mechanical butt splices as provided in Section 52-1.08E, "Job Control Tests."

The third and fourth paragraphs of Section 52-1.08A, "Lapped Splices," of the Standard Specifications are amended to read:

Where ASTM Designations: A 615/A 615M, Grade 420 or A 706/A 706M reinforcing bars are required, the length of lapped splices shall be as follows: Reinforcing bars No. 25, or smaller, shall be lapped at least 45 diameters of the smaller bar joined, and reinforcing bars Nos. 29, 32 and 36 shall be lapped at least 60 diameters of the smaller bar joined, except when otherwise shown on the plans.

Where ASTM Designation: A 615/A 615M, Grade 300 reinforcing bars are permitted, the length of lapped splices shall be as follows: Reinforcing bars No. 25, or smaller, shall be lapped at least 30 diameters of the smaller bar joined, and reinforcing bars Nos. 29, 32 and 36 shall be lapped at least 45 diameters of the smaller bar joined, except when otherwise shown on the plans.

Section 52-1.08B, "Butt Welded Splices," of the Standard Specifications is amended to read:

52-1.08B Butt Welded Splices.—Butt welded splices in reinforcing bars shall be complete joint penetration butt welds conforming to the requirements in AWS D1.4, and the requirements of these specifications and the special provisions.

At the option of the Contractor, shop produced resistance butt welds, that are produced by a fabricator who is approved by the Transportation Laboratory, may be used. These welds shall conform to the requirements of these specifications and the special provisions.

Only the joint details and dimensions as shown in Figure 3.2, "Direct Butt Joints," of AWS D 1.4-92, shall be used for making complete joint penetration butt welds of bar reinforcement. Split pipe backing shall not be used.

Material used as backing for complete joint penetration butt welds of bar reinforcement shall be a flat plate conforming to the requirements in ASTM Designation: A 709/A 709M, Grade 36[250]. The flat plate shall be 6 mm thick with a width, as measured perpendicular to the axis of the bar, equal to the nominal diameter of the bar, and a length which does not exceed twice the nominal diameter of the bar. The flat plate backing shall be fitted tightly to the bar with the root of the weld centered on the plate. Any bar deformation or obstruction preventing a tight fit shall be ground smooth and flush with the adjacent surface. Tack welds used to fit backing plates shall be within the weld root area so that they are completely consumed by the finished weld. Backing plates shall not be removed.

Butt welds shall be made with multiple weld passes using a stringer bead without an appreciable weaving motion. The maximum stringer bead width shall be 2.5 times the diameter of the electrode and slagging shall be performed between each weld pass. Weld reinforcement shall not exceed 4 mm in convexity.

Before any electrodes or flux-electrode combinations are used, the Contractor, at the Contractor's expense, shall furnish certified copies of test reports for all the pertinent tests specified in AWS A5.1, AWS A5.5, AWS A5.18 or AWS A5.20, whichever is applicable, made on electrodes or flux-electrode combinations of the same class, brand and nearest specified size as the electrodes to be used. The tests may have been made for process qualification or quality control, and shall have been made within one year prior to manufacture of the electrodes and fluxes to be used. The report shall include the manufacturer's certification that the process and material requirements were the same for manufacturing the tested electrodes and the electrodes to be used. The forms and certificates shall be as directed by the Engineer.

Electrodes for manual shielded metal arc welding of ASTM Designation: A 615/A 615M, Grade 420 bars shall conform to the requirements in AWS A5.5 for E9018-M or E10018-M electrodes.

Electrodes for manual shielded metal arc welding of ASTM Designation: A 706/A 706M bars shall conform to the requirements of AWS A5.5 for E8016-C3 or E8018-C3 electrodes.

Solid and composite electrodes for semiautomatic gas metal-arc and flux-cored arc welding of Grade 300 reinforcing bars shall conform to the requirements of AWS A5.18 for ER70S-2, ER70S-3, ER70S-6 or ER70S-7 electrodes; or AWS A5.20 for E70T-1, E70T-5, E70T-6 or E70T-8 electrodes.

Electrodes for semiautomatic welding of ASTM Designation: A 615/A 615M, Grade 420 and ASTM Designation: A 706/A 706M bars shall produce a weld metal deposit with properties conforming to the requirements of Section 5.3.4 of AWS D1.1-96 for ER80S-Ni1, ER80S-Ni2, ER80S-Ni3, ER80S-D2, E90T1-K2 and E91T1-K2 electrodes.

Reinforcing bars shall be preheated for a distance of not less than 150 mm on each side of the joint prior to welding.

For all welding of ASTM Designation: A 615/A 615M, Grade 300 or Grade 420 bars, the requirements of Table 5.2, "Minimum Preheat and Interpass Temperatures," of AWS D1.4-92 are superseded by the following:

The minimum preheat and interpass temperatures shall be 200°C for Grade 300 bars and 300°C for Grade 420 bars. Immediately after completing the welding, at least 150 mm of the bar on each side of the splice shall be covered by an insulated wrapping to control the rate of cooling. The insulated wrapping shall remain in place until the bar has cooled below 90°C.

When welding different grades of reinforcing bars, the electrode shall conform to Grade 300 bar requirements and the preheat shall conform to the Grade 420 bar requirements.

In the event that any of the specified preheat, interpass and post weld cooling temperatures are not met, all weld and heat affected zone metal shall be removed and the splice rewelded.

Welding shall be protected from air currents, drafts, and precipitation to prevent loss of heat or loss of arc shielding. The method of protecting the welding area from loss of heat or loss of arc shielding shall be subject to approval by the Engineer.

Reinforcing bars shall not be direct butt spliced by thermite welding.

The first paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

52-1.08C Mechanical Butt Splices.—Mechanical butt splices shall be the sleeve-filler metal type, the sleeve-threaded type, the sleeve-swaged type, the sleeve-filler grout type, the sleeve-lockshear bolt type, the two-part sleeve-forged bar type, or the two-part sleeve-friction bar type, at the option of the Contractor.

The third paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

The total slip of the reinforcing bars within the splice sleeve after loading in tension to 200 MPa and relaxing to 20 MPa shall not exceed the following, measured between gage points clear of the splice sleeve: 250 µm for reinforcing bars No. 43, or smaller, or 750 µm for reinforcing bars No. 57.

The following is added after the third paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications:

Slip requirements shall not apply to mechanical lap splices.

The fourth subparagraph of the last paragraph of Section 52-1.08C, "Mechanical Butt Splices," of the Standard Specifications is amended to read:

4. A statement that the splicing systems and materials used in accordance with the manufacturer's procedures will develop not less than the minimum tensile strengths, based on the nominal bar area, of 430 MPa for ASTM Designation: A 615/A 615M, Grade 300 bars and 550 MPa for ASTM Designations: A 615/A 615M, Grade 420 and A 706/A 706M bars, and will comply with the total slip requirements and the other requirements in these specifications.

Section 52-1.08C(5), "Sleeve-Extruded Mechanical Butt Splices," of the Standard Specifications is amended to read:

52-1.08C(5) Sleeve-Lockshear Bolt Mechanical Butt Splices.—The sleeve-lockshear bolt type of mechanical butt splices shall consist of a seamless steel sleeve, 2 serrated steel strips welded to the inside of the sleeve, center hole with centering pin, and bolts that are tightened until the bolt heads shear off and the bolt ends are embedded in the reinforcing bars.

52-1.08C(6) Two-Part Sleeve-Forged Bar Mechanical Butt Splices.—The two-part sleeve-forged bar type of mechanical butt splices shall consist of a shop machined two-part threaded steel sleeve that interlocks 2 hot-forged reinforcing bars ends. The forged bar ends may be either shop produced or field produced.

52-1.08C(7) Two-Part Sleeve-Friction Bar Mechanical Butt Splices.—The two-part sleeve-friction bar type of mechanical butt splices shall consist of a shop machined two-part threaded steel sleeve whose ends are friction welded, in the shop, to the reinforcing bars ends.

The fourth paragraph of Section 52-1.08D, "Qualification of Welding and Mechanical Splicing," of the Standard Specifications is amended to read:

Each operator qualification test for mechanical splices shall consist of 2 sample splices. Each mechanical splice procedure test shall consist of 2 sample splices.

For sleeve-filler, sleeve-threaded, sleeve-lockshear bolt and two-part sleeve friction bar mechanical butt splices, all sample splices shall be made on the largest reinforcing bar size to be spliced by the procedure or operator being tested except that No. 43 bars may be substituted for No. 57 bars.

For sleeve-swaged and two-part sleeve-forged mechanical butt splices, and mechanical lap splices, all sample splices shall be made on the largest reinforcing bar size of each deformation pattern to be spliced by the procedure or operator being tested. When joining new reinforcing bars to existing reinforcement, the qualification test sample bars shall be made using only the deformation patterns of the new reinforcement to be joined.

Section 52-1.08E, "Job Control Tests," of the Standard Specifications is amended to read:

52-1.08E Job Control Tests.—When mechanical butt splices, shop produced complete joint penetration butt welded splices, or shop produced resistance butt welded splices are used, the Contractor shall furnish job control tests from a local qualified testing laboratory. A job control test shall consist of the fabrication, under conditions used to produce the splice, and the physical testing of 3 sample splices for each lot of 150 splices.

A lot of mechanical butt splices is defined as 150, or fraction thereof, of the same type of mechanical butt splices used for each combination of bar size and bar deformation pattern that is used in the work.

A lot of shop produced complete joint penetration butt welded splices, or shop produced resistance butt welded splices, is defined as 150, or fraction thereof, of the same type of welds used for each combination of bar size and bar deformation pattern that is used in the work.

When joining new reinforcing bars to existing reinforcement, the job control test shall be made using only the deformation patterns of the new reinforcement to be joined.

A sample splice shall consist of a splice made at the job site to connect two 760 mm, or longer, bars using the same splice materials, position, location, and equipment, and following the same procedures as are being used to make splices in the work. Shorter sample splice bars may be used if approved by the Engineer.

Sample splices shall be made and tested in the presence of the Engineer or the Engineer's authorized representative.

Sample splices shall be suitably identified with weatherproof markings prior to shipment to the testing laboratory.

For sleeve-threaded mechanical butt splices, the reinforcing bars to be used for job control tests shall be fabricated on a random basis during the cutting of threads on the reinforcing bars of each lot and shipped to the job site with the material they represent.

For shop produced complete joint penetration butt welds, shop produced resistance butt welded splices and all types of mechanical butt splices, except the sleeve-threaded type, the Engineer will designate when samples for job control tests are to be fabricated, and will determine the limits of the lot represented by each job control test.

Should the average of the results of tests made on the 3 sample splices or should more than one sample splice in any job control test fail to meet the requirements for splices, all splices represented by that test will be rejected in accordance with the provisions in Section 6-1.04, "Defective Materials," of the Standard Specifications. This rejection shall prevail unless the Contractor, at the Contractor's expense, obtains and submits evidence, of a type acceptable to the Engineer, that the strength and quality of the splices in the work are acceptable.

Section 52-1.08F, "Nondestructive Splice Tests," of the Standard Specifications is amended to read:

52-1.08F Nondestructive Splice Tests.—All required radiographic examinations of complete joint penetration butt welded splices shall be performed by the Contractor in accordance with the requirements of AWS D 1.4 and these specifications.

Prior to radiographic examination, welds shall meet the requirements of Section 4.4, "Quality of Welds," of AWS D1.4-92.

Radiographic examinations shall be performed on 25 percent of all complete joint penetration butt welded splices from a production lot. The size of a production lot will be a maximum of 100 splices. The Engineer will select the splices which will compose the production lot and also the splices within each production lot to be radiographically examined.

Should more than 12 percent of the splices which have been radiographically examined in any production lot be defective, an additional 25 percent of the splices, selected by the Engineer from the same production lot, shall be radiographically examined. Should more than 12 percent of the cumulative total of splices tested from the same production lot be defective, all remaining splices in the lot shall be radiographically examined.

Additional radiographic examinations performed due to the identification of defective splices shall be at the Contractor's expense.

All defects shall be repaired in accordance with the requirements of AWS D1.4.

Radiographic examinations will not be required for either shop produced complete joint penetration butt welds or shop produced resistance butt welded splices of No. 25 or smaller bars used as spiral or hoop reinforcement.

In addition to radiographic examinations performed by the Contractor, any mechanical or welded splice may be subject to inspection or nondestructive testing by the Engineer. The Contractor shall provide sufficient access facilities in the shop and at the jobsite to permit the Engineer or his agent to perform the inspection or testing.

The Contractor shall notify the Engineer in writing 48 hours prior to performing any radiographic examinations.

The radiographic procedure used shall conform to the requirements of ASME Boiler and Pressure Vessels Code, Section V, Article 2 and the following:

Two exposures shall be made for each complete joint penetration butt welded splice. For each of the two exposures, the radiation source shall be centered on each bar to be radiographed. The first exposure shall be made with the radiation source placed at zero degrees from the top of the weld and perpendicular to the weld root and identified with a station mark of "0." When obstructions prevent a zero degree placement of the radiation source for

the first exposure, and when approved in writing by the Engineer, the source may be rotated, around the centerline of the reinforcing bar, a maximum of 25 degrees. The second exposure shall be at 90 degrees to the "0" station mark and shall be identified with a station mark of "90."

For field produced complete joint penetration butt welds, no more than one weld shall be radiographed during one exposure. For shop produced complete joint penetration butt welds, if more than one weld is to be radiographed during one exposure, the angle between the root line of each weld and the direction to the radiation source shall be not less than 65 degrees.

Radiographs shall be made by either X-ray or gamma ray. Radiographs made by X-ray or gamma rays shall have densities of not less than 2.3 nor more than 3.5 in the area of interest. A tolerance of 0.05 in density is allowed for densitometer variations. Gamma rays shall be from the iridium 192 isotope and the emitting specimen shall not exceed 4.45 mm in the greatest diagonal dimension.

The radiographic film shall be placed perpendicular to the radiation source at all times; parallel to the root line of the weld unless source placement determines that the film must be turned; and as close to the root of the weld as possible.

The minimum source to film distance shall be maintained so as to insure that all radiographs maintain a maximum geometric unsharpness of 0.020 at all times, regardless of the size of the reinforcing bars.

Penetrameters shall be placed on the source side of the bar and perpendicular to the radiation source at all times. One penetrometer shall be placed in the center of each bar to be radiographed, perpendicular to the weld root, and adjacent to the weld. Penetrometer images shall not appear in the weld area.

When radiography of more than one weld is being performed per exposure, each exposure shall have a minimum of one penetrometer per bar, or 3 penetrameters per exposure. When 3 penetrameters per exposure are used, one penetrometer shall be placed on each of the 2 outermost bars of the exposure, and the remaining penetrometer shall be placed on a centrally located bar.

An allowable weld buildup of 4 mm may be added to the total material thickness when determining the proper penetrometer selection. No image quality indicator equivalency will be accepted. Wire penetrameters or penetrometer blocks shall not be used.

Penetrameters shall be sufficiently shimmed using a radiographically identical material. Penetrometer image densities shall be a minimum of 2.0 and a maximum of 3.6.

All radiographic film shall be Class 1, regardless of the size of reinforcing bars.

Radiographs shall be free of film artifacts and processing defects, including, but not limited to, streaks, scratches, pressure marks, or marks made for the purpose of identifying film or welding indications.

Each splice shall be clearly identified on each radiograph and the radiograph identification and marking system shall be established between the Contractor and the Engineer before radiographic inspection begins. Film shall be identified by lead numbers only; etching, flashing, or writing in identifications of any type will not be permitted. Each piece of film identification information shall be legible and shall include, as a minimum, the following information: Contractor's name, date, name of nondestructive testing firm, initials of radiographer, contract number, part number, and weld number. The letter "R" and repair number shall be placed directly after the weld number to designate a radiograph of a repaired weld.

Radiographic film shall be developed within a time range of one minute less to one minute more than the film manufacturer's recommended maximum development time. Sight development will not be allowed.

Processing chemistry shall be done with a consistent mixture and quality, and processing rinses and tanks shall be clean to ensure proper results. Records of all developing processes and any chemical changes to the developing processes shall be kept and furnished to the Engineer upon request. The Engineer may request, at any time, that a sheet of unexposed film be processed in the presence of the Engineer to verify processing chemical and rinse quality.

All radiographs shall be interpreted and graded by a Level II or Level III technician who is qualified in accordance with the American Society for Nondestructive Testing's Recommended Practice No. SNT-TC-1A. The results of these interpretations shall be recorded on a signed certification and a copy kept with the film packet.

Technique sheets prepared in accordance with ASME Boiler and Pressure Vessels Code, Section V, Article 2 Section T-291 shall also contain the developer temperature, developing time, fixing duration and all rinse times.

All radiographic envelopes shall have clearly written on the outside of the envelope the following information: name of the Contractor's Quality Control Manager (QCM), name of the nondestructive testing firm, name of the radiographer, date, contract number, complete part description, and all included weld numbers or a report number, as detailed in the Contractor's Quality Control Plan (QCP). In addition, all innerleaves shall have clearly written on them the part description and all included weld numbers, as detailed in the Contractor's QCP.

The third paragraph of Section 52-1.10, "Measurement," of the Standard Specifications is amended to read:

The lap of bars for all splices, including splices shown on the plans where a continuous bar is used, will be measured for payment. The mass calculated shall be based upon the following table:

BAR REINFORCING STEEL

Deformed Bar Designation Number	Mass Kilogram Per Meter	Nominal Diameter, Millimeters
10	0.560	9.5
13	0.994	12.7
16	1.552	15.9
19	2.235	19.1
22	3.042	22.2
25	3.973	25.4
29	5.060	28.7
32	6.404	32.3
36	7.907	35.8
43	11.38	43.0
57	20.24	57.3
Note: Bar numbers approximate the number of millimeters of the nominal diameter of the bars. The nominal diameter of a deformed bar is equivalent to the diameter of a plain round bar having the same mass per meter as the deformed bar.		

10-1.22 MISCELLANEOUS CONCRETE CONSTRUCTION

Minor concrete pavement as shown on the plans, shall conform to the provisions in Section 73, "Concrete Curbs and Sidewalks," of the Standard Specifications.

10-1.23 MISCELLANEOUS METAL (BRIDGE)

Miscellaneous metal (bridge) shall conform to the provisions for miscellaneous bridge metal in Section 75, "Miscellaneous Metal," of the Standard Specifications and these special provisions.

The second paragraph of Section 75-1.02, "Miscellaneous Iron and Steel" of the Standard Specifications is amended to read:

Unless otherwise specified, materials shall conform to the following specifications:

MATERIAL	SPECIFICATION
Steel bars, plates and shapes	ASTM Designation: A 36/A 36M or A 575, A 576 (AISI or M Grades 1016 through 1030 except Grade 1017)
Other parts for general applications	Commercial quality
Steel fastener components for general applications: Bolts and studs Headed anchor bolts Nonheaded anchor bolts High-strength bolts and studs which include threaded rods and high-strength nonheaded anchor bolts Nuts Washers	ASTM Designation: A 307 ASTM Designation: A 307, Grade B, including S1 supplementary requirements ASTM Designation: A 307, Grade C, including S1 supplementary requirements and S1.6 of AASHTO Designation: M 314 supplementary requirements or AASHTO Designation: M 314, Grade 36 or 55, including S1 supplementary requirements ASTM Designation: A 449, Type 1 ASTM Designation: A 563, including Appendix X1 ^(a) ASTM Designation: F 844
Components of high-strength steel fastener assemblies for use in structural steel joints: Bolts Tension control bolts Nuts Hardened washers Direct tension indicators	ASTM Designation: A 325, Type 1 ASTM Designation: F 1852, Type 1 ASTM Designation: A 563, including Appendix X1 ^(a) ASTM Designation: F 436, Type 1, Circular, including S1 supplementary requirements ASTM Designation: F 959, Type 325, zinc-coated
Stainless steel fasteners for general applications: Bolts, screws, nuts and studs which include threaded rods and nonheaded anchor bolts Washers	Alloys 304 or 316 ASTM Designation: F 593 or F 738M ASTM Designation: A 240 and ANSI B 18.22M

Carbon-steel castings	ASTM Designation: A 27/A 27M, Grade 65-35 [450-240], Class 1
Malleable iron castings	ASTM Designation: A 47, Grade 32510 or A 47M, Grade 22010
Gray iron castings	ASTM Designation: A 48, Class 30B
Ductile iron castings	ASTM Designation: A 536, Grade 65-45-12
Cast iron pipe	Commercial quality standard soil
Steel pipe	Commercial quality welded
(a) Zinc-coated nuts that will be tightened beyond snug or wrench tight shall be furnished with a dry lubricant conforming to Supplementary Requirement S2 in ASTM Designation: A 563.	

Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications is amended by adding the following paragraph after paragraph 3:

High-strength bolted connections shall conform to the provisions for high-strength steel fasteners and for bolted connections in Section 55, "Steel Structures."

Miscellaneous metal components of the modified chain link fence shall be measured and paid for as specified in Chain Link Fence (Modified) of these special provisions.

10-1.24 CHAIN LINK FENCE

Chain link fence shall be Type CL-1.8 and shall conform to the provisions in Section 80, "Fences," of the Standard Specifications.

10-1.25 CHAIN LINK GATES

Chain link gates shall be Type CL-1.8 conforming to the provisions in Section 80, "Fences," of the Standard Specifications and these special provisions.

Gates shall be installed in existing fences at the locations shown on the plans. Gate installations shall be complete with gate post, latch post, concrete footings, braces, truss rods, and hardware. Gate and latch posts shall be braced to the next existing line post as shown on the plans.

At each gate location, an existing line post shall be removed and the new gate installed so it is centered on the post hole of the removed post. Holes resulting from the removal of line posts shall be backfilled.

Gate mounting and latching hardware shall not contain open-end slots for the fastening bolts.

Chain link fabric for gates shall be of the same mesh size as the existing fence in which the gates are installed.

Openings made in existing fences for installation of gates shall be closed during the working day in which the openings are made and when work is not in progress. Temporary closures shall be made with the existing fence fabric or with additional 1.83-m chain link fabric as directed by the Engineer.

Full compensation for making the openings in existing fences, for temporary closing of the openings (including furnishing additional fence fabric if necessary), and for new posts, footings, hardware, braces, and truss rods shall be considered as included in the contract unit price paid for the type of chain link gate (Type CL-1.8) designated in the Engineer's estimate and no additional compensation will be allowed therefor.

10-1.26 CHAIN LINK FENCE (MODIFIED)

Chain link fence (modified) shall conform to the provisions in Section 80, "Fences," of the Standard Specifications and these special provisions.

Chain link fencing materials listed below shall conform to the requirements in "Miscellaneous Metal (Bridge)" of these special provisions:

- 152 mm extra strong pipe
- 1 1/4 inch standard (42 mm) pipe
- U-bolts and nuts

Post tops, struts, tension bars, truss rods, and other required fittings and hardware shall be steel or malleable iron or wrought iron and shall be galvanized after fabrication in accordance with the provisions for posts and braces in Section 75-1.05, "Galvanizing," of the Standard Specifications.

Full compensation for furnishing and installing 152 mm extra strong pipe, 1 1/4 inch standard (42 mm) pipe, U-bolts and nuts, post tops, struts, tension bars, truss rods, and other required fittings and hardware necessary to construct the modified chain link fence, complete in place, as shown on the plans, shall be considered as included in the contract price paid per meter for chain link fence modified and no seperate payment will be allowed therefor.

SECTION 11. (BLANK)

SECTION 12. (BLANK)

SECTION 13. (BLANK)

**SECTION 14 FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION
PROJECTS**

GENERAL.—The work herein proposed will be financed in whole or in part with Federal funds, and therefore all of the statutes, rules and regulations promulgated by the Federal Government and applicable to work financed in whole or in part with Federal funds will apply to such work. The "Required Contract Provisions, Federal-Aid Construction Contracts, Form FHWA 1273, are included in this Section 14. Whenever in said required contract provisions references are made to "SHA contracting officer", "SHA resident engineer", or "authorized representative of the SHA", such references shall be construed to mean "Engineer" as defined in Section 1-1.18 of the Standard Specifications.

PERFORMANCE OF PREVIOUS CONTRACT.—In addition to the provisions in Section II, "Nondiscrimination," and Section VII, "Subletting or Assigning the Contract," of the required contract provisions, the Contractor shall comply with the following:

The bidder shall execute the CERTIFICATION WITH REGARD TO THE PERFORMANCE OF PREVIOUS CONTRACTS OR SUBCONTRACTS SUBJECT TO THE EQUAL OPPORTUNITY CLAUSE AND THE FILING OF REQUIRED REPORTS located in the proposal. No request for subletting or assigning any portion of the contract in excess of \$10,000 will be considered under the provisions of Section VII of the required contract provisions unless such request is accompanied by the CERTIFICATION referred to above, executed by the proposed subcontractor.

NON-COLLUSION PROVISION.—The provisions in this section are applicable to all contracts except contracts for Federal Aid Secondary projects.

Title 23, United States Code, Section 112, requires as a condition precedent to approval by the Federal Highway Administrator of the contract for this work that each bidder file a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with the submitted bid. A form to make the non-collusion affidavit statement required by Section 112 as a certification under penalty of perjury rather than as a sworn statement as permitted by 28, USC, Sec. 1746, is included in the proposal.

PARTICIPATION BY MINORITY BUSINESS ENTERPRISES IN SUBCONTRACTING.—Part 23, Title 49, Code of Federal Regulations applies to this Federal-aid project. Pertinent sections of said Code are incorporated in part or in its entirety within other sections of these special provisions.

Schedule B—Information for Determining Joint Venture Eligibility

(This form need not be filled in if all joint venture firms are minority owned.)

1. Name of joint venture _____
2. Address of joint venture _____
3. Phone number of joint venture _____
4. Identify the firms which comprise the joint venture. (The MBE partner must complete Schedule A.) _____

 - a. Describe the role of the MBE firm in the joint venture. _____
 - b. Describe very briefly the experience and business qualifications of each non-MBE joint venturer: _____
5. Nature of the joint venture's business _____
6. Provide a copy of the joint venture agreement.
7. What is the claimed percentage of MBE ownership? _____
8. Ownership of joint venture: (This need not be filled in if described in the joint venture agreement, provided by question 6.).
 - a. Profit and loss sharing.
 - b. Capital contributions, including equipment.
 - c. Other applicable ownership interests.

9. Control of and participation in this contract. Identify by name, race, sex, and "firm" those individuals (and their titles) who are responsible for day-to-day management and policy decision making, including, but not limited to, those with prime responsibility for:
- a. Financial decisions _____
 - b. Management decisions, such as:
 - (1) Estimating _____
 - (2). Marketing and sales _____
 - (3). Hiring and firing of management personnel _____
 - (4) Purchasing of major items or supplies _____
 - c. Supervision of field operations _____

Note.—If, after filing this Schedule B and before the completion of the joint venture's work on the contract covered by this regulation, there is any significant change in the information submitted, the joint venture must inform the grantee, either directly or through the prime contractor if the joint venture is a subcontractor.

Affidavit

"The undersigned swear that the foregoing statements are correct and include all material information necessary to identify and explain the terms and operation of our joint venture and the intended participation by each joint venturer in the undertaking. Further, the undersigned covenant and agree to provide to grantee current, complete and accurate information regarding actual joint venture work and the payment therefor and any proposed changes in any of the joint venture arrangements and to permit the audit and examination of the books, records and files of the joint venture, or those of each joint venturer relevant to the joint venture, by authorized representatives of the grantee or the Federal funding agency. Any material misrepresentation will be grounds for terminating any contract which may be awarded and for initiating action under Federal or State laws concerning false statements."

Name of Firm	Name of Firm
Signature	Signature
Name	Name
Title	Title
Date	Date

Date _____

State of _____

County of _____

On this ____ day of _____, 19 __, before me appeared (Name) _____, to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

Date _____

State of _____

County of _____

On this ____ day of _____, 19 __, before me appeared (Name) _____ to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

**REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS**

I. GENERAL

1. These contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.

2. Except as otherwise provided for in each section, the contractor shall insert in each subcontract all of the stipulations contained in these Required Contract Provisions, and further require their inclusion in any lower tier subcontract or purchase order that may in turn be made. The Required Contract Provisions shall not be incorporated by reference in any case. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with these Required Contract Provisions.

3. A breach of any of the stipulations contained in these Required Contract Provisions shall be sufficient grounds for termination of the contract.

4. A breach of the following clauses of the Required Contract Provisions may also be grounds for debarment as provided in 29 CFR 5.12:

Section I, paragraph 2;
Section IV, paragraphs 1, 2, 3, 4, and 7;
Section V, paragraphs 1 and 2a through 2g.

5. Disputes arising out of the labor standards provisions of Section IV (except paragraph 5) and Section V of these Required Contract Provisions shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the U.S. Department of Labor (DOL) as set forth in 29 CFR 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the DOL, or the contractor's employees or their representatives.

6. **Selection of Labor:** During the performance of this contract, the contractor shall not:

- a. discriminate against labor from any other State, possession, or territory of the United States (except for employment preference for Appalachian contracts, when applicable, as specified in Attachment A), or
- b. employ convict labor for any purpose within the limits of the project unless it is labor performed by convicts who are on parole, supervised release, or probation.

II. NONDISCRIMINATION

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

1. **Equal Employment Opportunity:** Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, and 41 CFR 60) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The Equal Opportunity Construction Contract Specifications set forth under 41 CFR 60-4.3 and the provisions of the American Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

- a. The contractor will work with the State highway agency (SHA) and the Federal Government in carrying out EEO obligations and in their review of his/her activities under the contract.
- b. The contractor will accept as his operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, preapprenticeship, and/or on-the-job training."

2. **EEO Officer:** The contractor will designate and make known to the SHA contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active contractor program of EEO and who must be assigned adequate authority and responsibility to do so.

3. **Dissemination of Policy:** All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:

- a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
- b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
- c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minority group employees.
- d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
- e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

4. **Recruitment:** When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minority groups in the area from which the project work force would normally be derived.

- a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minority group applicants. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority group applicants may be referred to the contractor for employment consideration.
- b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, he is expected to observe the provisions of that agreement to the extent that the system permits the contractor's compliance with EEO contract provisions. (The DOL has held that where implementation of such agreements have the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Executive Order 11246, as amended.)
- c. The contractor will encourage his present employees to refer minority group applicants for employment. Information and procedures with regard to referring minority group applicants will be discussed with employees.

5. **Personnel Actions:** Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:

- a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.
- b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
- c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

- d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with his obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of his avenues of appeal.
6. Training and Promotion:
 - a. The contractor will assist in locating, qualifying, and increasing the skills of minority group and women employees, and applicants for employment.
 - b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. Where feasible, 25 percent of apprentices or trainees in each occupation shall be in their first year of apprenticeship or training. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision.
 - c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
 - d. The contractor will periodically review the training and promotion potential of minority group and women employees and will encourage eligible employees to apply for such training and promotion.
7. **Unions:** If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use his/her best efforts to obtain the cooperation of such unions to increase opportunities for minority groups and women within the unions, and to effect referrals by such unions of minority and female employees. Actions by the contractor either directly or through a contractor's association acting as agent will include the procedures set forth below:
 - a. The contractor will use best efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minority group members and women for membership in the unions and increasing the skills of minority group employees and women so that they may qualify for higher paying employment.
 - b. The contractor will use best efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
 - c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the SHA and shall set forth what efforts have been made to obtain such information.
 - d. In the event the union is unable to provide the contractor with a reasonable flow of minority and women referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minority group persons and women. (The DOL has held that it shall be no excuse that the union with which the contractor has a collective bargaining agreement providing for exclusive referral failed to refer minority employees.) In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the SHA.
8. **Selection of Subcontractors, Procurement of Materials and Leasing of Equipment:** The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment.
 - a. The contractor shall notify all potential subcontractors and suppliers of his/her EEO obligations under this contract.
 - b. Disadvantaged business enterprises (DBE), as defined in 49 CFR 23, shall have equal opportunity to compete for and perform subcontracts which the contractor enters into pursuant to this contract. The contractor will use his best efforts to solicit bids from and to utilize DBE subcontractors or subcontractors with meaningful minority group and

female representation among their employees. Contractors shall obtain lists of DBE construction firms from SHA personnel.

c. The contractor will use his best efforts to ensure subcontractor compliance with their EEO obligations.

9. **Records and Reports:** The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following completion of the contract work and shall be available at reasonable times and places for inspection by authorized representatives of the SHA and the FHWA.

a. The records kept by the contractor shall document the following:

(1) The number of minority and non-minority group members and women employed in each work classification on the project;

(2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women;

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minority and female employees; and

(4) The progress and efforts being made in securing the services of DBE subcontractors or subcontractors with meaningful minority and female representation among their employees.

b. The contractors will submit an annual report to the SHA each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data.

III. NONSEGREGATED FACILITIES

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

a. By submission of this bid, the execution of this contract or subcontract, or the consummation of this material supply agreement or purchase order, as appropriate, the bidder, Federal-aid construction contractor, subcontractor, material supplier, or vendor, as appropriate, certifies that the firm does not maintain or provide for its employees any segregated facilities at any of its establishments, and that the firm does not permit its employees to perform their services at any location, under its control, where segregated facilities are maintained. The firm agrees that a breach of this certification is a violation of the EEO provisions of this contract. The firm further certifies that no employee will be denied access to adequate facilities on the basis of sex or disability.

b. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and washrooms, restaurants and other eating areas, time clocks, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive, or are, in fact, segregated on the basis of race, color, religion, national origin, age or disability, because of habit, local custom, or otherwise. The only exception will be for the disabled when the demands for accessibility override (e.g. disabled parking).

c. The contractor agrees that it has obtained or will obtain identical certification from proposed subcontractors or material suppliers prior to award of subcontracts or consummation of material supply agreements of \$10,000 or more and that it will retain such certifications in its files.

IV. PAYMENT OF PREDETERMINED MINIMUM WAGE

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural minor collectors, which are exempt.)

1. General:

a. All mechanics and laborers employed or working upon the site of the work will be paid unconditionally and not less often than once a week and without subsequent deduction or rebate on any account [except such payroll deductions as are permitted by regulations (29 CFR 3)] issued by the Secretary of Labor under the Copeland Act (40 U.S.C. 276c) the full amounts of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment. The payment shall be computed at wage rates not less than those contained in the wage determination of

the Secretary of Labor (hereinafter "the wage determination") which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor or its subcontractors and such laborers and mechanics. The wage determination (including any additional classifications and wage rates conformed under paragraph 2 of this Section IV and the DOL poster (WH-1321) or Form FHWA-1495) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers. For the purpose of this Section, contributions made or costs reasonably anticipated for bona fide fringe benefits under Section 1(b)(2) of the Davis-Bacon Act (40 U.S.C. 276a) on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of Section IV, paragraph 3b, hereof. Also, for the purpose of this Section, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs, which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in paragraphs 4 and 5 of this Section IV.

- b. Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein, provided, that the employer's payroll records accurately set forth the time spent in each classification in which work is performed.
- c. All rulings and interpretations of the Davis-Bacon Act and related acts contained in 29 CFR 1, 3, and 5 are herein incorporated by reference in this contract.

2. Classification:

- a. The SHA contracting officer shall require that any class of laborers or mechanics employed under the contract, which is not listed in the wage determination, shall be classified in conformance with the wage determination.
- b. The contracting officer shall approve an additional classification, wage rate and fringe benefits only when the following criteria have been met:
 - (1) the work to be performed by the additional classification requested is not performed by a classification in the wage determination;
 - (2) the additional classification is utilized in the area by the construction industry;
 - (3) the proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination; and
 - (4) with respect to helpers, when such a classification prevails in the area in which the work is performed.
- c. If the contractor or subcontractors, as appropriate, the laborers and mechanics (if known) to be employed in the additional classification or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the DOL, Administrator of the Wage and Hour Division, Employment Standards Administration, Washington, D.C. 20210. The Wage and Hour Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
- d. In the event the contractor or subcontractors, as appropriate, the laborers or mechanics to be employed in the additional classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. Said Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
- e. The wage rate (including fringe benefits where appropriate) determined pursuant to paragraph 2c or 2d of this Section IV shall be paid to all workers performing work in the additional classification from the first day on which work is performed in the classification.

3. Payment of Fringe Benefits:

- a. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor or subcontractors, as appropriate, shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly case equivalent thereof.
- b. If the contractor or subcontractor, as appropriate, does not make payments to a trustee or other third person, he/she may consider as a part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, provided, that the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

4. Apprentices and Trainees (Programs of the U.S. DOL) and Helpers:

a. Apprentices:

- (1) Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the DOL, Employment and Training Administration, Bureau of Apprenticeship and Training, or with a State apprenticeship agency recognized by the Bureau, or if a person is employed in his/her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Bureau of Apprenticeship and Training or a State apprenticeship agency (where appropriate) to be eligible for probationary employment as an apprentice.
- (2) The allowable ratio of apprentices to journeyman-level employees on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any employee listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate listed in the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor or subcontractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman-level hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.
- (3) Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeyman-level hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator for the Wage and Hour Division determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.
- (4) In the event the Bureau of Apprenticeship and Training, or a State apprenticeship agency recognized by the Bureau, withdraws approval of an apprenticeship program, the contractor or subcontractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the comparable work performed by regular employees until an acceptable program is approved.

b. Trainees:

- (1) Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the DOL, Employment and Training Administration.
- (2) The ratio of trainees to journeyman-level employees on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of

the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

- (3) Every trainee must be paid at not less than the rate specified in the approved program for his/her level of progress, expressed as a percentage of the journeyman-level hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman-level wage rate on the wage determination which provides for less than full fringe benefits for apprentices, in which case such trainees shall receive the same fringe benefits as apprentices.
- (4) In the event the Employment and Training Administration withdraws approval of a training program, the contractor or subcontractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. **Helpers:**

Helpers will be permitted to work on a project if the helper classification is specified and defined on the applicable wage determination or is approved pursuant to the conformance procedure set forth in Section IV.2. Any worker listed on a payroll at a helper wage rate, who is not a helper under an approved definition, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed.

5. Apprentices and Trainees (Programs of the U.S. DOT):

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

6. Withholding:

The SHA shall upon its own action or upon written request of an authorized representative of the DOL withhold, or cause to be withheld, from the contractor or subcontractor under this contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to Davis-Bacon prevailing wage requirements which is held by the same prime contractor, as much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the SHA contracting officer may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

7. Overtime Requirements:

No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers, mechanics, watchmen, or guards (including apprentices, trainees, and helpers described in paragraphs 4 and 5 above) shall require or permit any laborer, mechanic, watchman, or guard in any workweek in which he/she is employed on such work, to work in excess of 40 hours in such workweek unless such laborer, mechanic, watchman, or guard receives compensation at a rate not less than one-and-one-half times his/her basic rate of pay for all hours worked in excess of 40 hours in such workweek.

8. Violation:

Liability for Unpaid Wages; Liquidated Damages: In the event of any violation of the clause set forth in paragraph 7 above, the contractor and any subcontractor responsible thereof shall be liable to the affected employee for his/her unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory) for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer, mechanic, watchman, or guard employed in violation of the clause set forth in paragraph 7, in the sum of \$10 for each calendar day on which such employee was required or permitted to work in excess of the standard work week of 40 hours without payment of the overtime wages required by the clause set forth in paragraph 7.

9. Withholding for Unpaid Wages and Liquidated Damages:

The SHA shall upon its own action or upon written request of any authorized representative of the DOL withhold, or cause to be withheld, from any monies payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph 8 above.

V. STATEMENTS AND PAYROLLS

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural collectors, which are exempt.)

1. Compliance with Copeland Regulations (29 CFR 3):

The contractor shall comply with the Copeland Regulations of the Secretary of Labor which are herein incorporated by reference.

2. Payrolls and Payroll Records:

- a. Payrolls and basic records relating thereto shall be maintained by the contractor and each subcontractor during the course of the work and preserved for a period of 3 years from the date of completion of the contract for all laborers, mechanics, apprentices, trainees, watchmen, helpers, and guards working at the site of the work.
- b. The payroll records shall contain the name, social security number, and address of each such employee; his or her correct classification; hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalent thereof of the types described in Section 1(b)(2)(B) of the Davis Bacon Act); daily and weekly number of hours worked; deductions made; and actual wages paid. In addition, for Appalachian contracts, the payroll records shall contain a notation indicating whether the employee does, or does not, normally reside in the labor area as defined in Attachment A, paragraph 1. Whenever the Secretary of Labor, pursuant to Section IV, paragraph 3b, has found that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in Section 1(b)(2)(B) of the Davis Bacon Act, the contractor and each subcontractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, that the plan or program has been communicated in writing to the laborers or mechanics affected, and show the cost anticipated or the actual cost incurred in providing benefits. Contractors or subcontractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprentices and trainees, and ratios and wage rates prescribed in the applicable programs.
- c. Each contractor and subcontractor shall furnish, each week in which any contract work is performed, to the SHA resident engineer a payroll of wages paid each of its employees (including apprentices, trainees, and helpers, described in Section IV, paragraphs 4 and 5, and watchmen and guards engaged on work during the preceding weekly payroll period). The payroll submitted shall set out accurately and completely all of the information required to be maintained under paragraph 2b of this Section V. This information may be submitted in any form desired. Optional Form WH-347 is available for this purpose and may be purchased from the Superintendent of Documents (Federal stock number 029-005-0014-1), U.S. Government Printing Office, Washington, D.C. 20402. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors.
- d. Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his/her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:
 - (1) that the payroll for the payroll period contains the information required to be maintained under paragraph 2b of this Section V and that such information is correct and complete;
 - (2) that such laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in the Regulations, 29 CFR 3;

- (3) that each laborer or mechanic has been paid not less than the applicable wage rate and fringe benefits or cash equivalent for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.
- e. The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 2d of this Section V.
- f. The falsification of any of the above certifications may subject the contractor to civil or criminal prosecution under 18 U.S.C. 1001 and 31 U.S.C. 231.
- g. The contractor or subcontractor shall make the records required under paragraph 2b of this Section V available for inspection, copying, or transcription by authorized representatives of the SHA, the FHWA, or the DOL, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the SHA, the FHWA, the DOL, or all may, after written notice to the contractor, sponsor, applicant, or owner, take such actions as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

VI. RECORD OF MATERIALS, SUPPLIES, AND LABOR

1. On all Federal-aid contracts on the National Highway System, except those which provide solely for the installation of protective devices at railroad grade crossings, those which are constructed on a force account or direct labor basis, highway beautification contracts, and contracts for which the total final construction cost for roadway and bridge is less than \$1,000,000 (23 CFR 635) the contractor shall:
 - a. Become familiar with the list of specific materials and supplies contained in Form FHWA-47, "Statement of Materials and Labor Used by Contractor of Highway Construction Involving Federal Funds," prior to the commencement of work under this contract.
 - b. Maintain a record of the total cost of all materials and supplies purchased for and incorporated in the work, and also of the quantities of those specific materials and supplies listed on Form FHWA-47, and in the units shown on Form FHWA-47.
 - c. Furnish, upon the completion of the contract, to the SHA resident engineer on Form FHWA-47 together with the data required in paragraph 1b relative to materials and supplies, a final labor summary of all contract work indicating the total hours worked and the total amount earned.
2. At the prime contractor's option, either a single report covering all contract work or separate reports for the contractor and for each subcontract shall be submitted.

VII. SUBLETTING OR ASSIGNING THE CONTRACT

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the State. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635).
 - a. "Its own organization" shall be construed to include only workers employed and paid directly by the prime contractor and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor, assignee, or agent of the prime contractor.
 - b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid on the contract as a whole and in general are to be limited to minor components of the overall contract.
2. The contract amount upon which the requirements set forth in paragraph 1 of Section VII is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.

3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the SHA contracting officer determines is necessary to assure the performance of the contract.
4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the SHA contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the SHA has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

VIII. SAFETY: ACCIDENT PREVENTION

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the SHA contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).
3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).

IX. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, the following notice shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

Notice To All Personnel Engaged On Federal-Aid Highway Projects

18 U.S.C. 1020 READS AS FOLLOWS:

"Whoever being an officer, agent, or employee of the United States, or any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined not more than \$10,000 or imprisoned not more than 5 years or both."

X. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$100,000 or more.)

By submission of this bid or the execution of this contract, or subcontract, as appropriate, the bidder, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any facility that is or will be utilized in the performance of this contract, unless such contract is exempt under the Clean Air Act, as amended (42 U.S.C. 1857 et seq., as amended by Pub.L. 91-604), and under the Federal Water Pollution Control Act, as amended (33 U.S.C. 1251 et seq., as amended by Pub.L. 92-500), Executive Order 11738, and regulations in implementation thereof (40 CFR 15) is not listed, on the date of contract award, on the U.S. Environmental Protection Agency (EPA) List of Violating Facilities pursuant to 40 CFR 15.20.
2. That the firm agrees to comply and remain in compliance with all the requirements of Section 114 of the Clean Air Act and Section 308 of the Federal Water Pollution Control Act and all regulations and guidelines listed thereunder.
3. That the firm shall promptly notify the SHA of the receipt of any communication from the Director, Office of Federal Activities, EPA, indicating that a facility that is or will be utilized for the contract is under consideration to be listed on the EPA List of Violating Facilities.
4. That the firm agrees to include or cause to be included the requirements of paragraph 1 through 4 of this Section X in every nonexempt subcontract, and further agrees to take such action as the government may direct as a means of enforcing such requirements.

XI. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

1. Instructions for Certification - Primary Covered Transactions:

(Applicable to all Federal-aid contracts - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective primary participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective primary participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the department or agency determined to enter into this transaction. If it is later determined that the prospective primary participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause of default.
- d. The prospective primary participant shall provide immediate written notice to the department or agency to whom this proposal is submitted if any time the prospective primary participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "lower tier covered transaction," "participant," "person," "primary covered transaction," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the department or agency to which this proposal is submitted for assistance in obtaining a copy of those regulations.
- f. The prospective primary participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective primary participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier

Contract No. 07-172164

Covered Transaction," provided by the department or agency entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.

- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the nonprocurement portion of the "Lists of Parties Excluded From Federal Procurement or Nonprocurement Programs" (Nonprocurement List) which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- j. Except for transactions authorized under paragraph f of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Primary Covered Transactions

- 1. The prospective primary participant certifies to the best of its knowledge and belief, that it and its principals:
 - a. Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
 - b. Have not within a 3-year period preceding this proposal been convicted of or had a civil judgement rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
 - c. Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph 1b of this certification; and
 - d. Have not within a 3-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- 2. Where the prospective primary participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Covered Transactions:

(Applicable to all subcontracts, purchase orders and other lower tier transactions of \$25,000 or more - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.
- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "primary covered transaction," "participant," "person," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in

the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations.

- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.
- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the Nonprocurement List.
- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Lower Tier Covered Transactions

1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participation in this transaction by any Federal department or agency.
2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

XII. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

(Applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 - 49 CFR 20)

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
 - a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
 - b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.

2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.
3. The prospective participant also agrees by submitting his or her bid or proposal that he or she shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

FEDERAL-AID FEMALE AND MINORITY GOALS

In accordance with Section II, "Nondiscrimination," of "Required Contract Provisions Federal-aid Construction Contracts" the following are the goals for female utilization:

Goal for Women (applies nationwide).....(percent) 6.9

The following are goals for minority utilization:

CALIFORNIA ECONOMIC AREA

		Goal (Percent)
174	Redding, CA: Non-SMSA Counties CA Lassen; CA Modoc; CA Plumas; CA Shasta; CA Siskiyou; CA Tehama.	6.8
175	Eureka, CA Non-SMSA Counties CA Del Norte; CA Humboldt; CA Trinity.	6.6
176	San Francisco-Oakland-San Jose, CA: SMSA Counties: 7120 Salinas-Seaside-Monterey, CA CA Monterey. 7360 San Francisco-Oakland CA Alameda; CA Contra Costa; CA Marin; CA San Francisco; CA San Mateo. 7400 San Jose, CA CA Santa Clara. 7485 Santa Cruz, CA. CA Santa Cruz. 7500 Santa Rosa, CA CA Sonoma. 8720 Vallejo-Fairfield- Napa, CA CA Napa; CA Solano Non-SMSA Counties CA Lake; CA Mendocino; CA San Benito	28.9 25.6 19.6 14.9 9.1 17.1 23.2
177	Sacramento, CA: SMSA Counties: 6920 Sacramento, CA CA Placer; CA Sacramento; CA Yolo. Non-SMSA Counties CA Butte; CA Colusa; CA El Dorado; CA Glenn; CA Nevada; CA Sierra; CA Sutter; CA Yuba.	16.1 14.3
178	Stockton-Modesto, CA: SMSA Counties: 5170 Modesto, CA CA Stanislaus. 8120 Stockton, CA CA San Joaquin. Non-SMSA Counties CA Alpine; CA Amador; CA Calaveras; CA Mariposa; CA Merced; CA Tuolumne.	12.3 24.3 19.8

		Goal (Percent)
179	Fresno-Bakersfield, CA	
	SMSA Counties:	
	0680 Bakersfield, CA	19.1
	CA Kern.	
	2840 Fresno, CA	26.1
	CA Fresno.	
	Non-SMSA Counties	23.6
	CA Kings; CA Madera; CA Tulare.	
180	Los Angeles, CA:	
	SMSA Counties:	
	0360 Anaheim-Santa Ana-Garden Grove, CA	11.9
	CA Orange.	
	4480 Los Angeles-Long Beach, CA	28.3
	CA Los Angeles.	
	6000 Oxnard-Simi Valley-Ventura, CA	21.5
	CA Ventura.	
	6780 Riverside-San Bernardino-Ontario, CA.	19.0
	CA Riverside; CA San Bernardino.	
	7480 Santa Barbara-Santa Maria-Lompoc, CA	19.7
	CA Santa Barbara.	
	Non-SMSA Counties	24.6
	CA Inyo; CA Mono; CA San Luis Obispo.	
181	San Diego, CA:	
	SMSA Counties	
	7320 San Diego, CA.	16.9
	CA San Diego.	
	Non-SMSA Counties	18.2
	CA Imperial.	

In addition to the reporting requirements set forth elsewhere in this contract the Contractor and subcontractors holding subcontracts, not including material suppliers, of \$10,000 or more, shall submit for every month of July during which work is performed, employment data as contained under Form FHWA PR-1391 (Appendix C to 23 CFR, Part 230), and in accordance with the instructions included thereon.

FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS

As part of the Contractor's equal employment opportunity affirmative action program, training shall be provided as follows:

The Contractor shall provide on-the-job training to develop full journeymen in the types of trades or job classification involved.

The goal for the number of trainees or apprentices to be trained under the requirements of this special provision will be 3.

In the event the Contractor subcontracts a portion of the contract work, he shall determine how many, if any, of the trainees or apprentices are to be trained by the subcontractor, provided however, that the Contractor shall retain the primary responsibility for meeting the training requirements imposed by this special provision. The Contractor shall also insure that this Training Special Provision is made applicable to such subcontract. Where feasible, 25 percent of trainees or apprentices in each occupation shall be in their first year of apprenticeship or training.

The number of trainees or apprentices shall be distributed among the work classifications on the basis of the Contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment. Prior to commencing work, the Contractor shall submit to the Department for approval the number of trainees or apprentices to be trained in each selected classification and training program to be used. Furthermore, the Contractor shall specify the starting time for training in each of the classifications. The Contractor will be credited for each trainee or apprentice employed by him on the contract work who is currently enrolled or becomes enrolled in an approved program and will be reimbursed for such trainees or apprentices as provided hereinafter.

Training and upgrading of minorities and women toward journeymen status is a primary objective of this Training Special Provision. Accordingly, the Contractor shall make every effort to enroll minority and women trainees or apprentices (e.g., by conducting systematic and direct recruitment through public and private sources likely to yield minority and women trainees or apprentices) to the extent such persons are available within a reasonable area of recruitment. The Contractor will be responsible for demonstrating the steps that he has taken in pursuance thereof, prior to a determination as to whether the Contractor is in compliance with this Training Special Provision. This training commitment is not intended, and shall not be used, to discriminate against any applicant for training, whether a member of a minority group or not.

No employee shall be employed as a trainee or apprentice in any classification in which he has successfully completed a training course leading to journeyman status or in which he has been employed as a journeyman. The Contractor should satisfy this requirement by including appropriate questions in the employee application or by other suitable means. Regardless of the method used the Contractor's records should document the findings in each case.

The minimum length and type of training for each classification will be as established in the training program selected by the Contractor and approved by both the Department and the Federal Highway Administration. The Department and the Federal Highway Administration will approve a program if it is reasonably calculated to meet the equal employment opportunity obligations of the Contractor and to qualify the average trainee or apprentice for journeyman status in the classification concerned by the end of the training period. Furthermore, apprenticeship programs registered with the U.S. Department of Labor, Bureau of Apprenticeship and Training, or with the State of California, Department of Industrial Relations, Division of Apprenticeship Standards recognized by the Bureau and training programs approved but not necessarily sponsored by the U.S. Department of Labor, Manpower Administration, Bureau of Apprenticeship and Training shall also be considered acceptable provided it is being administered in a manner consistent with the equal employment obligations of Federal-aid highway construction contracts. Approval or acceptance of a training program shall be obtained from the State prior to commencing work on the classification covered by the program. It is the intention of these provisions that training is to be provided in the construction crafts rather than clerk-typists or secretarial-type positions. Training is permissible in lower level management positions such as office engineers, estimators, timekeepers, etc., where the training is oriented toward construction applications. Training in the laborer classification may be permitted provided that significant and meaningful training is provided and approved by the division office. Some offsite training is permissible as long as the training is an integral part of an approved training program and does not comprise a significant part of the overall training.

Except as otherwise noted below, the Contractor will be reimbursed 80 cents per hour of training given an employee on this contract in accordance with an approved training program. As approved by the Engineer, reimbursement will be made for training of persons in excess of the number specified herein. This reimbursement will be made even though the Contractor receives additional training program funds from other sources, provided such other source does not specifically prohibit the Contractor from receiving other reimbursement. Reimbursement for offsite training indicated above may only be made to the Contractor where he does one or more of the following and the trainees or apprentices are concurrently employed on a Federal-aid project; contributes to the cost of the training, provides the instruction to the trainee or apprentice or pays the trainee's or apprentice's wages during the offsite training period.

No payment shall be made to the Contractor if either the failure to provide the required training, or the failure to hire the trainee or apprentice as a journeyman, is caused by the Contractor and evidences a lack of good faith on the part of the Contractor in meeting the requirements of this Training Special Provision. It is normally expected that a trainee or apprentice will begin his training on the project as soon as feasible after start of work utilizing the skill involved and remain on the project as long as training opportunities exist in his work classification or until he has completed his training

program. It is not required that all trainees or apprentices be on board for the entire length of the contract. A Contractor will have fulfilled his responsibilities under this Training Special Provision if he has provided acceptable training to the number of trainees or apprentices specified. The number trained shall be determined on the basis of the total number enrolled on the contract for a significant period.

Only trainees or apprentices registered in a program approved by the State of California's State Administrator of Apprenticeship may be employed on the project and said trainees or apprentices shall be paid the standard wage specified under the regulations of the craft or trade at which they are employed.

The Contractor shall furnish the trainee or apprentice a copy of the program he will follow in providing the training. The Contractor shall provide each trainee or apprentice with a certification showing the type and length of training satisfactorily completed.

The Contractor will provide for the maintenance of records and furnish periodic reports documenting his performance under this Training Special Provision.