


**** WARNING ** WARNING ** WARNING ** WARNING ****
This document is intended for informational purposes only.

Users are cautioned that Caltrans does not assume any liability or responsibility based on these electronic files or for any defective or incomplete copying, excerpting, scanning, faxing or downloading of the contract documents. As always, for the official paper versions of the bidders and non-bidder packages, write to the California Department of Transportation, Plans and Bid Documents, Room 0200, P.O. Box 942874, Sacramento, CA 94272-0001, telephone (916) 654-4490 or fax (916) 654-7028. Office hours are 7:30 a.m. to 4:15 p.m. When ordering bidder or non-bidder packages it is important that you include a telephone and fax number, P.O. Box and street address so that you can receive addenda.

Note: Addenda information is NOT included with the electronic documents available via electronic file transfer. Only bidder or non-bidder package holders listed with the Caltrans Plans and Bid Documents section as described above will receive addenda information.

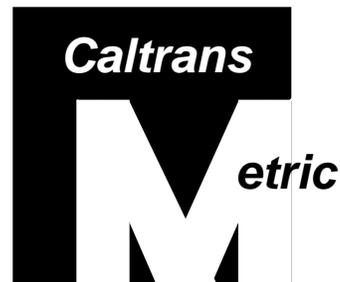

STATE OF CALIFORNIA

DEPARTMENT OF TRANSPORTATION

**NOTICE TO CONTRACTORS
AND**

SPECIAL PROVISIONS

FOR CONSTRUCTION ON STATE HIGHWAY IN

**LOS ANGELES COUNTY FROM 0.6 km EAST OF EASTERN AVENUE OVERCROSSING TO 0.7 km WEST OF
ROUTE 57/210/10 SEPARATION**

DISTRICT 07, ROUTE 10

**For Use in Connection with Standard Specifications Dated JULY 1999, Standard Plans Dated JULY 1999, and Labor
Surcharge and Equipment Rental Rates.**

CONTRACT NO. 07-4A1704

07-LA-10-33.0/67.6

Bids Open: May 31, 2001
Dated: April 30, 2001

IMPORTANT SPECIAL NOTICES

- **Payment Bonds**

Attention is directed to Section 5 of the Special Provisions, regarding contract bonds. The payment bond shall be in a sum not less than one hundred percent of the total amount payable by the terms of the contract.

TABLE OF CONTENTS

NOTICE TO CONTRACTORS.....	1
COPY OF ENGINEER'S ESTIMATE	3
SPECIAL PROVISIONS	5
SECTION 1. SPECIFICATIONS AND PLANS	5
SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS.....	5
2-1.01 GENERAL.....	5
2-1.02 DISABLED VETERAN BUSINESS ENTERPRISE (DVBE).....	5
2-1.03 DVBE GOAL FOR THIS PROJECT.....	6
2-1.04 SUBMISSION OF DVBE INFORMATION	6
2-1.05 SMALL BUSINESS PREFERENCE.....	7
2-1.06 CALIFORNIA COMPANY PREFERENCE.....	8
SECTION 3. AWARD AND EXECUTION OF CONTRACT.....	8
SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES	9
SECTION 5. GENERAL	9
SECTION 5-1. MISCELLANEOUS	9
5-1.01 PLANS AND WORKING DRAWINGS	9
5-1.011 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK	9
5-1.012 DIFFERING SITE CONDITIONS.....	9
5-1.015 LABORATORY	10
5-1.017 CONTRACT BONDS	10
5-1.018 EXCAVATION SAFETY PLANS	10
5-1.019 COST REDUCTION INCENTIVE.....	11
5-1.02 LABOR NONDISCRIMINATION	11
5-1.03 INTEREST ON PAYMENTS	11
5-1.031 FINAL PAYMENT AND CLAIMS.....	11
5-1.04 PUBLIC SAFETY	12
5-1.05 SURFACE MINING AND RECLAMATION ACT.....	13
5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES.....	13
5-1.07 YEAR 2000 COMPLIANCE.....	13
5-1.08 SUBCONTRACTOR AND DVBE RECORDS.....	13
5-1.086 PERFORMANCE OF DVBE SUBCONTRACTORS AND SUPPLIERS	13
5-1.09 SUBCONTRACTING.....	14
5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS	14
5-1.11 PARTNERING	14
5-1.12 AREAS FOR CONTRACTOR'S USE	15
5-1.13 PAYMENTS.....	15
5-1.14 SOUND CONTROL REQUIREMENTS.....	15
SECTION 6. (BLANK).....	15
SECTION 7. (BLANK).....	15
SECTION 8. MATERIALS	15
SECTION 8-1. MISCELLANEOUS	15
8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS	15
8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS	21
8-1.03 ASPHALT	26
8-1.04 SLAG AGGREGATE.....	28
SECTION 8-2. CONCRETE.....	28
8-2.01 PORTLAND CEMENT CONCRETE.....	28
SECTION 8-3. (BLANK)	38
SECTION 9. (BLANK).....	38
SECTION 10. CONSTRUCTION DETAILS.....	38
SECTION 10-1. GENERAL	38
10-1.01 ORDER OF WORK.....	38
10-1.02 WATER POLLUTION CONTROL.....	38
WATER POLLUTION CONTROL PROGRAM PREPARATION, APPROVAL AND UPDATES.....	39

WPCP IMPLEMENTATION	40
MAINTENANCE	40
PAYMENT	41
10-1.03 PROGRESS SCHEDULE	41
10-1.04 CONSTRUCTION AREA TRAFFIC CONTROL DEVICES	41
10-1.05 CONSTRUCTION AREA SIGNS	42
10-1.06 MAINTAINING TRAFFIC.....	42
10-1.07 CLOSURE REQUIREMENTS AND CONDITIONS	81
CLOSURE SCHEDULE	81
CONTINGENCY PLAN	81
LATE REOPENING OF CLOSURES	81
COMPENSATION	81
10-1.08 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE.....	82
STATIONARY LANE CLOSURE	82
MOVING LANE CLOSURE	82
PAYMENT	83
10-1.09 PORTABLE CHANGEABLE MESSAGE SIGN.....	83
10-1.10 TEMPORARY PAVEMENT DELINEATION	83
GENERAL	83
TEMPORARY LANELINE DELINEATION	84
TEMPORARY EDGELINE DELINEATION	84
10-1.11 TEMPORARY CRASH CUSHION MODULE.....	84
GENERAL	84
MATERIALS.....	84
INSTALLATION	85
MEASUREMENT AND PAYMENT	85
10-1.12 EXISTING HIGHWAY FACILITIES	85
REPAIR EXISTING ROADBED.....	86
REMOVE TRAFFIC STRIPE AND PAVEMENT MARKING	86
REMOVE ASPHALT CONCRETE DIKE	86
COLD PLANE ASPHALT CONCRETE PAVEMENT.....	87
10-1.13 FOG SEAL COAT.....	87
10-1.14 ASPHALT CONCRETE	87
10-1.15 REPLACE CONCRETE PAVEMENT (FAST SETTING HYDRAULIC CEMENT CONCRETE)	88
Fast Setting Hydraulic Cement Concrete.....	89
10-1.16 GRIND REPLACEMENT CONCRETE PAVEMENT.....	97
10-1.17 THERMOPLASTIC TRAFFIC STRIPE AND PAVEMENT MARKING	97
10-1.18 PAVEMENT MARKERS	98
SECTION 10-2. (BLANK)	98
SECTION 10-3. ELECTRICAL SYSTEMS	98
10-3.01 DESCRIPTION	98
10-3.02 CONDUIT	98
10-3.03 CONDUCTORS AND WIRING.....	98
10-3.04 DETECTORS	98
10-3.05 PAYMENT	98

STANDARD PLANS LIST

The Standard Plan sheets applicable to this contract include, but are not limited to those indicated below. The Revised Standard Plans (RSP) and New Standard Plans (NSP) which apply to this contract are included as individual sheets of the project plans.

A10A	Abbreviations
A10B	Symbols
A20A	Pavement Markers and Traffic Lines, Typical Details
A20B	Pavement Markers and Traffic Lines, Typical Details
A20C	Pavement Markers and Traffic Lines, Typical Details
A20D	Pavement Markers and Traffic Lines, Typical Details
A24A	Pavement Markings - Arrows
A24B	Pavement Markings - Arrows
A24D	Pavement Markings - Words
RSP T2	Temporary Crash Cushion, Sand Filled (Shoulder Installations)
T3	Temporary Railing (Type K)
T10	Traffic Control System for Lane Closure On Freeways and Expressways
T14	Traffic Control System for Ramp Closure
T15	Traffic Control System for Moving Lane Closure On Multilane Highways
RS1	Roadside Signs, Typical Installation Details No. 1
RS2	Roadside Signs - Wood Post, Typical Installation Details No. 2
RS4	Roadside Signs, Typical Installation Details No. 4
ES-1A	Signal, Lighting and Electrical Systems - Symbols and Abbreviations
ES-1B	Signal, Lighting and Electrical Systems - Symbols and Abbreviations
ES-5A	Signal, Lighting and Electrical Systems - Detectors
ES-5B	Signal, Lighting and Electrical Systems - Detectors
ES-5E	Signal, Lighting and Electrical Systems - Detectors
ES-13A	Signal, Lighting and Electrical Systems - Splicing Details

State Project with DVBE Goals (06-14-00)

DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS

CONTRACT NO. 07-4A1704

07-LA-10-33.0/67.6

Sealed proposals for the work shown on the plans entitled:

Contract No. 07-4A1704

**STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROJECT PLANS FOR CONSTRUCTION
ON STATE HIGHWAY IN LOS ANGELES COUNTY FROM 0.6 km EAST OF EASTERN AVENUE
OVERCROSSING TO 0.7 km WEST OF ROUTE 57/210/10 SEPARATION**

will be received at the Department of Transportation, 3347 Michelson Drive, Suite 100, Irvine, CA 92612-1692, until 2 o'clock p.m. on May 31, 2001, at which time they will be publicly opened and read in Room C - 1116 at the same address.

Proposal forms for this work are included in a separate book entitled:

**STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROPOSAL AND CONTRACT FOR
CONSTRUCTION ON STATE HIGHWAY IN LOS ANGELES COUNTY FROM 0.6 km EAST OF EASTERN
AVENUE OVERCROSSING TO 0.7 km WEST OF ROUTE 57/210/10 SEPARATION**

General work description: Replace concrete pavement with fast setting hydraulic cement concrete and cold plane and place asphalt concrete.

This project has a goal of 3 percent disabled veteran business enterprise (DVBE) participation.

No prebid meeting is scheduled for this project.

Bids are required for the entire work described herein.

At the time this contract is awarded, the Contractor shall possess either a Class A license or one of the following Class C licenses: C-8, C-12.

The Contractor must also be properly licensed at the time the bid is submitted, except that on a joint venture bid a joint venture license may be obtained by a combination of licenses after bid opening but before award in conformance with Business and Professions Code, Section 7029.1.

This contract is subject to state contract nondiscrimination and compliance requirements pursuant to Government Code, Section 12990.

Preference will be granted to bidders properly certified as a "Small Business" as determined by the Department of General Services, Office of Small Business Certification and Resources at the time of bid opening in conformance with the provisions in Section 2-1.05, "Small Business Preference," of the special provisions, and Section 1896 et seq, Title 2, California Code of Regulations. A form for requesting a "Small Business" preference is included with the bid documents. Applications for status as a "Small Business" must be submitted to the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814, Telephone No. (916) 322-5060.

A reciprocal preference will be granted to "California company" bidders in conformance with Section 6107 of the Public Contract Code. (See Sections 2 and 3 of the special provisions.) A form for indicating whether bidders are or are not a "California company" is included in the bid documents and is to be filled in and signed by all bidders.

Project plans, special provisions, and proposal forms for bidding this project can only be obtained at the Department of Transportation, Plans and Bid Documents, Room 0200, MS #26, Transportation Building, 1120 N Street, Sacramento, California 95814, FAX No. (916) 654-7028, Telephone No. (916) 654-4490. Use FAX orders to expedite orders for project plans, special provisions and proposal forms. FAX orders must include credit card charge number, card expiration date and authorizing signature. Project plans, special provisions, and proposal forms may be seen at the above Department of Transportation office and at the offices of the District Directors of Transportation at Irvine, Oakland, and the district in which the work is situated. Standard Specifications and Standard Plans are available through the State of California, Department of Transportation, Publications Unit, 1900 Royal Oaks Drive, Sacramento, CA 95815, Telephone No. (916) 445-3520.

Cross sections for this project are not available.

The successful bidder shall furnish a payment bond and a performance bond.

Pursuant to Section 1773 of the Labor Code, the general prevailing wage rates in the county, or counties, in which the work is to be done have been determined by the Director of the California Department of Industrial Relations. These wages are set forth in the General Prevailing Wage Rates for this project, available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated, and available from the California Department of Industrial Relations' Internet Web Site at: <http://www.dir.ca.gov>. Future effective general prevailing wage rates which have been predetermined and are on file with the Department of Industrial Relations are referenced but not printed in the general prevailing wage rates.

DEPARTMENT OF TRANSPORTATION

Deputy Director Transportation Engineering

Dated April 30, 2001

ASF

COPY OF ENGINEER'S ESTIMATE
(NOT TO BE USED FOR BIDDING PURPOSES)

07-4A1704

Item	Item Code	Item	Unit of Measure	Estimated Quantity
1 (S)	120090	CONSTRUCTION AREA SIGNS	LS	LUMP SUM
2 (S)	120100	TRAFFIC CONTROL SYSTEM	LS	LUMP SUM
3	150714	REMOVE THERMOPLASTIC TRAFFIC STRIPE	M	21 600
4	021232	REMOVE YELLOW THERMOPLASTIC TRAFFIC STRIPE	M	7200
5	150715	REMOVE THERMOPLASTIC PAVEMENT MARKING	M2	1900
6	150771	REMOVE ASPHALT CONCRETE DIKE	M	1360
7 (S)	153103	COLD PLANE ASPHALT CONCRETE PAVEMENT	M2	47 000
8	374002	ASPHALTIC EMULSION (FOG SEAL COAT)	TONN	70
9	390103	ASPHALT CONCRETE (TYPE B)	TONN	2440
10	390106	ASPHALT CONCRETE (OPEN GRADED)	TONN	3820
11	394040	PLACE ASPHALT CONCRETE DIKE (TYPE A)	M	1360
12	021233	REPLACE CONCRETE PAVEMENT (FSHCC)	M3	390
13 (S)	420201	GRIND EXISTING CONCRETE PAVEMENT	M2	1700
14 (S)	840515	THERMOPLASTIC PAVEMENT MARKING	M2	1370
15 (S)	840561	100 MM THERMOPLASTIC TRAFFIC STRIPE	M	166 000
16 (S)	840563	200 MM THERMOPLASTIC TRAFFIC STRIPE	M	4240
17 (S)	840564	200 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 3.66 M - 0.92 M)	M	720
18 (S)	840570	100 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 10.98 M - 3.66 M)	M	670
19 (S)	840571	100 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 5.18 M - 2.14 M)	M	870
20 (S)	850101	PAVEMENT MARKER (NON-REFLECTIVE)	EA	190

Item	Item Code	Item	Unit of Measure	Estimated Quantity
21 (S)	850111	PAVEMENT MARKER (RETROREFLECTIVE)	EA	3190
22 (S)	860810	INDUCTIVE LOOP DETECTOR	EA	120

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISIONS

Annexed to Contract No. 07-4A1704

SECTION 1. SPECIFICATIONS AND PLANS

The work embraced herein shall conform to the provisions in the Standard Specifications dated July 1999, and the Standard Plans dated July 1999, of the Department of Transportation insofar as the same may apply, and these special provisions.

Amendments to the Standard Specifications set forth in these special provisions shall be considered as part of the Standard Specifications for the purposes set forth in Section 5-1.04, "Coordination and Interpretation of Plans, Standard Specifications and Special Provisions," of the Standard Specifications. Whenever either the term "Standard Specifications is amended" or the term "Standard Specifications are amended" is used in the special provisions, the indented text or table following the term shall be considered an amendment to the Standard Specifications. In case of conflict between such amendments and the Standard Specifications, the amendments shall take precedence over and be used in lieu of the conflicting portions.

In case of conflict between the Standard Specifications and these special provisions, the special provisions shall take precedence over and shall be used in lieu of the conflicting portions.

SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS

2-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 2, "Proposal Requirements and Conditions," of the Standard Specifications and these special provisions for the requirements and conditions which the bidder must observe in the preparation of the proposal form and the submission of the bid.

In addition to the subcontractors required to be listed in conformance with Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications, each proposal shall have listed therein the name and address of each DVBE subcontractor to be used for credit in meeting the goal, and to whom the bidder proposes to directly subcontract portions of the work. The list of subcontractors shall also set forth the portion of work that will be performed by each subcontractor listed. A sheet for listing the subcontractors is included in the Proposal.

The Bidder's Bond form mentioned in the last paragraph in Section 2-1.07, "Proposal Guaranty," of the Standard Specifications will be found following the signature page of the Proposal.

In conformance with Public Contract Code Section 7106, a Noncollusion Affidavit is included in the Proposal. Signing the Proposal shall also constitute signature of the Noncollusion Affidavit.

Submit request for substitution of an "or equal" item, and the data substantiating the request to the Department of Transportation, Construction Division Chief, 120 S. Spring Street, Room 232, Los Angeles, CA 90012, so that the request is received by the Department by close of business on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening.

2-1.02 DISABLED VETERAN BUSINESS ENTERPRISE (DVBE)

Section 10115 of the Public Contract Code requires the Department to implement provisions to establish a goal for Disabled Veterans Business Enterprise (DVBE) in contracts.

It is the policy of the Department that Disabled Veteran Business Enterprise (DVBE) shall have the maximum opportunity to participate in the performance of contracts financed solely with state funds. The Contractor shall ensure that DVBEs have the maximum opportunity to participate in the performance of this contract and shall take all necessary and reasonable steps for this assurance. The Contractor shall not discriminate on the basis of race, color, national origin, or sex in the award and performance of subcontracts. Failure to carry out the requirements of this paragraph shall constitute a breach of contract and may result in termination of this contract or other remedy the Department may deem appropriate.

Bidder's attention is directed to the following:

- A. "Disabled Veteran Business Enterprise" (DVBE) means a business concern certified as a DVBE by the Office of Small Business Certification and Resources, Department of General Services.
- B. A DVBE may participate as a prime contractor, subcontractor, joint venture partner with a prime or subcontractor, or vendor of material or supplies.
- C. Credit for DVBE prime contractors will be 100 percent.
- D. A DVBE joint venture partner must be responsible for specific contract items of work, or portions thereof. Responsibility means actually performing, managing and supervising the work with its own forces. The DVBE joint venture partner must share in the ownership, control, management responsibilities, risks and profits of the joint venture. The DVBE joint venturer must submit the joint venture agreement with the Caltrans Bidder DVBE Information form required in Section 2-1.04, "Submission of DVBE Information," elsewhere in these special provisions.
- E. A DVBE must perform a commercially useful function, i.e., must be responsible for the execution of a distinct element of the work and must carry out its responsibility by actually performing, managing and supervising the work.
- F. Credit for DVBE vendors of materials or supplies is limited to 60 percent of the amount to be paid to the vendor for the material unless the vendor manufactures or substantially alters the goods.
- G. Credit for trucking by DVBEs will be as follows:
 - 1. One hundred percent of the amount to be paid when a DVBE trucker will perform the trucking with his/her own trucks, tractors and employees.
 - 2. Twenty percent of the amount to be paid to DVBE trucking brokers who do not have a "certified roster."
 - 3. One hundred percent of the amount to be paid to DVBE trucking brokers who have signed agreements that all trucking will be performed by DVBE truckers if credit is toward the DVBE goal, a "certified roster" showing that all trucks are owned by DVBEs, and a signed statement on the "certified roster" that indicates that 100 percent of revenue paid by the broker will be paid to the DVBEs listed on the "certified roster."
 - 4. Twenty percent of the amount to be paid to trucking brokers who are not a DVBE but who have signed agreements with DVBE truckers assuring that at least 20 percent of the trucking will be performed by DVBE truckers if credit is toward the DVBE goal, a "certified roster" showing that at least 20 percent of the number of trucks are owned by DVBE truckers, and a signed statement on the "certified roster" that indicates that at least 20 percent of the revenue paid by the broker will be paid to the DVBEs listed on the "certified roster."

The "certified roster" referred to herein shall conform to the requirements in Section 2-1.04, "Submission Of DVBE Information," elsewhere in these special provisions.

- H. DVBEs and DVBE joint venture partners must be certified DVBEs as determined by the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814, on the date bids for the project are opened before credit may be allowed toward the DVBE goal. It is the Contractor's responsibility to verify that DVBEs are certified.
- I. Noncompliance by the Contractor with these requirements constitutes a breach of this contract and may result in termination of the contract or other appropriate remedy for a breach of this contract.

2-1.03 DVBE GOAL FOR THIS PROJECT

The Department has established the following goal for Disabled Veteran Business Enterprise (DVBE) participation for this project:

Disabled Veteran Business Enterprise (DVBE): 3 percent.

It is the bidder's responsibility to make a sufficient portion of the work available to subcontractors and suppliers and to select those portions of the work or material needs consistent with the available DVBE subcontractors and suppliers, so as to assure meeting the goal for DVBE participation.

The Office of Small Business Certification and Resources, Department of General Services, may be contacted at (916) 322-5060 or visit their internet web site at <http://www.osmb.dgs.ca.gov/> for program information and certification status. The Department's Business Enterprise Program may also be contacted at (916) 227-9599 or the internet web site at <http://www.dot.ca.gov/hq/bep/>.

2-1.04 SUBMISSION OF DVBE INFORMATION

The required DVBE information shall be submitted on the "CALTRANS BIDDER - DVBE INFORMATION" form included in the Proposal. If this information is not submitted with the bid, the DVBE information forms shall be removed from the documents prior to submitting the bid.

It is the bidder's responsibility to make enough work available to DVBEs and to select those portions of the work or material needs consistent with the available DVBEs to meet the goal for DVBE participation or to provide information to establish that, prior to bidding, the bidder made adequate good faith efforts to do so.

If the DVBE information is not submitted with the bid, the apparent successful bidder (low bidder), the second low bidder and the third low bidder shall submit the DVBE information to the Department of Transportation, 1120 N Street, Room 0200, MS #26, Sacramento, California 95814 so the information is received by the Department no later than 4:00 p.m. on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening. DVBE information sent by U.S. Postal Service certified mail with return receipt and certificate of mailing and mailed on or before the third day, not including Saturdays, Sundays and legal holidays, following bid opening will be accepted even if it is received after the fourth day following bid opening. Failure to submit the required DVBE information by the time specified will be grounds for finding the bid or proposal nonresponsive. Other bidders need not submit DVBE information unless requested to do so by the Department.

The bidder's DVBE information shall establish that good faith efforts to meet the DVBE goal have been made. To establish good faith efforts, the bidder shall demonstrate that the goal will be met or that, prior to bidding, adequate good faith efforts to meet the goal were made.

Bidders are cautioned that even though their submittal indicates they will meet the stated DVBE goal, their submittal should also include their adequate good faith efforts information along with their DVBE goal information to protect their eligibility for award of the contract in the event the Department, in its review, finds that the goal has not been met.

The bidder's DVBE information shall include the names of DVBE firms that will participate, with a complete description of work or supplies to be provided by each, the dollar value of each DVBE transaction, and a written confirmation from the DVBE that it is participating in the contract. A copy of the DVBE's quote will serve as written confirmation that the DVBE is participating in the contract. When 100 percent of a contract item of work is not to be performed or furnished by a DVBE, a description of the exact portion of that work to be performed or furnished by that DVBE shall be included in the DVBE information, including the planned location of that work. The work that a DVBE prime contractor has committed to performing with its own forces as well as the work that it has committed to be performed by DVBE subcontractors, suppliers and trucking companies will count toward the goal.

If credit for trucking by a DVBE trucking broker is shown on the bidder's information as 100 percent of the revenue to be paid by the broker is to be paid to DVBE truckers, a "certified roster" of the broker's trucks to be used must be included. The "certified roster" must indicate that all the trucks are owned by certified DVBEs and must show the DVBE truck numbers, owner's name, Public Utilities Commission Cal-T numbers, and the DVBE certification numbers. The roster must indicate that all revenue paid by the broker will be paid to DVBEs listed on the "certified roster".

If credit for trucking by a trucking broker who is not a DVBE is shown in the bidder's information, a "certified roster" of the broker's trucks to be used must be included. The "certified roster" must indicate that at least 20 percent of the broker's trucks are owned by certified DVBEs and must show the DVBE truck numbers, owner's name, Public Utilities Commission Cal-T numbers, and the DVBE certification number. The roster must indicate that at least 20 percent of the revenue paid by the broker will be paid to DVBEs listed on the "certified roster".

A bidder shall be deemed to have made good faith efforts upon submittal, within time limits specified by the Department, of documentary evidence that all of the following actions were taken:

- A. Contact was made with the Office of Small Business Certification and Resources (OSBCR), Department of General Services or their web site at <http://www.osmb.dgs.ca.gov/> to identify Disabled Veteran Business Enterprises.
- B. Advertising was published in trade media and media focusing on Disabled Veteran Business Enterprises, unless time limits imposed by the Department do not permit that advertising.
- C. Invitations to bid were submitted to potential Disabled Veteran Business Enterprise contractors.
- D. Available Disabled Veteran Business Enterprises were considered.

2-1.05 SMALL BUSINESS PREFERENCE

Attention is directed to "Award and Execution of Contract" of these special provisions.

Attention is also directed to the Small Business Procurement and Contract Act, Government Code Section 14835, et seq and Title 2, California Code of Regulations, Section 1896, et seq.

Bidders who wish to be classified as a Small Business under the provisions of those laws and regulations, shall be certified as Small Business by the Department of General Services, Office of Small Business Certification and Resources, 1531 "I" Street, Second Floor, Sacramento, CA 95814.

To request Small Business Preference, bidders shall fill out and sign the Request for Small Business Preference form in the Proposal and shall attach a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form. The bidder's signature on the Request for Small Business Preference certifies, under penalty of perjury, that the bidder is certified as Small Business at the time of bid opening and further certifies, under penalty of perjury, that under the following conditions, at least 50 percent of the subcontractors to be utilized on the project are either

certified Small Business or have applied for Small Business certification by bid opening date and are subsequently granted Small Business certification.

The conditions requiring the aforementioned 50 percent level of subcontracting by Small Business subcontractors apply if:

- A. The lowest responsible bid for the project exceeds \$100,000; and
- B. The project work to be performed requires a Class A or a Class B contractor's license; and
- C. Two or more subcontractors will be used.

If the above conditions apply and Small Business Preference is granted in the award of the contract, the 50 percent Small Business subcontractor utilization level shall be maintained throughout the life of the contract.

2-1.06 CALIFORNIA COMPANY PREFERENCE

Attention is directed to "Award and Execution of Contract" of these special provisions.

In conformance with the requirements of Section 6107 of the Public Contract Code, a "California company" will be granted a reciprocal preference for bid comparison purposes as against a nonresident contractor from any state that gives or requires a preference to be given contractors from that state on its public entity construction contracts.

A "California company" means a sole proprietorship, partnership, joint venture, corporation, or other business entity that was a licensed California contractor on the date when bids for the public contract were opened and meets one of the following:

- A. Has its principal place of business in California.
- B. Has its principal place of business in a state in which there is no local contractor preference on construction contracts.
- C. Has its principal place of business in a state in which there is a local contractor construction preference and the contractor has paid not less than \$5000 in sales or use taxes to California for construction related activity for each of the five years immediately preceding the submission of the bid.

To carry out the "California company" reciprocal preference requirements of Section 6107 of the Public Contract Code, all bidders shall fill out and sign the California Company Preference form in the Proposal. The bidder's signature on the California Company Preference form certifies, under penalty of perjury, that the bidder is or is not a "California company" and if not, the amount of the preference applied by the state of the nonresident Contractor.

A nonresident Contractor shall disclose any and all bid preferences provided to the nonresident Contractor by the state or country in which the nonresident Contractor has its principal place of business.

Proposals without the California Company Preference form filled out and signed may be rejected.

SECTION 3. AWARD AND EXECUTION OF CONTRACT

The bidder's attention is directed to the provisions in Section 3, "Award and Execution of Contract," of the Standard Specifications and these special provisions for the requirements and conditions concerning award and execution of contract.

The award of the contract, if it be awarded, will be to the lowest responsible bidder whose proposal complies with all the requirements prescribed and who has met the goal for DVBE participation or has demonstrated, to the satisfaction of the Department, adequate good faith efforts to do so. Meeting the goal for DVBE participation or demonstrating, to the satisfaction of the Department, adequate good faith efforts to do so is a condition for being eligible for award of contract.

A "Payee Data Record" form will be included in the contract documents to be executed by the successful bidder. The purpose of the form is to facilitate the collection of taxpayer identification data. The form shall be completed and returned to the Department by the successful bidder with the executed contract and contract bonds. For the purposes of the form, payee shall be deemed to mean the successful bidder. The form is not to be completed for subcontractors or suppliers. Failure to complete and return the "Payee Data Record" form to the Department as provided herein will result in the retention of 20 percent of payments due the contractor and penalties of up to \$20,000. This retention of payments for failure to complete the "Payee Data Record" form is in addition to any other retention of payments due the Contractor.

Attention is also directed to "Small Business Preference" of these special provisions. Any bidder who is certified as a Small Business by the Department of General Services, Office of Small Business Certification and Resources will be allowed a preference in the award of this contract, if it be awarded, under the following conditions:

- A. The apparent low bidder is not certified as a Small Business, or has not filled out and signed the Request for Small Business Preference included with the bid documents and attached a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form; and

- B. The bidder filled out and signed the Request for Small Business Preference form included with the bid documents and attached a copy of their Office of Small Business Certification and Resources (OSBCR) small business certification letter to the form.

The small business preference will be a reduction in the bid submitted by the small business contractor, for bid comparison purposes, by an amount equal to 5 percent of the amount bid by the apparent low bidder, the amount not to exceed \$50,000. If this reduction results in the small business contractor becoming the low bidder, then the contract will be awarded to the small business contractor on the basis of the actual bid of the small business contractor notwithstanding the reduced bid price used for bid comparison purposes.

Attention is also directed to "California Company Preference" of these special provisions.

The amount of the California company reciprocal preference shall be equal to the amount of the preference applied by the state of the nonresident contractor with the lowest responsive bid, except where the "California company" is eligible for a California Small Business Preference, in which case the preference applied shall be the greater of the two, but not both.

If the bidder submitting the lowest responsive bid is not a "California company" and with the benefit of the reciprocal preference, a "California company's" responsive bid is equal to or less than the original lowest responsive bid, the "California company" will be awarded the contract at its submitted bid price except as provided below.

Small business bidders shall have precedence over nonsmall business bidders in that the application of the "California company" preference for which nonsmall business bidders may be eligible shall not result in the denial of the award to a small business bidder.

SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES

Attention is directed to the provisions in Section 8-1.03, "Beginning of Work," in Section 8-1.06, "Time of Completion," and in Section 8-1.07, "Liquidated Damages," of the Standard Specifications and these special provisions.

The Contractor shall begin work within 15 calendar days after the contract has been approved by the Attorney General or the attorney appointed and authorized to represent the Department of Transportation.

This work shall be diligently prosecuted to completion before the expiration of **130 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$400 per day, for each and every calendar day's delay in finishing the work in excess of the number of working days prescribed above.

SECTION 5. GENERAL

SECTION 5-1. MISCELLANEOUS

5-1.01 PLANS AND WORKING DRAWINGS

When the specifications require working drawings to be submitted to the Division of Structure Design, the drawings shall be submitted to: Division of Structure Design, Documents Unit, Mail Station 9, 1801 30th Street, Sacramento, CA 95816, Telephone 916 227-8252.

5-1.011 EXAMINATION OF PLANS, SPECIFICATIONS, CONTRACT, AND SITE OF WORK

The second paragraph of Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," of the Standard Specifications is amended to read:

- Where the Department has made investigations of site conditions, including subsurface conditions in areas where work is to be performed under the contract, or in other areas, some of which may constitute possible local material sources, bidders or Contractors may, upon written request, inspect the records of the Department as to those investigations subject to and upon the conditions hereinafter set forth.

Attention is directed to "Differing Site Conditions" of these special provisions regarding physical conditions at the site which may differ from those indicated in "Materials Information," log of test borings or other geotechnical information obtained by the Department's investigation of site conditions.

5-1.012 DIFFERING SITE CONDITIONS

Attention is directed to Section 5-1.116, "Differing Site Conditions," of the Standard Specifications.

During the progress of the work, if subsurface or latent conditions are encountered at the site differing materially from those indicated in the "Materials Information," log of test borings, other geotechnical data obtained by the Department's investigation of subsurface conditions, or an examination of the conditions above ground at the site, the party discovering those conditions shall promptly notify the other party in writing of the specific differing conditions before they are disturbed and before the affected work is performed.

The Contractor will be allowed 15 days from the notification of the Engineer's determination of whether or not an adjustment of the contract is warranted, in which to file a notice of potential claim in conformance with the provisions of Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications and as specified herein; otherwise the decision of the Engineer shall be deemed to have been accepted by the Contractor as correct. The notice of potential claim shall set forth in what respects the Contractor's position differs from the Engineer's determination and provide any additional information obtained by the Contractor, including but not limited to additional geotechnical data. The notice of potential claim shall be accompanied by the Contractor's certification that the following were made in preparation of the bid: a review of the contract, a review of the "Materials Information," a review of the log of test borings and other records of geotechnical data to the extent they were made available to bidders prior to the opening of bids, and an examination of the conditions above ground at the site. Supplementary information, obtained by the Contractor subsequent to the filing of the notice of potential claim, shall be submitted to the Engineer in an expeditious manner.

5-1.015 LABORATORY

When a reference is made in the specifications to the "Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations of the Department of Transportation, or established laboratories of the various Districts of the Department, or other laboratories authorized by the Department to test materials and work involved in the contract. When a reference is made in the specifications to the "Transportation Laboratory," the reference shall mean the Division of Materials Engineering and Testing Services and the Division of Structural Foundations, located at 5900 Folsom Boulevard, Sacramento, CA 95819, Telephone (916) 227-7000.

5-1.017 CONTRACT BONDS

Attention is directed to Section 3-1.02, "Contract Bonds," of the Standard Specifications and these special provisions.

The payment bond shall be in a sum not less than one hundred percent of the total amount payable by the terms of the contract.

5-1.018 EXCAVATION SAFETY PLANS

Section 5-1.02A, "Trench Excavation Safety Plans," of the Standard Specifications is amended to read:

5-1.02A Excavation Safety Plans

- The Construction Safety Orders of the Division of Occupational Safety and Health shall apply to all excavations. For all excavations 1.5 m or more in depth, the Contractor shall submit to the Engineer a detailed plan showing the design and details of the protective systems to be provided for worker protection from the hazard of caving ground during excavation. The detailed plan shall include any tabulated data and any design calculations used in the preparation of the plan. Excavation shall not begin until the detailed plan has been reviewed and approved by the Engineer.
- Detailed plans of protective systems for which the Construction Safety Orders require design by a registered professional engineer shall be prepared and signed by an engineer who is registered as a Civil Engineer in the State of California, and shall include the soil classification, soil properties, soil design calculations that demonstrate adequate stability of the protective system, and any other design calculations used in the preparation of the plan.
- No plan shall allow the use of a protective system less effective than that required by the Construction Safety Orders.
- If the detailed plan includes designs of protective systems developed only from the allowable configurations and slopes, or Appendices, contained in the Construction Safety Orders, the plan shall be submitted at least 5 days before the Contractor intends to begin excavation. If the detailed plan includes designs of protective systems developed from tabulated data, or designs for which design by a registered professional engineer is required, the plan shall be submitted at least 3 weeks before the Contractor intends to begin excavation.
- Attention is directed to Section 7-1.01E, "Trench Safety."

The third paragraph of Section 19-1.02, "Preservation of Property," of the Standard Specifications is amended to read:

- In addition to the provisions in Sections 5-1.02, "Plans and Working Drawings," and 5-1.02A, "Excavation Safety Plans," detailed plans of the protective systems for excavations on or affecting railroad property will be reviewed for adequacy of protection provided for railroad facilities, property, and traffic. These plans shall be submitted at least 9 weeks before the Contractor intends to begin excavation requiring the protective systems. Approval by the Engineer of the detailed plans for the protective systems will be contingent upon the plans being satisfactory to the railroad company involved.

5-1.019 COST REDUCTION INCENTIVE

Attention is directed to Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

Prior to preparing a cost reduction proposal, the Contractor shall request a meeting with the Engineer to discuss the proposal in concept and to determine the merit of the cost reduction proposal. Items of discussion will also include permit issues, impact on other projects, impact on the project schedule, peer reviews, and review times required by the Department and other agencies.

5-1.02 LABOR NONDISCRIMINATION

Attention is directed to the following Notice that is required by Chapter 5 of Division 4 of Title 2, California Code of Regulations.

NOTICE OF REQUIREMENT FOR NONDISCRIMINATION PROGRAM

(GOV. CODE, SECTION 12990)

Your attention is called to the "Nondiscrimination Clause", set forth in Section 7-1.01A(4), "Labor Nondiscrimination," of the Standard Specifications, which is applicable to all nonexempt State contracts and subcontracts, and to the "Standard California Nondiscrimination Construction Contract Specifications" set forth therein. The specifications are applicable to all nonexempt State construction contracts and subcontracts of \$5000 or more.

5-1.03 INTEREST ON PAYMENTS

Interest shall be payable on progress payments, payments after acceptance, final payments, extra work payments, and claim payments as follows:

- A. Unpaid progress payments, payment after acceptance, and final payments shall begin to accrue interest 30 days after the Engineer prepares the payment estimate.
- B. Unpaid extra work bills shall begin to accrue interest 30 days after preparation of the first pay estimate following receipt of a properly submitted and undisputed extra work bill. To be properly submitted, the bill must be submitted within 7 days of the performance of the extra work and in conformance with the provisions in Section 9-1.03C, "Records," and Section 9-1.06, "Partial Payments," of the Standard Specifications. An undisputed extra work bill not submitted within 7 days of performance of the extra work will begin to accrue interest 30 days after the preparation of the second pay estimate following submittal of the bill.
- C. The rate of interest payable for unpaid progress payments, payments after acceptance, final payments, and extra work payments shall be 10 percent per annum.
- D. The rate of interest payable on a claim, protest or dispute ultimately allowed under this contract shall be 6 percent per annum. Interest shall begin to accrue 61 days after the Contractor submits to the Engineer information in sufficient detail to enable the Engineer to ascertain the basis and amount of said claim, protest or dispute.

The rate of interest payable on any award in arbitration shall be 6 percent per annum if allowed under the provisions of Civil Code Section 3289.

5-1.031 FINAL PAYMENT AND CLAIMS

Attention is directed to Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications.

If the Contractor files a timely written statement of claims in response to the proposed final estimate, the District that administers the contract will submit a claim position letter to the Contractor by hand delivery or deposit in the U.S. mail within 135 days of acceptance of the contract. The claim position letter will delineate the District's position on the Contractor's claims. If the Contractor disagrees with the claim position letter, the Contractor shall submit a written notification of its disagreement to be received by the District not later than 15 days after the Contractor's receipt of the claim position letter. The written notification of disagreement shall set forth the basis for the Contractor's disagreement and be submitted to the office designated in the claim position letter. The Contractor's failure to provide a timely, written notification of disagreement shall constitute the Contractor's acceptance and agreement with the determinations provided in the claim position letter and with final payment pursuant to the claim position letter.

If the Contractor files a timely notification of disagreement with the District claim position letter, the board of review designated by the District Director to review claims that remain in dispute will meet with the Contractor within 45 days after receipt by the District of the notification of disagreement. Attendance by the Contractor at the board of review meeting shall be mandatory.

If the District fails to submit a claim position letter to the Contractor within 135 days after the acceptance of the contract and the Contractor has claims that remain in dispute, the Contractor may request a meeting with the person or board designated

by the District Director to review claims that remain in dispute. The Contractor's request for a meeting shall identify the claims that remain in dispute. If the Contractor files a request for a review meeting, the review person or board will meet with the Contractor within 45 days after the District receives the request for the meeting. Attendance by the Contractor at the District Director's board of review meeting shall be mandatory.

Failure of the Contractor to file a timely written statement of claims in response to the proposed final estimate, or to file a timely notification of disagreement with the District claim position letter, or to attend the District Director's board of review meeting shall constitute a failure to pursue diligently and exhaust the administrative procedures in the contract and shall be a bar to arbitration in conformance with the requirements in Section 10240.2 of the California Public Contract Code.

5-1.04 PUBLIC SAFETY

The Contractor shall provide for the safety of traffic and the public in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications and these special provisions.

The Contractor shall install temporary railing (Type K) between a lane open to public traffic and an excavation, obstacle or storage area when the following conditions exist:

- A. Excavations.—The near edge of the excavation is 3.6 m or less from the edge of the lane, except:
 - 1. Excavations covered with sheet steel or concrete covers of adequate thickness to prevent accidental entry by traffic or the public.
 - 2. Excavations less than 0.3-m deep.
 - 3. Trenches less than 0.3-m wide for irrigation pipe or electrical conduit, or excavations less than 0.3-m in diameter.
 - 4. Excavations parallel to the lane for the purpose of pavement widening or reconstruction.
 - 5. Excavations in side slopes, where the slope is steeper than 1:4 (vertical:horizontal).
 - 6. Excavations protected by existing barrier or railing.
- B. Temporarily Unprotected Permanent Obstacles.—The work includes the installation of a fixed obstacle together with a protective system, such as a sign structure together with protective railing, and the Contractor elects to install the obstacle prior to installing the protective system; or the Contractor, for the Contractor's convenience and with permission of the Engineer, removes a portion of an existing protective railing at an obstacle and does not replace such railing complete in place during the same day.
- C. Storage Areas.—Material or equipment is stored within 3.6 m of the lane and the storage is not otherwise prohibited by the provisions of the Standard Specifications and these special provisions.

The approach end of temporary railing (Type K), installed in conformance with the provisions in this section "Public Safety" and in Section 7-1.09, "Public Safety," of the Standard Specifications, shall be offset a minimum of 4.6 m from the edge of the traffic lane open to public traffic. The temporary railing shall be installed on a skew toward the edge of the traffic lane of not more than 0.3-m transversely to 3 m longitudinally with respect to the edge of the traffic lane. If the 4.6-m minimum offset cannot be achieved, the temporary railing shall be installed on the 10 to 1 skew to obtain the maximum available offset between the approach end of the railing and the edge of the traffic lane, and an array of temporary crash cushion modules shall be installed at the approach end of the temporary railing.

Temporary railing (Type K) shall conform to the provisions in Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications. Temporary railing (Type K), conforming to the details shown on 1999 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

Temporary crash cushion modules shall conform to the provisions in "Temporary Crash Cushion Module" of these special provisions.

Except for installing, maintaining and removing traffic control devices, whenever work is performed or equipment is operated in the following work areas, the Contractor shall close the adjacent traffic lane unless otherwise provided in the Standard Specifications and these special provisions:

Approach Speed of Public Traffic (Posted Limit) (Kilometers Per Hour)	Work Areas
Over 72 (45 Miles Per Hour)	Within 1.8 m of a traffic lane but not on a traffic lane
56 to 72 (35 to 45 Miles Per Hour)	Within 0.9-m of a traffic lane but not on a traffic lane

The lane closure provisions of this section shall not apply if the work area is protected by permanent or temporary railing or barrier.

When traffic cones or delineators are used to delineate a temporary edge of a traffic lane, the line of cones or delineators shall be considered to be the edge of the traffic lane, however, the Contractor shall not reduce the width of an existing lane to less than 3 m without written approval from the Engineer.

When work is not in progress on a trench or other excavation that required closure of an adjacent lane, the traffic cones or portable delineators used for the lane closure shall be placed off of and adjacent to the edge of the traveled way. The spacing of the cones or delineators shall be not more than the spacing used for the lane closure.

Suspended loads or equipment shall not be moved nor positioned over public traffic or pedestrians.

Full compensation for conforming to the provisions in this section "Public Safety," including furnishing and installing temporary railing (Type K) and temporary crash cushion modules, shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

5-1.05 SURFACE MINING AND RECLAMATION ACT

Attention is directed to the Surface Mining and Reclamation Act of 1975, commencing in Public Resources Code, Mining and Geology, Section 2710, which establishes regulations pertinent to surface mining operations, and to California Public Contract Code Section 10295.5.

Material from mining operations furnished for this project shall only come from permitted sites in compliance with California Public Contract Code Section 10295.5.

The requirements of this section shall apply to materials furnished for the project, except for acquisition of materials in conformance with the provisions in Section 4-1.05, "Use of Materials Found on the Work," of the Standard Specifications.

5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES

When the presence of asbestos or hazardous substances are not shown on the plans or indicated in the specifications and the Contractor encounters materials which the Contractor reasonably believes to be asbestos or a hazardous substance as defined in Section 25914.1 of the Health and Safety Code, and the asbestos or hazardous substance has not been rendered harmless, the Contractor may continue work in unaffected areas reasonably believed to be safe. The Contractor shall immediately cease work in the affected area and report the condition to the Engineer in writing.

In conformance with Section 25914.1 of the Health and Safety Code, removal of asbestos or hazardous substances including exploratory work to identify and determine the extent of the asbestos or hazardous substance will be performed by separate contract.

If delay of work in the area delays the current controlling operation, the delay will be considered a right of way delay and the Contractor will be compensated for the delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

5-1.07 YEAR 2000 COMPLIANCE

This contract is subject to Year 2000 Compliance for automated devices in the State of California.

Year 2000 compliance for automated devices in the State of California is achieved when embedded functions have or create no logical or mathematical inconsistencies when dealing with dates prior to and beyond 1999. The year 2000 is recognized and processed as a leap year. The product shall operate accurately in the manner in which the product was intended for date operation without requiring manual intervention.

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for all automated devices furnished for the project.

5-1.08 SUBCONTRACTOR AND DVBE RECORDS

The Contractor shall maintain records of all subcontracts entered into with certified DVBE subcontractors and records of materials purchased from certified DVBE suppliers. The records shall show the name and business address of each DVBE subcontractor or vendor and the total dollar amount actually paid each DVBE subcontractor or vendor.

Upon completion of the contract, a summary of these records shall be prepared on Form CEM-2402 (S) and certified correct by the Contractor or the Contractor's authorized representative, and shall be furnished to the Engineer.

5-1.086 PERFORMANCE OF DVBE SUBCONTRACTORS AND SUPPLIERS

The DVBEs listed by the Contractor in response to the provisions in Section 2-1.04, "Submission of DVBE Information," and Section 3, "Award and Execution of Contract," of these special provisions, which are determined by the Department to be certified DVBEs, shall perform the work and supply the materials for which they are listed, unless the Contractor has received prior written authorization to perform the work with other forces or to obtain the materials from other sources.

Authorization to utilize other forces or sources of materials may be requested for the following reasons:

- A. The listed DVBE, after having had a reasonable opportunity to do so, fails or refuses to execute a written contract, when the written contract, based upon the general terms, conditions, plans and specifications for the project, or on the terms of the subcontractor's or supplier's written bid, is presented by the Contractor.
- B. The listed DVBE becomes bankrupt or insolvent.
- C. The listed DVBE fails or refuses to perform the subcontract or furnish the listed materials.
- D. The Contractor stipulated that a bond was a condition of executing a subcontract and the listed DVBE subcontractor fails or refuses to meet the bond requirements of the Contractor.
- E. The work performed by the listed subcontractor is substantially unsatisfactory and is not in substantial conformance with the plans and specifications or the subcontractor is substantially delaying or disrupting the progress of the work.
- F. The listed DVBE subcontractor is not licensed pursuant to the Contractor's License Law.
- G. It would be in the best interest of the State.

The Contractor shall not be entitled to payment for the work or material unless it is performed or supplied by the listed DVBE or by other forces (including those of the Contractor) pursuant to prior written authorization of the Engineer.

5-1.09 SUBCONTRACTING

Attention is directed to the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, Section 2, "Proposal Requirements and Conditions," Section 2-1.04, "Submission of DVBE Information," and Section 3, "Award and Execution of Contract," of these special provisions and these special provisions.

Pursuant to the provisions in Section 1777.1 of the Labor Code, the Labor Commissioner publishes and distributes a list of contractors ineligible to perform work as a subcontractor on a public works project. This list of debarred contractors is available from the Department of Industrial Relations web site at:

<http://www.dir.ca.gov/DLSE/Debar.html>.

The DVBE information furnished under Section 3-1.01A, "DVBE Information," of these special provisions is in addition to the subcontractor information required to be furnished in Section 8-1.01, "Subcontracting," and Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications.

Section 10115 of the Public Contract Code requires the Department to implement provisions to establish a goal for Disabled Veteran Business Enterprise (DVBE) participation in highway contracts that are State funded. As a part of this requirement:

- A. No substitution of a DVBE subcontractor shall be made at any time without the written consent of the Department, and
- B. If a DVBE subcontractor is unable to perform successfully and is to be replaced, the Contractor shall make good faith efforts to replace the original DVBE subcontractor with another DVBE subcontractor.

The provisions in Section 2-1.02, "Disabled Veteran Business Enterprise (DVBE)," of these special provisions that DVBEs shall be certified on the date bids are opened does not apply to DVBE substitutions after award of the contract.

5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS

Attention is directed to the provisions in Sections 10262 and 10262.5 of the Public Contract Code and Section 7108.5 of the Business and Professions Code concerning prompt payment to subcontractors.

5-1.11 PARTNERING

The State will promote the formation of a "Partnering" relationship with the Contractor in order to effectively complete the contract to the benefit of both parties. The purpose of this relationship is to maintain a cooperative communication and to mutually resolve conflicts at the lowest responsible management level.

The Contractor may request the formation of a "Partnering" relationship by submitting a request in writing to the Engineer after approval of the contract. If the Contractor's request for "Partnering" is approved by the Engineer, scheduling of a "Partnering Workshop," selecting the "Partnering" facilitator and workshop site, and other administrative details shall be as agreed to by both parties. If agreed to by the parties, additional "Partnering Workshops" will be conducted as needed throughout the life of the contract.

The costs involved in providing the "Partnering Workshop" facilitator and workshop site will be borne equally by the State and the Contractor. The division of cost will be made by determining the cost in providing the "Partnering Workshop" facilitator and workshop site in conformance with the provisions in Section 9-1.03B, "Work Performed by Special Forces or

Other Special Services," of the Standard Specifications, and paying to the Contractor one-half of that cost, except no markups will be allowed.

All other costs associated with "Partnering Workshops" will be borne separately by the party incurring the costs, such as wages and travel expenses, and no additional compensation will be allowed therefor.

The establishment of a "Partnering" relationship will not change or modify the terms and conditions of the contract and will not relieve either party of the legal requirements of the contract.

5-1.12 AREAS FOR CONTRACTOR'S USE

Attention is directed to the provisions in Section 7-1.19, "Rights in Land and Improvements," of the Standard Specifications and these special provisions.

The highway right of way shall be used only for purposes that are necessary to perform the required work. The Contractor shall not occupy the right of way, or allow others to occupy the right of way, for purposes which are not necessary to perform the required work.

No State-owned parcels adjacent to the right of way are available for the exclusive use of the Contractor within the contract limits. The Contractor shall secure, at the Contractor's own expense, areas required for plant sites, storage of equipment or materials, or for other purposes.

5-1.13 PAYMENTS

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications and these special provisions.

No partial payment will be made for any materials on hand which are furnished but not incorporated in the work.

5-1.14 SOUND CONTROL REQUIREMENTS

Sound control shall conform to the provisions in Section 7-1.01I, "Sound Control Requirements," of the Standard Specifications and these special provisions.

The noise level from the Contractor's operations, between the hours of 9:00 p.m. and 7:00 a.m., shall not exceed 86 dbA at a distance of 15 m. This requirement shall not relieve the Contractor from responsibility for complying with local ordinances regulating noise level.

The noise level requirement shall apply to the equipment on the job or related to the job, including but not limited to trucks, transit mixers or transient equipment that may or may not be owned by the Contractor. The use of loud sound signals shall be avoided in favor of light warnings except those required by safety laws for the protection of personnel.

Full compensation for conforming to the requirements of this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

SECTION 6. (BLANK)

SECTION 7. (BLANK)

SECTION 8. MATERIALS

SECTION 8-1. MISCELLANEOUS

8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the United States Standard Measures which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following provisions:

- A. Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.
- B. Before other non-metric materials and products will be considered for use, the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish necessary information as required by the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision will be final.
- C. When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, the list of sources of material specified in Section 6-1.01, "Source of Supply and Quality of Materials," of the Standard Specification shall include a list of substitutions

Contract No. <Dist>-<Contract_No>

to be made and contract items involved. In addition, for a change in design or details, the Contractor shall submit plans and working drawings in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The plans and working drawings shall be submitted at least 7 days before the Contractor intends to begin the work involved.

Unless otherwise specified, the following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR SIZES OF HIGH STRENGTH STEEL FASTENERS

ASTM Designation: A 325M

METRIC SIZE SHOWN ON THE PLANS mm x thread pitch	SIZE TO BE SUBSTITUTED inch
M16 x 2	5/8
M20 x 2.5	3/4
M22 x 2.5	7/8
M24 x 3	1
M27 x 3	1-1/8
M30 x 3.5	1-1/4
M36 x 4	1-1/2

SUBSTITUTION TABLE FOR PLAIN WIRE REINFORCEMENT

ASTM Designation: A 82

METRIC SIZE SHOWN ON THE PLANS ² mm	SIZE TO BE SUBSTITUTED ² inch x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

SUBSTITUTION TABLE FOR BAR REINFORCEMENT

METRIC BAR DESIGNATION NUMBER ¹ SHOWN ON THE PLANS	BAR DESIGNATION NUMBER ² TO BE SUBSTITUTED
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

¹Bar designation numbers approximate the number of millimeters of the nominal diameter of the bars.

²Bar numbers are based on the number of eighths of an inch included in the nominal diameter of the bars.

No adjustment will be required in spacing or total number of reinforcing bars due to a difference in minimum yield strength between metric and non-metric bars.

SUBSTITUTION TABLE FOR SIZES OF:

(1) STEEL FASTENERS FOR GENERAL APPLICATIONS (ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55), and

(2) HIGH STRENGTH STEEL FASTENERS (ASTM Designation: A 325 or A 449)

METRIC SIZE SHOWN ON THE PLANS mm	SIZE TO BE SUBSTITUTED inch
6 or 6.35	1/4
8 or 7.94	5/16
10 or 9.52	3/8
11 or 11.11	7/16
13 or 12.70	1/2
14 or 14.29	9/16
16 or 15.88	5/8
19 or 19.05	3/4
22 or 22.22	7/8
24, 25, or 25.40	1
29 or 28.58	1-1/8
32 or 31.75	1-1/4
35 or 34.93	1-3/8
38 or 38.10	1-1/2
44 or 44.45	1-3/4
51 or 50.80	2
57 or 57.15	2-1/4
64 or 63.50	2-1/2
70 or 69.85	2-3/4
76 or 76.20	3
83 or 82.55	3-1/4
89 or 88.90	3-1/2
95 or 95.25	3-3/4
102 or 101.60	4

SUBSTITUTION TABLE FOR NOMINAL THICKNESS OF SHEET METAL

UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED SHEETS (GALVANIZED)	
METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch	METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch
7.94	0.3125	4.270	0.1681
6.07	0.2391	3.891	0.1532
5.69	0.2242	3.510	0.1382
5.31	0.2092	3.132	0.1233
4.94	0.1943	2.753	0.1084
4.55	0.1793	2.372	0.0934
4.18	0.1644	1.994	0.0785
3.80	0.1495	1.803	0.0710
3.42	0.1345	1.613	0.0635
3.04	0.1196	1.461	0.0575
2.66	0.1046	1.311	0.0516
2.28	0.0897	1.158	0.0456
1.90	0.0747	1.006 or 1.016	0.0396
1.71	0.0673	0.930	0.0366
1.52	0.0598	0.853	0.0336
1.37	0.0538	0.777	0.0306
1.21	0.0478	0.701	0.0276
1.06	0.0418	0.627	0.0247
0.91	0.0359	0.551	0.0217
0.84	0.0329	0.513	0.0202
0.76	0.0299	0.475	0.0187
0.68	0.0269	-----	-----
0.61	0.0239	-----	-----
0.53	0.0209	-----	-----
0.45	0.0179	-----	-----
0.42	0.0164	-----	-----
0.38	0.0149	-----	-----

SUBSTITUTION TABLE FOR WIRE

METRIC THICKNESS SHOWN ON THE PLANS mm	WIRE THICKNESS TO BE SUBSTITUTED inch	GAGE NO.
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

SUBSTITUTION TABLE FOR PIPE PILES

METRIC SIZE SHOWN ON THE PLANS mm x mm	SIZE TO BE SUBSTITUTED inch x inch
PP 360 x 4.55	NPS 14 x 0.179
PP 360 x 6.35	NPS 14 x 0.250
PP 360 x 9.53	NPS 14 x 0.375
PP 360 x 11.12	NPS 14 x 0.438
PP 406 x 12.70	NPS 16 x 0.500
PP 460 x T	NPS 18 x T"
PP 508 x T	NPS 20 x T"
PP 559 x T	NPS 22 x T"
PP 610 x T	NPS 24 x T"
PP 660 x T	NPS 26 x T"
PP 711 x T	NPS 28 x T"
PP 762 x T	NPS 30 x T"
PP 813 x T	NPS 32 x T"
PP 864 x T	NPS 34 x T"
PP 914 x T	NPS 36 x T"
PP 965 x T	NPS 38 x T"
PP 1016 x T	NPS 40 x T"
PP 1067 x T	NPS 42 x T"
PP 1118 x T	NPS 44 x T"
PP 1219 x T	NPS 48 x T"
PP 1524 x T	NPS 60 x T"

The thickness in millimeters (T) represents an exact conversion of the thickness in inches (T").

SUBSTITUTION TABLE FOR STRUCTURAL TIMBER AND LUMBER

METRIC MINIMUM DRESSED DRY, SHOWN ON THE PLANS mm x mm	METRIC MINIMUM DRESSED GREEN, SHOWN ON THE PLANS mm x mm	NOMINAL SIZE TO BE SUBSTITUTED inch x inch
19x89	20x90	1x4
38x89	40x90	2x4
64x89	65x90	3x4
89x89	90x90	4x4
140x140	143x143	6x6
140x184	143x190	6x8
184x184	190x190	8x8
235x235	241x241	10x10
286x286	292x292	12x12

SUBSTITUTION TABLE FOR NAILS AND SPIKES

METRIC COMMON NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC BOX NAIL, SHOWN ON THE PLANS Length, mm Diameter, mm	METRIC SPIKE, SHOWN ON THE PLANS Length, mm Diameter, mm	SIZE TO BE SUBSTITUTED Penny-weight
50.80 2.87	50.80 2.51	————	6d
63.50 3.33	63.50 2.87	————	8d
76.20 3.76	76.20 3.25	76.20 4.88	10d
82.55 3.76	82.55 3.25	82.55 4.88	12d
88.90 4.11	88.90 3.43	88.90 5.26	16d
101.60 4.88	101.60 3.76	101.60 5.72	20d
114.30 5.26	114.30 3.76	114.30 6.20	30d
127.00 5.72	127.00 4.11	127.00 6.68	40d
————	————	139.70 7.19	50d
————	————	152.40 7.19	60d

**SUBSTITUTION TABLE FOR IRRIGATION
COMPONENTS**

METRIC WATER METERS, TRUCK LOADING STANDPIPES, VALVES, BACKFLOW PREVENTERS, FLOW SENSORS, WYE STRAINERS, FILTER ASSEMBLY UNITS, PIPE SUPPLY LINES, AND PIPE IRRIGATION SUPPLY LINES SHOWN ON THE PLANS DIAMETER NOMINAL (DN) mm	NOMINAL SIZE TO BE SUBSTITUTED inch
15	1/2
20	3/4
25	1
32	1-1/4
40	1-1/2
50	2
65	2-1/2
75	3
100	4
150	6
200	8
250	10
300	12
350	14
400	16

Unless otherwise specified, substitutions of United States Standard Measures standard structural shapes corresponding to the metric designations shown on the plans and in conformance with the requirements in ASTM Designation: A 6/A 6M, Annex 2, will be allowed.

8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS

The Department maintains the following list of Prequalified and Tested Signing and Delineation Materials. The Engineer shall not be precluded from sampling and testing products on the list of Prequalified and Tested Signing and Delineation Materials.

The manufacturer of products on the list of Prequalified and Tested Signing and Delineation Materials shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each type of traffic product supplied.

For those categories of materials included in the list of Prequalified and Tested Signing and Delineation Materials, only those products shown within the listing may be used in the work. Other categories of products, not included in the list of Prequalified and Tested Signing and Delineation Materials, may be used in the work provided they conform to the requirements of the Standard Specifications.

Materials and products may be added to the list of Prequalified and Tested Signing and Delineation Materials if the manufacturer submits a New Product Information Form to the New Product Coordinator at the Transportation Laboratory. Upon a Departmental request for samples, sufficient samples shall be submitted to permit performance of required tests. Approval of materials or products will depend upon compliance with the specifications and tests the Department may elect to perform.

PAVEMENT MARKERS, PERMANENT TYPE

Retroreflective

- A. Apex, Model 921 (100 mm x 100 mm)
- B. Ray-O-Lite, Models SS (100 mm x 100 mm), RS (100 mm x 100 mm) and AA (100 mm x 100 mm)

- C. Stimsonite, Models 88 (100 mm x 100 mm), 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
- D. 3M Series 290 (89 mm x 100 mm)

Retroreflective With Abrasion Resistant Surface (ARS)

- A. Apex, Model 921AR (100 mm x 100 mm)
- B. Ray-O-Lite "AA" ARS (100 mm x 100 mm)
- C. Stimsonite, Models 911 (100 mm x 100 mm), 953 (70 mm x 114 mm)
- D. 3M Series 290 (89 mm x 100 mm)

Retroreflective With Abrasion Resistant Surface (ARS)

(Used for recessed applications)

- A. Stimsonite, Model 948 (58 mm x 119 mm)
- B. Ray-O-Lite, Model 2002 (58 mm x 117 mm)
- C. Stimsonite, Model 944SB (51 mm x 100 mm)*
- D. Ray-O-Lite, Model 2004 ARS (51 mm x 100 mm)*

*For use only in 114 mm wide (older) recessed slots

Non-Reflective For Use With Epoxy Adhesive, 100 mm Round

- A. Apex Universal (Ceramic)
- B. Highway Ceramics, Inc. (Ceramic)

Non-Reflective For Use With Bitumen Adhesive, 100 mm Round

- A. Alpine Products, "D-Dot" and "ANR" (ABS)
- B. Apex Universal (Ceramic)
- C. Apex Universal, Model 929 (ABS)
- D. Elgin Molded Plastics, "Empco-Lite" Model 900 (ABS)
- E. Highway Ceramics, Inc. (Ceramic)
- F. Hi-Way Safety, Inc., Models P20-2000W and 2001Y (ABS)
- G. Interstate Sales, "Diamond Back" (ABS) and (Polypropylene)
- H. Novabrite Models Adot-w (White) Adot-y (Yellow), (ABS)
- I. Road Creations, Model RCB4NR (Acrylic)
- J. Zumar Industries, "Titan TM40A" (ABS)

PAVEMENT MARKERS, TEMPORARY TYPE

Temporary Markers For Long Term Day/Night Use (6 months or less)

- A. Apex Universal, Model 924 (100 mm x 100 mm)
- B. Elgin Molded Plastics, "Empco-Lite" Model 901 (100 mm x 100 mm)
- C. Road Creations, Model R41C (100 mm x 100 mm)
- D. Vega Molded Products "Temporary Road Marker" (75 mm x 100 mm)

Temporary Markers For Short Term Day/Night Use (14 days or less)

(For seal coat or chip seal applications, clear protective covers are required)

- A. Apex Universal, Model 932
- B. Davidson Plastics, Models T.O.M., T.R.P.M., and "HH" (High Heat)
- C. Hi-Way Safety, Inc., Model 1280/1281

STRIPING AND PAVEMENT MARKING MATERIAL

Permanent Traffic Striping and Pavement Marking Tape

- A. Advanced Traffic Marking, Series 300 and 400
- B. Brite-Line, Series 1000
- C. Brite-Line "DeltaLine XRP"
- D. Swarco Industries, "Director 35" (For transverse application only)
- E. Swarco Industries, "Director 60"
- F. 3M, "Stamark" Series 380 and 5730
- G. 3M, "Stamark" Series 420 (For transverse application only)

Temporary (Removable) Striping and Pavement Marking Tape (6 months or less)

- A. Advanced Traffic Marking, Series 200
- B. Brite-Line, Series 100
- C. P.B. Laminations, Aztec, Grade 102
- D. Swarco Industries, "Director-2"
- E. 3M, "Stamark," Series 620
- F. 3M Series A145 Removable Black Line Mask
(Black Tape: For use only on Asphalt Concrete Surfaces)
- G. Advanced Traffic Marking Black "Hide-A-Line"
(Black Tape: For use only on Asphalt Concrete Surfaces)
- H. Brite-Line "BTR" Black Removable Tape
(Black Tape: For use only on Asphalt Concrete Surfaces)

Preformed Thermoplastic (Heated in place)

- A. Flint Trading, "Premark" and "Premark 20/20 Flex"
- B. Pavemark, "Hotape"

Removable Traffic Paint

- A. Belpro, Series 250/252 and No. 93 Remover

Ceramic Surfacing Laminate, 150 mm x 150 mm

- A. Safeline Industries/Highway Ceramics, Inc.

CLASS 1 DELINEATORS

One Piece Driveable Flexible Type, 1700 mm

- A. Carsonite, Curve-Flex CFRM-400
- B. Carsonite, Roadmarker CRM-375
- C. Davidson Plastics, "Flexi-Guide Models 400 and 566"
- D. FlexStake, Model 654 TM
- E. GreenLine Models HWD1-66 and CGD1-66
- F. J. Miller Industries, Model JMI-375 (with soil anchor)

Special Use Flexible Type, 1700 mm

- A. Carsonite, "Survivor" (with 450 mm U-Channel base)
- B. FlexStake, Model 604
- C. GreenLine Models HWD and CGD (with 450 mm U-Channel base)
- D. Safe-Hit with 200 mm pavement anchor (SH248-GP1)
- E. Safe-Hit with 380 mm soil anchor (SH248-GP2) and with 450 mm soil anchor (SH248-GP3)

Surface Mount Flexible Type, 1200 mm

- A. Bent Manufacturing Company, Masterflex Model MF-180EX-48
- B. Carsonite, "Super Duck II"
- C. FlexStake, Surface Mount, Models 704 and 754 TM

CHANNELIZERS

Surface Mount Type, 900 mm

- A. Bent Manufacturing Company, Masterflex Models MF-360-36 (Round) and MF-180-36 (Flat)
- B. Carsonite, "Super Duck" (Flat SDF-436, Round SDR-336)
- C. Carsonite, "Super Duck II" Model SDCF203601MB "The Channelizer"
- D. Davidson Plastics, Flex-Guide Models FG300LD and FG300UR
- E. FlexStake, Surface Mount, Models 703 and 753 TM
- F. GreenLine, Model SMD-36
- G. Hi-Way Safety, Inc. "Channel Guide Channelizer" Model CGC36
- H. The Line Connection, "Dura-Post" Model DP36-3 (Permanent)
- I. The Line Connection, "Dura-Post" Model DP36-3C (Temporary)
- J. Repo, Models 300 and 400
- K. Safe-Hit, Guide Post, Model SH236SMA

CONICAL DELINEATORS, 1070 mm

(For 700 mm Traffic Cones, see Standard Specifications)

- A. Bent Manufacturing Company "T-Top"
- B. Plastic Safety Systems "Navigator-42"
- C. Roadmaker Company "Stacker"
- D. Traffix Devices "Grabber"

OBJECT MARKERS

Type "K", 450 mm

- A. Carsonite, Model SMD-615
- B. FlexStake, Model 701 KM
- C. Repo, Models 300 and 400
- D. Safe-Hit, Model SH718SMA
- E. The Line Connection, Model DP21-4K

Type "K-4" / "Q" Object Markers, 600 mm

- A. Bent Manufacturing "Masterflex" Model MF-360-24
- B. Carsonite, Super Duck II
- C. FlexStake, Model 701KM
- D. Repo, Models 300 and 400
- E. Safe-Hit, Models SH8 24SMA_WA and SH8 24GP3_WA
- F. The Line Connection, Model DP21-4Q

TEMPORARY RAILING (TYPE K) REFLECTORS AND CONCRETE BARRIER MARKERS

Impactable Type

- A. ARTUK, "FB"
- B. Davidson Plastics, Model PCBM-12
- C. Duraflex Corp., "Flexx 2020" and "Electriflexx"
- D. Hi-Way Safety, Inc., Model GMKRM100

Non-Impactable Type

- A. ARTUK, JD Series
- B. Stimsonite, Model 967 (with 83 mm Acrylic cube corner reflector)
- C. Stimsonite, Model 967LS
- D. Vega Molded Products, Models GBM and JD

THREE BEAM BARRIER MARKERS

(For use to the left of traffic)

- A. Duraflex Corp., "Railrider"
- B. Davidson Plastics, "Mini" (75 mm x 254 mm)

CONCRETE BARRIER DELINEATORS, 400 mm

(For use to the right of traffic. When mounted on top of barrier, places top of reflective element at 1200 mm)

- A. Davidson Plastics, Model PCBM T-16
- B. Safe-Hit, Model SH216RBM
- C. Sun-Lab Technology, "Safety Guide Light, Model TM," 130 mm x 130 mm x 80 mm

CONCRETE BARRIER-MOUNTED MINI-DRUM (260 mm x 360 mm x 570 mm)

- A. Stinson Equipment Company "SaddleMarker"

SOUND WALL DELINEATOR

(Applied vertically. Place top of 75 mm x 300 mm reflective element at 1200 mm above roadway)

- A. Davidson Plastics, PCBM S-36
- B. Sun-Lab Technology, "Safety Guide Light, Model SM12," 130 mm x 130 mm x 80 mm

GUARD RAILING DELINEATOR

(Top of reflective element at 1200 mm above plane of roadway)

Wood Post Type, 686 mm

- A. Carsonite, Model 427
- B. Davidson Plastics FG 427 and FG 527
- C. FlexStake, Model 102 GR
- D. GreenLine GRD 27
- E. J.Miller Model JMI-375G
- F. Safe-Hit, Model SH227GRD

Steel Post Type

- A. Carsonite, Model CFGR-327 with CFGRBK300 Mounting Bracket

RETROREFLECTIVE SHEETING

Channelizers, Barrier Markers, and Delineators

- A. 3M, High Intensity
- B. Reflexite, PC-1000 Metalized Polycarbonate
- C. Reflexite, AC-1000 Acrylic
- D. Reflexite, AP-1000 Metalized Polyester
- E. Reflexite, AR-1000 Abrasion Resistant Coating
- F. Avery Dennison T-6500 Series (Formerly Stimsonite, Series 6200) (For rigid substrate devices only)

Traffic Cones, 330 mm Sleeves

- A. Reflexite SB (Polyester), Vinyl or "TR" (Semi-transparent)

Traffic Cones, 100 mm and 150 mm Sleeves

- A. 3M Series 3840
- B. Reflexite Vinyl, "TR" (Semi-transparent) or "Conformalite"

Barrels and Drums

- A. Reflexite, "Super High Intensity" or "High Impact Drum Sheeting"
- B. 3M Series 3810

Barricades: Type I, Engineer Grade

- A. American Decal, Adcolite
- B. Avery Dennison, T-1500 and T-1600
- C. 3M, Scotchlite, Series CW

Barricades: Type II, Super Engineer Grade

- A. Avery Dennison, T-2500 Series
- B. Kiwalite Type II
- C. Nikkalite 1800 Series

Signs: Type II, Super Engineer Grade

- A. Avery Dennison, T-2500 Series
- B. Kiwalite, Type II
- C. Nikkalite 1800 Series

Signs: Type III, High-Intensity Grade

- A. 3M Series 3800
- B. Nippon Carbide, Nikkalite Brand Ultralite Grade II

Signs: Type IV, High-Intensity Prismatic Grade

- A. Avery Dennison T-6500 (Formerly Stimsonite Series 6200)

Signs: Type VII, High-Intensity Prismatic Grade

- A. 3M Series 3900

Signs: Type VI, Roll-Up Signs

- A. Reflexite, Vinyl (Orange)
- B. Reflexite "SuperBright" (Fluorescent orange)
- C. Reflexite "Marathon" (Fluorescent orange)
- D. 3M Series RS34 (Orange) and RS20 (Fluorescent orange)

SPECIALTY SIGN (All Plastic)

- A. All Sign Products, STOP Sign, 750 mm

SIGN SUBSTRATE FOR CONSTRUCTION AREA SIGNS

Aluminum

Fiberglass Reinforced Plastic (FRP)

- A. Sequentia, "Polyplate"
- B. Fiber-Brite

8-1.03 ASPHALT

The first paragraph and tables following the first paragraph in Section 92-1.02, "Grades," of the Standard Specifications shall not apply.

The grade of asphalt to be used will be specified in "Asphalt Concrete" of these special provisions. The safe transportation, storage, use, and disposal of the asphalt specified shall be the responsibility of the Contractor.

A Certificate of Compliance, as specified in Section 92-1.03, "Test Report," of the Standard Specifications, shall accompany each shipment of asphalt to the project. When PBA Grade 6a, 6b or 7 is specified, the Certificate of Compliance shall include actual results of tests completed by the producer in addition to the items enumerated in Section 92-1.03 of the Standard Specifications. The Certificate of Compliance shall verify that the results of AASHTO Test Method T240 (Mass Loss after Rolling Thin Film Oven Test) indicate a maximum mass loss of 0.6 percent and that AASHTO Test Method T48 (Flash Point, Cleveland Open Cup) indicate a minimum flash point of 232°C. The actual formulation used by the asphalt producer shall be available to the Department upon written request. The Department will execute a non-disclosure agreement if requested by the asphalt producer.

For PBA Grades 6a, 6b or 7, if the results of mass loss after Rolling Thin Film Oven Test (AASHTO Test Method T240) or Flash Point, Cleveland Open Cup (AASHTO Test Method T48), shown on the Certificate of Compliance are not within the limits specified in the table entitled "PERFORMANCE BASED ASPHALT BINDER GRADES" or if the results are not shown on the Certificate of Compliance, the individual shipment of asphalt will be rejected. Rejected asphalt shall not be used on the project. Should rejected asphalt be unloaded into bulk storage tanks, asphalt from the tanks shall not be used on the project until tests and a Certificate of Compliance are furnished for the material and indicate compliance with the specifications.

Asphalt to be used as a binder for asphalt concrete will be sampled using the sampling device specified in Section 39-3.01C, "Asphalt Binder Storage," of the Standard Specifications. Two samples per operating day, each consisting of 2 one-liter containers, will be taken from the bulk storage tank feeder line.

For PBA Grades 6a, 6b or 7, if the test result of samples taken from the bulk storage tank, indicate mass loss greater than 0.6 percent, the material containing the paving asphalt represented by the tests shall be removed. However, if requested in writing by the Contractor and approved by the Engineer, the material containing the paving asphalt with mass loss greater than 0.6 percent may remain in place, and the Contractor shall pay to the State the amount calculated by the formulae listed below.

- A. For mass loss test results over 0.6 percent but less than or equal to 1.0 percent:
 - 1. (25 percent multiplied by 25 tonne average multiplied by the invoice price of paving asphalt)
- B. For mass loss test results over 1.0 percent:
 - 1. (100 percent multiplied by 25 tonne average multiplied by the invoice price of paving asphalt).
- C. The Department may deduct this amount from any moneys due, or that may become due, the Contractor under the contract. Each sample from the bulk storage shall represent 25 tonne average. The delivered price of the paving asphalt shall be based on a certified invoice provided by the Contractor.

PERFORMANCE BASED ASPHALT BINDER GRADES

Specification Designation	AASHTO Test Method	PBA Grade				
		1	4	6a	6b	7
Penetration (25°C, 100 g, 5 s), dmm RTFO Aged Residue, Min (Note 1)	T49	25	20	—	—	—
Absolute Viscosity (60°C), Pa•s(x10 ⁻¹) (Note 2) Original Binder, min RTFO Aged Residue	T202 T202	800 2500-5000 (Note 3)	2800 14000 Max	2000 5000 Min	2000 5000 Min	1100 3000 Min
Kinematic Viscosity (135°C), m ² /s(x10 ⁻⁶) Original Binder, Max RTFO Aged Residue, Min	T201 T201	— 275	— 350	2000 275	2000 275	2000 275
Absolute Viscosity Ratio (60°C), Max RTFO Visc./Orig. Visc.	—	4.0	4.0	4.0	4.0	4.0
Flash Point, Cleveland Open Cup, °C, (Note 4) Original Binder, Min	T48	232	232	232	232	232
Mass Loss After RTFO Test, % (Note 5)	T240	Report (Note 6)	Report	0.60	0.60	0.60
Solubility in Trichloroethylene, % Original Binder, Min	T44	99.0	99.0	Report	Report	Report
Ductility (25°C, 5 cm/min), cm RTFO Aged Residue, Min	T51	75	50	60	60	75
On Residue from Pav @: or Residue from Tilt Oven @ 113°C for: (hours)	PP1 (Note 7)	90°C 18	100°C 36	100°C 36	100°C 36	110°C 72
SSD -115(SSV)-50.6	(Note 9)	—	—	—	—	25°C
Stiffness, 300 MPa, Max @: and M-value, 0.30, Min	TP1	-6°C	-6°C	-24°C	-30°C	-6°C

Notes:

1. "RTFO Aged Residue" means the asphaltic residue obtained using the Rolling Thin Film Oven Test (RTFO Test), AASHTO Test Method T240 or ASTM Designation: D 2827.
2. The Absolute Viscosity (60°C) of PBA 6a, 6b, and 7 will be determined at 1 sec-1 using ASTM Designation: D 4957 with Asphalt Institute Vacuum Capillary Viscometers.
3. Where actual limits (e.g., 2500-500) are indicated, the actual test results shall be part of the certified copy of test results, or shall be furnished with the Certificate of Compliance.
4. Actual results of the test shall be part of the certified copy of test results and when PBA Grade 6a, 6b, or 7 is used an additional statement verifying an acceptable flash point shall be included with the Certificate of Compliance.
5. Actual results of the test shall be part of the certified copy of test results and when PBA Grade 6a, 6b, or 7 is used an additional statement verifying an acceptable mass loss shall be included with the Certificate of Compliance.
6. Where "Report" is indicated, there is no requirement; however the actual results of the test shall be part of the certified copy of test results, or shall be furnished with the Certificate of Compliance.
7. "Tilt Oven Residue" means the asphalt obtained using California Test 374, Method B, "Method for Determining Asphalt Durability Using the California Tilt-Oven Durability Test."
8. SSD = Shear susceptibility of Delta, SSV = Shear susceptibility of Viscosity.
9. California Test 381.

8-1.04 SLAG AGGREGATE

Aggregate produced from slag resulting from any steel-making process or from air-cooled iron blast furnace slag shall not be used on this project.

SECTION 8-2. CONCRETE

8-2.01 PORTLAND CEMENT CONCRETE

Portland cement concrete shall conform to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

Unless the use of a mineral admixture is prohibited, whenever the word "cement" is used in the Standard Specifications or the special provisions, it shall be understood to mean "cementitious material" when both of the following conditions are met:

- A. The cement content of portland cement concrete is specified, and
- B. Section 90, "Portland Cement Concrete," of the Standard Specifications is referenced.

Unless otherwise specified, a Type C accelerating chemical admixture conforming to the requirements in ASTM Designation: C 494 may be used in portland cement concrete for precast steam cured concrete members.

Section 90-1.01, "Description," of the Standard Specifications is amended to read:

90-1.01 DESCRIPTION

- Portland cement concrete shall be composed of cementitious material, fine aggregate, coarse aggregate, admixtures if used, and water, proportioned and mixed as specified in these specifications.
- Unless otherwise specified, cementitious material to be used in portland cement concrete shall conform to the provisions for cement and mineral admixtures in Section 90-2, "Materials," and shall be either: 1) "Type IP (MS) Modified" cement or 2) a combination of "Type II Modified" portland cement and mineral admixture.
- Concrete for each portion of the work shall comply with the provisions for the Class, cementitious material content in kilograms per cubic meter, 28-day compressive strength, minor concrete or commercial quality concrete, as shown on the plans or specified in these specifications or the special provisions.
 - Class 1 concrete shall contain not less than 400 kg of cementitious material per cubic meter.
 - Class 2 concrete shall contain not less than 350 kg of cementitious material per cubic meter.
 - Class 3 concrete shall contain not less than 300 kg of cementitious material per cubic meter.
 - Class 4 concrete shall contain not less than 250 kg of cementitious material per cubic meter.
 - Minor concrete shall contain not less than 325 kg of cementitious material per cubic meter unless otherwise specified in these specifications or the special provisions.
- Unless otherwise designated on the plans or specified in these specifications or the special provisions, the amount of cementitious material used per cubic meter of concrete in structures or portions of structures shall conform to the following:

Use	Cementitious Material Content (kg/m ³)
Concrete which is designated by compressive strength: Deck slabs and slab spans of bridges Roof sections of exposed top box culverts Other portions of structures	400 min., 475 max. 400 min., 475 max. 350 min., 475 max.
Concrete not designated by compressive strength: Deck slabs and slab spans of bridges Roof sections of exposed top box culverts Prestressed members Seal courses Other portions of structures	400 min. 400 min. 400 min. 400 min. 350 min.
Concrete for precast members	350 min., 550 max.

- Whenever the 28-day compressive strength shown on the plans is greater than 25 MPa, the concrete shall be considered to be designated by compressive strength. If the plans show a 28-day compressive strength which is 31 MPa or greater, an additional 7 days will be allowed to obtain the specified strength. The 28-day compressive strengths shown on the plans which are 25 MPa or less are shown for design information only and are not to be considered a requirement for acceptance of the concrete.
 - Concrete designated by compressive strength shall be proportioned such that the concrete will conform to the strength shown on the plans or specified in the special provisions.
 - The Contractor shall determine the mix proportions for all concrete except pavement concrete. The Engineer will determine the mix proportions for pavement concrete.
 - Before using concrete for which the mix proportions have been determined by the Contractor, or in advance of revising those mix proportions, the Contractor shall submit in writing to the Engineer a copy of the mix design.
 - Compliance with cementitious material content requirements will be verified in conformance with procedures described in California Test 518 for cement content. For testing purposes, mineral admixture shall be considered to be cement. Batch proportions shall be adjusted as necessary to produce concrete having the specified cementitious material content.
 - If any concrete used in the work has a cementitious material content, consisting of cement, mineral admixture, or cement plus mineral admixture, which is less than the minimum required for the work, the concrete shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place and the Contractor shall pay to the State \$0.55 for each kilogram of cement, mineral admixture, or cement plus mineral admixture which is less than the minimum required for the work. The Department may deduct the amount from moneys due, or that may become due, the Contractor under the contract. The deductions will not be made unless the difference between the contents required and those actually provided exceeds the batching tolerances permitted by Section 90-5, "Proportioning." No deductions for cementitious material content will be made based on the results of California Test 518.
 - The requirements of the preceding paragraph shall not apply to minor concrete or commercial quality concrete.
 - Concrete for which the mix proportions are determined either by the Contractor or the Engineer shall conform to the requirements of this Section 90.

The first paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

90-2.01 PORTLAND CEMENT

- Unless otherwise specified, portland cement shall be either "Type IP (MS) Modified" cement or "Type II Modified" portland cement.
 - "Type IP (MS) Modified" cement shall conform to the specifications for Type IP (MS) cement in ASTM Designation: C 595, and shall be comprised of an intimate mixture of Type II cement and not more than 25 percent of a mineral admixture. The type and minimum amount of mineral admixture used in the manufacture of "Type IP (MS) Modified" cement shall be in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."
 - "Type II Modified" portland cement shall conform to the requirements for Type II portland cement in ASTM Designation: C 150.
 - In addition, "Type IP (MS) Modified" cement and "Type II Modified" portland cement shall conform to the following requirements:
 - A. The cement shall not contain more than 0.60 percent by mass of alkalis, calculated as the percentage of Na₂O plus 0.658 times the percentage of K₂O, when determined by either direct intensity flame photometry or by the atomic absorption method. The instrument and procedure used shall be qualified as to precision and accuracy in conformance with the requirements in ASTM Designation: C 114.
 - B. The autoclave expansion shall not exceed 0.50 percent.
 - C. Mortar, containing the cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not expand in water more than 0.010 percent and shall not contract in air more than 0.048 percent except that when cement is to be used for precast prestressed concrete piling, precast prestressed concrete members or steam cured concrete products, the mortar shall not contract in air more than 0.053 percent.

The second paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is amended to read:

- Type III and Type V portland cements shall conform to the requirements in ASTM Designation: C 150, and the additional requirements listed above for Type II Modified portland cement, except that when tested in conformance with California Test 527, mortar containing Type III portland cement shall not contract in air more than 0.075 percent.

The third paragraph in Section 90-2.01, "Portland Cement," of the Standard Specifications is deleted.
 The twelfth paragraph in Section 90-2.02, "Aggregates," of the Standard Specifications is deleted.
 The first paragraph in Section 90-2.03, "Water," of the Standard Specifications is amended to read:

90-2.03 WATER

- In conventionally reinforced concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 1,000 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In prestressed concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 650 parts per million of chlorides as Cl, nor more than 1,300 parts per million of sulfates as SO₄. In no case shall the water contain an amount of impurities that will cause either: 1) a change in the setting time of cement of more than 25 percent when tested in conformance with the requirements in ASTM Designation: C 191 or ASTM Designation: C 266 or 2) a reduction in the compressive strength of mortar at 14 days of more than 5 percent, when tested in conformance with the requirements in ASTM Designation: C 109, when compared to the results obtained with distilled water or deionized water, tested in conformance with the requirements in ASTM Designation: C 109.

The following section is added to Section 90-2, "Materials," of the Standard Specifications:

90-2.04 ADMIXTURE MATERIALS

- Admixture materials shall conform to the requirements in the following ASTM Designations:
 - A. Chemical Admixtures—ASTM Designation: C 494.
 - B. Air-entraining Admixtures—ASTM Designation: C 260.
 - C. Calcium Chloride—ASTM Designation: D 98.
 - D. Mineral Admixtures—Coal fly ash, raw or calcined natural pozzolan as specified in ASTM Designation: C618. Silica fume conforming to the requirements in ASTM Designation: C1240, with reduction of mortar expansion of 80 percent, minimum, using the cement from the proposed mix design.
- Mineral admixtures shall be used in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."

The first paragraph in Section 90-3.03, "Fine Aggregate Grading," is amended to read:

Fine aggregate shall be graded within the following limits:

Sieve Sizes	Percentage Passing	
	Operating Range	Contract Compliance
9.5-mm	100	100
4.75-mm	95-100	93-100
2.36-mm	65-95	61-99
1.18-mm	X ± 10	X ± 13
600-µm	X ± 9	X ± 12
300-µm	X ± 6	X ± 9
150-µm	2-12	1-15
75-µm	0-8	0-10

Section 90-4.02, "Materials," of the Standard Specifications is amended to read:

90-4.02 MATERIALS

- Admixture materials shall conform to the provisions in Section 90-2.04, "Admixture Materials."

Section 90-4.05, "Optional Use of Chemical Admixtures," of the Standard Specifications is amended to read:

90-4.05 OPTIONAL USE OF CHEMICAL ADMIXTURES

- The Contractor will be permitted to use Type A or F, water-reducing; Type B, retarding; or Type D or G, water-reducing and retarding admixtures as described in ASTM Designation: C 494 to conserve cementitious material or to facilitate concrete construction application subject to the following conditions:

- A. When a water-reducing admixture or a water-reducing and retarding admixture is used, the cementitious material content specified or ordered may be reduced by a maximum of 5 percent by mass except that the resultant cementitious material content shall be not less than 300 kilograms per cubic meter.
- B. When a reduction in cementitious material content is made, the dosage of admixture used shall be the dosage used in determining approval of the admixture.

Section 90-4.07, "Optional Use of Air-entraining Admixtures," of the Standard Specifications is amended to read:

90-4.07 OPTIONAL USE OF AIR-ENTRAINING ADMIXTURES

- When air-entrainment has not been specified or ordered by the Engineer, the Contractor will be permitted to use an air-entraining admixture to facilitate the use of any construction procedure or equipment provided that the average air content, as determined by California Test 504, of 3 successive tests does not exceed 4 percent and no single test value exceeds 5.5 percent. If the Contractor elects to use an air-entraining admixture in concrete for pavement, the Contractor shall so indicate at the time the Contractor designates the source of aggregate as provided in Section 40-1.015, "Cement Content."

Section 90-4.08, "Required Use of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.08 REQUIRED USE OF MINERAL ADMIXTURES

- Unless otherwise specified, mineral admixture shall be combined with cement to make cementitious material for use in portland cement concrete.
 - The calcium oxide content of mineral admixtures shall not exceed 10 percent and the available alkali, as sodium oxide equivalent, shall not exceed 1.5 percent when determined in conformance with the requirements in ASTM Designation: C618.
 - The amounts of cement and mineral admixture used in cementitious material for portland cement concrete shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," and shall conform to the following:

- A. The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content.
- B. The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:
 1. When the calcium oxide content of a mineral admixture, as determined in conformance with the requirements in ASTM Designation: C618 and the provisions in Section 90-2.04, "Admixture Materials," is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix.
 2. When the calcium oxide content of a mineral admixture, as determined in conformance with the requirements in ASTM Designation: C618 and the provisions in Section 90-2.04, "Admixture Materials," is greater than 2 percent, the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix.
 3. When a mineral admixture is used, which conforms to the provisions for silica fume in Section 90-2.04, "Admixture Materials," the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix.
- C. If more than the required amount of cementitious material is used, the additional cementitious material in the mix may be either cement, a mineral admixture conforming to the provisions in Section 90-2.04, "Admixture Materials," or a combination of both; however, the maximum total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

Section 90-4.09, "Optional Use of Mineral Admixtures," of the Standard Specifications is deleted.

Section 90-4.11, "Storage, Proportioning, and Dispensing of Mineral Admixtures," of the Standard Specifications is amended to read:

90-4.11 STORAGE, PROPORTIONING, AND DISPENSING OF MINERAL ADMIXTURES

- Mineral admixtures shall be protected from exposure to moisture until used. Sacked material shall be piled to permit access for tally, inspection, and identification for each shipment.

- Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.
- Mineral admixtures shall be incorporated into concrete using equipment conforming to the requirements for cement weigh hoppers, and charging and discharging mechanisms in ASTM Designation: C 94, in Section 90-5.03, "Proportioning," and in this Section 90-4.11.
- When interlocks are required for cement and mineral admixture charging mechanisms by Section 90-5.03A, "Proportioning for Pavement," and cement and mineral admixtures are weighed cumulatively, their charging mechanisms shall be interlocked to prevent the introduction of mineral admixture until the mass of cement in the cement weigh hopper is within the tolerances specified in Section 90-5.02, "Proportioning Devices."
- Mineral admixture used in concrete for exposed surfaces of like elements of a structure shall be from the same source and of the same percentage.

Section 90-5.02, "Proportioning Devices," of the Standard Specifications is amended to read:

90-5.02 PROPORTIONING DEVICES

- Weighing, measuring or metering devices used for proportioning materials shall conform to the provisions in Section 9-1.01, "Measurement of Quantities," and this Section 90-5.02. In addition, automatic weighing systems used shall comply with the provisions for automatic proportioning devices in Section 90-5.03A, "Proportioning for Pavement." These automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, and mineral admixture for one batch of concrete is a single operation of a switch or starter.
- Proportioning devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy.
- Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the plant is in operation, the mass of each batch of material shall not vary from the mass designated by the Engineer by more than the tolerances specified herein.
- Equipment for cumulative weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. For systems with individual weigh hoppers for the various sizes of aggregate, the zero tolerance shall be ± 0.5 percent of the individual batch mass designated for each size of aggregate. Equipment for cumulative weighing of cement and mineral admixtures shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the cement and mineral admixture. Equipment for weighing cement or mineral admixture separately shall have a zero tolerance of ± 0.5 percent of their designated individual batch masses. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.
- The mass indicated for a batch of material shall not vary from the preselected scale setting by more than the following:
 - A. Aggregate weighed cumulatively shall be within 1.0 percent of the designated total batch mass of the aggregate. Aggregates weighed individually shall be within 1.5 percent of their respective designated batch masses.
 - B. Cement shall be within 1.0 percent of its designated batch mass. When weighed individually, mineral admixture shall be within 1.0 percent of its designated batch mass. When mineral admixture and cement are permitted to be weighed cumulatively, cement shall be weighed first to within 1.0 percent of its designated batch mass, and the total for cement and mineral admixture shall be within 1.0 percent of the sum of their designated batch masses.
 - C. Water shall be within 1.5 percent of its designated mass or volume.
- Each scale graduation shall be approximately 0.001 of the total capacity of the scale. The capacity of scales for weighing cement, mineral admixture, or cement plus mineral admixture and aggregates shall not exceed that of commercially available scales having single graduations indicating a mass not exceeding the maximum permissible mass variation above, except that no scale shall be required having a capacity of less than 500 kg, with 0.5 kg graduations.

Section 90-5.03, "Proportioning," excluding Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03 PROPORTIONING

- Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture, and water as provided in these specifications. Aggregates shall be proportioned by mass.

- At the time of batching, aggregates shall have been dried or drained sufficiently to result in a stable moisture content such that no visible separation of water from aggregate will take place during transportation from the proportioning plant to the point of mixing. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.
- Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.
- Bulk "Type IP (MS) Modified" cement that conforms to the provisions in Section 90-2.01, "Portland Cement," shall be weighed in an individual hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer.
- Bulk cement to be blended with mineral admixture for use in portland cement concrete for pavement and structures may be weighed in separate, individual weigh hoppers or may be weighed in the same weigh hopper with mineral admixture and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer. If the cement and mineral admixture are weighed cumulatively, the cement shall be weighed first.
- When cement and mineral admixtures are weighed in separate weigh hoppers, the weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material weighing device. The cement and the mineral admixture shall be discharged into the mixer simultaneously with the aggregate.
- The scale and weigh hopper for bulk weighing cement, mineral admixture, and cement plus mineral admixture shall be separate and distinct from the aggregate weighing equipment.
- When the source of an aggregate is changed for concrete structures, the Contractor shall adjust the mix proportions and submit in writing to the Engineer a copy of the mix design before using such aggregates. When the source of an aggregate is changed for other concrete, the Engineer shall be allowed sufficient time to adjust the mix and such aggregates shall not be used until necessary adjustments are made.
- For batches with a volume of one cubic meter or more, the batching equipment shall conform to one of the following combinations:
 - A. Separate boxes and separate scale and indicator for weighing each size of aggregate.
 - B. Single box and scale indicator for all aggregates.
 - C. Single box or separate boxes and automatic weighing mechanism for all aggregates.
- In order to check the accuracy of batch masses, the gross mass and tare mass of batch trucks, truck mixers, truck agitators, and non-agitating hauling equipment shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

Section 90-5.03A, "Proportioning for Pavement," of the Standard Specifications is amended to read:

90-5.03A PROPORTIONING FOR PAVEMENT

- Aggregates and bulk cement, mineral admixture, and cement plus mineral admixture for use in pavement shall be proportioned by mass by means of automatic proportioning devices of approved type conforming to the provisions in this Section 90-5.03A.
- The Contractor shall install and maintain in operating condition an electrically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.
- The batching of cement, mineral admixture, or cement plus mineral admixture and aggregate shall be interlocked so that a new batch cannot be started until all weigh hoppers are empty, the proportioning devices are within zero tolerance, and the discharge gates are closed. The interlock shall permit no part of the batch to be discharged until all aggregate hoppers and the cement and mineral admixture hoppers or the cement plus mineral admixture hopper are charged with masses which are within the tolerances specified in Section 90-5.02, "Proportioning Devices."
- The discharge gate on the cement and mineral admixture hoppers or the cement plus mineral admixture hopper shall be designed to permit regulating the flow of cement, mineral admixture or cement plus mineral admixture into the aggregate as directed by the Engineer.
- When separate weigh boxes are used for each size of aggregate, the discharge gates shall permit regulating the flow of each size of aggregate as directed by the Engineer.

- Material discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of withdrawal from the several bins, and of discharge from the weigh box, shall be interlocked so that not more than one bin can discharge at a time, and that the weigh box cannot be tripped until the required quantity from each of the several bins has been deposited therein. Should a separate weigh box be used for each size of aggregate, all may be operated and discharged simultaneously.
- When the discharge from the several bins is controlled by gates, each gate shall be actuated automatically so that the required mass is discharged into the weigh box, after which the gate shall automatically close and lock.
- The automatic weighing system shall be designed so that all proportions required may be set on the weighing controller at the same time.

The third paragraph in Section 90-6.01, "General," of the Standard Specifications is amended to read:

- Concrete shall be homogeneous and thoroughly mixed. There shall be no lumps or evidence of undispersed cement, mineral admixture, or cement plus mineral admixture.

The third and fourth paragraphs in Section 90-6.02, "Machine Mixing," of the Standard Specifications are amended to read:

- The batch shall be so charged into the mixer that some water will enter in advance of cementitious materials and aggregates. All water shall be in the drum by the end of the first one-fourth of the specified mixing time.
- Cementitious materials shall be batched and charged into the mixer by means that will not result either in loss of cementitious materials due to the effect of wind, or in accumulation of cementitious materials on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cementitious material in the concrete mixture.

The sixth paragraph in Section 90-6.02, "Machine Mixing," of the Standard Specifications is amended to read:

- The total elapsed time between the intermingling of damp aggregates and all cementitious materials and the start of mixing shall not exceed 30 minutes.

The seventh through tenth paragraphs in Section 90-6.03, "Transporting Mixed Concrete," of the Standard Specifications are amended to read:

- When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be completed within 1.5 hours, or before 250 revolutions of the drum or blades, whichever comes first, after the introduction of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C, or above, a time less than 1.5 hours may be required.
- When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be completed within one hour after the addition of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C, or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.
- Each load of concrete delivered at the job site shall be accompanied by a weight certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load and for transit-mixed concrete, the reading of the revolution counter at the time the truck mixer is charged with cement. This weight certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.
- Weight certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on 90 mm diskette with a capacity of at least 1.4 megabytes. Captured data, for the ingredients represented by each batch shall be LFCR (one line, separate record) with allowances for sufficient fields to satisfy the amount of data required by these specifications.
- The Contractor may furnish a weight certificate that is accompanied by a separate certificate which lists the actual batch masses or measurements for a load of concrete provided that both certificates are 1) imprinted with the same non-repeating load number that is unique to the contract and 2) delivered to the job site with the load.
- Weight certificates furnished by the Contractor shall conform to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications.

Section 90-6.05, "Hand-Mixing," of the Standard Specifications is amended to read:

90-6.05 HAND-MIXING

• Hand-mixed concrete shall be made in batches not more than one-fourth cubic meter and shall be mixed on a watertight, level platform. The proper amount of coarse aggregate shall be measured in measuring boxes and spread on the platform and the fine aggregate shall be spread on this layer, the 2 layers being not more than 0.3 meters in total depth. On this mixture shall be spread the dry cement and mineral admixture and the whole mass turned no fewer than 2 times dry; then sufficient clean water shall be added, evenly distributed, and the whole mass again turned no fewer than 3 times, not including placing in the carriers or forms.

The table in the first paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is replaced with the following table:

Type of Work	Nominal Penetration (mm)	Maximum Penetration (mm)
Concrete pavement	0-25	40
Non-reinforced concrete facilities	0-35	50
Reinforced concrete structures:		
Sections over 300 mm thick	0-35	65
Sections 300 mm thick or less	0-50	75
Concrete placed under water	75-100	115
Cast-in-place concrete piles	65-90	100

The first paragraph following the table of penetration ranges in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

• The amount of free water used in concrete shall not exceed 183 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 325 kg/m³.

The fourth paragraph in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications is amended to read:

• Where there are adverse or difficult conditions which affect the placing of concrete, the above specified penetration and free water content limitations may be exceeded providing the Contractor is granted permission by the Engineer in writing to increase the cementitious material content per cubic meter of concrete. The increase in water and cementitious material shall be at a ratio not to exceed 30 kg of water per added 100 kg of cementitious material per cubic meter. The cost of additional cementitious material and water added under these conditions shall be at the Contractor's expense and no additional compensation will be allowed therefor.

Section 90-9.01, "General," of the Standard Specifications is amended to read:

90-9.01 GENERAL

• Concrete compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified in these specifications or are shown on the plans.

• The compressive strength of concrete will be determined from test cylinders which have been fabricated from concrete sampled in conformance with California Test 539. Test cylinders will be molded and initial field cured in conformance with California Test 540. Test cylinders will be cured and tested after receipt at the testing laboratory in conformance with California Test 521. A strength test shall consist of the average strength of 2 cylinders fabricated from material taken from a single load of concrete, except that, if any cylinder should show evidence of improper sampling, molding, or testing, that cylinder shall be discarded and the strength test shall consist of the strength of the remaining cylinder.

• When concrete compressive strength is specified as a prerequisite to applying loads or stresses to a concrete structure or member, test cylinders for other than steam cured concrete will be cured in conformance with Method 1 of California Test 540. The compressive strength of concrete determined for these purposes will be evaluated on the basis of individual tests.

- When concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete strength to be used as a basis for acceptance of other than steam cured concrete will be determined from cylinders cured in conformance with Method 1 of California Test 540. If the result of a single compressive strength test at the maximum age specified or allowed is below the specified strength but is 95 percent or more of the specified strength, the Contractor shall, at the Contractor's expense, make corrective changes, subject to approval by the Engineer, in the mix proportions or in the concrete fabrication procedures, before placing additional concrete, and shall pay to the State \$14 for each in-place cubic meter of concrete represented by the deficient test. If the result of a single compressive strength test at the maximum age specified or allowed is below 95 percent of the specified strength, but is 85 percent or more of the specified strength, the Contractor shall make the corrective changes specified above, and shall pay to the State \$20 for each in place cubic meter of concrete represented by the deficient test. In addition, such corrective changes shall be made when the compressive strength of concrete tested at 7 days indicates, in the judgment of the Engineer, that the concrete will not attain the required compressive strength at the maximum age specified or allowed. Concrete represented by a single test which indicates a compressive strength of less than 85 percent of the specified 28-day compressive strength will be rejected in conformance with the provisions in Section 6-1.04, "Defective Materials."

- If the test result indicates that the compressive strength at the maximum curing age specified or allowed is below the specified strength, but 85 percent or more of the specified strength, payments to the State as required above shall be made, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength of the concrete placed in the work meets or exceeds the specified 28-day compressive strength. If the test result indicates a compressive strength at the maximum curing age specified or allowed below 85 percent, the concrete represented by that test will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the concrete placed in the work are acceptable. If the evidence consists of tests made on cores taken from the work, the cores shall be obtained and tested in conformance with the requirements in ASTM Designation: C 42.

- No single compressive strength test shall represent more than 250 cubic meters.

- When a precast concrete member is steam cured, the compressive strength of the concrete will be determined from test cylinders which have been handled and stored in conformance with Method 3 of California Test 540. The compressive strength of steam cured concrete will be evaluated on the basis of individual tests representing specific portions of production. When the concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete shall be considered to be acceptable whenever its compressive strength reaches the specified 28-day compressive strength provided that strength is reached in not more than the maximum number of days specified or allowed after the member is cast.

- If concrete is specified by compressive strength, then materials, mix proportions, mixing equipment, and procedures proposed for use shall be prequalified prior to placement of the concrete. Prequalification shall be accomplished by the submission of acceptable certified test data or trial batch reports by the Contractor. Prequalification data shall be based on the use of materials, mix proportions, mixing equipment, procedures, and size of batch proposed for use in the work.

- Certified test data, in order to be acceptable, must indicate that not less than 90 percent of at least 20 consecutive tests exceed the specified strength at the maximum number of cure days specified or allowed, and none of those tests are less than 95 percent of specified strength. Strength tests included in the data shall be the most recent tests made on concrete of the proposed mix design and all shall have been made within one year of the proposed use of the concrete.

- Trial batch test reports, in order to be acceptable, must indicate that the average compressive strength of 5 consecutive concrete cylinders, taken from a single batch, at not more than 28 days (or the maximum age allowed) after molding shall be at least 4 MPa greater than the specified 28-day compressive strength, and no individual cylinder shall have a strength less than the specified strength at the maximum age specified or allowed. Data contained in the report shall be from trial batches which were produced within one year of the proposed use of specified strength concrete in the project. Whenever air-entrainment is required, the air content of trial batches shall be equal to or greater than the air content specified for the concrete without reduction due to tolerances.

- Tests shall be performed in conformance with either the appropriate California Test methods or the comparable ASTM test methods. Equipment employed in testing shall be in good condition and shall be properly calibrated. If the tests are performed during the life of the contract, the Engineer shall be notified sufficiently in advance of performing the tests in order to witness the test procedures.

- The certified test data and trial batch test reports shall include the following information:

- A. Date of mixing.
- B. Mixing equipment and procedures used.
- C. The size of batch in cubic meters and the mass, type and source of ingredients used.
- D. Penetration of the concrete.
- E. The air content of the concrete if an air-entraining admixture is used.
- F. The age at time of testing and strength of concrete cylinders tested.

- Certified test data and trial batch test reports shall be signed by an official of the firm which performed the tests.
- When approved by the Engineer, concrete from trial batches may be used in the work at locations where concrete of a lower quality is required and the concrete will be paid for as the type or class of concrete required at that location.
- After materials, mix proportions, mixing equipment, and procedures for concrete have been prequalified for use, additional prequalification by testing of trial batches will be required prior to making changes which, in the judgment of the Engineer, could result in a lowering of the strength of the concrete below that specified.
- The Contractor's attention is directed to the time required to test trial batches. The Contractor shall be responsible for production of trial batches at a sufficiently early date so that the progress of the work is not delayed.
- When precast concrete members are manufactured at the plant of an established manufacturer of precast concrete members, the mix proportions of the concrete shall be determined by the Contractor, and a trial batch and prequalification of the materials, mix proportions, mixing equipment, and procedures will not be required.

Section 90-10.02A, "Portland Cement," of the Standard Specifications is renamed "Cementitious Material" and is amended to read:

90-10.02A CEMENTITIOUS MATERIAL

- Cementitious material shall conform to the provisions in Section 90-1.01, "Description." Compressive strength requirements consist of a minimum strength which must be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified in these specifications or are shown on the plans.

The fifth paragraph in Section 90-10.02B, "Aggregate," of the Standard Specifications is deleted.
Section 90-10.03, "Production," of the Standard Specifications is amended to read:

90-10.03 PRODUCTION

- Cementitious material, water, aggregate, and admixtures shall be stored, proportioned, mixed, transported, and discharged in conformance with recognized standards of good practice, which will result in concrete that is thoroughly and uniformly mixed, which is suitable for the use intended, and which conforms to provisions specified herein. Recognized standards of good practice are outlined in various industry publications such as those issued by American Concrete Institute, AASHTO, or California Department of Transportation.
- The cementitious material content of minor concrete shall conform to the provisions in Section 90-1.01, "Description."
- The amount of water used shall result in a consistency of concrete conforming to the provisions in Section 90-6.06, "Amount of Water and Penetration." Additional mixing water shall not be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer.
- Discharge of ready-mixed concrete from the transporting vehicle shall be made while the concrete is still plastic and before stiffening occurs. An elapsed time of 1.5 hours (one hour in non-agitating hauling equipment), or more than 250 revolutions of the drum or blades, after the introduction of the cementitious material to the aggregates, or a temperature of concrete of more than 32°C will be considered as conditions contributing to the quick stiffening of concrete. The Contractor shall take whatever action is necessary to eliminate quick stiffening, except that the addition of water will not be permitted.
- The required mixing time in stationary mixers shall be not less than 50 seconds or more than 5 minutes.
- The minimum required revolutions at mixing speed for transit-mixed concrete shall be not less than that recommended by the mixer manufacturer, and shall be increased, if necessary, to produce thoroughly and uniformly mixed concrete.
- Each load of ready-mixed concrete shall be accompanied by a weight certificate which shall be delivered to the Engineer at the discharge location of the concrete, unless otherwise directed by the Engineer. The weight certificate shall be clearly marked with the date and time of day when the load left the batching plant and, if hauled in truck mixers or agitators, the time the mixing cycle started.
- A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer, prior to placing minor concrete from a source not previously used on the contract, stating that minor concrete to be furnished meets contract requirements, including minimum cementitious material content specified.

The third and fourth paragraphs in Section 90-11.02, "Payment," of the Standard Specifications are amended to read:

- Should the Engineer order the Contractor to incorporate admixtures into the concrete when their use is not required by these specifications or the special provisions, furnishing the admixtures and adding them to the concrete will be paid for as extra work as provided in Section 4-1.03D.
- Should the Contractor use admixtures in conformance with the provisions in Section 90-4.05, "Optional Use of Chemical Admixtures," or Section 90-4.07, "Optional Use of Air-entraining Admixtures," or should the Contractor request and obtain permission to use other admixtures for the Contractor's benefit, the Contractor shall furnish those admixtures and incorporate them in the concrete at the Contractor's expense and no additional compensation will be allowed therefor.

SECTION 8-3. (BLANK)

SECTION 9. (BLANK)

SECTION 10. CONSTRUCTION DETAILS

SECTION 10-1. GENERAL

10-1.01 ORDER OF WORK

Order of work shall conform to the provisions in Section 5-1.05, "Order of Work," of the Standard Specifications and these special provisions.

Attention is directed to "Maintaining Traffic" and "Temporary Pavement Delineation" of these special provisions.

Pavement delineation removal shall be coordinated with new delineation so that lane lines are provided at all times on traveled ways open to public traffic.

Before obliterating any pavement delineation that is to be replaced on the same alignment and location, as determined by the Engineer, the pavement delineation shall be referenced by the Contractor, with a sufficient number of control points to reestablish the alignment and location of the new pavement delineation. The references shall include the limits or changes in striping pattern, including limit lines, crosswalks and other pavement markings. Full compensation for referencing pavement delineation shall be considered as included in the contract prices paid for new pavement delineation and no additional compensation will be allowed therefor.

Loop detectors shall be installed after paving is completed at each Location.

Existing loop detectors shall not be disabled more than 3 calendar days at each Location.

10-1.02 WATER POLLUTION CONTROL

Water pollution control work shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications and these special provisions.

Water pollution control work shall conform to the requirements in the Construction Contractor's Guide and Specifications of the Caltrans Storm Water Quality Handbooks, dated April 1997, and addenda thereto issued up to and including the date of advertisement of the project, hereafter referred to as the "Handbook." Copies of the Handbook may be obtained from the Department of Transportation, Material Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520 or from the internet at <http://www.dot.ca.gov/hq/construc/stormwater.html>.

Copies of the Handbook are also available for review at the Department of Transportation, Construction Office, Room 244, 120 South Spring Street, Los Angeles, California 90012.

The Contractor shall know and fully comply with the applicable provisions of the Handbook and Federal, State, and local regulations that govern the Contractor's operations and storm water discharges from both the project site and areas of disturbance outside the project limits during construction.

Unless arrangements for disturbance of areas outside the project limits are made by the Department and made part of the contract, it is expressly agreed that the Department assumes no responsibility whatsoever to the Contractor or property owner with respect to any arrangements made between the Contractor and property owner to allow disturbance of areas outside the project limits.

The Contractor shall be responsible for the costs and for liabilities imposed by law as a result of the Contractor's failure to comply with the requirements set forth in this section "Water Pollution Control" including, but not limited to, compliance with the applicable provisions of the Handbook and Federal, State, and local regulations. For the purposes of this paragraph, costs and liabilities include, but are not limited to, fines, penalties, and damages whether assessed against the State or the Contractor, including those levied under the Federal Clean Water Act and the State Porter Cologne Water Quality Act.

In addition to the remedies authorized by law, an amount of the money due the Contractor under the contract, as determined by the Department, may be retained by the State of California until disposition has been made of the costs and liabilities.

The retention of money due the Contractor shall be subject to the following:

- A. The Department will give the Contractor 30 days notice of the Department's intention to retain funds from partial payments which may become due to the Contractor prior to acceptance of the contract. Retention of funds from payments made after acceptance of the contract may be made without prior notice to the Contractor.
- B. No retention of additional amounts out of partial payments will be made if the amount to be retained does not exceed the amount being withheld from partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications.
- C. If the Department has retained funds and it is subsequently determined that the State is not subject to the costs and liabilities in connection with the matter for which the retention was made, the Department shall be liable for interest on the amount retained at the legal rate of interest for the period of the retention.

Conformance with the provisions in this section "Water Pollution Control" shall not relieve the Contractor from the Contractor's responsibilities as provided in Section 7, "Legal Relations and Responsibilities," of the Standard Specifications.

WATER POLLUTION CONTROL PROGRAM PREPARATION, APPROVAL AND UPDATES

As part of the water pollution control work, a Water Pollution Control Program, hereafter referred to as the "WPCP," is required for this contract. The WPCP shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications, the requirements in the Handbook, and these special provisions.

No work having potential to cause water pollution, as determined by the Engineer, shall be performed until the WPCP has been approved by the Engineer.

Within 5 days after the approval of the contract, the Contractor shall submit 3 copies of the WPCP to the Engineer. The Engineer will have 3 days to review the WPCP. If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the WPCP within 3 days of receipt of the Engineer's comments. The Engineer will have 3 days to review the revisions. Upon the Engineer's approval of the WPCP, 3 additional copies of the WPCP incorporating the required changes shall be submitted to the Engineer. Minor changes or clarifications to the initial submittal may be made and attached as amendments to the WPCP. In order to allow construction activities to proceed, the Engineer may conditionally approve the WPCP while minor revisions or amendments are being completed.

The WPCP shall identify pollution sources that may adversely affect the quality of storm water discharges associated with the project and shall identify water pollution control measures, hereafter referred to as control measures, to be constructed, implemented, and maintained in order to reduce to the extent feasible pollutants in storm water discharges from the construction site during construction under this contract.

The WPCP shall incorporate control measures in the following categories:

- A. Soil stabilization practices;
- B. Sediment control practices;
- C. Sediment tracking control practices;
- D. Wind erosion control practices; and
- E. Nonstorm water management and waste management and disposal control practices.

Specific objectives and minimum requirements for each category of control measures are contained in the Handbook.

The Contractor shall consider the objectives and minimum requirements presented in the Handbook for each of the above categories. When minimum requirements are listed for any category, the Contractor shall incorporate into the WPCP and implement on the project, one or more of the listed minimum controls required in order to meet the pollution control objectives for the category. In addition, the Contractor shall consider other control measures presented in the Handbook and shall incorporate into the WPCP and implement on the project the control measures necessary to meet the objectives of the WPCP. The Contractor shall document the selection process in conformance with the procedure specified in the Handbook.

The WPCP shall include, but not be limited to, the following items as described in the Handbook:

- A. Project description and Contractor's certification;
- B. Project information;
- C. Pollution sources, control measures, and water pollution control drawings; and
- D. Amendments, if any.

The Contractor shall amend the WPCP, graphically and in narrative form, whenever there is a change in construction activities or operations which may affect the discharge of significant quantities of pollutants to surface waters, ground waters, municipal storm drain systems or when deemed necessary by the Engineer. The WPCP shall be amended if the WPCP has not achieved the objective of reducing pollutants in storm water discharges. Amendments shall show additional control measures or revised operations, including those in areas not shown in the initially approved WPCP, which are required on the project to control water pollution effectively. Amendments to the WPCP shall be submitted for review and approval by the Engineer in the same manner specified for the initially approved WPCP. Amendments shall be dated and attached to the on-site WPCP document.

The Contractor shall keep a copy of the WPCP, together with updates, revisions and amendments at the project site.

WPCP IMPLEMENTATION

Upon approval of the WPCP, the Contractor shall be responsible throughout the duration of the project for installing, constructing, inspecting, and maintaining the control measures included in the WPCP and any amendments thereto and for removing and disposing of temporary control measures. Unless otherwise directed by the Engineer or specified in these special provisions, the Contractor's responsibility for WPCP implementation shall continue throughout any temporary suspension of work ordered in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. Requirements for installation, construction, inspection, maintenance, removal, and disposal of control measures are specified in the Handbook and these special provisions.

Soil stabilization practices and sediment control measures, including minimum requirements, shall be provided throughout the winter season, defined as between October 1 and May 1.

Implementation of soil stabilization practices and sediment control measures for soil-disturbed areas on the project site shall be completed, except as provided for below, not later than 20 days prior to the beginning of the winter season or upon start of applicable construction activities for projects which begin either during or within 20 days of the winter season.

Throughout the winter season, the active, soil-disturbed area of the project site shall be not more than 1.9 hectares. The Engineer may approve, on a case-by-case basis, expansions of the active, soil-disturbed area limit. The Contractor shall demonstrate the ability and preparedness to fully deploy soil stabilization practices and sediment control measures to protect soil-disturbed areas on the project site before the onset of precipitation. A quantity of soil stabilization and sediment control materials shall be maintained on site equal to 100 percent of that sufficient to protect unprotected, soil-disturbed areas on the project site. A detailed plan for the mobilization of sufficient labor and equipment shall be maintained to fully deploy control measures required to protect unprotected, soil-disturbed areas on the project site prior to the onset of precipitation. A current inventory of control measure materials and the detailed mobilization plan shall be included as part of the WPCP.

Throughout the winter season, soil-disturbed areas on the project site shall be considered to be nonactive whenever soil disturbing activities are expected to be discontinued for a period of 20 or more days and the areas are fully protected. Areas that will become nonactive either during the winter season or within 20 days thereof shall be fully protected with soil stabilization practices and sediment control measures within 10 days of the discontinuance of soil disturbing activities or prior to the onset of precipitation, whichever is first to occur.

Throughout the winter season, active soil-disturbed areas of the project site shall be fully protected at the end of each day with soil stabilization practices and sediment control measures unless fair weather is predicted through the following work day. The weather forecast shall be monitored by the Contractor on a daily basis. The National Weather Service forecast shall be used. An alternative weather forecast proposed by the Contractor may be used if approved by the Engineer. If precipitation is predicted prior to the end of the following work day, construction scheduling shall be modified, as required, and functioning control measures shall be deployed prior to the onset of the precipitation.

The Contractor shall implement, year-round and throughout the duration of the project, control measures included in the WPCP for sediment tracking, wind erosion, nonstorm water management, and waste management and disposal.

The Engineer may order the suspension of construction operations which create water pollution if the Contractor fails to conform to the provisions in this section "Water Pollution Control" as determined by the Engineer.

MAINTENANCE

To ensure the proper implementation and functioning of control measures, the Contractor shall regularly inspect and maintain the construction site for the control measures identified in the WPCP. The Contractor shall identify corrective actions and time needed to address any deficient measures or reinstate any measures that have been discontinued.

The construction site inspection checklist provided in the Handbook shall be used to ensure that the necessary measures are being properly implemented, and to ensure that the control measures are functioning adequately. One copy of each site inspection record shall be submitted to the Engineer.

During the winter season, inspections of the construction site shall be conducted by the Contractor to identify deficient measures, as follows:

- A. Prior to a forecast storm;
- B. After all precipitation which causes runoff capable of carrying sediment from the construction site;
- C. At 24-hour intervals during extended precipitation events; and
- D. Routinely, at a minimum of once every 2 weeks.

If the Contractor or the Engineer identifies a deficiency in the deployment or functioning of an identified control measure, the deficiency shall be corrected immediately. The deficiency may be corrected at a later date and time if requested by the Contractor and approved by the Engineer in writing, but not later than the onset of subsequent precipitation events. The correction of deficiencies shall be at no additional cost to the State.

PAYMENT

Full compensation for conforming to the provisions in this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

Those control measures which are shown on the plans and for which there is a contract item of work will be measured and paid for as that contract item of work.

The Engineer will retain an amount equal to 25 percent of the estimated value of the contract work performed during estimate periods in which the Contractor fails to conform to the provisions in this section "Water Pollution Control" as determined by the Engineer.

Retentions for failure to conform to the provisions in this section "Water Pollution Control" shall be in addition to the other retentions provided for in the contract. The amounts retained for failure of the Contractor to conform to the provisions in this section will be released for payment on the next monthly estimate for partial payment following the date that a WPCP has been implemented and maintained and water pollution is adequately controlled, as determined by the Engineer.

10-1.03 PROGRESS SCHEDULE

Progress schedules are required for this contract and shall be submitted in conformance with the provisions in Section 8-1.04, "Progress Schedule," of the Standard Specifications.

10-1.04 CONSTRUCTION AREA TRAFFIC CONTROL DEVICES

Flagging, signs, and all other traffic control devices furnished, installed, maintained, and removed when no longer required shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Category 1 traffic control devices are defined as those devices that are small and lightweight (less than 45 kg), and have been in common use for many years. The devices shall be known to be crashworthy by crash testing, crash testing of similar devices, or years of demonstrable safe performance. Category 1 traffic control devices include traffic cones, plastic drums, portable delineators, and channelizers.

If requested by the Engineer, the Contractor shall provide written self-certification for crashworthiness of Category 1 traffic control devices. Self-certification shall be provided by the manufacturer or Contractor and shall include the following: date, Federal Aid number (if applicable), expenditure authorization, district, county, route and kilometer post of project limits; company name of certifying vendor, street address, city, state and zip code; printed name, signature and title of certifying person; and an indication of which Category 1 traffic control devices will be used on the project. The Contractor may obtain a standard form for self-certification from the Engineer.

Category 2 traffic control devices are defined as those items that are small and lightweight (less than 45 kg), that are not expected to produce significant vehicular velocity change, but may otherwise be potentially hazardous. Category 2 traffic control devices include: barricades and portable sign supports.

Category 2 devices purchased on or after October 1, 2000 shall be on the Federal Highway Administration (FHWA) Acceptable Crashworthy Category 2 Hardware for Work Zones list. This list is maintained by FHWA and can be located at the following internet address: <http://safety.fhwa.dot.gov/fourthlevel/hardware/listing.cfm?code=workzone>. The Department maintains a secondary list at the following internet address: <http://www.dot.ca.gov/hq/traffops/signtech/signdel/pdffiles.htm>.

Category 2 devices that have not received FHWA acceptance, and were purchased before October 1, 2000, may continue to be used until they complete their useful service life or until January 1, 2003, whichever comes first. Category 2 devices in use that have received FHWA acceptance shall be labeled with the FHWA acceptance letter number and the name of the manufacturer by the start of the project. The label shall be readable. After January 1, 2003, all Category 2 devices without a label shall not be used on the project.

Full compensation for providing self-certification for crashworthiness of Category 1 traffic control devices and labeling Category 2 devices as specified shall be considered as included in the prices paid for the various contract items of work requiring the use of the Category 1 or Category 2 traffic control devices and no additional compensation will be allowed therefor.

10-1.05 CONSTRUCTION AREA SIGNS

Construction area signs shall be furnished, installed, maintained, and removed when no longer required in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. Type II retroreflective sheeting shall not be used on construction area sign panels.

The Contractor shall notify the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to commencing excavation for construction area sign posts. The regional notification centers include, but are not limited to, the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444 1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133 1-800-227-2600

Excavations required to install construction area signs shall be performed by hand methods without the use of power equipment, except that power equipment may be used if it is determined there are no utility facilities in the area of the proposed post holes.

Sign substrates for stationary mounted construction area signs may be fabricated from fiberglass reinforced plastic as specified under "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

10-1.06 MAINTAINING TRAFFIC

Attention is directed to Sections 7-1.08, "Public Convenience," 7-1.09, "Public Safety," and 12, "Construction Area Traffic Control Devices," of the Standard Specifications and to the provisions in "Public Safety", "Portable Changeable Message Sign" and "Replace Concrete Pavement (Fast Setting Hydraulic Cement Concrete)" of these special provisions and these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7-1.09.

Lane closures shall conform to the provisions in section "Traffic Control System for Lane Closure" of these special provisions.

In addition to the provisions set forth in "Public Safety" of these special provisions, whenever work to be performed on the freeway traveled way (except for grinding operations, saw-cutting concrete slabs with a truck mounted attenuator (TMA) as a shadow vehicle and the work of installing, maintaining and removing traffic control devices) is within 1.8 m of the adjacent traffic lane, the adjacent traffic lane shall be closed.

Personal vehicles of the Contractor's employees shall not be parked within the freeway right of way. The Contractor shall notify local authorities of the Contractor's intent to begin work at least 5 days before work is begun. The Contractor shall cooperate with local authorities relative to handling traffic through the area and shall make arrangements relative to keeping the working area clear of parked vehicles.

Whenever vehicles or equipment are parked on the freeway shoulder within 1.8 m of a traffic lane, the shoulder area shall be closed as shown on the plans.

Except as otherwise provided in these special provisions, freeway lanes and connectors shall be closed only during the hours shown on Charts 1 through 23 included in this section "Maintaining Traffic." Except work required under Sections 7-1.08 and 7-1.09, work that interferes with public traffic shall be performed only during the hours shown for lane closures.

The traffic lane, which is outside of through traffic lanes, as described in the Charts 1 through 8 may be closed anytime the adjacent connector or ramp is permitted to be closed in accordance with Charts 9 through 40. At any other locations, the traffic lane which outside of through traffic lanes may be closed anytime the adjacent freeway lane is permitted to be closed.

The bus/carpool (HOV) lanes on Route 10 freeway may be closed in either direction between the hours of 10:00 p.m. and 4:00 a.m., except as otherwise provided in these special provisions. Metropolitan Transportation Authority (MTA) bus officials and Foothill Transit shall be notified a minimum of 5 working days prior to closing the HOV lanes to do any work on or adjacent to said HOV lanes. MTA and Foothill Transit officials may be contacted by telephone during normal weekday work hours at (213) 922-6111 and (626) 279-9716.

When removing and replacing concrete slabs, the Contractor shall schedule his operations in conformance with the hours and requirements shown on Table A through Table F in place of Charts 1 through 8. The Contractor shall place a Special "WET CONCRETE" sign in front of newly poured concrete pavement during curing period.

When a designated legal holiday falls between and including Thursday and the following Tuesday, no work will be permitted during the intervening weekend for concrete pavement replacement.

When replacing the loop detectors at Frazier Street, the Contractor shall close the freeway lanes as shown on the Traffic Handling Plan (Flip-Flop Operation) between the hours of 1:00 am to 5:00 am, Monday through Friday, and 3:00 am to 6:00 am on Sundays.

Except as otherwise provided in these special provisions, ramps shall be closed only during the hours shown on Charts 24 through 40. At any other locations, ramps may be closed anytime the adjacent freeway lane is permitted to be closed.

No two consecutive on-ramps or consecutive off-ramps in the same direction of travel shall be closed at the same time unless otherwise permitted by the Engineer.

If two or more consecutive on-ramps are permitted to be closed, the Contractor, at his expense, shall furnish and install special signs for entrance ramp closures (sign SP-4) as directed by the Engineer.

When an off-ramp is closed, the Contractor shall furnish and erect, as directed by the Engineer, a special sign for exit ramp closures (sign SP-3 or SP-5) as shown on the plans.

Special advance notice publicity signs (sign SP-1), as shown on the plans shall be posted as directed by the Engineer, a minimum of 7 days prior to the actual ramp or connector closure. When ramps are closed, public traffic shall be detoured as directed by the Engineer. Furnishing, erecting, maintaining, and removing special portable freeway detour signs (sign SP-2) along the detour routes as directed by the Engineer shall be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Full compensation for furnishing, erecting, maintaining, and removing special signs for exit ramp closures (SP-3 or SP-5), special advance notice publicity signs (SP-1), and special "WET CONCRETE" (2100 MM X 900 MM, series "D" letter and black on orange) signs as shown on the plans or in these special provisions shall be considered as included in the contract lump sum price paid for traffic control system and no additional payment will be made therefor.

All aforementioned special signs shall become the property of the Contractor at the conclusion of this project and shall be removed from the worksite.

Designated legal holidays are: January 1st, the third Monday in February, the last Monday in May, July 4th, the first Monday in September, November 11th, Thanksgiving Day, and December 25th. When a designated legal holiday falls on a Sunday, the following Monday shall be a designated legal holiday. When November 11th falls on a Saturday, the preceding Friday shall be a designated legal holiday.

Minor deviations from the requirements of this section concerning hours of work which do not significantly change the cost of the work may be permitted upon the written request of the Contractor, if in the opinion of the Engineer, public traffic will be better served and the work expedited. These deviations shall not be adopted by the Contractor until the Engineer has approved the deviations in writing. All other modifications will be made by contract change order.

**Chart No. 1
Lane Requirements and Hours of Work**

Location: E/B Rte 10; Fremont Ave. UC to Baldwin Ave.

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	2	1	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X			3	2
Fridays	2	2	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X			3
Saturdays	2	2	2	1	1	2	2	3		X	X	X	X	X	X	X	X	X	X					3
Sundays	2	2	2	1	1	1	2	2	3			X	X	X	X	X	X	X	X				3	2
Working day before designated legal holiday	2	2	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on eastbound roadway

REMARKS: Number of Through Traffic Lanes - 4* (Does not include HOV/Bus lane)

Legend* - The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 2
Lane Requirements and Hours of Work**

Location: E/B Rte 10; Baldwin Ave to Route 605

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	2	1	1	1	1	2	3							X	X	X	X	X	X	X			3	2
Fridays	2	1	1	1	1	2	3					X	X	X	X	X	X	X	X	X	X			3
Saturdays	2	2	1	1	1	1	2	3			X	X	X	X	X	X	X	X	X	X				3
Sundays	2	2	2	1	1	1	1	2	3	3		X	X	X	X	X	X	X	X	X	X		3	2
Working day before designated legal holiday	2	1	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on eastbound roadway

REMARKS: Number of Through Traffic Lanes - 4*

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 3
Lane Requirements and Hours of Work**

Location: E/B Rte 10; Route 605 to Barranca St. OC

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X			3	3	2
Fridays	1	1	1	1	1	3	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X			3	2
Saturdays	2	1	1	1	1	2	2	3	3			X	X	X	X	X	X	X					3	3	3
Sundays	2	2	1	1	1	1	2	2	3	3			X	X	X	X	X						3	3	2
Working day before designated legal holiday	1	1	1	1	1	3	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on eastbound roadway

REMARKS: Number of Through Traffic Lanes - 4*

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 4
Lane Requirements and Hours of Work**

Location: E/B Rte 10; Barranca St. OC to 10/57/210 Interchange

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	1	1	1	1	1	2	3	X	X	X					X	X	X	X		4	3	3	3	2
Fridays	1	1	1	1	1	2	3	X	X	X					X	X	X	X		4	4	4	3	2
Saturdays	2	1	1	1	1	1	2	3	3									4	4	4	3	3	3	2
Sundays	2	1	1	1	1	1	1	2	2	3								4	4	4	4	3	3	2
Working day before designated legal holiday	1	1	1	1	1	2	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
4	Provide at least four through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on eastbound roadway

REMARKS: Number of Through Traffic Lanes - 5*

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 5
Lane Requirements and Hours of Work**

Location: W/B Rte 10; 10/57/210 Interchange to Via Verde UC

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	1	1	1	1	3					4	4	4	4	4	4	4					3	3	3	2	2
Fridays	1	1	1	1	3					4	4	4	4	4	4					4	3	3	3	2	
Saturdays	2	1	1	1	1	2	3	3	4	4	4	4	4	4	4	4	4	4	4	4	4	3	3	3	3
Sundays	2	1	1	1	1	1	1	2	2	3	4	4	4	4	4	4	4	4	4	4	4	4	3	3	2
Working day before designated legal holiday	1	1	1	1	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
4	Provide at least four through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on westbound roadway

REMARKS: Number of Through Traffic Lanes - 4 and 5

**Chart No. 6
Lane Requirements and Hours of Work**

Location: W/B Rte 10; Via Verde UC to Route 605

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	1	3	X	X	X	X	X	X	X	X	X	X	X	X	X			4	3	3	3	2
Fridays	1	1	1	1	3	X	X	X	X	X	X	X	X	X	X	X	X	X			4	4	4	3	3
Saturdays	2	1	1	1	2	2	3		X	X	X	X	X	X	X	X	X	X					4	4	3
Sundays	2	2	1	1	1	1	2	2	3	4		X	X	X	X	X	X	X					4	3	2
Working day before designated legal holiday	1	1	1	1	3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
4	Provide at least four through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on westbound roadway

REMARKS: Number of Through Traffic Lanes - 4 and 5*

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 7
Lane Requirements and Hours of Work**

Location: W/B Rte 10; Route 605 to Baldwin Ave.

FROM HOUR TO HOUR	a.m.												p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X				3	3	3	2
Fridays	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X						3	2
Saturdays	2	1	1	1	1	2	3		X	X	X	X	X	X	X	X	X	X	X	X	X	X				3
Sundays	2	2	1	1	1	1	2	2	3		X	X	X	X	X	X	X	X	X	X	X	X			3	2
Working day before designated legal holiday	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on westbound roadway

REMARKS: Number of Through Traffic Lanes - 4*

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 8
Lane Requirements and Hours of Work**

Location: W/B Rte 10; Baldwin Ave. to Rte 710

FROM HOUR TO HOUR	a.m.												p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X							3	3	3	2
Fridays	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X									3	2
Saturdays	2	1	1	1	1	2	3	3		X	X	X	X	X	X	X										3
Sundays	2	2	1	1	1	1	2	2	3			X	X	X	X	X									3	2
Working day before designated legal holiday	1	1	1	1	2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Designated legal holidays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

Legend:

1	Provide at least one through freeway lane open in direction of travel
2	Provide at least two through freeway lanes open in direction of travel
3	Provide at least three through freeway lanes open in direction of travel
	No lane closure permitted; work permitted anywhere that does not require freeway lane closure
X	No lane closure permitted; no work permitted on westbound roadway

REMARKS: Number of Through Traffic Lanes - 4* (Does not include HOV Lane)

Legend* -The traffic lane which is outside of the through traffic lanes and is delineated with a double line of pavement markers as shown on "Pavement Markers and Traffic Lines Detail 37 series," shall not be closed at same time as through traffic lanes, except as otherwise provided in this section.

**Chart No. 9
Connector Lane Requirements and Hours of Work**

Location: Westbound Rte 10 to Route 710

FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X																	X
Sundays	X	X	X	X	X	X	X	X	X	X															X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to exit at Fremont Ave. off-ramp, west on Hellman Ave., north on Fremont Ave., west on Valley Blvd. to the on-ramp to southbound Rte 710 Fwy. Place a Portable Changeable Message Sign on the right shoulder of westbound Rte 10 Fwy; by call box #229 with the message:

"RTE 710 / EXITS / CLOSED -- USE / FREMONT / AVE"

**Chart No. 10
Connector Lane Requirements and Hours of Work**

Location: Westbound Rte 10 to Southbound Rte 710

FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X																			X	X
Fridays	X	X	X	X	X																			X	X
Saturdays	X	X	X	X	X	X	X	X	X															X	X
Sundays	X	X	X	X	X	X	X	X	X	X														X	X
Working day before designated legal holiday	X	X	X	X	X																				
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to northbound Rte 710 Fwy to exit at Valley Blvd and back on southbound Rte 710 Fwy. Place a Portable Changeable Message Sign on the right shoulder of westbound Rte 10 Fwy; by call box #229 with the message:

"S 710 / EXIT / CLOSED -- USE / N 710 TO / VALLEY"

**Chart No. 11
Connector Lane Requirements and Hours of Work**

Location: Northbound Rte 710 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X															X	X	X	X	X
Fridays	X	X	X	X	X	X															X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

- X Connector may be closed
- Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to eastbound Rte 10 and exit at Fremont Ave., north on Fremont Ave., east on Hellman Ave. to the on-ramps to Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of northbound Rte 710 Fwy; 500 meters in advance of Ramona Blvd. off-ramp with the message:

"WEST 10 / EXIT / CLOSED -- USE / E 10 TO / FREMONT"

**Chart No. 12
Connector Lane Requirements and Hours of Work**

Location: Southbound Rte 710 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X									X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X									X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to eastbound 10 Fwy to exit at Fremont Ave. off-ramp, north on Fremont Ave., east on Hellman Ave. to the on-ramps to Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of southbound 710 Fwy; 500 meters in advance of the eastbound Rte 10 off-connector with the message:

"WEST 10 / EXIT / CLOSED -- USE / E 10 TO / FREMONT"

**Chart No. 13
Connector Lane Requirements and Hours of Work**

Location: Eastbound Rte 10 to Northbound Rte 605

FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X															X	X	X	X	X
Fridays	X	X	X	X	X	X																X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X											X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X											X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic onto southbound Rte 605 Fwy and exit at Valley Blvd. off-ramp, east on Valley Blvd. to the on-ramp to northbound Rte 605 Fwy. Place a Portable Changeable Message Sign on the right shoulder of eastbound Rte 10 Fwy at the gore of Garvey Ave on-ramp with the message:

"N 605 / EXIT / CLOSED -- USE / S 605 TO / VALLEY"

Alternate Detour:

Detour traffic to continue and exit at Frazier St. off-ramp, south on Frazier St., north on Athol St., east on Bess Ave. to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of eastbound Rte 10 Fwy at the gore of Garvey Ave on-ramp with the message:

N 605 / EXIT / CLOSED -- USE / FRAZIER / STREET"

**Chart No. 14
Connector Lane Requirements and Hours of Work**

Location: Eastbound Rte 10 to Southbound Rte 605

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X														X	X	X	X	X
Fridays	X	X	X	X	X	X														X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X											X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X										X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to northbound Rte 605 and exit at Ramona Blvd., west on Ramona Blvd to the on-ramp to southbound Rte 605 Fwy. Place a Portable Changeable Message Sign on the right shoulder of eastbound Rte 10 Fwy, at the gore of Garvey Ave. on-ramp with the message:

"S 605 / EXIT / CLOSED -- USE / N 605 TO / RAMONA"

Alternate Detour:

Detour traffic to continue and exit Frazier St. off-ramp, south on Frazier St., north on Athol St., east on Bess Ave. to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of eastbound Rte 10 Fwy at the gore of Garvey Ave on-ramp with the message:

"S 605 / EXIT / CLOSED -- USE / FRAZIER / STREET"

**Chart No. 15
Connector Lane Requirements and Hours of Work**

Location: Westbound Rte 10 to Rte 605

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X																				X	X
Fridays	X	X	X	X																					X
Saturdays	X	X	X	X	X	X	X																		X
Sundays	X	X	X	X	X	X	X	X																X	X
Working day before designated legal holiday	X	X	X	X																					
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to continue on westbound Rte 10 Fwy and exit at Durfee/Garvey Ave off-ramp straight to Garvey Ave., west on Valley Blvd. to the on-ramp to Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of westbound Rte 10 Fwy; 500 meters in advance of Durfee/Garvey Ave. off-ramp with the message:

"RTE 605 / EXITS / CLOSED -- USE / DURFEE TO / GARVEY"

Truck Detour:

Detour trucks to go south on Durfee Ave., west on Valley Blvd. to the on-ramp to Rte 10 Fwy. Place a Portable Changeable Message Sign 60 meters in advance of the intersection of Durfee Ave. with the message:

"TRUCK / DETOUR -- LEFT / ON / DURFEE"

**Chart No. 16
Connector Lane Requirements and Hours of Work**

Location: Northbound Rte 605 to Eastbound Rte 10

FROM HOUR TO HOUR	a.m.											p.m.														
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	X	X	X	X	X	X																			X	X
Fridays	X	X	X	X	X	X																				X
Saturdays	X	X	X	X	X	X	X	X	X																X	X
Sundays	X	X	X	X	X	X	X	X	X	X															X	X
Working day before designated legal holiday	X	X	X	X	X	X																				
Designated legal holidays																										

Legend:

- X Connector may be closed
- Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to continue on to westbound Rte 10 Fwy and exit at Durfee/Garvey Ave off-ramp straight to Garvey Ave., west on Valley Blvd. to the on-ramp to Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of northbound Rte 605 Fwy; 500 meters in advance of northbund Rte 605 to Rte 10 off-connector with the message:

"EAST 10 / EXIT / CLOSED -- USE / W 10 TO / DURFEE"

Truck Detour:

Detour trucks to go south on Durfee Ave., west on Valley Blvd. to the on-ramp to Rte 10 Fwy. Place a Portable Changeable Message Sign 60 meters in advance of the intersection of Durfee Ave. with the message:

" TRUCK / DETOUR -- LEFT / ON / DURFEE"

**Chart No. 17
Connector Lane Requirements and Hours of Work**

Location: Northbound Rte 605 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X				X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X	X				X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X								X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X							X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								

Legend:

- X Connector may be closed
- Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to continue and exit at Ramona Blvd., west on Ramona Blvd to the on-ramp to southbound Rte 605 Fwy. Place a Portable Changeable Message Sign on the right shoulder of northbound Rte 605 Fwy, 500 meters in advance of Rte 10 off-connector with the message:

"WEST 10 / EXIT / CLOSED -- USE / RAMONA / BLVD"

**Chart No. 18
Connector Lane Requirements and Hours of Work**

Location: Southbound Rte 605 to Eastbound Rte 10

FROM HOUR TO HOUR	a.m.											p.m.																	
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12				
Mondays through Thursdays	X	X	X	X	X	X																			X	X	X	X	
Fridays	X	X	X	X	X	X																					X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X																X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X														X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																							
Designated legal holidays																													

Legend:

- X Connector may be closed
- Work permitted that does not require connector lane closure

REMARKS:

Detour traffic on to westbound Rte 10 Fwy and exit at Durfee/Garvey Ave. off-ramp straight to Garvey Ave., west on Valley Blvd. to the on-ramp to eastbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of southbound Rte 605 Fwy; 500 meters in advance of southbound Rte 605 to Rte 10 off-connector with the message:

"EAST 10 / EXIT / CLOSED -- USE / W 10 TO / DURFEE"

Truck Detour:

Detour trucks to go south on Durfee Ave., west on Valley Blvd. to the on-ramp to Rte 10 Fwy. Place a Portable Changeable Message Sign 60 meters in advance of the intersection of Durfee Ave. with the message:

"TRUCK / DETOUR -- LEFT / ON / DURFEE"

**Chart No. 19
Connector Lane Requirements and Hours of Work**

Location: Southbound Rte 605 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

- X Connector may be closed
- Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to exit at Ramona Blvd. off-ramp, west to Peck Rd., south to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of southbound Rte 605 Fwy, 500 meters in advance of Ramona Blvd off-ramp with the message:

"S 605 / EXIT / CLOSED -- DETOUR / USE / RAMONA"

Chart No. 20
Connector Lane Requirements and Hours of Work

Location: Eastbound Rte 10 to Westbound Rte 210/Southbound Rte 57

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X						X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X						X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to continue and exit Fairplex Dr., north on Fairplex Dr. to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign inside the connector closure with the message:

"57/210 / EXITS / CLOSED -- USE / FAIRPLEX / DRIVE"

**Chart No. 21
Connector Lane Requirements and Hours of Work**

Location: Northbound Rte 57 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to eastbound Rte 10 and exit Fairplex Dr., north on Fairplex Dr. to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of northbound Rte 57 Fwy; 500 meters in advance of off-connector with the message:

"WEST 10 / EXIT / CLOSED -- USE / E 10 TO / FAIRPLEX"

Chart No. 22
Connector Lane Requirements and Hours of Work

Location: Northbound Rte 71 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to exit Fairplex Dr., north on Fairplex Dr. to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of northbound Rte 71 Fwy; 500 meters in advance of Fairplex Dr. off-ramp with the message:

"WEST 10 / EXIT / CLOSED -- USE / FAIRPLEX / DRIVE"

Close on-ramp from Ridgeway St.

**Chart No. 23
Connector Lane Requirements and Hours of Work**

Location: Eastbound Rte 210 to Westbound Rte 10

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X	X					X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Connector may be closed
	Work permitted that does not require connector lane closure

REMARKS:

Detour traffic to eastbound Rte 10 and exit Fairplex Dr., north on Fairplex Dr. to the on-ramp to westbound Rte 10 Fwy. Place a Portable Changeable Message Sign on the right shoulder of eastbound Rte 210; 500 meters in advance of off-connector with the message:

"WEST 10 / EXIT / CLOSED -- USE / E 10 TO / FAIRPLEX"

Chart No. 24																									
Ramp Lane Requirements and Hours of Work																									
Location: Westbound Rte 10 off-ramp to Campus Dr.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X				X	X	X	X	X	X					X	X	X	X	X	
Fridays	X	X	X	X	X	X				X	X	X	X	X	X						X	X	X	X	
Saturdays	X	X	X	X	X	X	X	X	X	X	X										X	X	X	X	
Sundays	X	X	X	X	X	X	X	X	X	X	X									X	X	X	X	X	
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 25																									
Ramp Lane Requirements and Hours of Work																									
Location: Westbound Rte 10 on-ramp from Winthrop Dr.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X				X	X	X	X	X	X					X	X	X	X	X	
Fridays	X	X	X	X	X	X				X	X	X	X	X	X						X	X	X	X	
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS: The full width of the traveled way shall be open for use by public traffic when construction operations are not actively in progress.																									

Chart No. 26																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 off-ramps to Atlantic Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																			X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X																	X
Sundays	X	X	X	X	X	X	X	X	X																X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 27																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 on-ramps from Atlantic Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																			X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X																	X
Sundays	X	X	X	X	X	X	X	X	X																X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 28																								
Ramp Lane Requirements and Hours of Work																								
Location: Westbound Rte 10 off-ramps to Atlantic Ave.																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X																		X
Fridays	X	X	X	X	X	X																		X
Saturdays	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X															X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								
Legend:																								
X	Ramp may be closed																							
	Work permitted anywhere that does not require ramp lane closure																							
REMARKS:																								

Chart No. 29																								
Ramp Lane Requirements and Hours of Work																								
Location: Westbound Rte 10 on-ramps from Atlantic Ave.																								
FROM HOUR TO HOUR	a.m.												p.m.											
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	X	X	X	X	X	X																		X
Fridays	X	X	X	X	X	X																		X
Saturdays	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X															X
Working day before designated legal holiday	X	X	X	X	X	X																		
Designated legal holidays																								
Legend:																								
X	Ramp may be closed																							
	Work permitted anywhere that does not require ramp lane closure																							
REMARKS:																								

Chart No. 30																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 off-ramps to Garfield Ave.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X																			X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X																	X
Sundays	X	X	X	X	X	X	X	X	X																X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 31																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 on-ramps from Garfield Ave.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X																			X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X																	X
Sundays	X	X	X	X	X	X	X	X	X																X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 32																									
Ramp Lane Requirements and Hours of Work																									
Location: Westbound Rte 10 off-ramps to Garfield Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X	X														X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 33																									
Ramp Lane Requirements and Hours of Work																									
Location: Westbound Rte 10 on-ramps from Garfield Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X	X														X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

**Chart No. 34
Ramp Lane Requirements and Hours of Work**

Location: Eastbound Rte 10 off-ramps to New Ave.

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X	X														X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

- Ramp may be closed
- Work permitted anywhere that does not require ramp lane closure

REMARKS:

Chart No. 35																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 on-ramps from New Ave.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X																		X	X
Fridays	X	X	X	X	X	X																			X
Saturdays	X	X	X	X	X	X	X	X	X																X
Sundays	X	X	X	X	X	X	X	X	X	X														X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 36																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 off-ramps to San Gabriel Ave.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X				X	X	X										X	X	X	X
Fridays	X	X	X	X	X	X				X	X	X											X	X	X
Saturdays	X	X	X	X	X	X	X	X	X														X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X												X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 37																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 on-ramps from San Gabriel Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X					X	X	X									X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X										X	X	X
Saturdays	X	X	X	X	X	X	X	X	X														X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X												X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

Chart No. 38																									
Ramp Lane Requirements and Hours of Work																									
Location: Westbound Rte 10 off-ramps to San Gabriel Ave.																									
FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X																X	X	X	X
Fridays	X	X	X	X	X	X																	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X														X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X												X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS:																									

**Chart No. 39
Ramp Lane Requirements and Hours of Work**

Location: Westbound Rte 10 on-ramps from San Gabriel Ave.

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	X	X	X	X	X	X															X	X	X	X	X
Fridays	X	X	X	X	X	X																X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X													X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X												X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									

Legend:

X	Ramp may be closed
	Work permitted anywhere that does not require ramp lane closure

REMARKS:

Chart No. 40																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Route 10 off-ramp to Baldwin Park Blvd.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X						X	X	X	X	X
Fridays	X	X	X	X	X	X					X	X	X	X	X						X	X	X	X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS: The full width of the traveled way shall be open for use by public traffic when construction operations are not actively in progress.																									

Chart No. 41																									
Ramp Lane Requirements and Hours of Work																									
Location: Eastbound Rte 10 off-ramp to Francisquito Ave.																									
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9		10	11
Mondays through Thursdays	X	X	X	X	X	X					X	X	X	X	X									X	X
Fridays	X	X	X	X	X	X					X	X	X	X										X	X
Saturdays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Working day before designated legal holiday	X	X	X	X	X	X																			
Designated legal holidays																									
Legend:																									
X	Ramp may be closed																								
	Work permitted anywhere that does not require ramp lane closure																								
REMARKS: The full width of the traveled way shall be open for use by public traffic when construction operations are not actively in progress.																									

TABLE A

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: E/B Route 10 Fwy between Rosemead Blvd. and Baldwin Ave.		
Lane No. Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
Lane No. Being Replaced	Other Closure Requirements	
# 3	<p>Open lane # 2 by 8:00 am during curing period.</p> <p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Close Walnut Grove Ave. off and on-ramps, Rosemead Blvd. off and on-ramps, Flair Dr. off and on-ramps and Baldwin Ave. off-ramp as necessary.</p>	

TABLE B

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: E/B Route 10 Fwy between Baldwin Ave. and Santa Anita Ave.		
Slab Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
Slab Being Replaced	Other Closure Requirements	
# 3	<p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Place a second Portable Changeable Message Sign on the right shoulder by the gore point of City of Terrace Dr. off-ramp with the message: "SINGLE / LANE / ONLY -- AT / BALDWIN / AVE"</p> <p>Close Baldwin Ave. off and on-ramps and Santa Anita Ave. off-ramp as necessary.</p>	

TABLE C

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: E/B Route 10 Fwy between Santa Anita Ave. and Route 605		
Lane No. Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
# 4	# 3 & 4	midnight Friday to 8:00 am Saturday midnight Saturday to 10:00 a.m. Sunday
Lane No. Being Replaced	Other Closure Requirements	
# 3	<p>Open lane # 2 by 8:00 am during curing period.</p> <p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Close Baldwin Ave. on-ramp, Santa Anita Ave. off and on-ramps, SB Peck Rd off-ramp, North Peck Rd/Valley Blvd. off and on-ramps, North Peck Rd/Stewart St on-ramp, Garvey Ave/Durfee Ave. on-ramp as necessary.</p> <p>Close EB Rte 10 to NB Rte 605 and EB Rte 10 to SB Rte 605 off-connectors and detour traffic as necessary and in accordance with Charts 13 and 14 respectively.</p>	
# 4	<p>Open lane # 3 by 7:00 am on Saturday and 8:00 am on Sunday during curing period.</p> <p>Close Baldwin Ave. on-ramp, Santa Anita Ave. off and on-ramps, SB Peck Rd off-ramp, North Peck Rd/Valley Blvd. off and on-ramps, North Peck Rd/Stewart St. on-ramp, Garvey Ave/Durfee Ave. on-ramp as necessary.</p> <p>Close EB Rte 10 to NB Rte 605 and EB Rte 10 to SB Rte 605 off-connectors and detour traffic as necessary and in accordance with Charts 13 and 14 respectively.</p>	

TABLE D

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: W/B Route 10 Fwy between Rte 605 and Santa Anita Ave.		
Lane No. Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
# 4	# 3 & 4	11:00 pm Friday to 7:00 am Saturday 1:00 am Sunday to 9:00 a.m. Sunday
Lane No. Being Replaced	Other Closure Requirements	
# 3	<p>Open lane # 2 by 6:00 am during curing period.</p> <p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Close Garvey Ave/Durfee Ave. off-ramp, North Peck Rd. off-ramp, Valley Blvd. off and on-ramps, South Peck Rd. off and on-ramps and Santa Anita Ave. off-ramp as necessary.</p> <p>Close NB Rte 605 to WB Rte 10 and SB Rte 605 to WB Rte 10 off-connector and detour traffic as necessary and in accordance with Charts 17 and 19 respectively.</p>	
# 4	<p>Open lane # 3 by 6:00 am on Saturday and 8:00 am on Sunday during curing period.</p> <p>Close Garvey Ave/Durfee Ave. off-ramp, North Peck Rd off-ramp, Valley Blvd. off and on-ramps, South Peck Rd. off and on-ramps and Santa Anita Ave. off-ramp as necessary.</p> <p>Close NB Rte 605 to WB Rte 10 and SB Rte 605 to WB Rte 10 off-connector and detour traffic as necessary and in accordance with Charts 17 and 19 respectively.</p>	

TABLE E

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: W/B Route 10 Fwy between Santa Anita Ave. and Temple City Blvd.		
Slab Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
Slab Being Replaced	Other Closure Requirements	
# 3	<p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Place a second Portable Changeable Message Sign on the right shoulder, a minimum of 500 meters in advance of Rte 605 off-connector with the message: "SINGLE / LANE / ONLY -- AT / SANTA / ANITA AV"</p> <p>Close Santa Anita Blvd. off and on-ramps, Temple City Blvd. off-ramp as necessary.</p>	

TABLE F

PERMISSIBLE HOURS OF LANE CLOSURES FOR
CONCRETE SLAB REPLACEMENT

LOCATION: W/B Route 10 between Temple City Blvd. and Rosemead Blvd.		
Lane No. Being Replaced	Lane No. Closed	Remove, Replace, and Cure Slabs
		Closure Hours
# 3	# 2, 3 & 4	1:00 am Sunday to 9:00 a.m. Sunday
Lane No. Being Replaced	Other Closure Requirements	
# 3	<p>Open lane # 2 by 6:00 am during curing period.</p> <p>Place a Portable Changeable Message Sign as shown on the plans.</p> <p>Close Temple City Blvd. off and on-ramps, Rosemead Blvd. off and on-ramps as necessary.</p>	

10-1.07 CLOSURE REQUIREMENTS AND CONDITIONS

Lane closures shall conform to the provisions in "Maintaining Traffic" of these special provisions and these special provisions.

The term closure, as used herein, is defined as the closure of a traffic lane or lanes, including ramp or connector lanes, within a single traffic control system.

CLOSURE SCHEDULE

By noon Monday, the Contractor shall submit a written schedule of planned closures for the following week period, defined as Friday noon through the following Friday noon.

The Closure Schedule shall show the locations and times when the proposed closures are to be in effect. The Contractor shall use the Closure Schedule request forms furnished by the Engineer. Closure Schedules submitted to the Engineer with incomplete, unintelligible or inaccurate information will be returned for correction and resubmittal. The Contractor will be notified of disapproved closures or closures that require coordination with other parties as a condition of approval.

Amendments to the Closure Schedule, including adding additional closures, shall be submitted to the Engineer, in writing, at least 3 working days in advance of a planned closure. Approval of amendments to the Closure Schedule will be at the discretion of the Engineer.

The Contractor shall confirm, in writing, all scheduled closures by no later than 8:00 a.m. 3 working days prior to the date on which the closure is to be made. Approval or denial of scheduled closures will be made no later than 4:00 p.m. 2 working days prior to the date on which the closure is to be made. Closures not confirmed or approved will not be allowed.

Confirmed closures that are cancelled due to unsuitable weather may be rescheduled at the discretion of the Engineer for the following working day.

CONTINGENCY PLAN

The Contractor shall prepare a contingency plan for reopening closures to public traffic. The Contractor shall submit the contingency plan for a given operation to the Engineer within one working day of the Engineer's request.

LATE REOPENING OF CLOSURES

If a closure is not reopened to public traffic by the specified time, work shall be suspended in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. The Contractor shall not make any further closures until the Engineer has accepted a work plan, submitted by the Contractor, that will insure that future closures will be reopened to public traffic at the specified time. The Engineer will have 2 working days to accept or reject the Contractor's proposed work plan. The Contractor will not be entitled to any compensation for the suspension of work resulting from the late reopening of closures.

For each 10-minute interval, or fraction thereof past the time specified to reopen the closure, the Department will deduct \$8,400 per interval from moneys due or that may become due the Contractor under the contract.

COMPENSATION

The Contractor shall notify the Engineer of any delay in the Contractor's operations due to the following conditions, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of those conditions, and the Contractor's loss due to that delay could not have been avoided by rescheduling the affected closure or by judicious handling of forces, equipment and plant, the delay will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09:

- A. The Contractor's proposed Closure Schedule is denied and his planned closures are within the time frame allowed for closures in "Maintaining Traffic" of these special provisions, except that the Contractor will not be entitled to any compensation for amendments to the Closure Schedule that are not approved.
- B. The Contractor is denied a confirmed closure.

Should the Engineer direct the Contractor to remove a closure prior to the time designated in the approved Closure Schedule, any delay to the Contractor's schedule due to removal of the closure will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09.

10-1.08 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE

A traffic control system shall consist of closing traffic lanes and ramps in conformance with the details shown on the plans, the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications, the provisions under "Maintaining Traffic" and "Construction Area Signs" of these special provisions, and these special provisions.

The provisions in this section will not relieve the Contractor of responsibility for providing additional devices or taking measures as may be necessary to comply with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

When performing traffic control on the high occupancy vehicle lane (HOV lane) or where the median is less than 3 meters, the Contractor shall conform to the requirements under the moving type lane closure for truck mounted attenuator (TMA).

During traffic stripe operations and pavement marker placement operations using bituminous adhesive, traffic shall be controlled, at the option of the Contractor, with either stationary or moving lane closures. During other operations, traffic shall be controlled with stationary lane closures. Attention is directed to the provisions in Section 84-1.04, "Protection From Damage," and Section 85-1.06, "Placement," of the Standard Specifications.

If components in the traffic control system are displaced or cease to operate or function as specified, from any cause, during the progress of the work, the Contractor shall immediately repair the components to the original condition or replace the components and shall restore the components to the original location.

STATIONARY LANE CLOSURE

When lane and ramp closures are made for work periods only, at the end of each work period, components of the traffic control system, except portable delineators placed along open trenches or excavation adjacent to the traveled way, shall be removed from the traveled way and shoulder. If the Contractor so elects, the components may be stored at selected central locations, designated by the Engineer within the limits of the highway right of way.

Each vehicle used to place, maintain and remove components of a traffic control system on multilane highways shall be equipped with a Type II flashing arrow sign which shall be in operation when the vehicle is being used for placing, maintaining or removing the components. Vehicles equipped with Type II flashing arrow sign not involved in placing, maintaining or removing the components when operated within a stationary type lane closure shall only display the caution display mode. The sign shall be controllable by the operator of the vehicle while the vehicle is in motion. The flashing arrow sign shown on the plans shall not be used on the vehicles which are doing the placing, maintaining and removing of components of a traffic control system and shall be in place before a lane closure requiring the sign's use is completed.

The 150-m section of a lane closure, shown along lane lines between the 300-m lane closure tapers on the plans entitled "Traffic Control System for Lane Closures on Freeways and Expressways" and "Traffic Control System for Lane and Complete Closures on Freeways and Expressways" shall not be used.

MOVING LANE CLOSURE

Flashing arrow signs used in moving lane closures shall be truck-mounted. Changeable message signs used in moving lane closure operations shall conform to the provisions in Section 12-3.12, "Portable Changeable Message Signs," of the Standard Specifications, except the signs shall be truck-mounted and the full operation height of the bottom of the sign may be less than 2.1 m above the ground, but should be as high as practicable.

Truck-mounted attenuators (TMA) for use in moving lane closures shall be any of the following approved models, or equal:

- A. Hexfoam TMA Series 3000, Alpha 1000 TMA Series 1000 and Alpha 2001 TMA Series 2001, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone (312) 467-6750.
 - 1. Distributor (Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX (916) 387-9734.
 - 2. Distributor (Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274.
- B. Cal T-001 Model 2 or Model 3, manufacturer and distributor: Hexcel Corporation, 11711 Dublin Boulevard, P.O. Box 2312, Dublin, CA 94568, Telephone (510) 828-4200.
- C. Renco Rengard Model Nos. CAM 8-815 and RAM 8-815, manufacturer and distributor: Renco Inc., 1582 Pflugerville Loop Road, P.O. Box 730, Pflugerville, TX 78660-0730, Telephone 1-800-654-8182.

Each TMA shall be individually identified with the manufacturer's name, address, TMA model number, and a specific serial number. The names and numbers shall each be a minimum 13 mm high and located on the left (street) side at the lower front corner. The TMA shall have a message next to the name and model number in 13 mm high letters which states, "The bottom of this TMA shall be _____ mm ± _____ mm above the ground at all points for proper impact performance." Any TMA which is damaged or appears to be in poor condition shall not be used unless recertified by the manufacturer. The Engineer shall be the sole judge as to whether used TMAs supplied under this contract need recertification. Each unit shall be certified by the manufacturer to meet the requirements for TMA in conformance with the standards established by the Transportation Laboratory.

Approvals for new TMA designs proposed as equal to the above approved models shall be in conformance with the procedures (including crash testing) established by the Transportation Laboratory. For information regarding submittal of new designs for evaluation contact: Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, California 95819.

New TMAs proposed as equal to approved TMAs or approved TMAs determined by the Engineer to need recertification shall not be used until approved or recertified by the Transportation Laboratory.

PAYMENT

The contract lump sum price paid for traffic control system shall include full compensation for furnishing all labor (except for flagging costs), materials (including signs), tools, equipment, and incidentals, and for doing all the work involved in placing, removing, storing, maintaining, moving to new locations, replacing and disposing of the components of the traffic control system shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer. Flagging costs will be paid for as provided in Section 12-2.02, "Flagging Costs," of the Standard Specifications.

The adjustment provisions in Section 4-1.03, "Changes," of the Standard Specifications shall not apply to the item of traffic control system. Adjustments in compensation for traffic control system will be made only for increased or decreased traffic control system required by changes ordered by the Engineer and will be made on the basis of the cost of the increased or decreased traffic control necessary. The adjustment will be made on a force account basis as provided in Section 9-1.03, "Force Account Payment," of the Standard Specifications for increased work and estimated on the same basis in the case of decreased work.

Traffic control system required by work which is classed as extra work, as provided in Section 4-1.03D of the Standard Specifications, will be paid for as a part of the extra work.

10-1.09 PORTABLE CHANGEABLE MESSAGE SIGN

Portable changeable message signs shall be furnished, placed, operated, and maintained at those locations provided for in these special provisions or where designated by the Engineer in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to Charts 9 through 23 and Table A through F in "Maintaining Traffic" of these special provisions regarding the use and locations of the portable changeable message signs.

Full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing, placing, operating, maintaining, repairing, replacing, transporting from location to location, and removing the portable changeable message signs as specified in these special provisions shall be considered as included in the contract lump sum price paid for traffic control system and no separate payment will be made therefor.

10-1.10 TEMPORARY PAVEMENT DELINEATION

Temporary pavement delineation shall be furnished, placed, maintained, and removed in conformance with the provisions in Section 12-3.01, "General," of the Standard Specifications and these special provisions. Nothing in these special provisions shall be construed as reducing the minimum standards specified in the Manual of Traffic Controls published by the Department or as relieving the Contractor from his responsibility as provided in Section 7-1.09, "Public Safety," of the Standard Specifications.

GENERAL

Whenever the work causes obliteration of pavement delineation, temporary or permanent pavement delineation shall be in place prior to opening the traveled way to public traffic. Laneline pavement delineation shall be provided at all times for traveled ways open to public traffic. On multilane roadways (freeways and expressways), edgeline delineation shall be provided at all times for traveled ways open to public traffic.

Work necessary, including required lines or marks, to establish the alignment of temporary pavement delineation shall be performed by the Contractor. Surfaces to receive temporary pavement delineation shall be dry and free of dirt and loose material. Temporary pavement delineation shall not be applied over existing pavement delineation or other temporary pavement delineation. Temporary pavement delineation shall be maintained until superseded or replaced with a new pattern of temporary pavement delineation or permanent pavement delineation.

Temporary pavement markers which conflicts with a new traffic pattern or which is applied to the final layer of surfacing or existing pavement to remain in place shall be removed when no longer required for the direction of public traffic, as determined by the Engineer.

TEMPORARY LANELINE DELINEATION

Whenever lanelines are obliterated, the minimum laneline delineation to be provided shall be temporary raised pavement markers placed at longitudinal intervals of not more than 7.3 m. The temporary raised pavement markers shall be the same color as the laneline or centerline the markers replace. Temporary raised pavement markers shall be, at the option of the Contractor, one of the temporary pavement markers listed for short term day/night use (14 days or less) or long term day/night use (6 months or less) in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Temporary raised pavement markers shall be placed in conformance with the manufacturer's instructions and shall be cemented to the surfacing with the adhesive recommended by the manufacturer, except epoxy adhesive shall not be used to place pavement markers in areas where removal of the markers will be required.

Temporary laneline delineation consisting entirely of temporary raised pavement markers placed on longitudinal intervals of not more than 7.3 m shall be used on lanes open to public traffic for a maximum of 14 days. Prior to the end of the 14 days, the permanent pavement delineation shall be placed. If the permanent pavement delineation is not placed within the 14 days, additional temporary pavement delineation shall be provided at the Contractor's expense. The additional temporary pavement delineation to be provided shall be equivalent to the pattern specified for the permanent pavement delineation for the area, as determined by the Engineer.

Full compensation for furnishing, placing, maintaining, and removing the temporary raised pavement markers used for temporary laneline delineation and for providing equivalent patterns of permanent traffic lines for these areas when required shall be considered as included in the contract prices paid for the items of work that obliterated the laneline pavement delineation and no separate payment will be made therefor.

TEMPORARY EDGELINE DELINEATION

Whenever edgelines are obliterated on multilane roadways (freeways and expressways), the edgeline delineation to be provided for that area adjacent to lanes open to public traffic shall consist of solid 100-mm wide traffic stripe of the same color as the stripe the temporary edgeline delineation replaces.

Traffic stripe (100-mm wide) placed for temporary edgeline delineation shall conform to Section 84-3, "Painted Traffic Stripes And Pavement Markings," of the Standard Specifications, except for payment and the number of coats shall be, at the option of the Contractor, either one or 2 coats.

Temporary edgeline delineation shall be removed when no longer required for the direction of public traffic, as determined by the Engineer.

Full compensation for furnishing, placing, maintaining, and removing temporary edgeline delineation shall be considered as included in the contract prices paid for the items of work that obliterated the edgeline pavement delineation and no separate payment will be made therefor.

10-1.11 TEMPORARY CRASH CUSHION MODULE

This work shall consist of furnishing, installing, and maintaining sand filled temporary crash cushion modules in groupings or arrays at each location shown on the plans, as specified in these special provisions or where designated by the Engineer. The grouping or array of sand filled modules shall form a complete sand filled temporary crash cushion in conformance with the details shown on the plans and these special provisions.

Attention is directed to "Public Safety" of these special provisions.

GENERAL

Whenever the work or the Contractor's operations establishes a fixed obstacle, the exposed fixed obstacle shall be protected with a sand filled temporary crash cushion. The sand filled temporary crash cushion shall be in place prior to opening the lanes adjacent to the fixed obstacle to public traffic.

Sand filled temporary crash cushions shall be maintained in place at each location, including times when work is not actively in progress. Sand filled temporary crash cushions may be removed during a work period for access to the work provided that the exposed fixed obstacle is 4.6 m or more from a lane carrying public traffic and the temporary crash cushion is reset to protect the obstacle prior to the end of the work period in which the fixed obstacle was exposed. When no longer required, as determined by the Engineer, sand filled temporary crash cushions shall be removed from the site of the work.

MATERIALS

At the Contractor's option, the modules for use in sand filled temporary crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules or Traffix Sand Barrels manufactured after March 31, 1997, or equal:

- A. Energite III Inertial Modules, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone 1-312-467-6750, FAX 1-800-770-6755.
 - 1. Distributor (Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX 1-916-387-9734
 - 2. Distributor (Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274, FAX 1-714-937-1070.

- B. Fitch Inertial Modules, manufactured by Roadway Safety Service, Inc., 1050 North Rand Road, Wauconda, IL 60084, Telephone 1-800-426-0839, FAX 1-847-487-9820.
 - 1. Distributor (Northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone 1-800-884-8274, FAX 1-916-387-9734
 - 2. Distributor (Southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone 1-800-222-8274, FAX 1-714-937-1070.

- C. Traffix Sand Barrels, manufactured by Traffix Devices, Inc., 220 Calle Pintoresco, San Clemente, CA 92672, Telephone 1-949-361-5663, FAX 1-949-361-9205.
 - 1. Russ Enterprises, Inc., 1533 Berger Drive, San Jose, CA 95112, Telephone 1-408-287-4303, FAX 1-408-287-1929.
 - 2. Statewide Safety, P.O. Box 1440, Pismo Beach, CA 93448, Telephone 1-800-559-7080, FAX 1-805-929-5786.

Modules contained in each temporary crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color, as furnished by the vendor, with black lids. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects. The modules need not be new. Good used undamaged modules conforming to color and quality of the types specified herein may be utilized. If used Fitch modules requiring a seal are furnished, the top edge of the seal shall be securely fastened to the wall of the module by a continuous strip of heavy duty tape.

Modules shall be filled with sand in conformance with the manufacturer's directions, and to the sand capacity in kilograms for each module shown on the plans. Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water as determined by California Test 226.

Modules damaged due to the Contractor's operations shall be repaired immediately by the Contractor at the Contractor's expense. Modules damaged beyond repair, as determined by the Engineer, due to the Contractor's operations shall be removed and replaced by the Contractor at the Contractor's expense.

INSTALLATION

Temporary crash cushion modules shall be placed on movable pallets or frames conforming to the dimensions shown on the plans. The pallets or frames shall provide a full bearing base beneath the modules. The modules and supporting pallets or frames shall not be moved by sliding or skidding along the pavement or bridge deck.

A Type R or P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of the crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods determined by the Engineer.

At the completion of the project, temporary crash cushion modules, sand filling, pallets or frames, and marker panels shall become the property of the Contractor and shall be removed from the site of the work. Temporary crash cushion modules shall not be installed in the permanent work.

MEASUREMENT AND PAYMENT

Temporary crash cushion modules placed in conformance with the provisions in "Public Safety" of these special provisions will not be measured nor paid for.

10-1.12 EXISTING HIGHWAY FACILITIES

The work performed in connection with various existing highway facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

REPAIR EXISTING ROADBED

Where directed by the Engineer failed portions of the existing roadbed shall be removed and disposed of and the resulting hole shall be backfilled as directed by the Engineer.

Removing and replacing failed existing pavement will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

REMOVE TRAFFIC STRIPE AND PAVEMENT MARKING

Traffic stripes and pavement markings to be removed shall be removed at the locations shown on the plans and at the locations designated by the Engineer.

Attention is directed to "Water Pollution Control" of these special provisions.

Yellow thermoplastic traffic stripes may contain lead and chromium. Residue produced when yellow thermoplastic are removed may contain heavy metals in concentrations that exceed hazardous waste thresholds established by the California Code of Regulations and may produce toxic fumes when heated.

The removed yellow thermoplastic material shall be disposed of at a Class 1 disposal facility in conformance with the requirements of the disposal facility operator within 90 days after accumulating 100 kg of residue and dust. The Contractor shall make necessary arrangements with the operator of the disposal facility and perform required testing of the yellow thermoplastic residue required by the operator. The Contractor shall submit the name and location of the disposal facility along with testing requirements to the Engineer not less than 21 days prior to the start of removal of yellow thermoplastic traffic stripes.

At least 21 days prior to the start of removal operations of yellow thermoplastic traffic stripes, the Contractor shall submit the written compliance programs required in Subsection (e)(2), "Compliance Program," of Section 1532.1, "Lead," of the Construction Safety Orders to the Engineer. The compliance programs shall be prepared by an industrial hygienist certified by the American Board of Industrial Hygiene and shall cover all Contractor employees removing or handling the yellow thermoplastic residue. Inspection reports shall be made in conformance with the requirements in Section 1532.1 and shall be submitted to the Engineer.

Prior to performing yellow thermoplastic traffic stripes removal, personnel who have no prior lead training, including State personnel, shall complete a safety training class provided by the Contractor. The training shall conform to the requirements in Section 1532.1. The number of State personnel to be trained shall not exceed 2.

Where grinding or other methods approved by the Engineer are used to remove yellow thermoplastic traffic stripes, the removal residue including dust, shall be contained and collected immediately. Sweeping equipment shall not be used. Collection shall be by a High Efficiency Particulate Air (HEPA) vacuum attachment operated concurrently with the removal operations or other equally effective methods as approved by the Engineer. The Contractor shall submit a written work-plan for the removal, storage, and disposal of yellow thermoplastic traffic stripes to the Engineer for approval not less than 21 days prior to the start of the removal operations.

The collected yellow thermoplastic removal residue shall be stored and labeled in covered containers. The containers shall be a type as approved by the United States Department of Transportation for the transportation and temporary storage of the removal residue. The containers shall be handled in a manner that no spillage will occur. The containers shall be stored in a secured enclosure at a location within the project limits, as approved by the Engineer, until disposal.

The collected yellow thermoplastic removal residue shall be transported to a Class 1 disposal facility, using manifesting procedures, by a transporter registered with the California Department of Toxic Substance Control. The Engineer will obtain the United States Environmental Protection Agency Identification Number and sign all manifests as the generator.

The Contractor shall assume that the yellow thermoplastic removal residue is not regulated under the Federal Resource Conservation and Recovery Act (RCRA). Additional disposal costs for removal residue regulated under RCRA, as determined by test results required by the disposal facility, will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Nothing in these special provisions shall relieve the Contractor of the Contractor's responsibilities as specified in Section 7-1.09, "Public Safety," of the Standard Specifications.

Except as otherwise provided, the contract price paid per meter for remove yellow thermoplastic traffic stripe shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in the removal and disposal of yellow thermoplastic traffic stripes, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

REMOVE ASPHALT CONCRETE DIKE

Existing asphalt concrete dike, where shown on the plans to be removed, shall be removed.

Prior to removing the dike, the outside edge of the asphalt concrete to remain in place shall be cut on a neat line to a minimum depth of 50 mm.

The dike shall be removed in such a manner that the surfacing which is to remain in place is not damaged.

The dike shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13 of the Standard Specifications.

COLD PLANE ASPHALT CONCRETE PAVEMENT

Existing asphalt concrete pavement shall be cold planed at the locations and to the dimensions shown on the plans.

Planing asphalt concrete pavement shall be performed by the cold planing method. Planing of the asphalt concrete pavement shall not be done by the heater planing method.

Cold planing machines shall be equipped with a cutter head not less than 750 mm in width and shall be operated so that no fumes or smoke will be produced. The cold planing machine shall plane the pavement without requiring the use of a heating device to soften the pavement during or prior to the planing operation.

In areas less than 750 mm in width, cold planing shall be done by utilizing the cutting head specified above with fewer cutters, or by other methods as approved by the Engineer.

The depth, width, and shape of the cut shall be as shown on the typical cross sections or as designated by the Engineer. The final cut shall result in a uniform surface conforming to the typical cross sections. The outside lines of the planed area shall be neat and uniform. Planing asphalt concrete pavement operations shall be performed without damage to the surfacing to remain in place.

Where transverse joints are planed in the pavement at conform lines no drop-off shall remain between the existing pavement and the planed area when the pavement is opened to public traffic. If asphalt concrete has not been placed to the level of existing pavement before the pavement is to be opened to public traffic a temporary asphalt concrete taper shall be constructed. Asphalt concrete for temporary tapers shall be placed to the level of the existing pavement and tapered on a slope of 1:30 (Vertical: Horizontal) or flatter to the level of the planed area.

Asphalt concrete for temporary tapers shall be commercial quality and may be spread and compacted by any method that will produce a smooth riding surface. Temporary asphalt concrete tapers shall be completely removed, including the removal of loose material from the underlying surface, before placing the permanent surfacing. The removed material shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Operations shall be scheduled so that not more than 7 days shall elapse between the time when transverse joints are planed in the pavement at the conform lines and the permanent surfacing is placed at the conform lines.

The material planed from the roadway surface, including material deposited in existing gutters or on the adjacent traveled way, shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications. Removal operations of cold planed material shall be concurrent with planing operations and follow within 15 m of the planer, unless otherwise directed by the Engineer.

Cold plane asphalt concrete pavement will be measured by the square meter. The quantity to be paid for will be the actual area of surface cold planed irrespective of the number of passes required to obtain the depth shown on the plans.

The contract price paid per square meter for cold plane asphalt concrete pavement shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in cold planing asphalt concrete surfacing and disposing of planed material, including furnishing the asphalt concrete for and constructing, maintaining, removing, and disposing of temporary asphalt concrete tapers, as specified in the Standard Specifications and these special provisions and as directed by the Engineer.

10-1.13 FOG SEAL COAT

Fog seal coat shall conform to the provisions in Section 37-1, "Seal Coats," of the Standard Specifications and these special provisions.

Asphaltic emulsion shall be either SS1h or CSS1h grade.

10-1.14 ASPHALT CONCRETE

Asphalt concrete shall be Type B and asphalt concrete (open graded) and shall conform to the provisions in Section 39, "Asphalt Concrete," of the Standard Specifications and these special provisions.

Open graded asphalt concrete may be placed when the atmospheric temperature is below 20°C, but above 7°C, provided the following requirements are met:

- A. The aggregate grading shall be 12.5-mm maximum.
- B. Open graded asphalt concrete shall not be placed in a windrow or stockpile. Open graded asphalt concrete shall be transferred directly from the hauling vehicle to the asphalt paver hopper.
- C. Open graded asphalt concrete shall be not less than 25 mm in compacted thickness.

- D. Immediately prior to adding the asphalt binder to the open graded asphalt concrete mixture, the temperature of the aggregate shall be not more than 135°C. Open graded asphalt concrete shall be spread at a temperature of not less than 105°C measured in the hopper in the asphalt paver.
- E. The compaction operation shall be such that the maximum distance between the asphalt paver and the initial breakdown rolling shall be no greater than 15 m.
- F. During the placement of open graded asphalt concrete, the speed of the asphalt paver shall not exceed 10 m per minute.
- G. The Contractor shall cover loads of open graded asphalt concrete with tarpaulins. The tarpaulins shall completely cover exposed open graded asphalt concrete in the hauling vehicle until the open graded asphalt concrete has been completely transferred into the asphalt paver hopper.

The grade of asphalt binder to be mixed with aggregate for asphalt concrete (open graded) shall be PBA Grade 6a and shall conform to the provisions in "Asphalt" of these special provisions.

The aggregate for asphalt concrete (open graded) shall conform to the 12.5 mm maximum grading specified in Section 39-2.02, "Aggregate," of the Standard Specifications.

The amount of asphalt binder used in asphalt concrete placed in dikes shall be increased one percent by mass of the aggregate over the amount of asphalt binder determined for use in asphalt concrete placed on the traveled way.

Aggregate for asphalt concrete dikes shall be in conformance with the provisions for 9.5-mm Maximum grading in Section 39-2.02, "Aggregate," of the Standard Specifications.

If the Contractor selects the batch mixing method, asphalt concrete shall be produced by the automatic batch mixing method in conformance with the provisions in Section 39-3.03A(2), "Automatic Proportioning," of the Standard Specifications.

The area to which paint binder has been applied shall be closed to public traffic. Care shall be taken to avoid tracking binder material onto existing pavement surfaces beyond the limits of construction.

Shoulders adjacent to a lane being paved shall be surfaced prior to opening the lane to public traffic.

10-1.15 REPLACE CONCRETE PAVEMENT (Fast Setting Hydraulic Cement Concrete)

General — Replace concrete pavement shall consist of removing existing portland cement concrete pavement and replacing the removed pavement with Fast Setting Hydraulic Cement Concrete (FSHCC) as shown on the plans and in conformance with provisions in Section 40, "Portland Cement Concrete Pavement," of the Standard Specifications and these special provisions.

Attention is directed to "Maintaining Traffic" of these special provisions.

Removing Existing Pavement and Base — The exact limits of concrete pavement removal and replacement will be determined by the Engineer.

Existing concrete pavement material removed during a work period shall be replaced, in that same work period, with FSHCC pavement. In the event, the existing pavement is removed and the Contractor is unable, as determined by the Engineer, to construct, finish and cure the new concrete pavement by the time the replacement pavement is to be opened to traffic, the excavation shall be filled and compacted with a temporary roadway structural section as specified in this section "Replace Concrete Pavement."

The outline of concrete pavement to be removed shall be sawed full depth with a power-driven saw except where the concrete pavement is adjacent to an asphalt concrete shoulder.

Saw cuts within concrete pavement slabs shall be cut no more than 7 days prior to slab removal. Saw cuts made in work shifts prior to actual removal shall not be made parallel or diagonal to the traveled way and shall be cut so that traffic will not dislodge any pieces or segments.

Concrete pavement shall be removed by a non-impact method. Each pavement panel shall be removed in one or more pieces without disturbance or damage to the underlying base.

Regardless of the type of equipment used to remove concrete within the sawed outline, the surface of the concrete to be removed shall not be impacted within 0.5-m of the pavement to remain in place. Pavement removal shall be performed without damage to pavement that is to remain in place. Damage to pavement, which is to remain in place, shall be repaired to a condition satisfactory to the Engineer, or the damaged pavement shall be removed and replaced with new FSHCC pavement if ordered by the Engineer. Repairing or removing and replacing damaged pavement outside the limits of concrete pavement replacement shall be at the Contractor's expense and will not be measured nor paid for.

Removed materials shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications.

Trial Slab — Prior to placement of FSHCC pavement, the Contractor shall construct one or more trial slabs for each mix design to demonstrate that the personnel, equipment and the mixing, placing, curing, and sawing techniques will produce a concrete pavement conforming to these special provisions in the anticipated time period under similar atmospheric and temperature conditions as pavement construction and to establish the correlation described below. The Contractor shall not proceed to placing replacement pavement within the roadway until a trial slab has been constructed that meets the requirements of these special provisions.

The trial slab shall have dimensions of not less than 3 m by 6 m by 230 mm thick. The trial slab shall not be placed on the roadway or within the project limits. The trial slab shall be placed in a location agreed to by the Engineer.

During trial slab construction, beams shall be fabricated within 20 minutes of delivery of concrete. Beams shall be used to determine the early age and 7-day modulus of rupture. Beams fabricated for the early age test shall be cured under the same temperature conditions ($\pm 3^{\circ}\text{C}$) as the trial slab. The temperature of the slab and beams shall be monitored and recorded at time intervals of 5 minutes or less, 25 mm from the top, 25 mm from the bottom and 75 mm from any edge until the early age testing is completed. Beams fabricated for the 7-day test shall be cured in accordance with California Test 523, except they shall be placed into the sand at between 5 and 10 times the time to final set or 24 hours whichever is earlier. The strengths determined from these beams shall be the basis for determining whether FSHCC pavement production and placement may proceed. Strength results from beams shall be the basis for determining whether FSHCC pavement operations may proceed. Beams failing the "early age" or 7-day modulus of rupture requirements shall be cause for rejection of the trial slab.

During curing of the trial slab correlation testing shall be done to determine the relation between the modulus of rupture and ASTM Designation: C 805 or C 900 performed on the trial slab. When agreed to by the Contractor and the Engineer C 805 or C 900 shall be used to estimate the modulus of rupture of the pavement, at early age, based on the correlation. The correlation shall be established by testing at four or more time intervals. At least one test each shall be one hour before and after the opening age and one shall be within 15 minutes of the opening age. Estimates of modulus of rupture shall be calculated based on a least squares best-fit equation, either linear, exponential or logarithmic, whichever provides the best correlation coefficient.

Concrete pavement shall not be placed when the atmospheric temperature during placement and curing is expected to be below 10°C .

No more than 25 cubic meter of concrete pavement shall be replaced during the first concrete replacement work shift without Engineer's prior approval.

Materials resulting from construction of trial slabs and test specimens shall become the property of the Contractor and shall be removed and disposed of outside the highway right of way as provided in Section 7-1.13 of the Standard Specifications.

Fast Setting Hydraulic Cement Concrete

General — FSHCC shall be a concrete made with hydraulic cement that develops service strength prior to the time the lane is to be opened to public traffic as designated in "Maintaing Traffic" of these special provisions. Pavement made with FSHCC shall conform to the provisions in Section 40, "Portland Cement Concrete Pavement," of the Standard Specifications and these special provisions. The requirements in Section 40-1.015, "Cement Content;" Section 40-1.05, "Proportioning;" and Section 90-1.01, "Description;" of the Standard Specifications shall not apply.

The combined aggregate grading used in concrete for replacement pavement shall be either the 37.5-mm maximum or the 25-mm maximum grading.

FSHCC pavement shall develop a flexural strength (modulus of rupture) of 2.8 MPa or greater before opening to public or Contractor traffic and also shall develop a modulus of rupture of not less than 4.2 MPa 7 days after placement. The modulus of rupture shall be considered to be the average of test results of 3 beam specimens determined by California Test 523. Beam specimens may be fabricated using an internal vibrator in conformance with ASTM Designation: C31. No single test shall represent more than the production for one day.

Modulus of rupture at early ages may be determined by estimation based on a correlation determined during trial slab placement or using beams cured under the same atmospheric and temperature conditions ($\pm 3^{\circ}\text{C}$) as the pavement. Modulus of rupture at other ages shall be determined by using beams cured and tested in accordance with California Test Method 523 except they shall be placed into the sand at between five and 10 times the time to final set or 24 hours whichever is earlier. "Early age" is defined as any time less than 10 times the time to final setas determined by ASTM Designation: C 403 and reported in the mix design submittal. Testing to determine the modulus of rupture will be performed by the Engineer. The modulus of rupture, as determined above, will be the basis for accepting or rejecting the FSHCC pavement for modulus of rupture requirements.

The cement for FSHCC pavement shall be hydraulic cement as defined in ASTM Designation: C219 and conform to the following requirements:

Property	Test Method	Requirement
Contraction in Air	California Test 527 w/c Ratio =0.39±0.010	0.053% (max)
Mortar Expansion in Water	ASTM: C1038	0.04% (max)
Soluble Chloride	California Test 422	0.05% (max)*
Soluble Sulfates	California Test 417	0.30% (max)*
Thermal Stability	California Test 553	60% (min)
Compressive Strength @ 3 days	ASTM C109	17 MPa

The test is to be done on a C 109 cube specimen cured at least 14 days and then pulverized to 100% passing the 300µm sieve.

At least 45 days prior to intended use, the Contractor shall furnish a sample of the fast-setting hydraulic cement from each lot proposed for use and all admixtures proposed for use in the quantities ordered by the Engineer. A Type C, accelerating chemical admixture, conforming to the requirements of ASTM C494, and to the requirements in Section 90-4, "Admixtures," of the Standard Specifications may be used upon approval of the Engineer. Accelerating chemical admixture shall be a non-corrosive and non-chloride admixture to be added to the concrete mix at a rate recommended by the manufacturer. In addition to the admixtures listed on the Department's current list of approved brands of admixtures, citric acid or borax may be used if requested in writing by the fast-setting hydraulic cement manufacturer and a sample is submitted to the Engineer. All chemical admixtures, if used, shall be included in all the testing for the requirements listed in the table above.

At least 10 days prior to use, the Contractor shall submit in writing to the Engineer a proposed mix design that shall include:

- A. The "opening age," the age at which the concrete will achieve the specified strength for opening to public or Contractor's traffic;
- B. The proposed aggregate gradings;
- C. The mix proportions of hydraulic cement and aggregate;
- D. The type and amount of chemical admixture;
- E. The maximum time allowed between batching and placing roadway pavement;
- F. The range of temperature over which this mix design is effective (10°C maximum);
- G. The final set time of the concrete; and
- H. Any special conditions (including water temperature) or instructions.

The Contractor shall submit more than one mix design to include the temperature range when the anticipated atmospheric temperature during placement of the FSHCC pavement exceeds 10°C. In addition, the Contractor shall furnish samples of the cement, aggregates and chemical admixture proposed for use in FSHCC pavement in the quantity ordered by the Engineer. The Contractor shall develop and furnish flexural strength gain curves for each proposed mix design. The strength gain curves for up to 7 days must be provided to the engineer prior to beginning paving with any given mix design. The minimum testing ages for strength gain curves shall be: one hour before opening age, opening age, one hour after opening age, 24 hours, 7 days and 28 days. Strength gain curves may be developed from laboratory prepared samples.

The penetration requirement in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications shall not apply.

Fast-Setting Hydraulic Cement Concrete Proportioning — Weighing, measuring and metering devices used for proportioning materials shall conform to the requirements in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications and these special provisions.

The eleventh paragraph of Section 9-1.01, "Measurement of Quantities," of the Standard Specifications shall not apply to FSHCC. When an automatic weighing system is used it shall comply with the requirements for automatic proportioning devices in these specifications. These automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, or mineral admixture for one designated batch or draft is a single operation of a switch or starter.

Aggregates shall be handled and stored in accordance with the requirements of Section 90-5.01, "Storage of Aggregates" of the Standard Specifications. Liquid admixtures shall be proportioned as required in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures," of the Standard Specifications. Mineral admixtures shall be protected from exposure to moisture until used. Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.

Proportioning devices shall be tested in accordance with California Test 109 at the expense of the Contractor as frequently as the Engineer may deem necessary to insure their accuracy. All proportioning devices shall be tested in advance of FSHCC production and re-tested upon moving to a new location.

Weighing equipment shall be insulated against vibration or movement of other operating equipment. When the plant is in operation, the mass of each draft of material shall not vary from the designated mass by more than the tolerances specified herein. Each scale graduation shall be 0.001 of the usable scale capacity but in no event greater than 10 kg or smaller than 0.45 kg.

Aggregate shall be weighed cumulatively and equipment for the weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. Equipment for the separate weighing of the cement or mineral admixture shall have a zero tolerance of ± 0.5 percent of their designated individual batch drafts. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.

The mass indicated for any individual batch of material shall not vary from the preselected scale setting by more than the following:

Material	Tolerance
Aggregate	± 1.0 percent of designated batch mass
Cement	± 0.5 percent of designated batch mass
Mineral Admixture	± 1.0 percent of designated batch mass
Water	± 1.5 percent of designated batch mass or volume

Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture and water as provided in these specifications. Dry ingredients shall be proportioned by mass. Liquid ingredients shall be proportioned by mass or volume.

At the time of batching, all aggregates shall have been dried or drained sufficiently to result in stable moisture content such that no visible separation of water from aggregate will take place during the proportioning process. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

If separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.

The -cement shall be kept separate from the aggregates until it is released for discharge into the mixer. The -cement shall be free of lumps and clods when discharged into the mixer. Fabric containers used for transportation or proportioning of the cement shall be clean and free of residue before reuse.

The weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material-weighing device.

For all batches with a volume of one cubic meter or more, the proportioning equipment shall conform to one of the following methods:

- A. All ingredients shall be batched at a central batch plant and charged into a mixer truck for transportation to the pour site. Ingredient proportioning shall meet the requirements of Section 90-5, "Proportioning" of the Standard Specifications.
- B. All ingredients except cement shall be batched at a central batch plant and charged into a mixer truck for transportation to a remote located silo and weigh system for the proportioning of cement. This system shall proportion cement for charging the mixer truck.
- C. All ingredients except cement shall be batched at a central batch plant and charged into a mixer truck for transportation to a remote location where pre-weighed, containerized cement shall be added to the mixer truck. The cement pre-weighing operation shall utilize a platform scale. The platform scale shall have a maximum capacity of 2.5 tonnes with a maximum graduation size of 0.5 kilograms. Cement shall be pre-weighed into a fabric container. The minimum amount of cement to be proportioned into any single container shall be one half of the total amount required for the load of FSHCC being produced.

D. Cement, water, and aggregate shall be proportioned volumetrically as required by these special provisions.

In order to check the accuracy of batch masses, the gross mass and tare mass of truck mixers shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

The Contractor shall install and maintain in operating condition an electrically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.

No additional mixing water shall be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer. If the Engineer authorizes additional water to be incorporated into the concrete, the drum shall be revolved not less than 30 revolutions at mixing speed after the water is added and before discharge is commenced. Water added to the truck mixer at the job site shall be measured through a meter that conforms to the requirements of Section 9-1.01, "Measurement of Quantities" of the Standard Specifications.

Aggregate discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of discharge from the several bins, and from the weigh hopper, shall be interlocked so that not more than one bin can discharge at a time, and that the weigh hopper cannot be discharged until the required quantity from each of the several bins has been deposited in the weigh hopper.

Weighmaster Certificates — Each load of FSHCC delivered at the job site shall be accompanied by a weighmaster certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load, the reading of the revolution counter at the time the truck mixer is charged with the cement. This weighmaster certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.

Weighmaster certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on 90-mm diskette with a capacity of at least 1.4 megabytes. Captured data for the ingredients represented by each batch shall be followed by a line-feed carriage-return. There shall be sufficient fields to satisfy the amount of data required by these specifications.

The Contractor may furnish a weighmaster certificate that is accompanied by a separate certificate which lists the actual batch masses or measurements for a load of FSHCC provided that both certificates are: 1) imprinted with the same non-repeating load number that is unique to the contract and; 2) delivered to the pour site with the load.

Weighmaster certificates for FSHCC, regardless of the proportioning method used, shall include all information necessary to trace the manufacturer, and manufacturer's lot number for the cement being used. When proportioned into fabric containers the weight certificates for the cement shall contain the date of proportioning, the location of proportioning and the actual net draft mass of the cement. When proportioned at the pour site from a storage silo the weighmaster certificates shall contain the date of proportioning, the location of proportioning and the net draft mass of the cement used in the load.

All weighmaster certificates furnished by the Contractor shall conform to the requirements of Section 9 - 1.01, "Measurement of Quantities," of the Standard Specifications.

Volumetric Proportioning — When FSHCC is proportioned by volume, the method used shall be in compliance with the following:

Aggregates shall be handled and stored in accordance with the requirements of Section 90-5.01, "Storage of Aggregates" of the Standard Specifications. Liquid admixtures shall be proportioned as required in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures," of the Standard specifications. Mineral admixtures shall be protected from exposure to moisture until used. Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the batch-mixer storage hopper or in the feed line.

Batch-mixer trucks shall be equipped to proportion the cement, water, aggregate, and additives by volume. Aggregate feeders shall be connected directly to the drive on the cement vane feeder. The cement feed rate shall be tied directly to the feed rate for the aggregate and other ingredients. Any change in the ratio of cement to aggregate shall be accomplished by changing the gate opening for the aggregate feed. The drive shaft of the aggregate feeder shall be equipped with a revolution counter reading to the nearest full or partial revolution of the aggregate delivery belt.

The aggregate shall be proportioned using a belt feeder operated with an adjustable cutoff gate delineated to the nearest quarter increment. The height of the gate opening shall be readily determinable. Cement shall be proportioned by a method that meets the accuracy requirements of these specifications. Water shall be proportioned by a meter conforming to Section 9-1.01, "Measurement and Payment" of the Standard Specifications and these specifications.

The delivery rate of aggregate and cement per revolution of the aggregate feeder shall be calibrated at the appropriate gate settings for each batch-mixer truck used on the project and for each aggregate source. The batch-mixer trucks shall be calibrated at 3 different aggregate gate settings that are commensurate with production needs. Two or more calibration runs

shall be required at each of the different aggregate gate openings. The actual mass of material delivered for aggregate proportioning device calibrations shall be determined by a platform scale as specified in these special provisions.

The aggregate belt feeder shall deliver aggregate to the mixer with such volumetric consistency that the deviation for any individual aggregate delivery rate check-run shall not exceed 1.0 percent of the mathematical average of all runs for the same gate opening and aggregate type. Test run length shall be at least 500 kg each in duration. Fine aggregate used for calibration shall not be reused for device calibration.

At the time of batching, all aggregates shall have been dried or drained sufficiently to result in stable moisture content such that no visible separation of water from aggregate will take place during the proportioning process. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively until completely exhausted before starting to use another.

All rotating and reciprocating equipment on batch-mixer trucks shall be covered with metal guards.

The cement proportioning system shall deliver cement to the mixer with such volumetric consistency that the deviation for any individual delivery rate check-run shall be within 1.0 percent of the mathematical average of 3 runs of at least 500 kg each in duration. Cement used for calibration shall not be reused for device calibration.

Water meter accuracy shall be such that, when operating between 50 percent and 100 percent of production capacity, the difference between the indicated mass of water delivered and the actual mass delivered shall not exceed 1.5 percent of the actual mass for each of 2 individual runs of 1200 liters in duration. The water meter shall be calibrated in accordance with California Test 109 and shall be equipped with a resettable totalizer and to display the operating rate.

Calibration tests for aggregate, cement and water proportioning devices shall be weighed on a platform scale located at the calibration site. The weighing of test run calibration material shall be performed on a platform scale having a maximum capacity not exceeding 2.5 tonnes with a maximum graduation size of 0.5 kg. The platform scale shall be error tested within 8 hours of calibration of batch-mixer truck proportioning devices. The error test shall be performed with test masses conforming to the requirements of California Test 109 and shall produce a witness scale that is within 2 graduations of the test mass load. This scale shall be available for use at the production site through out the production period. All equipment needed for the calibration of proportioning systems shall remain available at the production site through out the production period.

The batch-mixer truck shall be equipped so that this accuracy check can be made prior to the first operation for a project and at any other time as directed by the Engineer. Further calibration of proportioning devices shall be required every 30 calendar days after production begins, when the source or type of any ingredient is changed, or the mix design is changed. A two run spot re-calibration of cement proportioning system shall be performed each time 50 tons of cement has passed through the batch-truck mixer.

Liquid admixtures shall be proportioned by a meter.

The cement storage shall be located immediately before the cement feeder and shall be equipped with a device which will automatically shut down the power to the cement feeder and aggregate belt feeder when the cement storage level is lowered to a point where less than 20 percent of the total volume is left in storage.

The Contractor shall furnish an aggregate moisture determination at least every 2 hours of the proportioning and mixing operation. Moisture determinations shall be recorded and presented to the Engineer at the end of the production shift.

Each aggregate storage bin shall be equipped with a device which will automatically shut down the power to the aggregate belt feeder when the aggregate storage level is lowered to a point where less than 20 percent of the total volume is left in storage.

All indicators required by these specifications shall be in working order prior to commencing the proportioning and mixing operations and shall be visible while standing near the batch-mixer truck.

In addition to the requirements of the fourth paragraph of Section 5-1.10, "Equipment and Plants," of the Standard Specifications, the identifying number of batch-mixer trucks shall be at least 75 mm in height, located on the front and rear of the vehicle.

Volumetric proportioned FSHCC shall be mixed in a mechanically operated mixer of adequate size and power for the type of FSHCC to be placed. Mixers may be of the auger type and shall be operated uniformly at the mixing speed recommended by the manufacturer. Mixers that have an accumulation of hard concrete or mortar shall be removed from service until cleaned. Other types of mixers may be used provided the mixing quality meets the requirements of these special provisions.

The charge or the rate of feed to the mixer shall not exceed that which will permit complete mixing of all of the material. Dead areas in the mixer, in which the material does not move or is not sufficiently agitated, shall be corrected by a reduction in the volume of material or by other adjustments. The mixer shall be designed to provide sufficient mixing action and movement to the mixture to produce properly mixed FSHCC and mixing shall continue until a homogeneous mixture of thoroughly and uniformly dispersed ingredients of unchanging appearance is produced at discharge from the mixer. There shall be no lumps or evidence of non-dispersed cement at discharge from the mixer. No water shall be added to the FSHCC after discharge from the mixer.

Equipment having components made of aluminum or magnesium alloys, which would have contact with plastic concrete during mixing, transporting FSHCC, shall not be used.

Uniformity of concrete mixtures will be determined by differences in penetration as determined by California Test 533. The difference in penetration, determined by comparing penetration tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed 10 mm. The Contractor, at the Contractor's expense, shall furnish samples of individual ingredients and freshly mixed concrete and provide facilities for obtaining the samples. Sampling facilities shall be safe, accessible, clean and produce a sample which is representative of production. Sampling devices and methods shall also meet the requirements of California Test 125.

Ice shall not be used to cool the concrete. When ice is used to cool water used in the mix, all of the ice shall be melted before entering the mixer.

Cement shall be proportioned and charged into the mixer by means that will not result either in loss of cement due to the effect of wind, or in accumulation of cement on surfaces of conveyors or hoppers, or in other conditions which reduce or vary the required quantity of cement in the concrete mixture.

Each mixer shall have a metal plate or plates, prominently attached, on which the following information is provided:

- A. Uses for which the equipment is designed.
- B. Manufacturer's guaranteed capacity of the mixer in terms of the volume of mixed concrete.
- C. Speed of rotation of the mixer.

The consistency and workability of the mixed concrete upon discharge at the delivery point shall be suitable for placement and consolidation.

Information generated by volumetric proportioning devices shall not be used for payment calculations.

The device that controls the proportioning of cement, aggregate and water shall produce a log of production data. The log of production data shall consist of a series of snapshots captured at 15-minute intervals throughout the period of daily production. Each snapshot of production data shall be a register of production activity at that time and not a summation of the data over the preceding 15 minutes. The amount of material represented by each snapshot shall be that amount produced for the period of time from 7.5 minutes before and 7.5 minutes after the capture time. The daily log shall be submitted to the Engineer, in electronic or printed media, at the end of each production shift, or as requested by the Engineer, and shall include the following:

- A. Mass of cement per revolution count,
- B. Mass of each aggregate size per revolution count,
- C. Gate openings for each aggregate size being used,
- D. Mass of water added to the concrete per revolution count,
- E. Moisture content of each aggregate size being used,
- F. Individual volume of all other admixtures per revolution count,
- G. Time of day,
- H. Production start and stop times,
- I. Day of week,
- J. Batch-mixer truck identification,
- K. Name of supplier,
- L. Specific type, size, or designation of concrete being produced,
- M. Source of the individual aggregates sizes being used,
- N. Source, brand and type of the cement being used,
- O. Source, brand and type of individual admixtures being used,
- P. Name of operator

Required report items may be input by hand into a pre-printed form or captured and printed by the proportioning device. Electronic media containing recorded production data shall be presented in a tab delimited format on a 90-mm diskette with a capacity of at least 1.4 megabytes. Each snapshot of the continuous production data shall be followed by a line-feed carriage-return with allowances for sufficient fields to satisfy the amount of data required by these specifications. The reported data shall be in the above order and shall include data titles at least once per report.

Spreading, Compacting and Shaping — FSHCC shall be spread, shaped and consolidated so that the completed pavement conforms to the thickness and cross section requirements of the plans and specifications. Sides of pavement may be constructed on a batter not to exceed 6.0 vertical to 1.0 horizontal, provided the top of the pavement is maintained at the specified width.

FSHCC to be constructed contiguous with an existing parallel concrete pavement not constructed as part of the contract shall be spread, compacted, and shaped so that completed pavement will conform to the thickness and cross section requirements of the plans and specifications.

The elevation of the pavement surface shall be such that water will not pond on either side of the longitudinal contact joint with existing pavement.

The new pavement surface at the longitudinal contact joint shall conform to the elevation of the existing concrete pavement. Any difference in elevation between the new pavement and the existing pavement shall be eliminated by finishing the new pavement within 300 mm of the existing pavement by hand methods.

Side form sections shall be straight, free from warps, bends, indentations, or other defects. Defective forms shall be removed from the work. Metal or wood side forms may be used. When wood side forms are used they shall be not less than 38 mm in thickness. Wood side forms shall conform to the provisions in Section 51-1.05, "Forms," of the Standard Specifications.

Side forms may be built up by rigidly attaching a section to either top or bottom of forms. If the buildup is attached to the top of metal forms, the buildup shall be of metal.

Width of the base of all forms shall be equal to at least 80 percent of specified pavement thickness.

Side forms shall be of sufficient rigidity, both in the form and in the interlocking connection with adjoining forms, that springing will not occur under the force from grading and paving equipment or from the pressure of concrete. The Contractor shall provide sufficient forms so that there will be no delay in placing the fast-setting hydraulic concrete due to lack of forms.

Before placing side forms, the underlying material shall be at the proper grade. Side forms shall have full bearing upon the foundation throughout their length and width of base and shall be placed to the required grade and alignment of the edge of the finished pavement. They shall be firmly supported during the entire operation of placing, compacting, and finishing the pavement.

Immediately in advance of placing fast-setting hydraulic concrete and after all subgrade operations are completed, side forms shall be trued and maintained to the required line and grade for a distance sufficient to prevent delay in placing fast-setting hydraulic concrete.

Side forms shall remain in place until the edge of the pavement no longer requires the protection of the forms. Side forms shall be thoroughly cleaned and oiled each time they are used and before fast-setting hydraulic concrete is placed against them.

FSHCC for the full paving width shall be effectively consolidated with surface vibrators, internal vibrators, or by some other method of consolidation that produces equivalent results without segregation. Consolidation of the FSHCC shall be by means of high-frequency internal vibrators after it is deposited on the subgrade. Vibrating shall be done with care and in such manner to assure adequate consolidation adjacent to forms and uniformly across the full paving width. Use of vibrators for shifting of the mass of FSHCC will not be permitted. When vibrators are used to consolidate FSHCC, the rate of vibration shall be not less than 3500 cycles per minute for surface vibrators and shall be not less than 5000 cycles per minute for internal vibrators. Amplitude of vibration shall be sufficient to be perceptible on the surface of FSHCC more than 0.3 m from the vibrating element. The Contractor shall furnish a tachometer or other suitable device for measuring and indicating frequency of vibration.

Vibrators shall not rest on new pavement or side forms. Power to vibrators shall be connected so that vibration ceases when forward or backward motion of the machine is stopped.

FSHCC shall be spread and shaped by any suitable powered finishing machines, supplemented by handwork as necessary. Methods of spreading, shaping and compacting that result in segregation, voids or rock pockets shall be discontinued, and the Contractor shall adopt methods which will produce dense homogeneous pavement conforming to required cross section.

After the FSHCC has been mixed and placed, no additional water shall be added to the surface to facilitate finishing. If surface finishing additives are to be used, they must be approved by the Engineer prior to use. Finishing surface additives shall be as recommended by the manufacturer of the cement used.

Joints — Prior to placing concrete against existing concrete, a 6-mm thick commercial quality polyethylene flexible foam expansion joint filler shall be placed across the original transverse joint faces and extend the full depth of the excavation with the top of the joint filler flush with the top of pavement. The joint filler shall be secured to the face of the existing pavement joint face by any method that will hold the joint filler in place during placement of concrete.

Transverse weakened plane joints in pavement replacement shall be constructed to match the spacing and skew of the weakened plane joints in the existing pavement. Where the existing transverse weakened plane joint spacing (in an adjacent lane) exceeds 4.6m, an additional transverse weakened plane joint shall be constructed equal distance between the existing joints.

The provisions in the second and third paragraphs in Section 40-1.08B, "Weakened Plane Joints," of the Standard Specifications and the provisions in the third paragraph in Section 40-1.08B(1), "Sawing Method," shall not apply. Sawing of weakened plane joints shall be completed within 2 hours of completion of final finishing. The minimum depth of the cut for the weakened plane joint shall be 70 mm.

Curing Method — The method of cure for replacement pavement shall be as recommended by the manufacturer of the cement and approved by the Engineer.

Bond Breaker — A bond breaker shall be placed between the replacement pavement and the existing cement treated base. Bond breaker shall be Pigmented Curing Compound conforming to the requirements in ASTM C309, Type 2, Class A and shall contain 22 percent minimum nonvolatile vehicles consisting of at least 50 percent paraffin wax.

All foreign material and loose material remaining from slab removal shall be removed prior to application of bond breaker.

Curing compound shall be applied in two separate applications. Each application of curing compound shall be applied at the approximate rate of 0.3 to 0.5 L/m². Application of curing compound shall cover the entire surface evenly.

Temporary Roadway Structural Section — The Contractor shall provide, at the job site, a sufficient standby quantity, as determined by the Engineer, of asphalt concrete and aggregate base for construction of a temporary roadway structural section where existing pavement is being replaced. The temporary structural section shall be maintained, and later removed as a first order of work when the Contractor is able to construct and cure the new concrete pavement replacement within the prescribed time limit. The temporary structural section shall consist of 90-mm thick asphalt concrete over aggregate base.

The aggregate base for the temporary structural section shall be produced from commercial quality aggregates consisting of broken stone, crushed gravel, natural rough-surfaced gravel or reclaimed concrete and sand, or any combination thereof. The grading of the aggregate base shall conform to the 19-mm maximum grading specified in Section 26-1.02A, "Class 2 Aggregate Base," of the Standard Specifications.

The asphalt concrete for the temporary structural section shall be produced from commercial quality aggregates and asphalt binder. The grading of the aggregate shall conform to the 19-mm Maximum, Medium grading in Section 39-2.02, "Aggregate," of the Standard Specifications and the asphalt binder shall conform to the provisions for liquid asphalt SC-800 in Section 93, "Liquid Asphalts," of the Standard Specifications. The amount of asphalt binder to be mixed with the aggregate shall be approximately 0.3-percent less than the optimum bitumen content as determined by California Test 367.

Aggregate base and asphalt concrete for the temporary structural section shall be spread and compacted by methods that will produce a well-compacted, uniform base, free from pockets of coarse or fine material and a surface of uniform smoothness, texture, and density. The aggregate base may be spread and compacted in one layer and the asphalt concrete may be spread and compacted in one layer. The finished surface of the asphalt concrete shall not vary more than 15 mm from the lower edge of a straightedge, 3.6 m ±0.06-m long, placed parallel with the centerline and shall match the elevation of the existing concrete pavement along the joint between the existing pavement and temporary surfacing. At the option of the Engineer, FSHCC not conforming to these special provisions for Fast Setting Hydraulic Cement Concrete may be used for temporary structural section.

The material from the removed temporary structural section shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13 of the Standard Specifications except that removed aggregate base may be stockpiled at the job site and reused for construction of another temporary structural section. When no longer required, standby material or stockpiled material for construction of temporary structural sections shall be removed and disposed of outside the right of way in accordance with Section 7-1.13 of the Standard Specifications.

Payment and Acceptance — Replace concrete pavement (FSHCC) will be measured and paid for in the same manner specified for concrete pavement in Sections 40-1.13, "Measurement," and 40-1.14, "Payment," of the Standard Specifications, and these special provisions, except that the provisions in Section 40-1.135, "Pavement Thickness," of the Standard Specifications shall not apply.

All replacement concrete pavement produced and placed during construction of the roadway will be accepted or rejected as follows:

Replacement concrete pavement (FSHCC) that has modulus of rupture of 2.3 MPa or greater before the lane is opened to the traffic and a 7 day modulus of rupture of 4.2 MPa or greater will be accepted and paid at the contract price paid per cubic meter of replace concrete pavement (FSHCC).

Replacement concrete pavement (FSHCC) that has a modulus of rupture less than 1.8 MPa when the lane is opened to traffic will be rejected. Rejected replacement pavement shall be removed and replaced at the Contractor's expense.

Payment shall be made according to following table for other combinations of modulus of rupture achieved upon opening to traffic and at 7 days.

Percentage Pay Table

		7-Day Modulus of Rupture (MPa)			
		Greater than or equal to 4.20	3.81 - 4.19	3.41 - 3.80	Less than 3.40
Modulus of Rupture (MPa) at opening to traffic	Greater than or equal to 2.30	100%	95%	90%	80%
	2.01 - 2.29	95%	95%	90%	80%
	1.80 - 2.00	80%	80%	80%	50%
	Less than 1.80	0	0	0	0

Full compensation for removing and disposing of existing concrete pavement; furnishing and placing bond breaker, furnishing and disposing of standby materials for construction of a temporary structural section; and constructing, maintaining, removing and disposing of temporary structural sections shall be considered as included in the contract price paid per cubic meter for replace concrete pavement (FSHCC) and no separate payment will be made therefor.

The contract price paid per cubic meter for replace concrete pavement (FSHCC) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved, complete in place, including contractor process control and removal of existing pavement, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.16 GRIND REPLACEMENT CONCRETE PAVEMENT

Grinding replacement concrete pavement shall conform to the provisions in Section 42-2, "Grinding," of the Standard Specifications and these special provisions.

Grinding replacement concrete pavement will be measured and paid for as grind existing concrete pavement.

Removed residue from grinding replacement concrete pavement shall be disposed of outside the highway right of way in accordance with the provisions in Section 7-1.13, "Disposal of Material Outside of the Highway Right of Way," of the Standard Specification.

There is no "Materials Information" listing locations where grinding residue may be disposed of for this contract.

Residue from grinding replacement concrete pavement shall be disposed of at a site chosen by the Contractor provided the Contractor has obtained approval from the California Regional Water Quality Control Board having jurisdiction over any required site. The Contractor shall deliver to the Engineer a copy of the approval or approvals not less than 5 working days prior to disposing any residue at the disposal site.

The Contractor shall provide to the Engineer a landfill receipt and weight ticket to verify that the material has been disposed of in a manner consistent with this section of these special provisions.

The drying or storing of wet residue within the project limits or elsewhere within the State right of way will not be permitted. The wet residue shall be transported to a suitable intermediate location obtained by the Contractor to dry the material. This off-site drying location shall be approved by the California Regional Water Quality Control Board. The Contractor shall deliver to the Engineer a copy of the approval or approvals from the California Regional Water Quality Control Board not less than 5 working days prior to beginning any portland cement concrete grinding. Dried residue material shall be disposed at a disposal site qualified to receive it.

The Contractor shall make all necessary arrangements for the disposal of the residue from the grinding of replacement concrete pavement, including but not limited to the drying of the material, agreements with property owners and obtaining necessary permits, licenses and environmental clearances. Before performing the grinding of replacement concrete pavement, the Contractor shall furnish to the Engineer satisfactory evidence that the Contractor has made all arrangements required above.

Full compensation for conforming to the requirements of this section shall be considered as include in the contract price paid per square meter for grind existing concrete pavement and no separate payment will be made therefor.

10-1.17 THERMOPLASTIC TRAFFIC STRIPE AND PAVEMENT MARKING

Thermoplastic traffic stripes (traffic lines) and pavement markings shall be applied in conformance with the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

Where striping joins existing striping, the Contractor shall begin and end the transition from the existing striping pattern into or from the new striping pattern a sufficient distance to ensure continuity of the striping pattern.

Thermoplastic material shall conform to the requirements in State Specification 8010-19A.

Thermoplastic material for traffic stripes shall be applied at a minimum thickness of 2.03 mm.

At the option of the Contractor, permanent striping tape as specified in "Prequalified and Tested Signing and Delineation Materials" of these special provisions, may be placed instead of the thermoplastic traffic stripes and pavement markings specified herein, except that 3M, "Stamark" Series A320 Bisymmetric Grade, manufactured by the 3M Company, shall not be used. Pavement tape, if used, shall be installed in conformance with the manufacturer's specifications. If pavement tape is placed instead of thermoplastic traffic stripes and pavement markings, the pavement tape will be measured and paid for by the meter as thermoplastic traffic stripe and by the square meter as thermoplastic pavement marking.

10-1.18 PAVEMENT MARKERS

Pavement markers shall be placed in conformance with the provisions in Section 85, "Pavement Markers," of the Standard Specifications and these special provisions.

Attention is directed to "Traffic Control System For Lane Closure" of these special provisions regarding the use of moving lane closures during placement of pavement markers with bituminous adhesive.

Retroreflective pavement markers shall comply with the specific intensity provisions for reflectance after abrading the lens surface in conformance with the "Steel Wool Abrasion Procedure" specified for pavement markers placed in pavement recesses in Section 85-1.05, "Retroreflective Pavement Markers," of the Standard Specifications.

SECTION 10-2. (BLANK)

SECTION 10-3. ELECTRICAL SYSTEMS

10-3.01 DESCRIPTION

Inductive loop detectors shall conform to the provisions in Section 86, "Signals, Lighting and Electrical Systems," of the Standard Specifications and these special provisions.

10-3.02 CONDUIT

Detector termination conduits shall be Type 1.

After conductors have been installed, the ends of conduits terminating in pull boxes shall be sealed with an approved type of sealing compound.

10-3.03 CONDUCTORS AND WIRING

Splices shall be insulated by "Method B".

The minimum insulation thickness, at any point, for Type USE, RHH or RHW wire shall be 1.0 mm for conductor sizes No. 14 to No. 10, inclusive, and 1.3 mm for No. 8 to No. 2, inclusive. The minimum insulation thickness, at any point, for Type THW and TW wires shall be 0.69 mm for conductor sizes No. 14 to No. 10, inclusive, 1.02 mm for No. 8, and 1.37 mm for No. 6 to No. 2, inclusive.

10-3.04 DETECTORS

For Type E detector loops, sides of the slot shall be vertical and the minimum radius of the slot entering and leaving the circular part of the loop shall be 40 mm. Slot width shall be a maximum of 20 mm. Loop wire for circular loops shall be Type 2. Slots of circular loops shall be filled with hot melt rubberized asphalt sealant.

10-3.05 PAYMENT

The contract unit price paid for inductive loop detector shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved for inductive loop detector, complete in place, including detector termination conduits, splicing conductors, identifying and tagging existing detector loop cable in the controller cabinet, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.