



TYPE III-BF SERVICE EQUIPMENT ENCLOSURE (TYPICAL)
DETAIL A

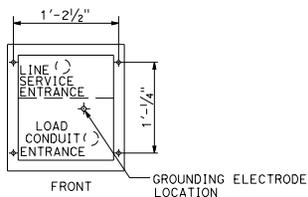

BASE FOR TYPE III-B SERVICE EQUIPMENT ENCLOSURE
DETAIL B

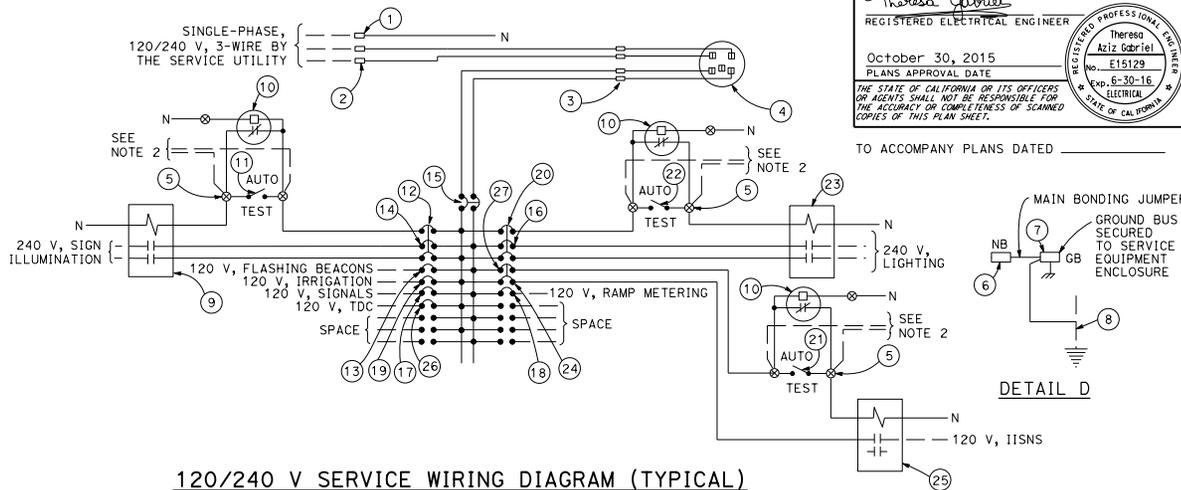

120/240 V SERVICE WIRING DIAGRAM (TYPICAL)
DETAIL C

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL SHEETS


Theresa Gabriel
REGISTERED ELECTRICAL ENGINEER

October 30, 2015
PLANS APPROVAL DATE

Theresa Aziz Gabriel
No. E15129
Exp. 6-30-16
ELECTRICAL ENGINEER
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED _____



TYPE III-B SERVICE EQUIPMENT ENCLOSURE LEGEND (120/240 V)					
ITEM	COMPONENT	NAMEPLATE DESCRIPTION	ITEM	COMPONENT	NAMEPLATE DESCRIPTION
①	NEUTRAL LUG		⑭	30 A, 240 V, 2P, CB	SIGN ILLUMINATION
②	LANDING LUG		⑮	100 A, 240 V, 2P, CB	MAIN BREAKER
③	TEST BYPASS FACILITY		⑯	30 A, 240 V, 2P, CB	LIGHTING
④	METER SOCKET AND SUPPORT		⑰	50 A, 120 V, 1P, CB	SIGNALS
⑤	TERMINAL BLOCKS		⑱	30 A, 120 V, 1P, CB	RAMP METERING
⑥	NEUTRAL BUS		⑲	20 A, 120 V, 1P, CB	IRRIGATION
⑦	GROUND BUS		⑳	15 A, 120 V, 1P, CB	LIGHTING CONTROL
⑧	GROUNDING ELECTRODE		㉑	15 A, 1P, TEST SWITCH	IISNS TEST SWITCH
⑨	30 A, 2P, NO CONTACTOR	SIGN ILLUMINATION	㉒	15 A, 1P, TEST SWITCH	LIGHTING TEST SWITCH
⑩	PHOTOELECTRIC UNIT (NOTE 4)	PEU	㉓	60 A, 2P, NO CONTACTOR	LIGHTING
⑪	15 A, 1P, TEST SWITCH	SIGN ILLUMINATION TEST SWITCH	㉔	15 A, 120 V, 1P, CB	IISNS
⑫	15 A, 120 V, 1P, CB	SIGN ILLUMINATION CONTROL	㉕	30 A, 2P, NO CONTACTOR	IISNS
⑬	15 A, 120 V, 1P, CB	FLASHING BEACON	㉖	20 A, 120 V, 1P, CB	TELEPHONE DEMARCATION CABINET
			㉗	15 A, 120 V, 1P, CB	IISNS CONTROL

NOTES:

- Unless otherwise indicated on the plans, service equipment items shall be provided for each service equipment enclosure as shown.
- Connect to remote test switch mounted on lighting standards, sign post or structure when required.
- Items ① and ⑥ shall be isolated from the service equipment enclosure.
- Type I photoelectric control shall be used unless otherwise indicated on the plans.
- Item ⑫, ⑲ and ㉗ shall be ganged operated CB.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
ELECTRICAL SYSTEMS
(SERVICE EQUIPMENT ENCLOSURE AND TYPICAL WIRING DIAGRAM, TYPE III-B SERIES)

NO SCALE

RSP ES-2E DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-2E DATED MAY 20, 2011 - PAGE 432 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-2E

2010 REVISED STANDARD PLAN RSP ES-2E