

| Dist | COUNTY | ROUTE | POST MILES TOTAL PROJECT | SHEET No. | TOTAL SHEETS |
|------|--------|-------|--------------------------|-----------|--------------|
| | | | | | |

Theresa Gabriel
REGISTERED ELECTRICAL ENGINEER

October 30, 2015
PLANS APPROVAL DATE


Theresa Aziz Gabriel
No. E15129
Exp. 6-30-16
ELECTRICAL
STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED _____

NOTES:

- Dimensions are nominal.
- The steel pedestal, base plate, bolt circle and foundation for the telephone demarcation cabinet shall be the same as that shown for a Type 1-C Standard. The steel pedestal shall be 2'-1" to 2'-6" in length. Anchor bolts shall be 3/4" ø x 1'-6" with a 2" - 90° bend. Four bolts required per cabinet.
- Telephone interconnect conductors shall be enclosed in a 3/4" C or larger conduit through the foundation. Type 4 conduit shall be used to separate telephone and power conductors in the cabinet and pedestal.
- For termination cabinet:
 - Mount cabinet on Type G cabinet pedestal (see Revised Standard Plan RSP ES-3B).
 - Use Type G cabinet foundation.

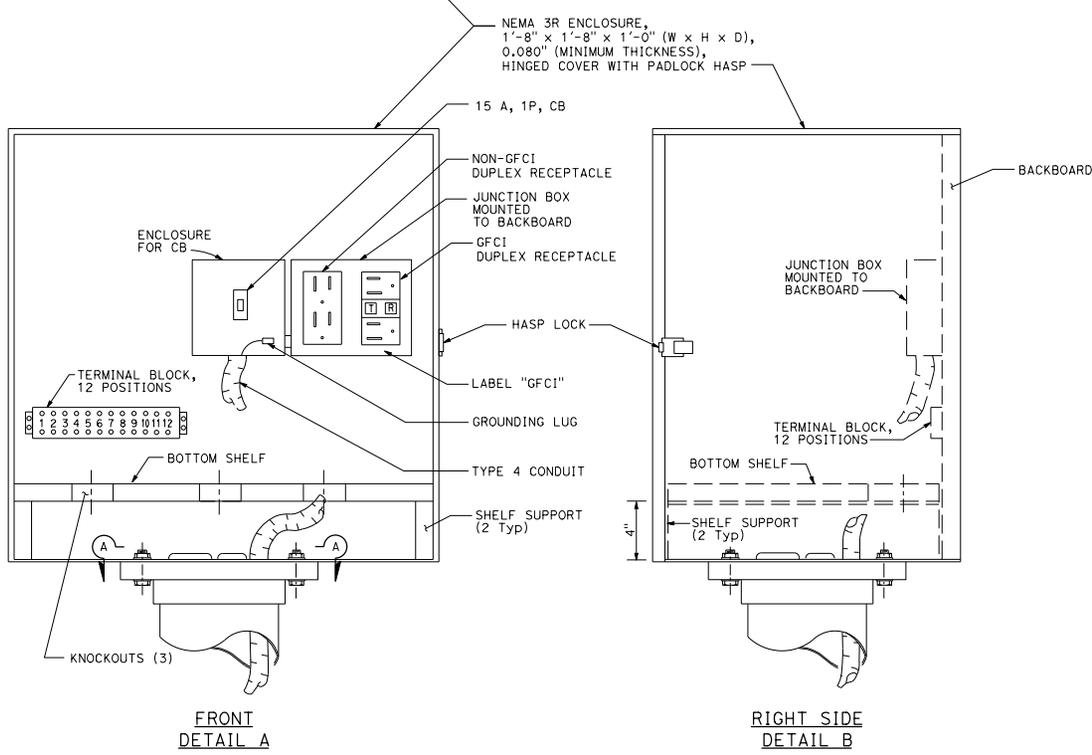

FASTENER SCHEDULE

| | |
|------------------|-------------------------------|
| BACKBOARD | 4 - 3/4" (LENGTH) WOOD SCREWS |
| 2 SHELF SUPPORTS | 4 - 3/4" (LENGTH) WOOD SCREWS |
| JUNCTION BOX | 4 - 1/2" (LENGTH) WOOD SCREWS |
| TERMINAL BLOCK | 4 - 3/4" (LENGTH) WOOD SCREWS |

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(TELEPHONE DEMARCATION
CABINET, TYPE A)**

NO SCALE

RSP ES-3D DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-3D DATED MAY 20, 2011 - PAGE 438 OF THE STANDARD PLANS BOOK DATED 2010.

REVISED STANDARD PLAN RSP ES-3D

2010 REVISED STANDARD PLAN RSP ES-3D