


NOTES:

- Type G, M, P, R, S and Model 336L cabinets shall be installed with the back toward the nearest lane of traffic.
- In unpaved areas, a raised portland cement concrete pad shall be constructed in front of each controller cabinet. The pad shall be 3'-0" x 3'-0" x 4" for a Type G cabinet and shall be 3'-0" x 4" thick x width of foundation for Type M, P, R, S and Model 336L cabinets.
- The steel pedestal, base plate, and bolt circle for Type G cabinet shall be the same as that shown for a Type 1-C Standard (see ES-7B). Pedestal shall be 2'-1" to 2'-6" in length. Anchor bolts shall be 3/4" ϕ x 1'-6" with a 2" - 90° bend. Four bolts required per cabinet.
- Type G cabinet shall be provided with a slipfitter to permit mounting on 4 1/2" outside diameter pedestal. Slipfitter shall be bolted to bottom of the cabinet.
- A 1" drain shall be provided through the foundation of a Type M or Model 336L cabinet. Drain pipe shall be screened.
- Cabinet shelves shall be adjustable for vertical spacing and shall be removable. Type M, P, R and S cabinets shall be provided with a minimum of two shelves.
- Controller units, plug-mounted equipment, shelf-mounted equipment and wall-mounted equipment shall be located to permit safe and easy removal or replacement without removing any other piece of equipment.
- Where telephone interconnect is required, a minimum of 5" clear vertical space shall be provided inside the cabinet for the equipment.
- Telephone interconnect conductors shall be enclosed in a 3/4" C or larger conduit through the foundation. Type 4 conduit shall be used to separate telephone and power conductors in cabinets or pedestals.
- Anchor bolts for Type M, P, R, S and Model 336L cabinets shall be 3/4" ϕ x 1'-6" with a 2" - 90° bend.

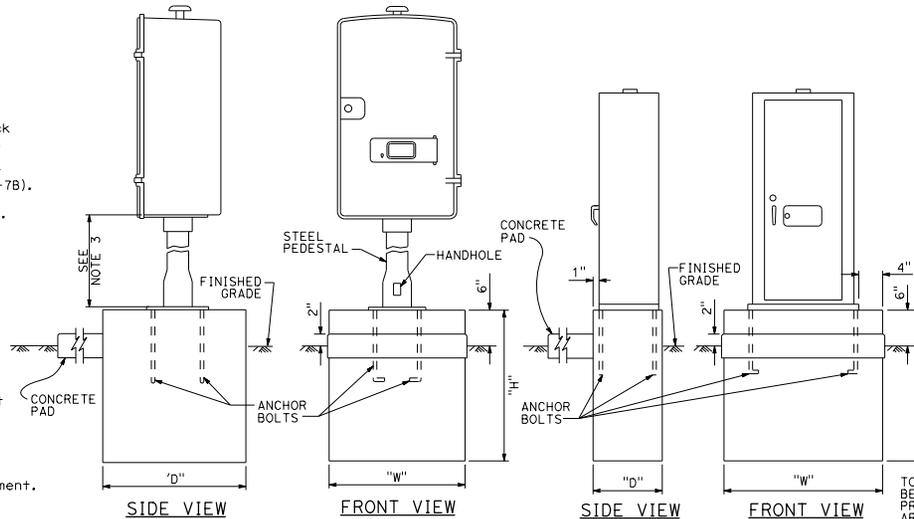

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

Theresa Gabriel
REGISTERED ELECTRICAL ENGINEER




April 15, 2016
PLANS APPROVAL DATE

Theresa Gabriel
No. E15129
Exp. 6-30-16
REGISTERED PROFESSIONAL ENGINEER
ELECTRICAL
STATE OF CALIFORNIA


TO ACCOMPANY PLANS DATED _____

CABINET TYPE	FOUNDATION		
	"W"	"H"	"D"
G	2'-0"	3'-6"	2'-0"
M	3'-2"	2'-6"	1'-6"
P	4'-4 1/2"	1'-6"	2'-4"
R	4'-2"	1'-6"	2'-4"
S	5'-11 1/2"	1'-6"	2'-4"


TOP OF PEDESTAL SHALL BE LARGE ENOUGH TO PROVIDE 3/4" CLEARANCE AROUND CABINET BASE. CHAMFER EDGE 3/8" x 3/8"

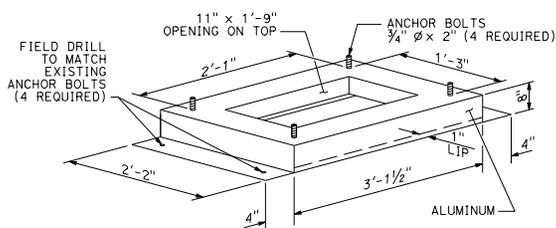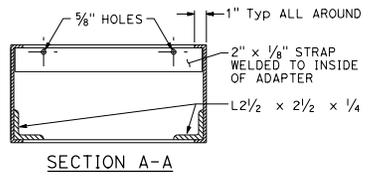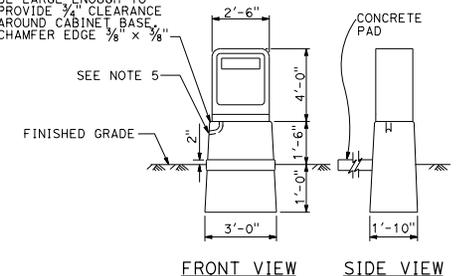

See Notes A and B

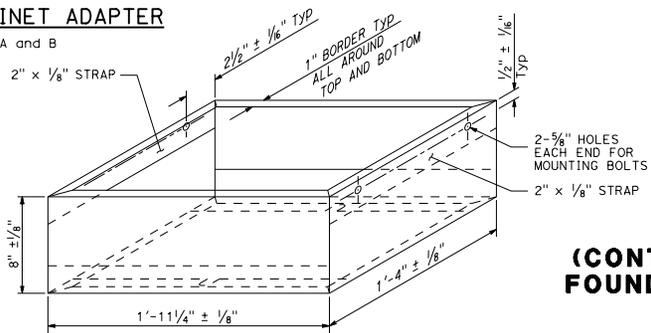

See Notes A, C, and D

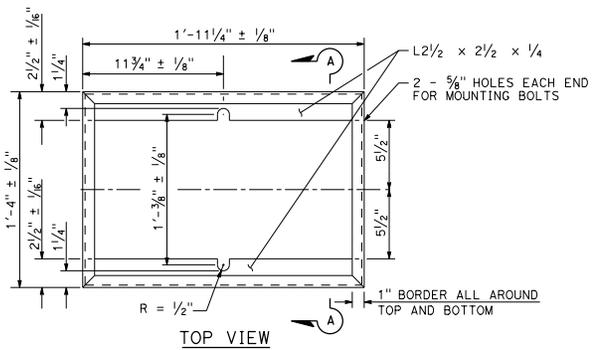

NOTES:

- Material: 0.188" thickness aluminum plate.
- Adapter for Type P or Type R cabinet foundation.
- Adapter for Type M cabinet foundation.
- Mounting bolts shall be 3/8" ϕ minimum size.

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(CONTROLLER CABINET ADAPTER,
FOUNDATIONS, AND PAD DETAILS)**

NO SCALE

RSP ES-3B DATED APRIL 15, 2016 SUPERSEDES STANDARD PLAN ES-3B DATED OCTOBER 30, 2015 - PAGE 429 OF THE STANDARD PLANS BOOK DATED 2015.

REVISED STANDARD PLAN RSP ES-3B

2015 REVISED STANDARD PLAN RSP ES-3B