

NOTES:







1. The maximum tolerance between door and lens shall be $\frac{1}{64}$ ". Casting dimensions of shell are nominal and are subject to such tolerances as are consistent with sound foundry practice.
2. Continuous grounding between fixtures and from fixture to end post carrying conductors shall be provided.

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

William G. McFar
 REGISTERED ELECTRICAL ENGINEER
 License No. 44512
 State of California

May 20, 2011
 PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

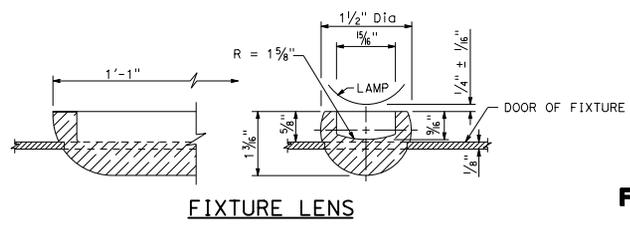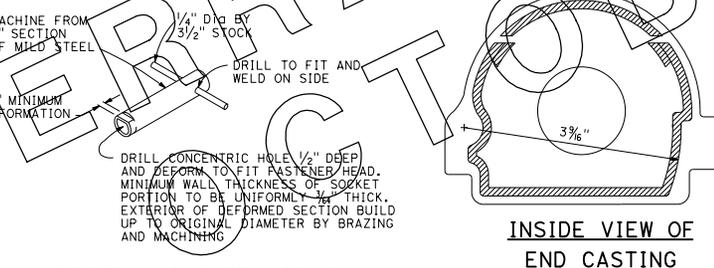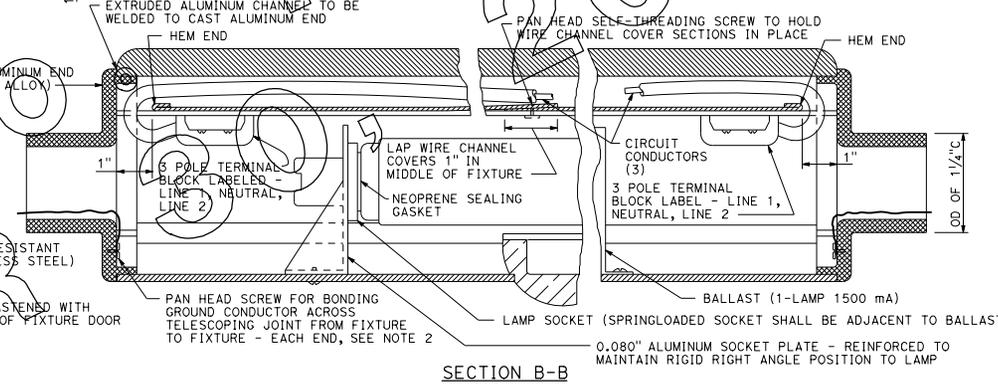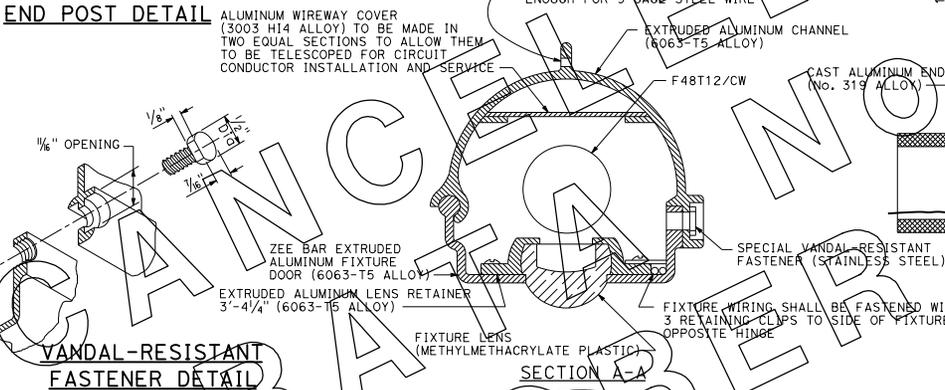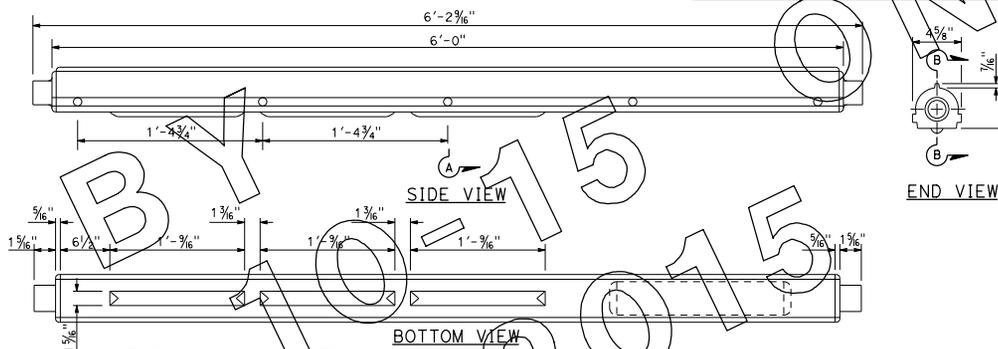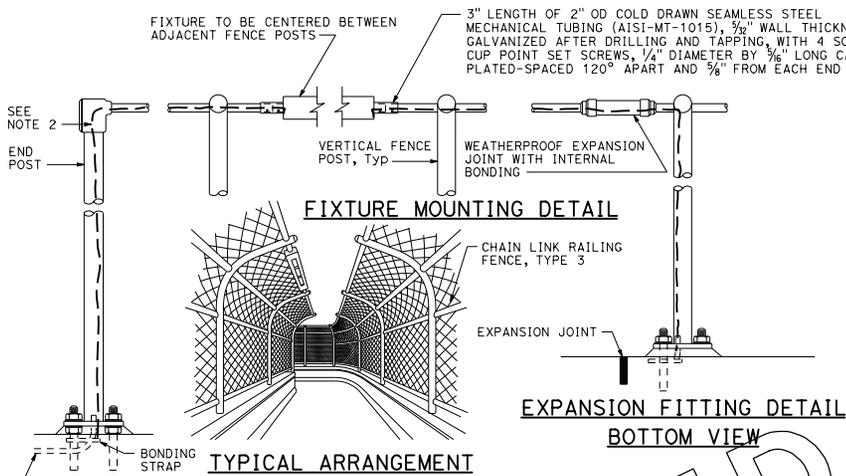

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
(PEDESTRIAN OVERCROSSING
FLUORESCENT LIGHTING FIXTURE)**

NO SCALE

ES-12A