
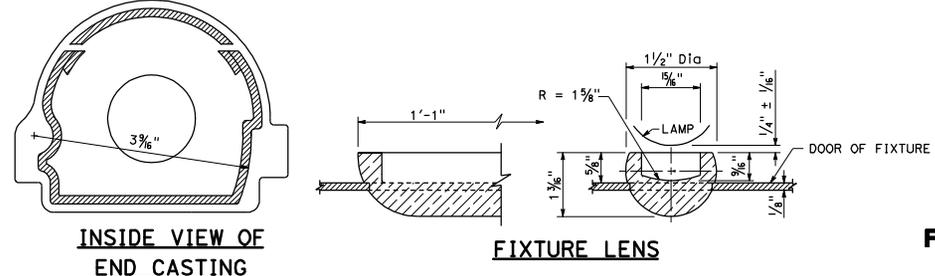
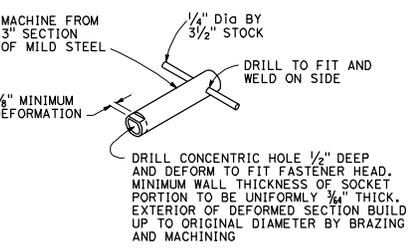
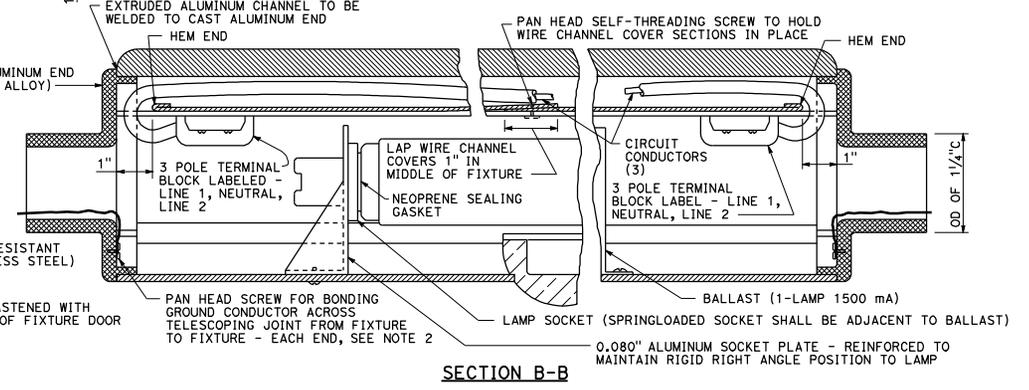
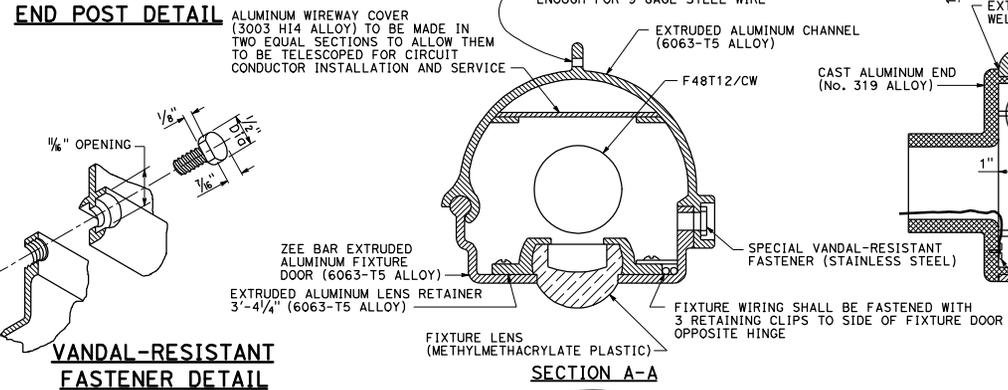


- NOTES:**
1. The maximum tolerance between door and lens shall be 1/4". Casting dimensions of shell are nominal and are subject to such tolerances as are consistent with sound foundry practice.
 2. Continuous grounding between fixtures and from fixture to end post carrying conductors shall be provided.

D16+	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

Registered Electrical Engineer
 Jeffrey G. McRob
 No. E14512
 Exp. 6-30-12
 STATE OF CALIFORNIA

May 20, 2011
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

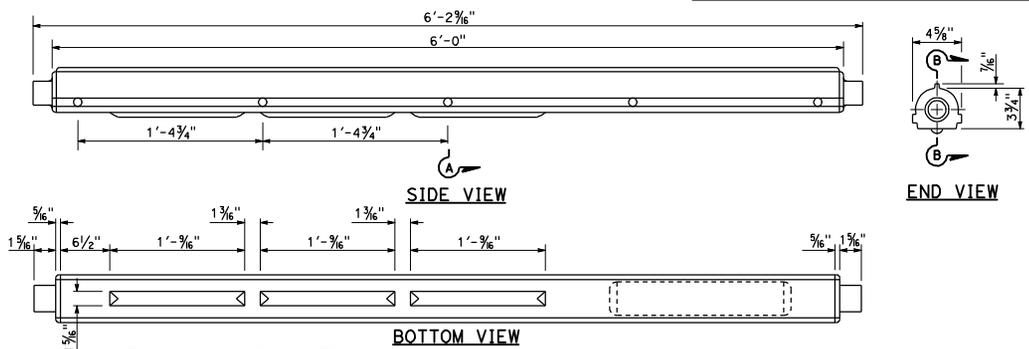

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION

**ELECTRICAL SYSTEMS
 (PEDESTRIAN OVERCROSSING
 FLUORESCENT LIGHTING FIXTURE)**

NO SCALE