

TYPICAL SECTION

- NOTES:**
- For details not shown and drainage notes see RSP B3-5
 - For wall stem joint details see B0-3 3-3 and B0-3 3-4
 - At (a) and short (a) bars:
H < 6', no splices are allowed within 1'-8" above the top of footing.
H > 6', no splices are allowed within H/4 above the top of footing.
 - Bundle (a) bars for H ≥ 26'.
 - Hook stirrups around & space with alternating transverse reinforcement at 2 x "S".

DESIGN CONDITIONS:

Design H may be exceeded by 6" before going to the next size. Special footing design is required where foundation material is incapable of supporting bearing stress listed in the table.


DESIGN NOTES:

- DESIGN:** AASHTO LRFD Bridge Design Specifications, 4th Edition with California Amendments
- LS:** Varied surcharge on level ground surface
- DC:** Stem Architectural Treatment of thickness up to 6" of concrete (75 psf) considered
- SEISMIC:** $k_h = 0.2$
 $k_v = 0.0$
- SOIL:** $\phi = 34^\circ$
 $\gamma = 120$ pcf
- REINFORCED CONCRETE:** $f'_c = 3,600$ psi
 $f_y = 60,000$ psi
- LOAD COMBINATIONS AND LIMIT STATES:**
Service I $Q = 1.00DC+1.00EV+1.00EH+1.00LS$
Strength I $Q = aDC+pEV+nEH+1.75LS$
Extreme I $Q = 1.00DC+1.00EV+1.00EH+1.00EQD+1.00EQE$

- Where:**
- Q: Force Effects
 - a: 1.25 or 0.90, Whichever Controls Design
 - p: 1.35 or 1.00, Whichever Controls Design
 - n: 1.50 or 0.90, Whichever Controls Design
 - DC: Dead Load of Structure Components
 - EH: Horizontal Earth Fill Pressure
 - EV: Vertical Earth Pressure from Earth Fill Weight
 - LS: Live Load Surcharge
 - EQE: Seismic Earth Pressure
 - EQD: Soil and Structural and Nonstructural Components Inertia

SYMBOLS:

- TO ACCOMPANY PLANS DATED _____
- Ser - service limit state I
Str - strength limit state I
Ext - extreme event limit state I
B' - effective footing width (ft)
 q_0 - net bearing stress (ksf), OG assumed to be FG at toe
 q_0 - gross uniform bearing stress (ksf)
h1 = Top of footing to top of short (a) bar
h2 = Top of footing to top of (b) bar
h3 = Top of footing to top of (c) bar
h4 = Top of footing to top of (d) bar
Zone 1 = Top half of stem height
Zone 2 = Bottom half of stem height
∞ - Bundle of two bars

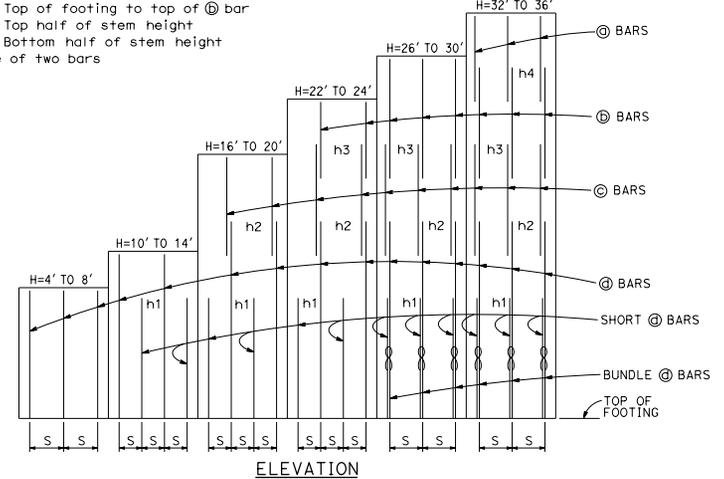

DESIGN H	4'	6'	8'	10'	12'	14'	16'	18'	20'	22'	24'	26'	28'	30'	32'	34'	36'
W	6'-0"	7'-6"	9'-6"	11'-0"	12'-6"	15'-6"	17'-3"	19'-6"	21'-9"	23'-6"	26'-0"	28'-1"	30'-3"	31'-6"	33'-0"	34'-8"	35'-11"
C	2'-0"	2'-6"	3'-3"	3'-6"	4'-3"	5'-0"	5'-3"	5'-9"	6'-9"	7'-3"	8'-3"	8'-9"	9'-0"	9'-6"	10'-0"	10'-10"	11'-3"
B	4'-0"	5'-0"	6'-3"	7'-6"	8'-3"	10'-6"	12'-0"	13'-9"	15'-0"	16'-3"	17'-9"	19'-4"	21'-3"	22'-0"	23'-0"	23'-10"	24'-8"
F	1'-6"	1'-6"	2'-0"	2'-3"	2'-6"	2'-8"	2'-10"	3'-0"	3'-4"	3'-6"	3'-6"	3'-7"	3'-7"	3'-9"	3'-9"	4'-0"	4'-4"
T	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11 1/2"	11'-2"	1'-5"	1'-10"	2'-3"	2'-9"
BATTER	1/2:12	1/2:12	1/2:12	1/2:12	1/2:12	5/8:12	5/8:12	3/4:12	7/8:12	1:12	1 1/8:12	1 1/8:12	1 1/4:12	1 1/4:12	1 1/2:12	1 1/2:12	1 1/2:12
SPACING "S"	16"	12"	10"	7"	7"	7"	7"	7"	7"	6"	6"	10"	8"	7"	7"	7"	7"
(a) BARS	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	#5	#5
(b) BARS	-	-	-	-	-	-	-	-	-	#5	#5	#5	#5	#5	#5	#7	#7
(c) BARS	-	-	-	-	-	-	#6	#6	#6	#7	#8	#8	#8	#8	#9	#9	#9
(d) BARS	#5	#5	#6	#6	#7	#8	#9	#10	#10	#10	#11	#11	#11	#11	#11	#11	#11
(e) BARS	#5	#5	#6	#6	#7	#8	#9	#10	#10	#10	#11	#11	#11	#11	#11	#11	#11
h1	-	-	-	5'-3"	6'-4"	7'-6"	8'-9"	9'-9"	11'-0"	11'-3"	11'-6"	10'-3"	11'-9"	12'-3"	12'-6"	13'-3"	13'-8"
h2	-	-	-	-	-	12'-8"	15'-6"	17'-0"	16'-6"	17'-3"	18'-0"	17'-6"	17'-3"	18'-0"	18'-6"	19'-6"	19'-6"
h3	-	-	-	-	-	-	-	-	18'-9"	21'-3"	21'-3"	22'-4"	22'-8"	18'-0"	18'-6"	19'-6"	19'-6"
h4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	26'-3"	27'-4"	28'-6"
No. of Toe Stirrups	0	0	0	0	0	0	0	0	0	0	0	5	5	6	7	8	9
No. of Heel Stirrups	0	0	0	0	0	0	0	0	4	6	7	8	10	10	11	11	11
ZONE 1 (a) BARS	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 12	#5 @ 12	#5 @ 12	#5 @ 12	#5 @ 12	#5 @ 12	#6 @ 12	#6 @ 12	#6 @ 10
ZONE 2 (b) BARS	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 18	#5 @ 12	#5 @ 12	#5 @ 12	#5 @ 12	#6 @ 12	#6 @ 12	#7 @ 12	#7 @ 12	#7 @ 12	#7 @ 10	#7 @ 10	#7 @ 10
ZONE 1 (c) BARS	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#5 @ 12	#5 @ 12	#5 @ 12
ZONE 2 (d) BARS	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 18	#4 @ 12	#4 @ 12	#4 @ 12	#4 @ 12	#4 @ 12	#4 @ 12	#5 @ 12	#5 @ 12	#6 @ 12
Ser: B', q ₀	4.0, 0.9	5.5, 1.0	9.3, 1.0	10.9, 1.3	12.3, 1.5	14.8, 1.9	16.6, 2.1	18.7, 2.4	20.6, 2.7	22.3, 3.0	24.2, 3.3	26.1, 3.5	28.2, 3.9	29.6, 4.0	31.1, 4.2	32.7, 4.4	34.1, 4.6
Str: B', q ₀	2.2, 2.2	3.5, 2.2	5.1, 2.3	6.3, 2.6	7.6, 2.7	12.9, 3.1	14.3, 3.6	16.5, 3.9	19.4, 4.5	20.7, 4.8	22.5, 5.2	24.3, 5.6	26.2, 6.0	27.5, 6.3	28.8, 6.6	30.3, 6.9	31.8, 7.2
Ext: B', q ₀	2.3, 3.4	2.7, 4.4	3.6, 5.0	3.8, 6.5	4.5, 7.0	7.0, 6.1	7.6, 6.9	9.3, 7.0	11.0, 7.1	11.8, 7.6	14.1, 7.4	15.6, 7.7	17.1, 8.0	17.2, 8.7	18.1, 9.0	19.0, 9.4	19.4, 10.0

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
RETAINING WALL TYPE 1 (CASE 2)
NO SCALE

REVISED STANDARD PLAN RSP B3-1B

RSP B3-1B DATED APRIL 20, 2012 SUPPLEMENTS THE STANDARD PLANS BOOK DATED 2010.

2010 REVISED STANDARD PLAN RSP B3-1B

D16+	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL NO. SHEETS

April 20, 2012
PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.