
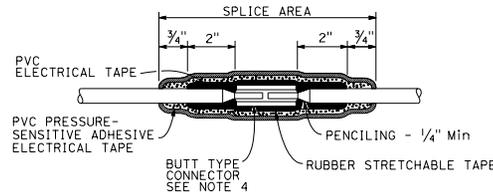
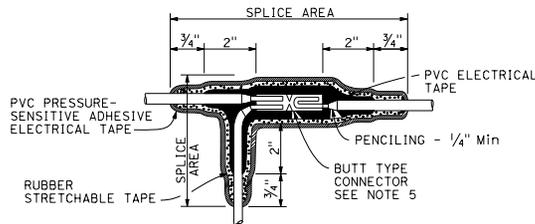
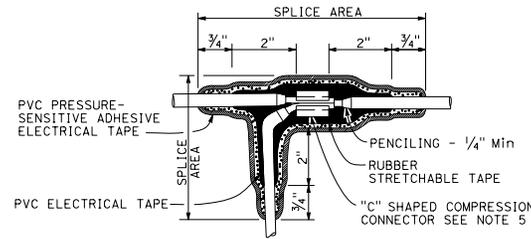


DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS




*Theresa Gabriel*  
 REGISTERED ELECTRICAL ENGINEER  
 April 15, 2016  
 PLANS APPROVAL DATE  
 No. E15129  
 Exp. 6-30-16  
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

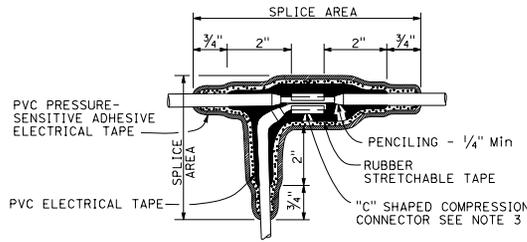

**NOTES:**

1. Dimensions are minimum.
2. Rubber tapes shall be rolled after application.
3. Between 1 free-end and 1 through conductor.
4. Between 2 free-end conductors.
5. Between 3 free-end conductors.

**TYPICAL SPLICE INSULATION METHOD B**

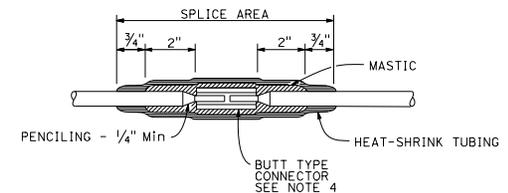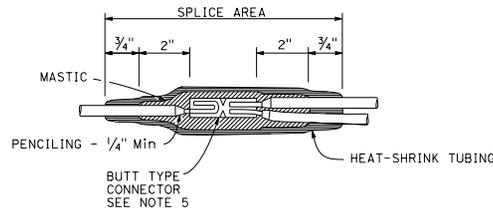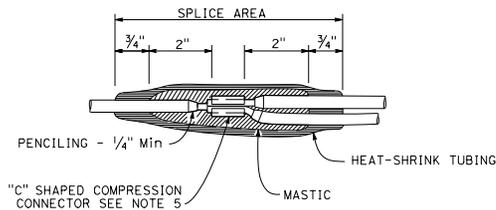

**TYPICAL SPLICE INSULATION HEAT-SHRINK TUBING**

STATE OF CALIFORNIA  
DEPARTMENT OF TRANSPORTATION  
**ELECTRICAL SYSTEMS**  
**(SPLICE INSULATION METHODS DETAILS)**

NO SCALE

RSP ES-13A DATED APRIL 15, 2016 SUPERSEDES STANDARD PLAN ES-13A  
DATED OCTOBER 30, 2015 - PAGE 484 OF THE STANDARD PLANS BOOK DATED 2015.

**REVISED STANDARD PLAN RSP ES-13A**

2015 REVISED STANDARD PLAN RSP ES-13A